

EPA-600/2-76-221
September 1976

REMOVAL OF SOLUBLE BOD₅
IN PRIMARY CLARIFIERS

by

George A. Dubey
Averill J. Wiley
John W. Collins

Effluent Processes Group
The Institute of Paper Chemistry
Appleton, Wisconsin 54911

Grant Number R-803119

Project Officer

Ralph H. Scott
Food & Wood Products Branch
Industrial Environmental Research Laboratory-Cincinnati
Corvallis, Oregon 97330

INDUSTRIAL ENVIRONMENTAL RESEARCH LABORATORY
OFFICE OF RESEARCH AND DEVELOPMENT
U.S. ENVIRONMENTAL PROTECTION AGENCY
CINCINNATI, OHIO 45268

LIBRARY

S. ENVIRONMENTAL PROTECTION AGENCY
08817

DISCLAIMER

This report has been reviewed by the Industrial Environmental Research Laboratory, U.S. Environmental Protection Agency, and approved for publication. Approval does not signify that the contents necessarily reflect the views and policies of the U.S. Environmental Protection Agency, nor does mention of trade names or commercial products constitute endorsement or recommendation for use.

FOREWORD

When energy and material resources are extracted, processed, converted, and used, the related pollutional impacts on our environment and even on our health often require that new and increasingly more efficient pollution control methods be used. The Industrial Environmental Research Laboratory - Cincinnati (IERL-Ci) assists in developing and demonstrating new and improved methodologies that will meet these needs both efficiently and economically.

Removal of soluble BOD₅ in primary clarifiers presents research findings related to means and methods for improving the efficiency of primary sedimentation systems treating pulp and paper wastes. The possibility of greater BOD removal was investigated by examining effects of flocculants and coagulants in removing soluble and colloidal constituents of such wastes. The report also discloses that certain process waste streams may be antagonistic to efficient sedimentation and should be treated separately from total mill wastes. This information will be of interest to segments of the industry wishing to upgrade primary treatment efficiency to reduce loadings on secondary treatment. The findings are also applicable to treatment of waste streams not containing significant additives, as the tissue industry, wherein effluent guide-line allowances may possibly be satisfied by efficient primary treatment. For further information contact the Food and Wood Products Branch, Industrial Environmental Research Laboratory-Cincinnati.

David G. Stephan
Director
Industrial Environmental Research Laboratory
Cincinnati

ABSTRACT

Primary clarifiers used in the pulp and paper industry show wide variations in BOD removal. This project was directed to evaluating means for increasing BOD removal and developing an understanding of the mechanism. Such understanding should permit optimization of BOD removal during primary clarification.

A survey involved twelve mills, nine with primary clarifiers, to obtain data on total and soluble BOD₅, COD, suspended solids, and color. These data were used to select mill effluents for additional study.

Laboratory studies showed that, with the proper flocculating agent and operating conditions, the BOD₅ concentration of some mill effluents could be markedly reduced during clarification. These findings were confirmed by pilot-scale clarifier field trials at two mills.

Measurement of sludge volumes and sludge dewatering characteristics resulting from chemical treatment were outside the objectives of this study.

Gel chromatography studies showed that considerable low molecular weight biodegradable residues along with colloidal material were also flocculated and removed. Studies with model compounds indicated that increased removal is apparently related to the pH of the solution and to the functional groups (hydroxyl, phenolic, and carboxylic), chain length, branching, and solubility of the compound.

Chemical costs may range from 3¢ to 10¢ per 1000 gallons of feed to the clarifier. Decreased cost and increased operating efficiency in total treatment systems, as a result of improved clarification, could more than justify this chemical charge. Minimum levels of chemical costs will depend upon minimizing or eliminating overflows or spills of colloids and dispersants detrimental to clarifier efficiency.

This report was submitted in fulfillment of Project No. R803-119 by The Institute of Paper Chemistry Effluent Processes Group under the partial sponsorship of the Environmental Protection Agency. Work was completed as of August, 1975.

CONTENTS

	<u>Page</u>
Abstract	iv
List of Figures	vi
List of Tables	x
Acknowledgments	xiv
I Introduction	1
II Summary and Conclusions	3
III Recommendations	5
IV Mill Surveys	6
V Laboratory Study of Processes for Higher Levels of Soluble BOD ₅ Removal	20
VI Pilot Scale Clarifier Studies	49
VII Jar Tests with Individual Sewer Discharges	67
VIII Discussion of the Mechanisms of Soluble BOD ₅ Removal	77
IX Areas for Cost Reductions	96
X References	98
XI Glossary	100
XII Appendices	101

FIGURES

<u>Number</u>		<u>Page</u>
1	Schematic for processing clarifier samples for soluble BOD ₅ study	11
2	The separation of insoluble from soluble BOD ₅ by filters of various pore sizes.	13
3	Total biochemical oxygen demand in clarifier influent and effluent samples	16
4	Total chemical oxygen demand in clarifier influent and effluent samples	17
5	Suspended solids in clarifier influent and effluent collected on a 0.45 μ m filter.	18
6	Suspended solids and BOD ₅ in various concentrations of influents treated with Fe ³⁺ or alum.	33
7	In jar tests with Mosinee mill effluent, pH 8.5, ferric chloride and ferric sulfate at 25 and 50 mg/l of Fe ³⁺ (<u>a</u>), (<u>b</u>), (<u>d</u>), and (<u>e</u>), precipitated more solids than when they were used at a higher concentration, 100 mg/l of Fe ³⁺ (<u>c</u>) and (<u>f</u>).	40
8	Schematic of pilot-scale clarifier installation	50
9	Variation in pH of Mosinee mill effluent entering pilot-scale clarifier.	54
10	Bauer Hydrasieve used to remove the longer fibers from the Combined Locks mill effluent	62
11	Jar tests on wastes from individual sewers in the Mosinee mill (paper machine, high density, pulp mill, and foul evaporator condensate)	68
12	Jar tests on wastes from individual sewers in the Mosinee mill (continued) (soda recovery, digester blowdown, foul condensate, digester, and 5th stage brownstock water). . .	69
13	Jar tests on special <u>composites</u> of Mosinee individual waste streams.	72
14	Jar tests showed mixed effluents with addition of, left to right, 25, 50, 75, 100, 150 mg/l Fe ³⁺ ; the control, no addition, is jar f. A Mosinee effluent was used	73

15	Jar tests with Combined Locks individual sewer effluents. . .	74
16	Jar tests on wastes from individual sewers in the Combined Locks mill	75
17	Jar tests on special <u>composites</u> of Combined Locks individual waste streams.	76
18	TOC and molecular weight distribution of gel-chromatographed chemimechanical mill effluent before and after coagulation with 70 mg/l Fe^{3+} as ferric chloride	78
19	Phenol sulfuric acid test for aldoses and molecular weight determination of gel-chromatographed chemimechanical mill effluent before and after coagulation with 10 mg/l Nalco 73C32.	79
20	Ultraviolet light transmittance profile and molecular weight distribution of a gel-chromatographed solution of sodium gluconate and ferrous ammonium sulfate, pH 2	81
21	Transmittance and molecular weight distribution of a gel- chromatographed solution of sodium gluconate and ferrous ammonium sulfate, pH 7.0	82
22	Phenol sulfuric acid test for aldoses and molecular weight distribution of gel-chromatographed chemimechanical pulp mill effluents	83
23	Effect of pulp fibers on removal of soluble compounds	86
24a	Effect of kraft pulp fibers at 350 mg/l on removal of soluble compounds with 100 mg/l of Fe^{3+} (as FeCl_3) at various pH's (acetic acid, methyl acetate, ethyl acetate, oxalic acid, lactic acid, and methyl lactate).	88
24b	Effect of kraft pulp fibers at 350 mg/l on removal of soluble compounds with 100 mg/l of Fe^{3+} (as FeCl_3) at various pH's (raffinose, hexanedioic acid, 2-pentanol, and tertiary amyl alcohol)	89
24c	Effect of kraft fibers at 350 mg/l on removal of soluble compounds with 100 mg/l of Fe^{3+} (as FeCl_3) at various pH's (<u>trans</u> -butenedioic acid, <u>cis</u> -butenedioic acid, propanedioic acid, hydroxymalonic acid, benzylmalonic acid, and 1,4- butanedioic acid).	90
24d	Effect of kraft fibers at 350 mg/l on removal of soluble compounds with 100 mg/l of Fe^{3+} (as FeCl_3) at various pH's (benzoic acid, <u>p</u> -hydroxybenzoic acid, <u>o</u> -hydroxybenzoic acid, <u>p</u> -methylbenzoic acid, 3,4,5-trihydroxybenzoic acid, and 3-methoxy-4-hydroxy-benzaldehyde).	91

24e	Effect of kraft fibers at 350 mg/l on removal of soluble compounds with 100 mg/l of Fe^{3+} (as FeCl_3) at various pH's (<u>m</u> -dihydroxy-benzene, <u>o</u> -dihydroxy-benzene, <u>p</u> -hydroxy cinnamic acid, 4-hydroxy-3-methoxy cinnamic acid, D-galacturonic acid, and polygalacturonic acid).	92
25	The model compounds shown in Figures 23-24e cluster in two groups on the basis of solubility in water and removability with Fe^{3+}	95
B-1	BOD ₅ reduction during clarification with Hercofloc.	107
B-2	Color and suspended solids reduction during clarification with Hercofloc	108
B-3	BOD ₅ reduction during clarification with alum	109
B-4	Color and suspended solids reduction during clarification with alum.	110
B-5	BOD ₅ reduction during clarification with ferric chloride.	111
B-6	Color and suspended solids reduction during clarification with ferric chloride	112
B-7	BOD ₅ reduction during clarification with ferric sulfate	113
B-8	Color and suspended solids reduction during clarification with ferric sulfate.	114
B-9	BOD ₅ reduction during clarification with sulfuric acid, Hercofloc, or ferrous sulfate plus Hercofloc	115
B-10	Color and suspended solids reduction during clarification with sulfuric acid, Hercofloc, or ferrous sulfate plus Hercofloc.	116
C-1	Total and soluble BOD ₅ in base-line study (no additives) at Locks Mill.	124
C-2	Color and suspended solids in base-line study (no additives) at Locks Mill	125
C-3	Effect of ferric chloride — 75 mg Fe^{3+} (without polymer) on BOD ₅ at Locks Mill.	126
C-4	Effect of ferric chloride — 75 mg Fe^{3+} (without polymer) on color and suspended solids at Locks Mill.	127
C-5	Effect of ferric chloride (75 mg Fe^{3+} /liter) + Nalcolyte 73C32 (1 mg/liter) on BOD ₅ at Locks Mill	128

C-6	Effect of ferric chloride (75 mg Fe ³⁺ /liter) + Nalcolyte 73C32 (1 mg/liter) on color and suspended solids at Locks Mill	129
C-7	Effect of ferric sulfate (100 mg Fe ³⁺ /liter) on BOD ₅ at Locks Mill	130
C-8	Effect of ferric sulfate (100 mg Fe ³⁺ /liter) on color and suspended solids at Locks Mill	131
C-9	Effect of alum (300 mg/liter) on BOD ₅ at Locks Mill	132
C-10	Effect of alum (300 mg/liter) on color and suspended solids at Locks Mill.	133
C-11	Effect of alum (300 mg/liter) + Hercofloc 812.3 (0.75 mg/liter) on BOD ₅ at Locks Mill.	134
C-12	Effect of alum (300 mg/liter) + Hercofloc 812.3 (0.75 mg/liter) on color and suspended solids at Locks Mill.	135
C-13	Total and soluble BOD ₅ in second base line (gravity sedimentation) at Locks Mill	136
C-14	Color and suspended solids in second base line (gravity sedimentation) at Locks Mill	137

TABLES

<u>Number</u>		<u>Page</u>
1	Description of Mills Surveyed	7
2	Analysis of Filtrates Prepared with and without Filter Aid. .	9
3	Comparison of Ultrafiltrates from a 100-A Membrane with Filtrates Prepared with Filter Aid over 0.45 and 0.10 μm Filters	9
4	Analytical Data for Treated and Untreated Samples During Evaluation of Method for "Soluble" BOD_5	12
5	BOD_5 in Clarifier Influent and Effluent Samples ("As Received" and Filtered Through a 0.45 μm Filter)	14
6	COD in Clarifier Influent and Effluent Samples ("As Received" and Filtered Through a 0.45 μm Filter)	14
7	Suspended Solids in Clarifier Influent and Effluent Samples Removed by a 0.45 μm Filter.	15
8	The Variability of pH, BOD_5 and COD in Clarifier Influent and Effluent Samples from Different Sources.	19
9	Screening Trials of Flocculants and Polymers by Analysis of Soluble Organic Carbon and Soluble BOD_5	22
10	COD and BOD_5 of Various Polymers used as Flocculation Aids. .	23
11	Comparison of Phenol Sulfuric Acid Test with BOD_5 Test to Evaluate Flocculants in Test Tube Tests.	24
12	Comparison of Phenol Sulfuric Acid Test with BOD_5 Test to Evaluate Flocculants in Jar Tests.	25
13	A Comparison of Zeta Potential, Soluble COD and BOD_5 , and Floc Form in Jar Tests of Flocculants.	26
14	Jar Tests of Primary Flocculants with Mill A and Mill D Influents and Effluents.	28
15	Jar Tests of Primary Flocculants with Mill F Total Clarifier Influent	29
16	Jar Tests of Polymers and Additives with Mill F Total Clarifier Influent	30

17	Jar Tests of the Effect of Activated Carbon and Various Additives on Soluble COD and BOD ₅ in Mill F Clarifier Influent	31
18	Jar Tests of the Effect of Activated Carbon and Additives on COD and BOD ₅ of Mill F Chemimechanical Pulpig Effluent. .	32
19	Jar Tests of the Effect of Flocculants on BOD ₅ , COD, Organic Carbon, and Color in Mosinee Clarifier Influent.	35
20	Jar Tests of FeCl ₃ , Alum, and Additives as Flocculants for Mosinee Clarifier Influent	36
21	Jar Tests of the Effects of Primary Flocculants and Polymers on pH and Clarity of Mosinee Clarifier Influent	37
22	Jar Tests of the Effect of Flocculants on pH, BOD ₅ , COD, and Color of Effluents from Mosinee Clarifiers	38
23	Effect of pH on Jar Test Flocculation of Mosinee Clarifier Influent	39
24	Volume of Sludge from Mosinee Clarifier Influent Treated with Various Flocculants and Polymer.	41
25	Removal of BOD ₅ from Effluents of Combined Locks Mill by Flocculants and Polymers	42
26	Sources of Soluble and Total COD and BOD ₅ in Effluents of Mill F	43
27	Chemical, Biological, and Physical Analyses of Various Process Streams within the Mosinee Mill (Mill K)	44
28	Release of Solids, Soluble COD and BOD ₅ by Beating.	45
29	Jar Tests of Various Flocculation Treatments of Filtered 90-Minute Beater Samples	46
30	Soluble COD and BOD ₅ in Mill F Effluents Treated with Flocculants and Reverse Osmosis or Ultrafiltration	47
31	Laboratory Evaluation of Pilot-Scale Clarifier.	52
32	Analysis of Individual Samples to Establish Range	53
33	Analysis of Special and Regular Samples of Clarifier Influent, Trial No. 1.	55
34	Analysis of Special and Regular Samples of Clarifier Influent, Trial No. 2.	56

35	Various Treatments of Mosinee Mill Effluent in Pilot-Scale and Mill Clarifiers.	60
36	Analysis of Special and Regular Samples of the Clarifier Influent of the Combined Locks Mill.	64
37	Clarifier Study — Combined Locks Paper Corporation Average Effluent Quality and Removal Values for IPC and Mill Clarifiers	66
38	BOD of Individual Effluent Streams and Total Mill Effluent of Mosinee Mill.	70
39	Removal of Different Molecular Weight Fractions of Organic Residues by Flocculation	80
40	Removal of Carbohydrates and Weak Acids from Mosinee and Combined Locks Waste Streams by Pilot-Scale Clarification.	85
41	TOC Removal from Solutions of Model Compounds Treated in Jar Tests with Aluminum Sulfate.	87
42	Solubility in Water of Various Model Compounds and Their Removal in Jar Tests with Fe^{3+} and Pulp Fibers	94
43	Chemical Costs for Clarification.	97
B-1	Clarifier Studies with Hercofloc 812.3 (0.75 mg/l) at Mosinee Paper Corporation	102
B-2	Clarifier Study with Alum (200 mg/l) plus Hercofloc 812.3 (0.75 mg/l) at Mosinee Paper Corporation	103
B-3	Clarifier Study with Ferric Chloride (100 mg/l Fe^{3+} Plus Hercofloc 812.3 (0.75 mg/l) at Mosinee Paper Corporation	104
B-4	Clarifier Study with Ferric Sulfate and Hercofloc at Mosinee Paper Corporation.	105
B-5	Clarifier Study with Sulfuric Acid, Sulfuric Acid Plus Polymer, and Ferrous Sulfate Plus Polymer at Mosinee Paper Corporation.	106
C-1	Clarifier Study at Combined Locks — Base Line (Gravity Clarification after 0.010 Inch Sieve) Without Additives	117
C-2	Clarifier Study at Combined Locks — Ferric Chloride (75 mg/l Fe^{3+}) Without Polymer	118
C-3	Clarifier Study at Combined Locks — Ferric Chloride (75 mg/l Fe^{3+}) Plus Nalcolyte 73C32 (0.75 mg/l).	119

C-4	Clarifier Study at Combined Locks — Ferric Sulfate (100 mg/l Fe^{3+})	120
C-5	Clarifier Study at Combined Locks — Alum (300 mg/l)	121
C-6	Clarifier Study at Combined Locks — with and Without Alum (300 mg/l) Plus Hercofloc 812.3 (0.75 mg/l)	122
C-7	Clarifier Study at Combined Locks — Second Base Line (Gravity Sedimentation After 0.010 Inch Sieve) Without Additives	123

ACKNOWLEDGEMENTS

The original objectives of this project in terms of evaluating the degree of BOD removal attained in primary clarification of pulp and paper effluent waters were conceived by Dr. Everett Cann of the Wisconsin State Department of Natural Resources. The project was organized and conducted by the staff of The Institute of Paper Chemistry. George Dubey, Project Supervisor, had responsibility for detailing and conducting the laboratory and field studies and for reporting the results of this research in cooperation with Averill Wiley, Project Director, and Hardev Dugal, Director of the Institute's Division of Industrial and Environmental Systems.

Gerald Hovind, Arthur Webb, and Gay Fraundorf were principally involved in the extensive analytical program. The field studies were greatly facilitated by help from John Baumann who installed and operated The Institute of Paper Chemistry pilot equipment, by James Albrecht and Al Kleist of the Mosinee Paper Corporation, and by Lawrence Weyenberg and James Roovers of the Combined Locks plant at National Cash Register.

Ralph H. Scott, Chief of Pulp, Paper and Wood Staff, Food and Wood Products Branch, IERL-Ci, EPA, as Project Officer, has had responsibilities for the immediate supervision of this project in accordance with the objectives of the program.

SECTION I

INTRODUCTION

The overall degree of biochemical oxygen demand (BOD) removal actually observed in most conventional out-plant clarifiers treating total mill effluents has been relatively small (5-15 percent) and has seldom extended to levels that would significantly improve effluent quality. A search of the literature disclosed few published investigations of the mechanisms for the BOD removal in clarifiers. Only two (1,2) gave data indicating possible sources of BOD that is removed during clarification. The State of the Art Review of Pulp and Paper Waste Treatment by Gehm (1) attributes the BOD to "the high content of suspended organics and small quantities of dissolved organic matter" in certain types of waste and to the "fact that the oxygen uptake rate of fiber is slower than that of dissolved materials, since it must first be liquefied before oxidation can take place." Das and Lomas (2) point to glucuronoxylans and araboglucuroxylans as water soluble hemicelluloses (from the beating of pulp) that reduce the BOD when removed with the floc. One of the first goals of Phase I of this research program was, therefore, to evaluate by a controlled analytical study the removal performance for total and "soluble" BOD₅ in different clarifiers at pulp and paper mills. Surveys of mill waste flows and clarifier effluents were conducted at 12 mills owned by 11 companies. The analytical data developed during this survey established the basic program of the investigation and the definitions of the terms "soluble" and "total 5-day biochemical oxygen demand (BOD₅)" to be used throughout the balance of this study.

Three different classes of BOD-forming components in the various waste flows were identified:

1. Substantial quantities of the BOD being removed in clarifiers are obviously suspended fibers and related solids in various stages of physical, chemical, and biological degradation. These suspended particles may originally have low levels of solubility and low BOD but can undergo degradation to produce soluble substances responsible for BOD. This fraction comprises the principal source of BOD readily removed in conventional clarifiers.
2. Advanced degradation of cellulose and hemicellulose particles and the presence of papermaking additives such as starch may provide a substantial amount of soluble, high molecular weight components with biochemical demand for oxygen. Most of these kinds of substances can be surface-adsorbed and removed by advanced clarification procedures. The further development and field testing of routes to removal of this fraction comprised a principal area for development under Phase II of this project.

3. A third fraction of the BOD contained in pulp and paper waste waters is comprised of low molecular weight degradation products of carbohydrates, such as acetic acid, aldehydes and alcohols, which are not readily amenable to physical adsorption and flocculation. Removal of these components has not been reported for primary treatment if we except those cases of prolonged holding time or other conditions where advanced stages of microbiological action are evident in the clarifier.

The fundamental physicochemical mechanisms of flocculation of pulp mill white water fines studied by Williams (3) and the work by Back (4) on the nature of wood components dissolved in the pressure refining of mechanical pulps provide information on a possible approach to the development of an understanding of the mechanisms involved in the removal of BOD components from waste streams. Their ideas were used to develop the jar testing procedures used in our laboratory for the optimization of the removal of BOD₅ constituents from various total mill effluents.

Phase I studies were funded jointly by a group of U.S. pulp and paper companies (Appendix A), the U.S. Environmental Protection Agency (EPA) (Grant No. 803 119), and the Wisconsin Department of Natural Resources (Ref. No. 8100).

For a supplementary and confirming Phase II program, small-scale pilot equipment was used for on-site comparative studies, paralleling commercial clarifiers operating at two mills representative of a broad segment of the pulp and paper industry. Additional funds were supplied by the U.S. Environmental Protection Agency under an extension of the above grant and by The Institute of Paper Chemistry. This confirming program of study was designed to evaluate the operating parameters developed in the earlier Phase I laboratory research under mill conditions. The first trial was conducted at an integrated kraft mill and the second at an integrated mill producing pulp by a recently developed chemimechanical (CM) pulping process.

Laboratory jar tests were also used to evaluate the flocculation and clarification characteristics of individual sewer discharges at these two mills. We studied the effects of processing each of these streams separately and we could also check the effect each had on the overall BOD₅ efficiency of the clarifier when processed as a part of the total mill effluent. Additionally, the jar tests were used to test the removal of soluble model compounds (acetic acid, aromatic dicarboxylic acids, etc.) from solution with the various flocculating agents in order to help elucidate the mechanism of BOD₅ reduction.

An economic evaluation of the data of two field trials and the results of the jar tests conducted on individual streams show the savings which might be realized if the relatively small volumes of stronger pulping effluents, containing lignin compounds with dispersant properties, were not treated in the clarifier.

SECTION II

SUMMARY AND CONCLUSIONS

1. A large portion of the BOD entering the primary clarifiers processing pulp and paper manufacturing waste waters are solubles that can pass through a 0.45 μm filter.

2. These components are generated from wood in pulp and papermaking steps, including wood handling. They may also come from papermaking additives such as starch or sizes. These materials can be degraded within the mill or during out-plant treatment.

3. Laboratory jar tests with various chemical flocculating agents and operating parameters showed that significant quantities, ranging to 20 percent or more, of the soluble BOD₅ and color could be removed from wastes from mills surveyed in Phase I studies. These findings were confirmed by pilot scale field trials at Mosinee Paper Company at Mosinee, Wisconsin, and at the Combined Locks mill of the NCR Corporation in Combined Locks, Wisconsin.

4. Jar tests with the individual waste streams making up the total mill discharge have shown that certain streams contribute both high BOD₅ levels and chemicals that are detrimental to the efficient operation of the clarifiers. Elimination of these streams from the out-plant clarifiers could provide increased quality to the mill discharge. It would also decrease the load on the secondary treatment plant. The streams that were removed from the influent to the clarifier could be treated separately in small clarifiers or by reverse osmosis, ultrafiltration, or other small unit processes.

5. The mechanism for the removal of soluble BOD₅ is very complex due to the heterogeneity of the wastes treated in the clarifiers. There was no apparent relationship between the initial soluble BOD₅ concentration and the ultimate removal of the soluble BOD₅ components by the clarification process.

6. Gel chromatography analysis of effluents before and after coagulation with iron and pulp fines showed a significant number of low molecular weight compounds were removed. Model compound studies showed that many organic acids including some quite soluble could be partially coagulated in an iron-pulp fines system as well as substances which do not form salts with iron.

7. Evaluation of the benefits and costs of achieving improved performance of clarifiers requires detailed engineering studies to fit individual mill situations. Such studies were beyond the scope and objectives of this study. However, it was apparent that total chemical costs, including the chemical additives which may be used in existing practices at these mills,

might range from 3¢ to 10¢ per 1000 gallons treated. Efficient use of these chemicals would be balanced by benefits and cost reductions in the overall systems of waste treatment.

8. Good clarifier performance and low chemical costs could only result from adequate control of mill overflows and spills so that strong colloids or dispersants do not enter the clarifier.

SECTION III

RECOMMENDATIONS

These studies have shown that with the proper selection of flocculating agents and operating conditions, soluble BOD₅ concentrations in waste streams can be markedly reduced (10-50 percent) in the primary clarifier.

Collapse of the double layer surrounding the charged molecule, bridging, and decreased solubility after treatment with the flocculating agent are mechanisms which could be expected to contribute to the removal of both total and soluble BOD₅ components, as well as color, from the effluents.

1. We need to know more about the constituents and characteristics of different kinds of sludges — those from high and low levels of soluble BOD₅ removal — and their effect on the efficiency of clarification in mills processing under different conditions. This could add considerably to our knowledge of the mechanisms involved. The influence of individual mill waste streams in clarifier sludge performance also needs further study.

2. Many of the individual sewer discharges were found to have adverse effects on the efficiency of the clarifiers and also to have a toxic effect on the 5-day BOD test. Removal of these streams from the clarifier inflow could markedly increase the efficiency of both the primary and secondary (biological-type) treatment systems. Diversion of these flows, which are usually of small volume, to other treatment systems is recommended.

3. Selection of the streams to be "eliminated" could be undertaken under laboratory conditions with a combination of jar and BOD₅ tests. Processes for treating the eliminated streams by separate in-plant clarification, reverse osmosis, ultrafiltration, or the training of plant personnel to reduce the discharge of the detrimental stream would follow the identification of these major sources of difficulty.

SECTION IV

MILL SURVEYS

EQUIPMENT AND PROCEDURES

Weekly samples from mills using clarifiers consisted of two gallons of the influent to the clarifier and a single gallon of the clarifier effluent. Where possible, both samples were collected as 24-hour composites. Mills not using clarifiers sent in two gallons of the effluent they were discharging into ponds or aeration lagoons. Table 1 describes the types of mills and their facilities for pulping, bleaching, and effluent treatment; this table is based on data supplied by the mill staff.

As soon as the samples were received in the Institute laboratories at Appleton, Wisconsin, the influent samples were composited, well mixed and immediately transferred to one-gallon plastic bottles. One bottle was filled to the brim, set aside to settle for one hour, and the top 6 inches of supernatant was withdrawn using a light vacuum and a short U-bend at the end of a glass tube. This permitted removal of the top layer of "clear" fluid without drawing the "settled" material from the bottom layer. A second bottle of the influent and also a bottle of clarifier effluent were separately mixed and analyzed "as received."

Samples of the "as received" and "settled" material were pressure filtered through various porosity filters. These filters were 1.2- μ m and 0.45- μ m pore size Metrical membranes from Gelman Instruments of Ann Arbor, Michigan and a 0.10- μ m plastic filter from Nuclepore of Pleasant, California.

Suspended solids, BOD₅, and chemical oxygen demand (COD) were determined on the initial samples and on all fractions.

Samples for suspended solids were processed on 1.2- and 0.45- μ m filters on a Gelman pressure funnel at 6.9 kg/cm² (100 psig) with N₂ and dried at 103-105°C (218-221°F) for one hour. For biochemical oxygen demand we used the standard APHA Method (5), keeping the samples at 20°C (69°F) in a water bath and determining the dissolved oxygen with a Weston and Stack probe. The COD was determined by the dichromate oxidation method of APHA (6). Color was determined at pH 7.6 using the National Council for Air and Stream Improvement method (20).

Some waste samples filtered slowly through 0.45- and 0.10- μ m filters. To avoid filter clogging, a pad of filter aid (Celite, AR, Johns-Manville) was used on 1.2-, 0.45- and 0.10- μ m filters for these wastes. The filter-aid pad was formed from a 1-percent slurry of Celite AR poured onto the filters and then dewatered. Analysis of these samples with and without the use of the filter aid (Table 2) indicated that the filter aid did not adversely affect the analytical accuracy. Therefore, in later work, the filter aid was

TABLE 1. DESCRIPTION OF MILLS SURVEYED

Mill	Type of cook	Tons/day	Bleaching sequence	Effluent sewers	Volume, mgd ^a	Clarifier additives
A	Ammonium bisulfite, aspen	NA	NA ^b	Pulp mill wash water	5.6	Gendriv 162 2 mg/l
B	Acid sulfite	NA	NA	NA		No clarifier
C	Groundwood	225		Coater Paper machines Boiler room & treatment plant	0.19 2.3 0.2	Cationic polymer 1.7 mg/l
D	Acid sulfite (pH 2.5) 66% softwood 34% hardwood	115	Single stage calcium hypochlorite	Evaporator condensate Decker Bleach washer Paper mill Miscellaneous	0.1 5.0 1.5 ^c 1.0 ^d 0.4	None
E, EE	Kraft, groundwood	NA				No clarifiers
F	Chemimechanical, also NSSC and kraft fibers used in papermaking	350	High density peroxide	Wet room CM No. 6 Main No. 5 Old filter backwash New filter backwash	2.16 ^e 1.41 1.17 1.10 0.53 0.40 ^e 0.43	None
G	None-deinking mill	150	C-EH-H at volume ratio 90:5:5	Decker deink Bookstock deink No. 3 & 4 paper machines No. 5 Paper machine Beater room additives Chlorination waste water Misc. (water treatment plant sludge, etc.)	1.2 ^e 0.8 ^e 0.40 ^c 0.55 ^c 0.47 ^c 0.38 0.40	Anionic polymer 1.5 mg/l

See end of table for footnotes.

TABLE 1 (Continued). DESCRIPTION OF MILLS SURVEYED

Mill	Type of cook	Tons/day	Bleaching sequence	Effluent sewers	Volume, mgd ^a	Clarifier additives
H	Kraft Pine with 10% hardwood (oak)	370	None	Paper machine Salvage filter Excess screen room white water Water treatment blowdown Utilities department Kinney strainer reject Hot pond overflow	4.5 4.0 4.0 ^g 0.6 ^g 3.0 3.0 1.0	None
I	Kraft Pine, Douglas- fir, western larch, spruce	1150	CHHD	Clear water Pulp mill & recovery Bleach plant, paper mill & recaustizing	3.5 5.0 ^c 7.3 ^{c,d}	None
JJ	Converting mill	205	None	Mill effluent Sludge from water treatment	4.75 ^h 0.08 ⁱ	None
J	Groundwood	455	None	Paper machine stock room and coating plant Paper machine Off-machine coater Groundwood operation Cooling & miscellaneous	3.0 1.5 0.5 2.0 1.0	Polymer, 0.5 mg/l
K	Kraft Pine	230	None	Paper machine High density Pulp mill Foul evaporator condensate Soda recovery Digester blowdown condensate Digester room 5th Stage brownstock washer	10.0 ^e 1.5 0.6 0.3 0.28 0.07 0.05 0.04	Hercoflocc 812.3, 0.75 mg/l

^amgd = Million gallons per day.^bNA = information not available.^cDefoamers added.^dPitch control chemical added.^eEstimate.^fDefoamers and detergent added.^gAlum and silicates added.^hWet strength resin, defoamer, talc, animal glue, slimicides,ⁱrewetting agent, dryer release, and organic dispersants added.^jAlum and chlorine added.

used as a standard practice with the precaution of first checking the effect on one or two samples of each waste stream. Eventually the exploratory studies with various grades of filters resulted in adoption of the 0.45- μ m porosity as a standardized procedure.

TABLE 2. ANALYSIS OF FILTRATES PREPARED
WITH AND WITHOUT FILTER AID^a

Sample	BOD ₅ , mg/l				COD, mg/l			
	1.2 μ m ^b		0.45 μ m ^c		1.2 μ m		0.45 μ m	
	With	Without	With	Without	With	Without	With	Without
F	190	178	182	176	464	436	409	369
	74	82	70	80	212	216	199	191
H	32	34	31	32	133	123	108	114
	48	42	44	46	105	126	118	106
B	770	778	672	675	3741	3650	3636	3615
	1246	1230	1218	1184	5363	5320	5190	4890
C	166	192	188	184	352	362	329	329
	184	181	168	174	316	316	275	292

^aCelite (AR) BOD₅ = 0.04 mg/g.

^b1.2- μ m BOD₅ = 1.92 mg/sheet.

^c0.45- μ m BOD₅ = 0.62 mg/sheet.

A few samples were also processed through a Dia-Flo (Amicon Scientific Systems) stirred ultrafiltration (UF) unit with a nominal 100-A (0.01 μ m) pore filter. The results were compared with those from the 0.45- and 0.10- μ m filters (Table 3). Since no differences were apparent in either BOD₅ or COD, the more time consuming UF procedure was not routinely used.

TABLE 3. COMPARISON OF ULTRAFILTRATES
FROM A 100-A MEMBRANE WITH FILTRATES
PREPARED WITH FILTER AID OVER
0.45- AND 0.10- μ m FILTERS

Sample	BOD, mg/l		
	SUF ^a	SO45F	SO10F
F	259	310	266
	272	256	267
H	30	43	32
	59	48	50
JJ	40	38	35
	35	40	40

^aSUF - Dia-Flo stirred ultrafiltration cell with 100-A membrane.

DATA AND DISCUSSION

In order to establish the various total and soluble components of BOD₅, the incoming samples were analyzed "as received," "settled," and after passage through either 1.2-, 0.45-, or 0.10- μ m filters (Figure 1). Throughout this section of the report, the designations are as follows:


AR	As received
AR045F	As received, filtered through 0.45- μ m filter with a Celite overlay
S	Settled
S12	Settled and passed through a 1.2- μ m filter
S12F	Same as S12, except with Celite overlay
S045	Settled and passed through a 0.45- μ m filter
S045F	Same as S045, except with Celite overlay
S010F	Settled and passed through a 0.01- μ m filter with a Celite overlay
SUF	Settled sample filtered through a 100-A UF unit

Data in Table 4 are averages of the six samples from each mill, along with high and low values (range) for each set. The values in parentheses are the percentages of the constituent in the sample after treatment. BOD₅ decreases as filter pore size decreases (Figure 2). The data in Table 4 and Figure 2 can be summarized as follows:

1. Comparing "as received" and "settled" values, we find a marked reduction in BOD₅ (to 62 percent) after simple settling (JJ).
2. The 0.45- μ m filter was, for all practical purposes, the best filter for the removal of "insoluble" BOD₅. This filter was used for further studies of "soluble" versus "total" BOD₅.
3. Seven percent additional BOD₅ could be removed from the JJ mill samples by passing them through the 0.45- μ m filter.
4. The COD values paralleled, but did not directly correlate with, the BOD₅ values.

In order to evaluate the operation of the mill clarifiers we analyzed clarifier influent and effluent samples in the same manner. Data for these samples "as received," and filtered through 0.45- μ m filters, are given in Table 5 (BOD), Table 6 (COD) and Table 7 (suspended solids). In order to simplify the presentation, the "as received" values are plotted in the same sequence in Figures 3, 4, and 5. Marked reduction in total BOD₅ was achieved in clarifier JJ. All clarifiers except those of Mills I and J achieved 50-90 percent removal of suspended solids.

Unfortunately, the values for constituents and removals are quite erratic, probably due to a time lag for arrival of these constituents at the sampling points. Although most samples were 24-hour composites, compensation for the effect of the clarifier "holding time," in some cases on the order of 18 hours and in most cases at least 4 hours, was not built into the sampling system. While this would have little effect on the monthly mill averages, it had a marked effect on the samples sent to our laboratories (Table 8). We found major differences in pH, BOD₅, and COD for the two streams in spite of

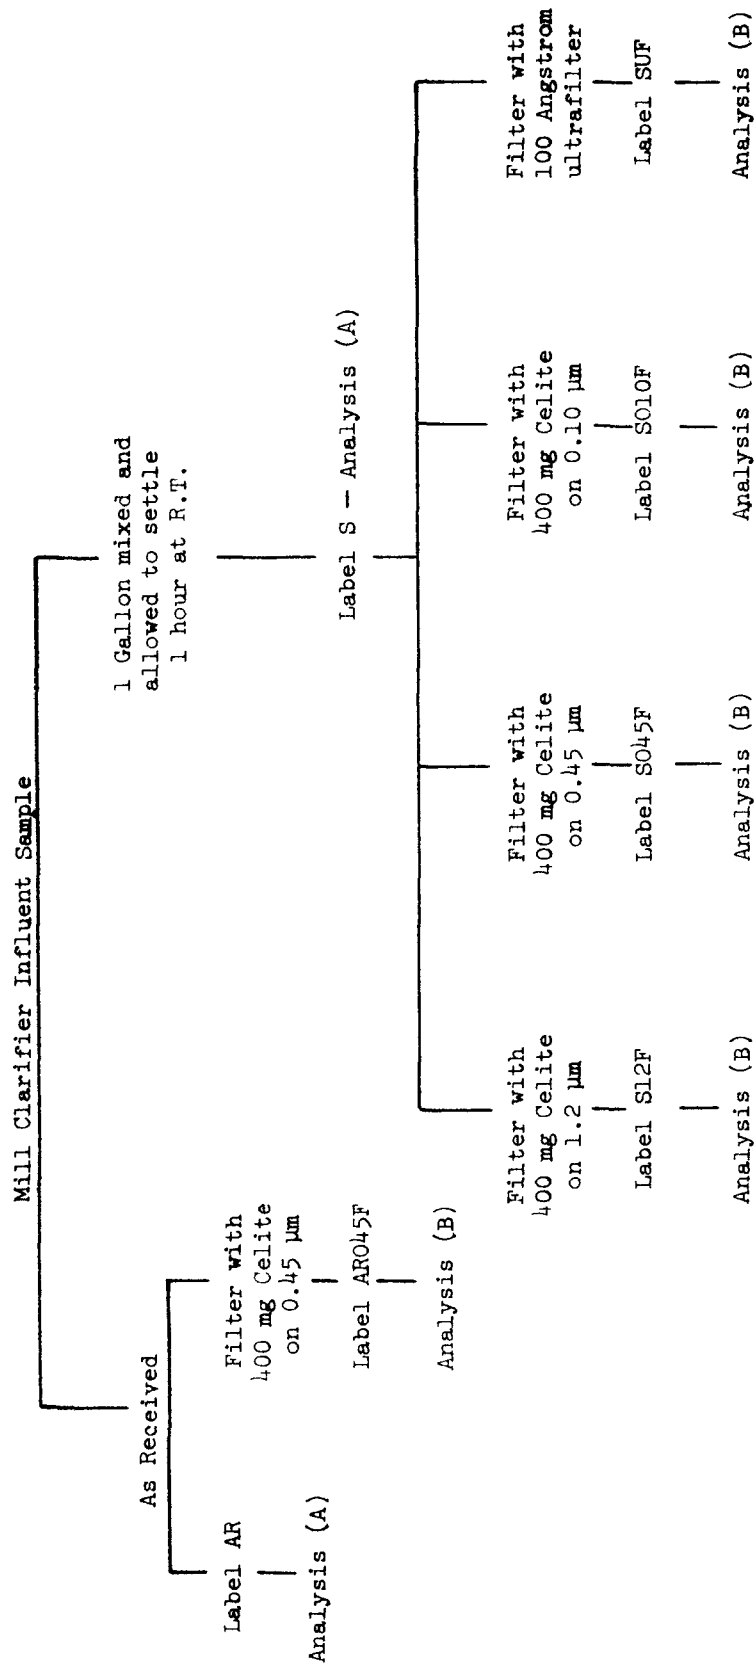

Analysis (A) - Suspended solids with 1.2 and 0.45 μm , BOD₅ and COD

Analysis (B) - BOD₅ and COD

Figure 1. Schematic for processing clarifier samples for soluble BOD₅ study.

TABLE 4. ANALYTICAL DATA FOR TREATED AND UNTREATED SAMPLES DURING EVALUATION OF METHOD FOR "SOLUBLE" BODs

Well	pH	AR	BOD ₅ , mg/l			COD, mg/l			Suspended solids, mg/l							
			AR045F	S	S12F	S045F	S010F	AR	S	S12F	S045F	S010F	AR045	S12	S045	
A	6.68	495	315(64)	354(71)	311(63)	293(59)	279(56)	1863	1262(68)	1218(65)	1207(65)	1066(57)	380	441	45	76
	6.5-6.8	358-664	215-422	254-510	231-486	232-390	214-382	1402-2286	1016-1624	1000-1529	960-1538	892-1396	262-524	262-548	0-70	46-96
B	5.00	1120	1081(96)	1076(96)	1014(90)	938(84)	906(81)	4860	4548(94)	4370(90)	4347(89)	4032(83)	353	412	154	214
	4.0-9.8	864-1485	602-1359	726-1407	756-1338	603-1218	552-1231	3660-6140	2457-6000	2127-5765	2150-5880	2132-5355	184-824	232-872	44-260	104-314
C	6.98	276	168(61)	208(75)	172(63)	165(60)	162(59)	712	427(60)	292(41)	283(40)	260(36)	1092	1126	182	201
	6.7-7.6	222-327	108-266	128-273	112-254	108-266	100-239	608-780	313-621	215-401	188-382	171-372	508-1788	752-1780	124-241	120-280
D	7.20	149	88(59)	73(49)	71(48)	65(44)	65(44)	583	383(66)	277(47)	246(42)	248(42)	202	235	53	64
	6.6-8.2	100-212	51-144	30-143	28-126	24-132	24-132	477-724	310-499	182-404	175-405	167-390	124-390	154-408	32-96	50-88
E	4.77	490	456(93)	451(92)	424(86)	412(84)	2024	1523(75)	1360(67)	1349(67)	801-2186	787-2106	278	318	137	173
	3.4-10.2	298-710	285-665	272-663	263-600	251-591	940-3494	854-2472	801-2186	448(25)	414(23)	395(22)	136-2110	192-384	108-206	128-228
EE	6.16	295	197(67)	235(80)	191(65)	188(64)	188(64)	1763	589(33)	448(25)	414(23)	395(22)	868	1218	136	171
	5.2-6.6	156-394	182-285	125-281	119-226	112-234	112-211	1156-3284	442-696	304-598	302-544	309-498	136-2110	216-2332	36-272	90-284
F	5.43	359	197(55)	154(43)	147(41)	140(37)	1684	522(31)	387(23)	366(22)	191-508	331(20)	1097	1242	110	115
	3.6-7.9	121-613	84-393	79-280	70-267	72-220	802-2268	238-762	212-527	191-508	156-472	676-1461	888-1848	25-245	52-205	
G	9.93	787	630(80)	538(68)	536(68)	498(63)	2918	1821(62)	1214(42)	1201(41)	574-2565	574-1521	3984	4165	1680	1679
	6.6-11.5	482-927	286-847	270-692	286-711	255-687	1702-3990	812-2796	574-1633	107(39)	108(49)	100(37)	2453-6075	2473-6086	556-2333	520-2573
H	7.46	76	49(64)	39(52)	39(52)	36(47)	272	168(62)	107(39)	83-130	73-132	75-118	177	240	66	72
	6.9-8.7	44-110	26-70	27-52	28-46	24-50	174-416	102-246	83-130	73-132	75-118	97-222	182-376	36-108	38-116	
I	8.24	622	575(92)	432(69)	404(65)	409(66)	2132	1910(90)	1668(78)	1144(54)	588-2350	1388(65)	633	853	348	426
	6.5-10.2	328-836	311-765	184-724	225-728	222-730	1065-3388	914-3195	597-2975	1144(54)	588-2350	491-2495	260-1456	360-1628	164-536	198-648
J	8.74	230	204(88)	132(57)	134(58)	136(59)	715	502(70)	370(52)	329(46)	259-540	336(47)	644	690	337	365
	7.0-8.1	153-310	120-263	94-167	89-164	86-162	411-1138	357-756	275-586	99(14)	88(13)	87(13)	270-1034	290-1118	88-654	152-652
JJ	8.02	122	46(38)	44(36)	38(31)	38(31)	691	218(32)	99(14)	88(13)	65-112	64-113	568	581	33	43
	7.4-8.8	69-246	30-82	30-86	26-47	32-44	404-802	86-626	71-123	65-112	64-113	386-647	409-665	8-92	14-90	

(* Remaining = settled (or filtered) value x 100)
as received value

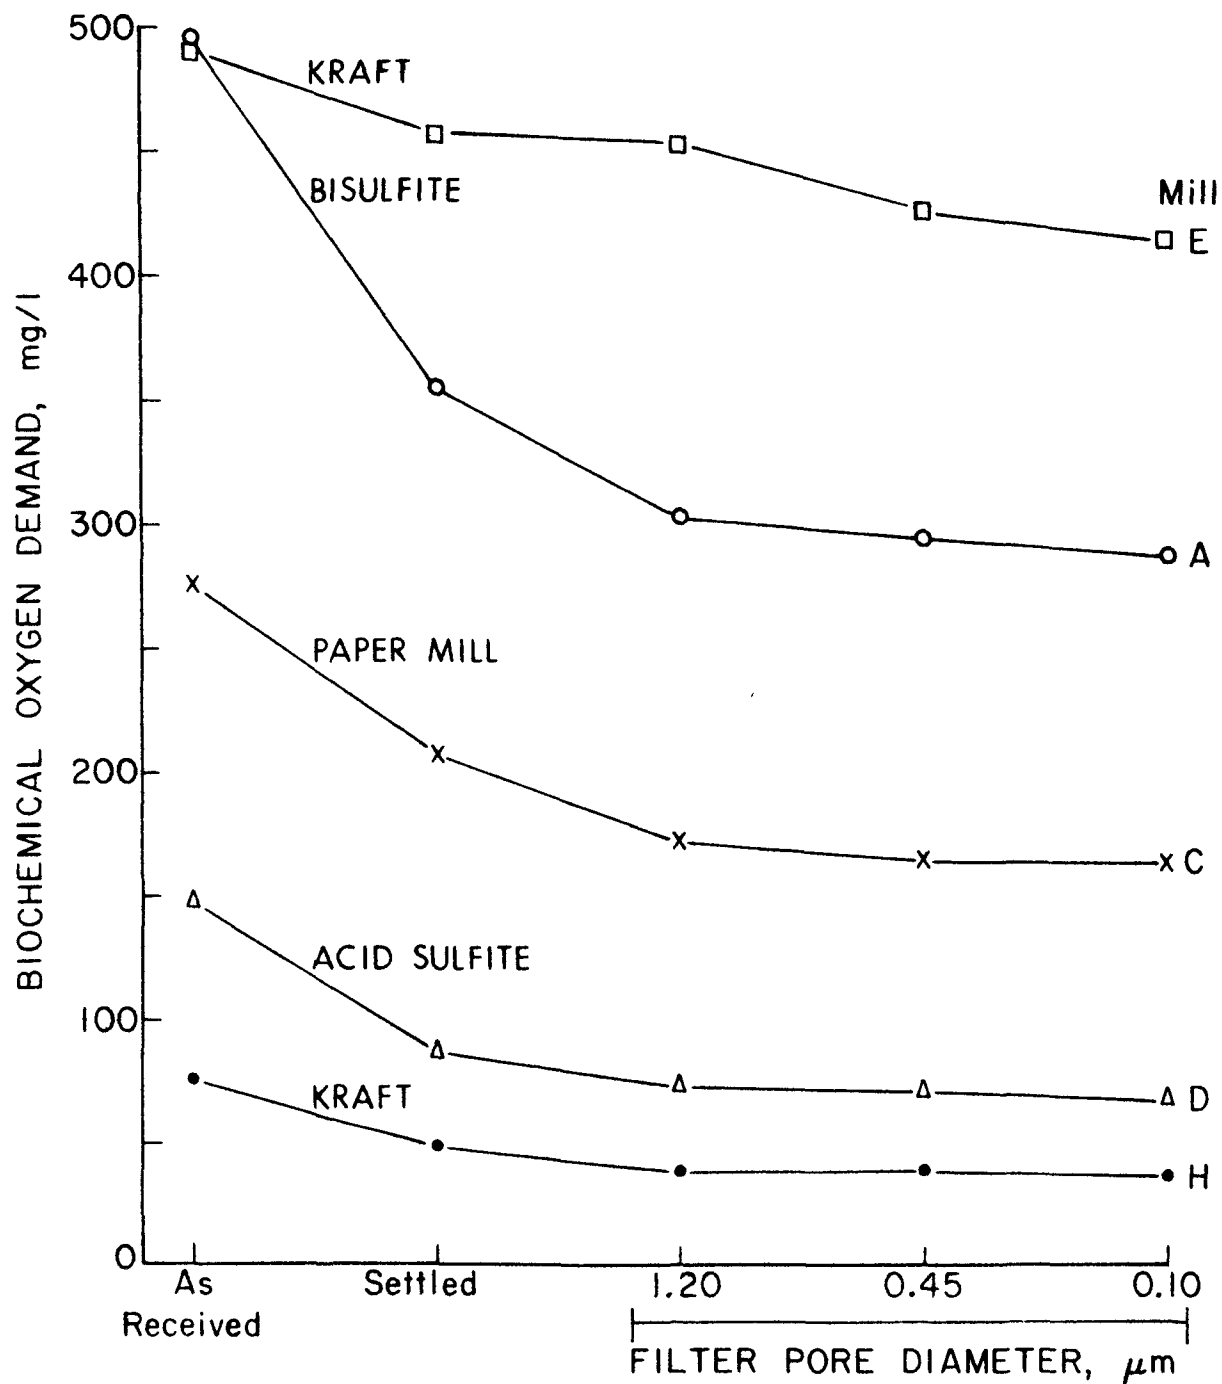


Figure 2. The separation of insoluble from soluble BOD_5 by filters of various pore sizes.

TABLE 5. BOD₅ IN CLARIFIER INFLUENT AND EFFLUENT SAMPLES ("AS RECEIVED" AND FILTERED THROUGH A 0.45 μ m FILTER)

Mill	As received (total)			Filtered (soluble)		
	Influent, mg/l	Effluent, mg/l	Removal, %	Influent, mg/l	Effluent, mg/l	Removal, %
A	495	341	31	303	304	-0.3
B	No clarifier					
C	264	192	27	145	138	5
D	156	90	42	75	59	22
E	No clarifier					
EE	No clarifier					
F	378	322	15	179	200	-12
G	787	645	18	536	432	45
H	76	51	33	39	33	15
I	622	557	10	371	247	34
J	230	152	33	134	124	8
JJ	122	37	70	38	32	16

TABLE 6. COD IN CLARIFIER INFLUENT AND EFFLUENT SAMPLES ("AS RECEIVED" AND FILTERED THROUGH 0.45 μ m FILTER)

Mill	As received (total)			Filtered (soluble)		
	Influent, mg/l	Effluent, mg/l	Removal, %	Influent, mg/l	Effluent, mg/l	Removal, %
A	1863	1328	29	1207	1236	-2
B	No clarifier					
C	712	429	40	283	286	-1
D	583	386	34	246	254	-3
E	No clarifier					
EE	No clarifier					
F	1695	642	62	408	399	2
G	2918	1606	45	1201	1149	4
H	272	188	31	108	98	9
I	2132	2013	6	1144	1104	4
J	715	433	40	351	284	19
JJ	691	126	82	88	84	5

the fact that both were collected within the same time period. This lack of continuity in the two samples could explain not only the lack of removal observed at times but could also be the reason that our studies showed the higher or lower removal values than did general mill experience.

TABLE 7. SUSPENDED SOLIDS IN CLARIFIER INFLUENT
AND EFFLUENT SAMPLES REMOVED
BY A 0.45 μ m FILTER

Mill	Influent, mg/l	Effluent, mg/l	Removal, %
A	441	63	86
B	No clarifier		
C	1126	248	78
D	235	77	67
E	No clarifier		
EE	No clarifier		
F	1187	213	82
G	4165	1034	75
H	240	99	59
I	853	587	31
J	690	340	47
JJ	581	50	91

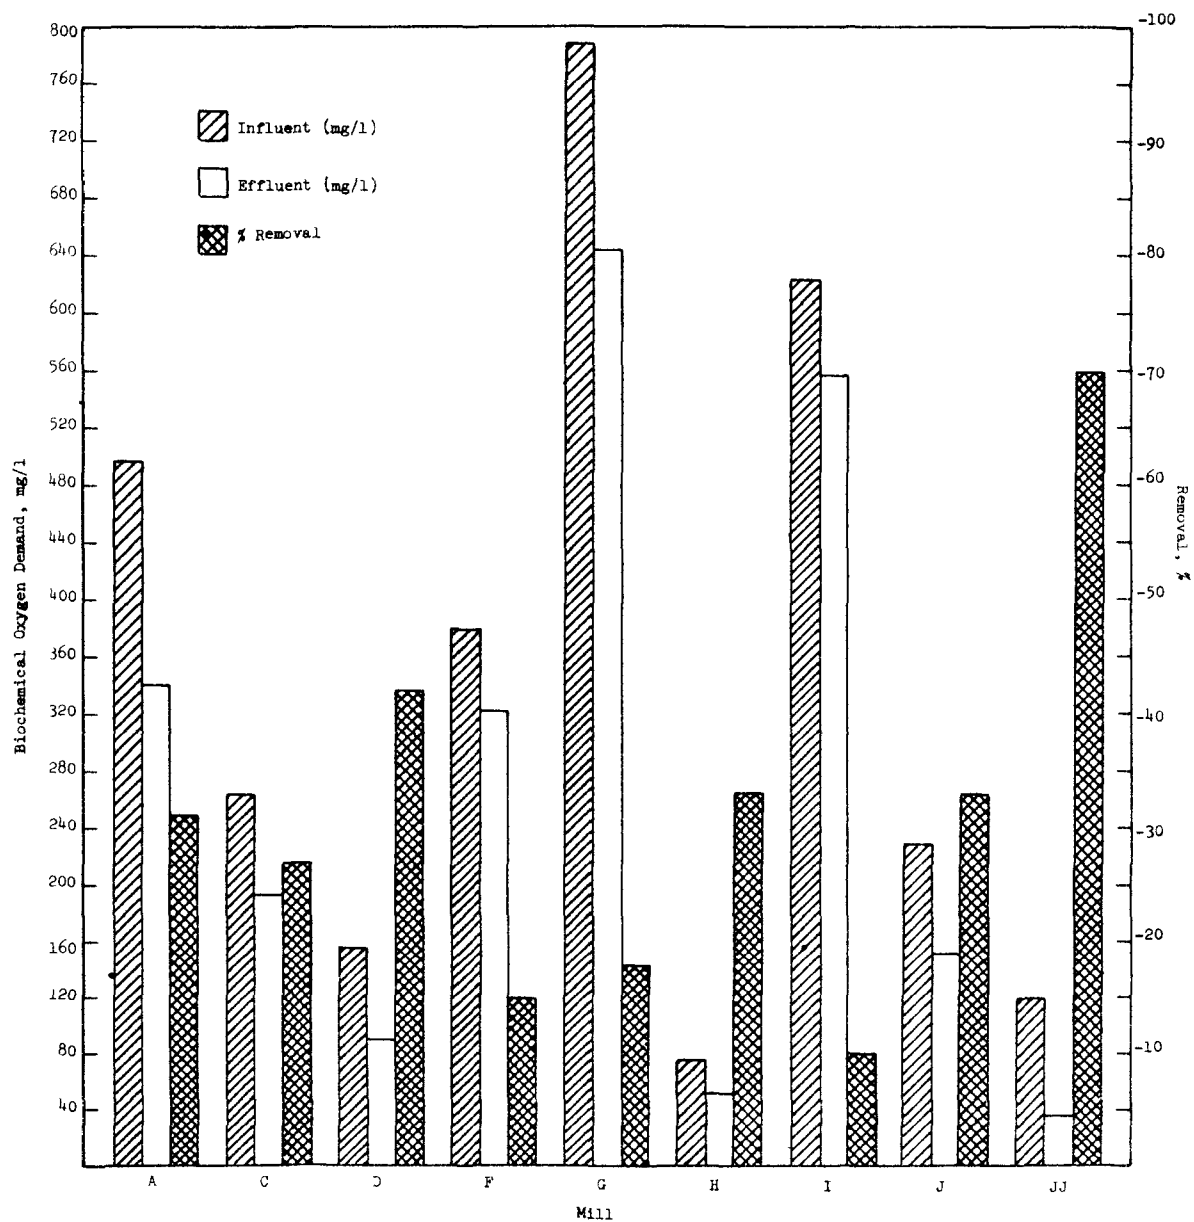


Figure 3. Total biochemical oxygen demand in clarifier influent and effluent samples.

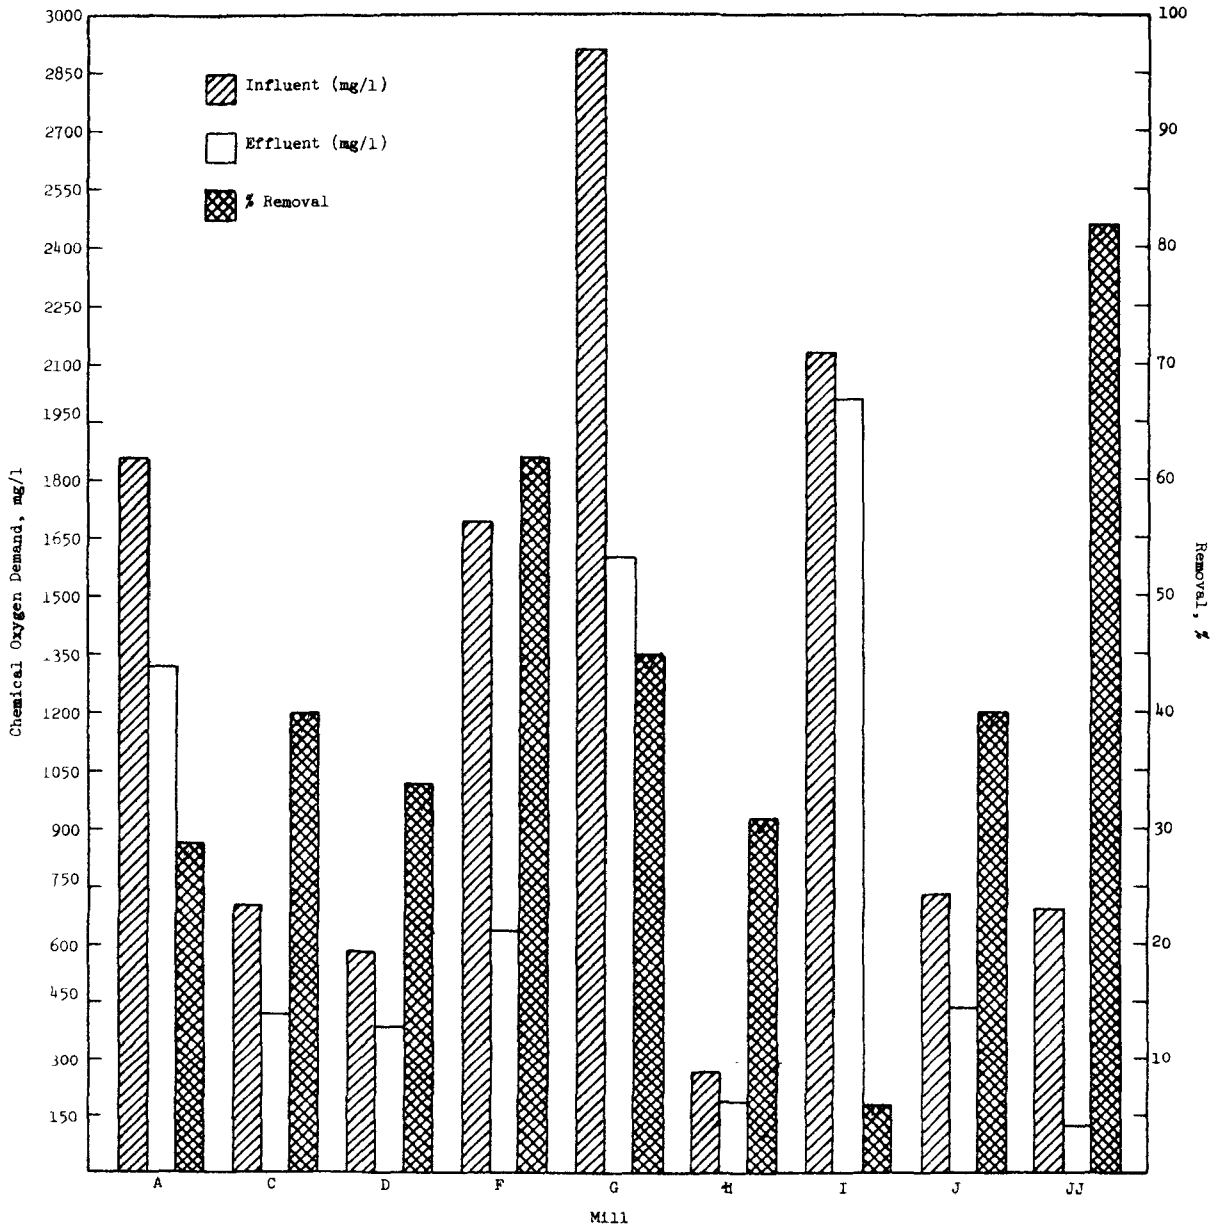


Figure 4. Total chemical oxygen demand in clarifier influent and effluent samples.

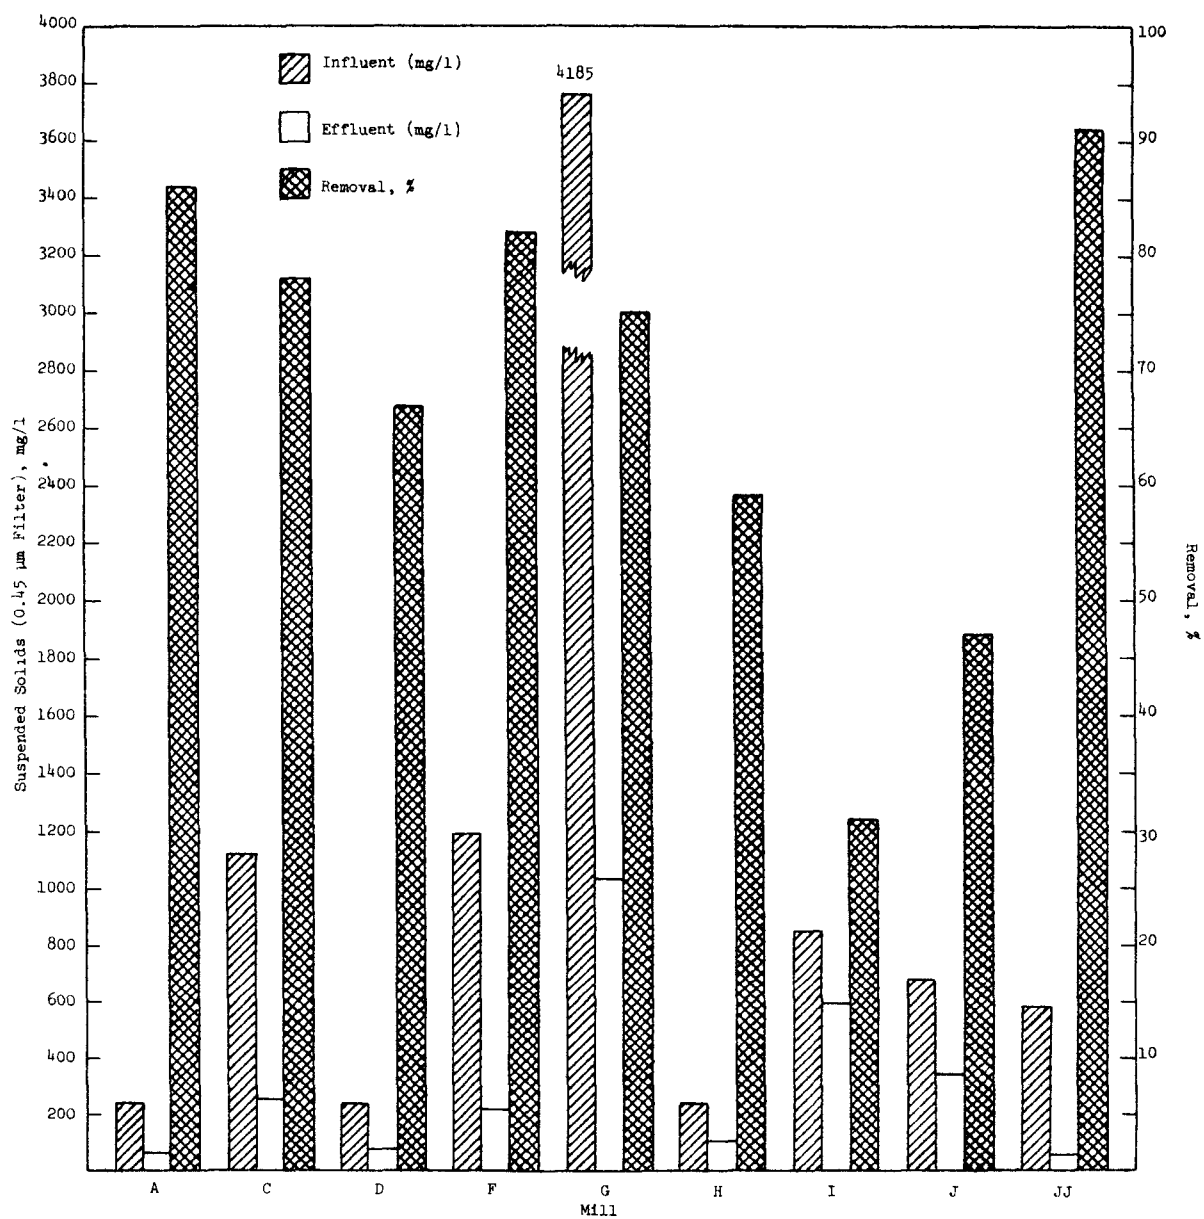


Figure 5. Suspended solids in clarifier influent and effluent collected on a 0.45-µm filter.

TABLE 8. THE VARIABILITY OF pH, BOD₅ AND COD
IN CLARIFIER INFLUENT AND EFFLUENT
SAMPLES FROM DIFFERENT SOURCES^{a,b}

Influent			Effluent		
pH	BOD ₅	COD	pH	BOD ₅	COD
4.81	274	2268	6.88	268	552
8.28	884	3899	10.68	555	1548
10.42	482	1702	11.05	489	812
11.53	634	2498	9.88	777 ^c	2202
10.18	836	3388	10.80	1104 ^c	2478
7.35	476	1413	9.80	822 ^c	2293
7.11	168	411	10.78	258 ^c	869

^aThese values are from all of the samples (54 sets) where pH differences and/or negative "removal" was noted.

^bInfluent and effluent samples were taken during the same time period.

^cProlonged holding time probably explained the apparent negative removal.

SECTION V

LABORATORY STUDY OF PROCESSES FOR HIGHER LEVELS OF SOLUBLE BOD₅ REMOVAL

We approached the problems of improving pulp and paper mill liquid waste treatment by two differing routes. A first route studied possibilities for improving the methods for conventional, out-plant primary clarification treatment of the total mill discharge. The second, a more innovative route, was directed to the principle of separation of flows, particularly spills of strong process water, and was also directed to individual, high-efficiency treatments, preferably within the plant, for those flows detrimental to clarifier performance.

Various treatment methods, such as sedimentation, flotation, filtration, membrane separation (reverse osmosis, ultrafiltration), carbon adsorption, and ion exchange could be used. The results of some of these methods are described in this section.

New and relatively more expensive methods of processing would be feasible for only parts of the total flow in order to prevent buildup of solubles in streams, especially those being recycled. These fractions could be treated in-plant in small, highly efficient systems or, if the streams are not to be recycled, they could be treated before they are mixed with other process waters entering the total sewer system.

However, since many of the mills involved in this study were already using clarifiers or had plans to use them, the laboratory study was carefully planned to develop a better understanding of the conventional, out-plant clarification process.

SCREENING TESTS

Following the survey of mill discharges and clarifier efficiencies (Section IV), a study to optimize the removal of soluble BOD₅ from both total mill waste waters and individual streams was begun in the laboratory.

We preferred to evaluate clarification efficiency by some means other than the BOD₅ test because the 5-10 days time to run each test, depending upon the day of the week that the samples were prepared, made systematic laboratory studies very difficult. Also, we wanted a procedure based on small sample volume.

TEST TUBE TRIALS

We had developed in our laboratory a simple test tube flocculation test using a 15-ml sample in an 18 x 150 mm test tube mounted on a 12-inch diameter, vertically oriented, platform rotating at 3 rpm (unpublished). The

slow transfer of fluid from one end of the tube to the other produced a floc form and supernatant clarity that correlated well with jar tests with the same sample/flocculant combination. This simple, small-volume system was used in the early part of the work for screening the incoming samples.

JAR TESTS

At the same time, jar tests were carried out on the same waste material using a Phipps and Bird laboratory flocculator. Various flocculating agents, alone or in combination, were added under carefully standardized conditions of chemical addition, rapid mixing, flocculation mixing, settling and sampling. Briefly, these can be described as:

1. The treatment of 1.0 or 1.5 liters of waste in 3-liter jars;
2. The addition of the primary flocculant, followed by one minute of mixing at 100 rpm;
3. If a second agent (e.g., polymer, silica, activated carbon, etc.) was added, it was followed by a second rapid mix of one-half minute at 100 rpm;
4. The paddle speed was reduced to 20 rpm for 20 minutes to provide time for flocculation. The flocculation step was done after the final addition of chemical, no matter how many additives were involved;
5. At the end of the flocculation period, the jar was removed from the unit and the sample allowed to settle for one hour;
6. Samples were withdrawn into 250-ml bottles under slight vacuum, with the tip of the sample tube one-half inch under the surface of the liquid in the jar;
7. An untreated jar of the waste was carried through the entire test from rapid mix to sampling. All "removal" data are based on the comparison of the analyses of the control sample with the treated samples.

All samples were stored at 4°C (40°F) prior to analysis.

ORGANIC CARBON ANALYSIS

Use of a Beckman Process Carbonaceous Analyzer permitted relatively rapid (15 samples per day), small-volume analysis of solutions for total organic carbon (TOC). The test tube trials, after the floc was removed with the 0.45- μ m filter, provided sufficient sample for the determination of soluble organic carbon. The use of larger test tubes (25 x 250 mm) and additional sample volume on the same flocculator table, or jar tests directly, allowed determination of both total and soluble BOD₅ and TOC, and soluble organic carbon (OC) on the same sample.

We found little correlation between the reduction of soluble organic carbon and the reduction of soluble BOD₅ for a series of flocculation studies (Table 9). We also found no relationship of COD to BOD₅ during the mill survey; these results are probably due to the high ratio of nonbiodegradable to biodegradable carbon in these waste streams. Total and soluble organic carbon and BOD₅ components removed during flocculation would be both degradable

and nondegradable substances, with the percentage removal of degradable being overshadowed by nondegradables. While the polymers did have both biochemical and chemical oxygen demands (Table 10), the amounts added to the solutions were so small (1 to 10 mg/liter) that they did not contribute significantly to COD or BOD₅. The addition of the polymer at the 10 mg/liter level would add less than 2 percent COD and 1 percent BOD₅ to most samples if all of the polymer remained in solution and none was removed by flocculation and/or filtration.

TABLE 9. SCREENING TRIALS OF FLOCCULANTS AND POLYMERS BY ANALYSIS OF SOLUBLE ORGANIC CARBON AND SOLUBLE BOD₅

Flocculant		Polymer (0.5 mg/l)	Reduction ^a , %	
Type	mg/l		Soluble OC	Soluble BOD ₅
Alum	200	None	18.2	-9.7
Alum	200	Nalco 607	34.3	-20.9
	250	Nalco 627	26.5	8.1
	250	Nalco 634	15.7	5.4
	250	Nalco 73C32	6.0	0
FeCl ₃	100 ^b	None	20.7	20.3
	150	None	17.4	-20.5
	200	None	25.4	21.2
	200	Nalco 607	21.3	16.8
	200	Nalco 609	23.1	20.7
	200	Nalco 627	-7.4	15.7
	250	None	20.5	19.7
Lime	25	None	1.8	-1.9
	25	Nalco 634	-6.2	8.4
	25	Nalco 73C32	2.3	0

^aValues on "as received" samples:

Soluble OC = 125-425 mg/l.

Soluble BOD₅ = 100-200 mg/l.

^bAs Fe³⁺.

TABLE 10. COD AND BOD₅ OF VARIOUS POLYMERS
USED AS FLOCCULATION AIDS^a

Manufacturer	Soluble COD, mg/l	Soluble BOD ₅ , mg/l
Nalco		
607	231	0
609	740	14
634	333	0
73C32	402	0
Dow		
PAA	1544	214
Tydex 12	1665	0
Hercules		
Hercofloc 812.3	--	66

^aPolymer concentration 1 g/l.

PHENOL SULFURIC ACID TEST

The phenol-sulfuric acid test (7) is a rapid method for the estimation of carbohydrates, including virtually all classes of sugars, sugar derivatives, oligo- and polysaccharides, ketoses, aldoses and aldehydes. This method has been used for several years in these laboratories for monitoring gel chromatographic columns and for the study of aldehydes in solution, both carbohydrates and noncarbohydrates (8).

Although the method appeared to be useful for measuring the removal of soluble BOD₅ during trials in the test tubes (Table 11), it did not give reproducible results in the jar tests; therefore, it was not useful as a replacement for the BOD₅ test (Table 12).

ZETA POTENTIAL

"If the zeta potential of the colloid is lowered below a critical value, the colloids tend to coalesce, resulting in coagulation" (9). Many of the "soluble" BOD₅ components in the waste stream are colloids, medium and low molecular weight organics, and in some cases simpler carbonaceous compounds, which should be amenable to colloidal coagulation and coprecipitation (10). Zeta potential changes and final values were compared with the removal of COD and BOD₅ components by flocculation (Table 13). No correlation could be drawn between the zeta potential and the reduction of either COD or BOD₅ for the waste stream after flocculation and filtration. There was, however, the expected correlation of near zero zeta potentials with good floc formation and supernatant clarity.

TABLE 11. COMPARISON OF PHENOL SULFURIC ACID TEST WITH BOD₅ TEST TO EVALUATE FLOCCULANTS IN TEST TUBE TESTS

Flocculant		Polymer (1 mg/l)	Reduction, ^a %	
Type	mg/l		Soluble glucose equivalent	Soluble BOD ₅
FeCl ₃	50 ^b	None	28.9	22.8
	100	None	45.6	32.1
	150	None	50.0	36.2
	200	None	46.7	33.9
Lime	250	None	17.7	5.0
	300	None	6.3	18.4
	300	Nalco 609	25.6	16.4
	300	Nalco 627	40.5	12.9
	300	Nalco 634	40.5	25.9
	300	Nalco 73C32	20.0	12.9
	300	Dow PAA	39.1	23.2
	300	Dow Tydex 12	32.6	31.7
	400	None	28.1	7.1

^aValues "as received":

Soluble glucose equivalent = 216 mg/l.

Soluble BOD₅ = 200 mg/l.

^bAs Fe³⁺.

As the study progressed we found little relation of the visual clarity of the supernatant or the rate of floc settling with the reduction of BOD₅. A finely divided floc seemed to result in the greatest reduction in soluble BOD₅ after filtration with the 0.45-μm filter, whether or not the floc had settled.

JAR TESTS FOR OPTIMIZING BOD₅ REMOVAL BY CLARIFICATION

General

Following the lack of success in developing a rapid screening test to correlate flocculation with the removal of soluble BOD₅, a number of jar tests were made with several mill effluents. We used the standard BOD₅ analysis to test these flocculants. While this resulted in a rather delayed evaluation, it could be used for: (1) a study of many flocculating agents and variables or (2) careful consideration and selection of both flocculants and process variables, with BOD₅ determinations on either (a) all samples or (b) selected samples from each series. With frequent reevaluation of the procedure as BOD₅ results became available, the (2b) scheme was selected for the majority of the jar tests.

TABLE 12. COMPARISON OF PHENOL SULFURIC ACID TEST WITH
BOD₅ TEST TO EVALUATE FLOCCULANTS
IN JAR TESTS

Flocculant		pH	Reduction ^a , %		
Manufacturer	mg/l		Soluble glucose equivalent	Soluble BOD ₅	Soluble COD
Nalco					
607	6.0	7.5	-1.5	2.6	-1.8
609	6.0	3.0	12.0	11.3	10.2
	6.0	7.5	11.5	6.8	7.2
	10.0	7.5	16.5	9.8	7.2
627	6.0	3.0	4.5	8.4	5.9
634	6.0	7.5	7.3	6.8	2.7
	10.0	7.5	15.3	10.0	16.6
73C32	6.0	7.5	7.3	-2.1	1.8
	10.0	7.5	11.5	23.8	5.4
Dow					
PAA	6.0	7.5	15.3	2.1	8.6
	10.0	7.5	15.3	12.8	9.3
	20.0	5.0	10.8	-1.7	4.2
Tydex 12	6.0	3.0	3.2	4.6	1.3
	6.0	5.0	-1.2	-24.8	3.3
	6.0	7.5	7.3	8.1	3.8
	10.0	7.5	14.2	5.1	6.8

^aValues "as received":

Soluble glucose equivalent = 250 mg/l.

Soluble COD = 550 mg/l.

Soluble BOD₅ = 220 mg/l.

TABLE 13. A COMPARISON OF ZETA POTENTIAL, SOLUBLE COD AND BOD₅,
AND FLOC FORM IN JAR TESTS OF FLOCCULANTS

Flocculant		Effluent ^a	pH	Zeta potential, mv	Reduction ^b , %		Floc ^c form
Type	mg/l				Soluble COD	Soluble BOD ₅	
Alum	200	A	--	-9.3	2.1	0.0	--
	395	B	--	0	17.3	-1.5	4+
	632	B	--	0	12.2	3.6	4+
Fe ³⁺	50	C	--	0 to -24.5	16.8	5.3	--
	75	C	--	0	23.2	11.9	--
	84	B	3.0	0	30.5	21.9	4+
	84	B	5.0	-17.8	33.3	17.2	3+
	200	A	3.0	0	45.3	51.0	--
Lime	200	A	11.6	-20.2	4.0	5.8	--

^aA = special sample of beaten sulfite pulp.

B = total mill effluent (Mill F).

C = digester room effluent (Mill F).

^bValues for "as recieved":

A - soluble COD = 462 mg/l.
soluble BOD₅ = 128 mg/l.

B - soluble COD = 453 mg/l.
soluble BOD₅ = 190 mg/l.

C - soluble COD = 1284 mg/l.
soluble BOD₅ = 585 mg/l.

^cFloc form - 0 = supernatant clarity equal to untreated control.
5+ = clear supernatant without suspended solids.

To reduce the problem involved in setting up sampling schedules, sample transportation and storage, it was further decided to select mills by two criteria: (1) their proximity to our Appleton laboratories and (2) those having high soluble BOD₅ values in the initial survey. Others could be added, as time permitted, to allow studies of special effluents, of effluents with lower soluble BOD₅, or of effluents from more distant mills.

TOTAL MILL EFFLUENTS WITH PRIMARY FLOCCULANTS

Tables 14, 15 and 16 summarize the large volumes of data gathered from jar tests with effluents from Mills A, D, and F, which are using conventional clarifiers or flotation systems. These data can be summarized as follows:

1. Ferric chloride in the range of 75-150 mg/l Fe^{3+} was the best flocculating agent for these waste streams. The optimum pH was dependent upon the particular stream being processed and the concentration of the iron salt added.
2. Lime, at higher concentrations (200-500 mg/l) also removed soluble BOD_5 (21-40 percent).
3. Alum did not remove more than 17 percent of the soluble BOD_5 , although there was evidence that, with some of the waste streams, careful pH control and optimized alum concentrations could result in the removal of substantial quantities of soluble BOD_5 .
4. The polymers plus bentonite or Celite to provide high surface area did not appear any more effective than the cheaper iron salts.
5. Some trials had shown that considerable amounts (22 percent) of soluble BOD_5 could be removed from the clarifier effluents with ferric chloride or lime (Table 14).
6. When the concentration of the flocculating agent and the pH are carefully controlled, from 25 to 50 percent of the soluble BOD_5 would probably be removed from the clarifier influents.
7. In recent similar studies in Finland (11), fly ash obtained from the burning of calcium-base spent liquor was used as a flocculating agent, it was used to raise the pH during alum treatment, and it was used as a sludge conditioner. Reductions of 50 percent for BOD_5 and 70 percent for COD are reported in the treatment of kraft effluents. The authors also report that the sludge is easier to handle.

ADDITION OF ACTIVATED CARBON

Studying pilot-scale columns of activated carbon processing a chemimechanical (CM) pulping waste, we found that 83-90 percent of the total BOD_5 was removed (12). We have no information, however, on the degree of soluble BOD_5 removed by adsorption on activated carbon. Therefore, we used jar tests to measure the reduction in soluble BOD_5 by powdered (300 mesh) activated carbon, with and without the addition of cationic polyelectrolytes, for the treatment of the total mill effluent (Table 17) and CM sewer discharge from Mill F (Table 18).

Soluble BOD_5 could be reduced by 32 percent in the total mill effluent and 17 percent in the CM streams. The variability of the results for the various levels of activated carbon was quite high. This was most likely due to changing conditions in the mill — high hourly variations in the flow and concentration of substances in these streams — rather than to differences in the effects of the activated carbon and polymers.

TABLE 14. JAR TESTS OF PRIMARY FLOCCULANTS WITH MILL A AND
MILL D INFLUENTS AND EFFLUENTS^a

Flocculant Type	mg/l	Final pH	Mill A influent		Mill A influent		Mill A effluent		Mill D influent	
			No additive COD = 1200 mg/l BOD ₅ = 238 mg/l	Reduction, % COD BOD ₅	2 mg/l COD = 1178 mg/l BOD ₅ = 228 mg/l	Reduction, % COD BOD ₅	2 mg/l Gendriv 162 COD = 1126 mg/l BOD ₅ = 238 mg/l	Reduction, % COD BOD ₅	No additive COD = 843 mg/l BOD ₅ = 292 mg/l	Reduction, % COD BOD ₅
None	pH study	3.6	--	--	0	0	0.4	0	3.3	--
		3.8	--	--	0	0	0.9	0	0	--
		4.0	--	--	0	3.9	2.1	0	2.0	1.4
		4.2	--	--	0.1	0	0.9	0	0	-1.4
		4.4	--	--	0	0	0.9	0	1.1	1.4
		4.6	--	--	0	0	0.4	0	3.6	2.4
Fe ³⁺	70 ^b	3.6	31.8	14.3	23.6	21.0	22.9	22.3	22.4	--
		3.8	31.6	13.4	26.4	25.5	23.4	21.8	21.9	--
		4.0	23.8	10.1	27.5	13.2	24.1	10.9	22.2	-1.4
		4.2	23.3	11.3	27.2	3.7	26.8	12.7	21.7	14.0
		4.4	22.9	11.8	26.8	19.3	24.2	15.9	21.9	21.2
		4.6	23.3	8.4	26.4	13.9	6.5	20.9	23.2	13.4
		10.0	7.8	17.2	--	--	23.0	13.2	25.1	--
Lime		50	--	--	1.8	--	0.3	5.4	2.8	4.4
		50	--	--	--	--	--	--	--	--
		50	--	--	--	--	--	--	--	--
		100	2.8	13.4	1.3	--	0.3	1.8	--	--
		100	--	--	--	--	--	--	3.6	-1.4
		200	--	--	--	--	4.3	5.4	--	--
		200	4.9	11.8	4.8	--	--	--	9.0	-2.7
		200	--	--	--	--	--	--	--	--
		300	--	--	--	--	8.2	2.7	--	--
		400	22.0	15.5	22.4	--	19.2	3.6	--	--
		400	--	--	--	--	--	--	16.7	-4.5
		500	24.6	18.1	25.8	--	24.6	1.4	--	--
		500	--	--	--	--	--	--	18.0	15.4

^aSoluble COD and BOD₅ were measured.

^bAs FeCl₃.

TABLE 15. JAR TESTS OF PRIMARY FLOCCULANTS WITH MILL F
TOTAL CLARIFIER INFLUENT^a

		Sample 8/13			Sample 8/21		Sample 9/10	
		COD = 508 mg/l			COD = 209 mg/l		COD = 440 mg/l	
		BOD ₅ = 223 mg/l			BOD ₅ = 102 mg/l		BOD ₅ = 194 mg/l	
Flocculant		Reduction, %		Reduction, %		Reduction, %		
Type	mg/l	Final pH	COD	BOD ₅	COD	BOD ₅	COD	BOD ₅
Lime	50	8.8	-7.2	-10.2	-3.8	0	--	--
	100	9.2	0	-10.2	-1.9	0	--	--
	200	10.6	7.2	-1.6	10.0	21.4	--	--
	800	11.4	11.8	3.7	14.8	18.4	--	--
	400	11.6	12.9	15.5	17.1	36.7	--	--
	500	11.7	--	--	20.0	40.0	--	--
Bentonite	50	--	5.1	1.4	--	--	--	--
	100	--	7.6	1.0	--	--	--	--
	150	--	6.5	-3.6	--	--	--	--
	200	--	7.6	-1.4	--	--	--	--
Fe ³⁺ (as FeCl ₃)	12.5	6.8	--	--	5.4	1.4	--	--
	25	6.5	--	--	8.9	1.4	--	--
	28 ^b	2.7	--	--	--	--	12.9	7.5
	50 ^b	5.7	--	--	19.8	7.2	--	--
	70 ^b	5.2	--	--	--	--	31.3	5.2
	70 ^b	4.6	--	--	--	--	35.8	24.0
	70 ^b	4.1	--	--	--	--	34.8	22.4
	70 ^b	8.6	--	--	--	--	33.7	8.8
	70 ^b	3.5	--	--	--	--	28.0	6.2
	84 ^b	5.1	--	--	--	--	33.3	12.2
	84 ^b	4.2	--	--	--	--	33.7	18.8
	84 ^b	3.2	--	--	--	--	30.5	21.9
	100 ^b	3.3	--	--	15.8	8.7	--	--
	112 ^b	6.0	--	--	--	--	32.4	17.5
	112 ^b	3.8	--	--	--	--	30.7	11.3
	150	2.9	--	--	13.9	10.1	--	--
	200	2.7	--	--	15.8	18.8	--	--
Alum	25	--	--	--	9.0	-1.0	--	--
	50	--	--	--	4.3	4.9	--	--
	100	--	--	--	3.8	3.9	--	--
	150	--	--	--	5.2	2.0	--	--
	158 ^b	3.5	--	--	--	--	8.2	3.0
	200	--	--	--	10.0	2.0	--	--
	250 ^b	--	--	--	10.0	2.0	--	--
	385 ^b	8.9	--	--	--	--	8.7	-5.2
	385 ^b	6.8	--	--	--	--	19.2	-24.2
	385 ^b	6.2	--	--	--	--	21.9	12.0
	385 ^b	5.3	--	--	--	--	21.9	-18.3
	385 ^b	4.6	--	--	--	--	23.9	16.7
	385 ^b	4.3	--	--	--	--	19.2	11.4
	385 ^b	3.9	--	--	--	--	11.9	7.3
	632 ^b	10.6	--	--	--	--	12.2	3.6
	632 ^b	6.9	--	--	--	--	17.8	-2.1

^aSoluble COD and BOD₅ were measured.

^bAdded on molar basis of Fe³⁺ and Al³⁺ (0.5, 1.25, 2.0 millimolar).

TABLE 16. JAR TESTS OF POLYMERS AND ADDITIVES WITH
MILL F TOTAL CLARIFIER INFLUENT^a

					Sample 7/31		Sample 8/13	
					COD = 552 mg/l		COD = 508 mg/l	
					BOD ₅ = 234 mg/l		BOD ₅ = 223 mg/l	
Flocculant		Additive ^b		Final pH	Reduction, %		Reduction, %	
Manufacturer	mg/l	Type	mg/l		COD	BOD ₅	COD	BOD ₅
Nalco								
607	1.0	Bentonite	200	--	--	--	8.2	11.9
607	1.0	A/C	200	--	--	--	7.0	-4.6
607	6.0	None	--	7.5	-1.8	2.6	--	--
609	1.0	Bentonite	200	--	--	--	9.4	3.2
609	1.0	A/C	200	--	--	--	8.2	18.7
609	6.0	None	--	7.5	6.8	7.2	--	--
609	6.0	None	--	3.0	10.2	11.3	--	--
609	10.0	None	--	7.5	7.2	9.8	--	--
627	1.0	Bentonite	200	--	--	--	9.2	1.8
627	1.0	A/C	200	--	--	--	9.6	16.9
627	6.0	None	--	3.0	5.9	8.4	--	--
634	1.0	Bentonite	200	--	--	--	8.0	-1.4
634	1.0	A/C	200	--	--	--	5.1	1.4
634	6.0	None	--	7.5	2.7	6.8	--	--
634	10.0	None	--	7.5	10.0	16.6	6.7	23.8
73C32	1.0	Bentonite	200	--	--	--	7.4	9.1
73C32	1.0	A/C	200	--	--	--	8.0	19.6
73C32	6.0	None	--	7.5	1.8	-2.1	--	--
73C32	10.0	None	--	7.5	5.4	23.8	6.1	29.4
73C32	10.0	Celite	200	7.5	--	--	3.0	21.2
Dow								
Tydex 12	1.0	Bentonite	200	--	--	--	12.4	-1.4
Tydex 12	1.0	A/C	200	--	--	--	9.0	20.5
Tydex 12	6.0	None	--	7.5	3.8	8.1	--	--
Tydex 12	6.0	None	--	5.0	3.3	-24.8	--	--
Tydex 12	6.0	None	--	3.0	1.3	4.6	--	--
Tydex 12	10.0	None	--	7.5	6.8	5.1	--	--
PAA	1.0	Bentonite	200	--	--	--	14.7	-4.5
PAA	1.0	A/C	200	--	--	--	8.6	-11.4
PAA	6.0	None	--	7.5	8.6	2.1	--	--
PAA	10.0	None	--	7.5	9.3	12.8	6.3	21.8
PAA	10.0	Celite	200	--	--	--	7.4	14.2
PAA	20.0	None	--	5.0	4.2	-1.7	--	--

^aSoluble COD and BOD₅ were measured.

^bA/C = activated carbon (Filtrisorb 300, powdered).

TABLE 17. JAR TESTS OF THE EFFECT OF ACTIVATED CARBON
AND VARIOUS ADDITIVES ON SOLUBLE COD AND BOD₅
IN MILL F CLARIFIER INFLUENT

Activated carbon				Sample 8/13			Sample 8/21		Sample 9/10	
				COD = 508 mg/l			COD = 209 mg/l		COD = 426 mg/l	
				BOD ₅ = 223 mg/l			BOD ₅ = 102 mg/l		BOD ₅ = 196 mg/l	
Type ^a	mg/l	Additives		Final pH	Reduction, %		Reduction, %		Reduction, %	
		Type	mg/l		COD	BOD ₅	COD	BOD ₅	COD	BOD ₅
(1)	50	None	--	7.4	6.1	19.2	4.1	3.4	--	--
	100	None	--	7.5	5.7	8.7	6.9	--	--	--
	150	None	--	7.5	5.9	12.3	--	--	--	--
	200	None	--	7.4	5.7	-5.5	13.4	11.5	3.5	2.0
	200	Nalco 73C32	1.0	7.5	8.0	19.6	--	--	6.3	23.5
	200	Dow Tydex	1.0	7.4	9.0	20.5	--	--	5.2	6.1
	200	Cellulose	500	--	--	--	--	--	5.2	12.2
	200	Nalco 609	1.0	7.9	8.2	18.7	--	--	--	--
	200	Nalco 627	1.0	7.9	9.6	16.9	--	--	--	--
	200	Nalco 634	1.0	7.8	5.1	1.4	--	--	--	--
	200	Dow PAA	1.0	7.9	8.6	--	--	--	--	--
(2)	50	None	--	--	--	--	14.7	17.0	--	--
	100	None	--	--	--	--	17.4	7.5	--	--
	200	None	--	--	--	--	11.9	27.4	--	--
	200	Nalco 73C32	1.0	--	--	--	--	--	16.4	12.2
	200	Dow Tydex	1.0	--	--	--	--	--	7.5	9.2
	200	Cellulose	500	--	--	--	--	--	8.0	11.2
	200	Cellulose	500	--	--	--	--	--	4.0	19.4
		+ Tydex	1.0	--	--	--	--	--	--	--
	200	Cellulose	500	--	--	--	--	--	5.2	14.3
		+ 73C32	1.0	--	--	--	--	--	--	--
	300	None	--	--	--	--	17.9	13.2	--	--
	400	None	--	--	--	--	17.9	32.1	--	--

^a(1) Filtrasorb 300, powdered.

(2) Same alcohol and water washed (oven dried).

In all of the jar tests the samples were first screened through a 60-mesh stainless steel screen, the activated carbon (and polymers, if used) was added, and the sample was processed through the mixing and settling cycles.

No attempt was made to correlate the degree of soluble BOD₅ removal with the presence of fiber fines or other carbonaceous adsorbing materials.

Although the activated carbon-soluble BOD₅ complex could be readily filtered by a 0.45- μ m filter, it did not settle in the jars with or without the use of polymer flocculants. Activated carbon, therefore, seems useful as an additive to the primary system for the reduction of BOD₅ if the carbon could be removed in either the primary or secondary system. Larger carbon particles might be easier to remove; however, they would have less surface area and, therefore, probably be less sorptive.

EFFECT OF THE CONCENTRATION OF THE EFFLUENT

If the total water use in the mill were reduced through recycling, the wastes would be more concentrated. In order to study the flocculation and soluble BOD₅ removal characteristics of such wastes we concentrated by reverse osmosis a sample of the total mill effluent (clarifier influent) from

the Mosinee mill. We have been evaluating and developing uses for reverse osmosis (RO) in our laboratories since 1964 (13). This process can concentrate solutions and at the same time remove some of the soluble BOD₅.

TABLE 18. JAR TESTS OF THE EFFECT OF ACTIVATED CARBON AND ADDITIVES ON COD AND BOD₅ OF MILL F CHEMIMECHANICAL PULPING EFFLUENT^a

Carbon, ^b mg/l	Additive		Reduction, %		Final pH
	Type	mg/l	COD	BOD ₅	
50	None	--	2.5	15.9	7.4
100	None	--	3.4	--	7.5
125	None	--	5.9	11.6	7.6
150	None	--	4.5	5.2	7.7
200	None	--	5.2	12.0	7.5
200	Nalco 634	10.0	4.3	2.0	7.5
200	Nalco 73C32	10.0	5.9	13.1	7.5
200	Dow Tydex 12	10.0	10.0	9.0	7.5
200	Dow PAA	10.0	10.5	16.8	7.5
300	None	--	10.2	9.8	7.5
None	Nalco 634	10.0	-1.0	-1.5	7.4
None	Nalco 73C32	10.0	1.0	5.9	7.4
None	Dow PAA	10.0	-4.1	-5.1	7.6


^aSoluble COD and BOD₅ were measured.

Initial values: Soluble COD = 1105 mg/l
Soluble BOD₅ = 490 mg/l.

^bActivated carbon - Filtrasorb 300, powdered, alcohol/water washed, oven dried.

Reverse osmosis was used to make a fourfold v/v concentrate of the total mill effluent. This solution was diluted with the permeate (fluid passing through the RO membrane during the concentration process) to prepare 3:1, 2:1, and 1:1 concentrations. Jar tests were made with all concentrations, and the samples were analyzed for suspended solids, total and soluble BOD₅, and color before and after treatment with ferric chloride-polymer and alum-polymer combinations (Figure 6).

These data indicate that treatment with ferric chloride at 100 mg Fe³⁺ per liter and Hercofloc 812.3 at 0.75 mg per liter could produce an acceptable effluent for discharge, in terms of suspended solids and BOD₅, up to concentration of approximately 3:1 and reduce both hydraulic and gravimetric loads.

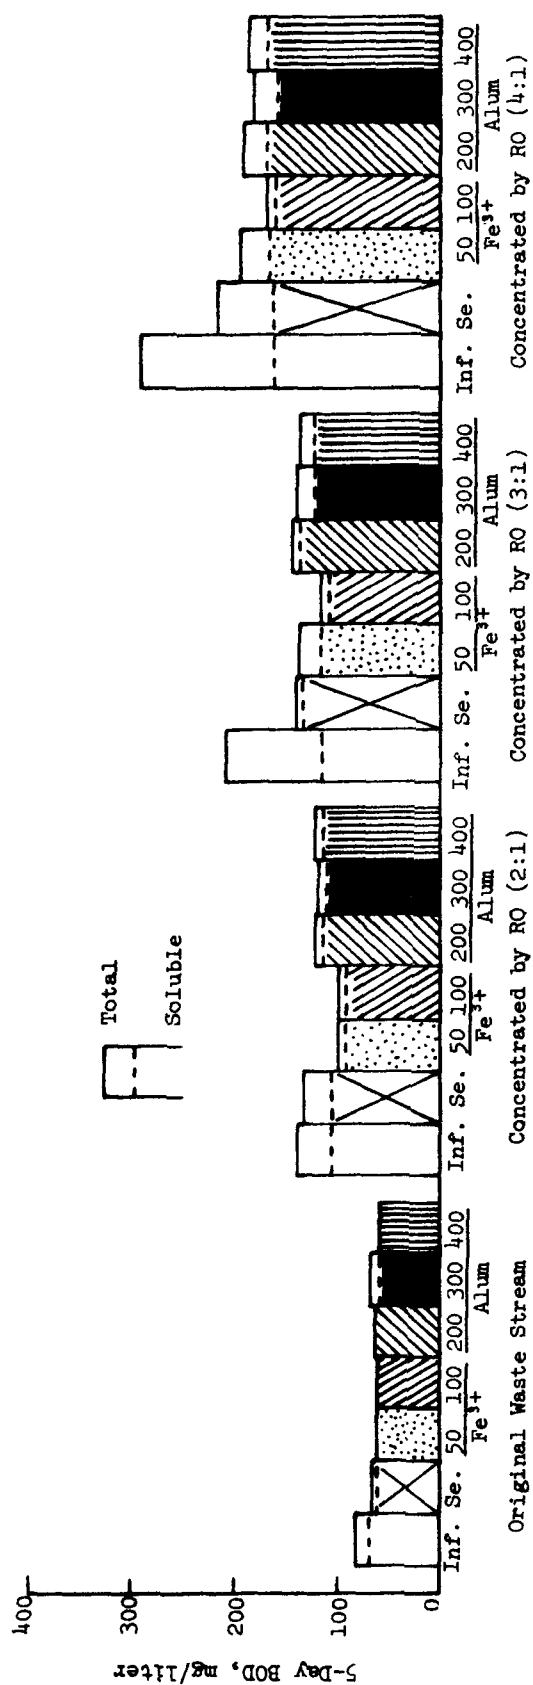

Inf. = Influent without treatment
 Se. = Influent settled without addition of chemicals
 Fe³⁺ = Influent with 50-100 mg ferric ion added (as FeCl₃) per liter
 Alum = Influent with 200-400 mg alum added per liter

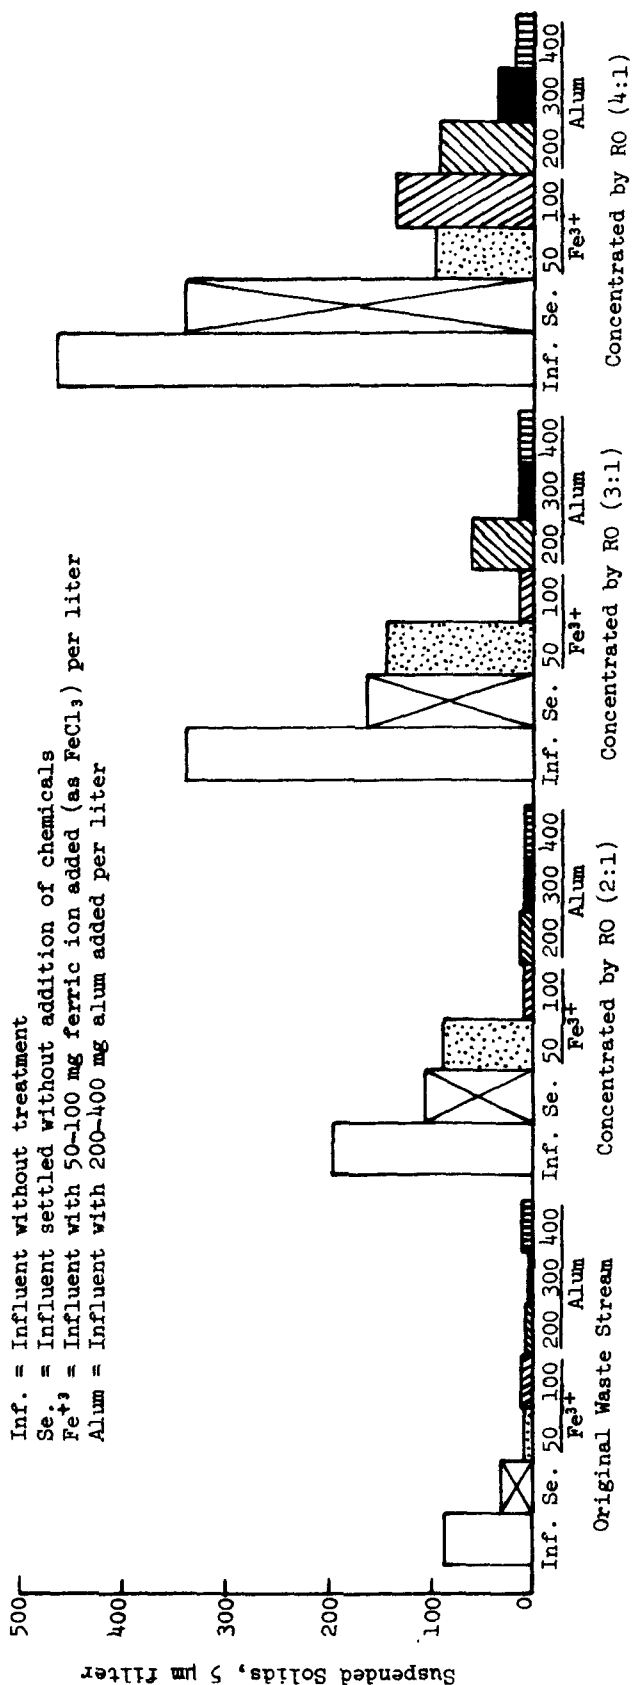


Figure 6. Suspended solids and BODs in various concentrations of influents treated with Fe³⁺ or alum.

With effluents more concentrated than 3:1, flocculating agents did not produce adequate effluents.

While this was a rough study and practical means of processing were not worked out — we did not study spill control, the effect of spills on water reuse within the mill, or economics — it certainly indicates that wastes can be successfully treated at higher concentrations.

JAR TESTS ON WASTE STREAMS PRIOR TO PILOT SCALE TRIALS

Mosinee Paper Company of Mosinee, Wisconsin and the Combined Locks mill of Appleton Papers Division of NCR, Combined Locks, Wisconsin were selected for the two pilot-scale clarifier trials. Jar tests were made on the total mill effluents. These preliminary tests were followed periodically by other jar tests while the field trials were in progress.

Tests on Mosinee Paper Company Effluent

Samples from these jar tests were, in some cases, analyzed completely for suspended solids, total and soluble BOD₅, organic carbon, COD and color (Tables 19 and 20) in order to measure the removals that might be attained under different conditions of treatment. Others were merely used to establish flocculating characteristics (Table 21) and/or sludge volumes that would develop with the addition of the chemical combinations.

In the early trials we established that alum at 200-300 mg/l and ferric chloride at 100 mg/l Fe³⁺ could be used in jar tests to remove BOD₅ — 35-55 percent (total) and 12-25 percent (soluble) — from the wastes. The addition of 0.75 mg/l Hercofloc 812.3 appeared to provide additional removal of soluble BOD₅: removal increased from 13 to 35 percent when Hercofloc was added with 100 mg/l alum, and from 12 to 28 percent with 200 mg/l alum (Table 19). The use of the Hercofloc polymer alone at 0.75 and 1.5 mg/l markedly increased the removal of soluble BOD₅: we found 14 and 21 percent removal, respectively.

Lime as a primary flocculating agent and activated silica as an additive (Table 20) appeared to be relatively effective (4-16 percent) in the removal of soluble BOD₅ from the Mosinee mill effluent.

Of great interest in these studies was the high removal of COD, color, and total and soluble BOD₅ that could be achieved with ferric chloride and alum from the clarifier effluent from this mill (Table 22). Twenty-five to forty percent removal of the soluble BOD₅ components was obtained with these primary flocculants added to either the north or south clarifier effluents. Lime and "additional" Hercofloc 812.3 did not enhance the removal of the "solubles" but did increase the removal of total BOD₅, COD and color.

Adjustment of the pH from the initial 11, or higher, to 8 with sulfuric acid prior to the addition of the chemicals, markedly increased the amount of suspended solids removed. This only slightly affected the amount of soluble BOD₅ remaining in solution (Table 23). The ferric ion was equally effective as the chloride or sulfate salt when they were used at the same concentration

TABLE 19. JAR TESTS OF THE EFFECT OF FLOCCULANTS ON BOD₅,
COD, ORGANIC CARBON, AND COLOR IN
MOSINEE CLARIFIER INFLUENT^a

Flocculant		Final pH	% Reduction in				Total color ^c
Type	mg/l		Total		Soluble ^b		
			BOD ₅	COD	OC	BOD ₅	
FeCl ₃	50 ^d	6.4	51	71	31	13	52
	100	6.0	37	70	44	25	43
	150	5.0	58	76	47	24	89
Alum	100	7.2	49	60	14	13	24
	200	7.0	56	68	24	12	43
	300	6.8	56	73	31	12	47
Lime	200	11.1	22	52	-13	-16	15
	300	11.6	39	68	-1	-14	58
	500	12.0	41	71	1	-9	11
Hercofloc							
812.3	0.75	8.4	18	8	3	14	0
	1.5	8.2	19	11	6	21	15
Hercofloc 812.3 at 0.75 mg/l was added after 1 min mixing with the following primary flocculant:							
FeCl ₃	10	7.0	No floc formation				
	25	6.8	No floc formation				
	50	6.4	56	72	30	30	47
Alum	50	7.4	No floc formation				
	100	7.2	54	76	14	35	18
	200	7.0	52	71	21	28	32

^aInitial control values for sample taken 11/21/74:

Total COD = 711 mg/l
BOD₅ = 215 mg/l
Color = 109 units.
Soluble OC = 87 mg/l
BOD₅ = 122 mg/l

^bFiltered through a 0.45 µm Metrical filter.

^cCo-Pt units at 465 nm (NCASI Method).

^dAs Fe³⁺.

TABLE 20. JAR TESTS OF FeCl_3 , ALUM, AND ADDITIVES AS FLOCCULANTS FOR MOSINEE CLARIFIER INFLUENT^a

Flocculant			Final pH	Reduction, %				
Primary, mg/l	Polymer, ^b mg/l	Total BOD ₅		COD	Soluble OC	BOD ₅	Color	
Analytical grade primary chemicals:								
FeCl ₃ 50 ^c	--	--	5.8	38	56	49	29	88
	Herc.	0.75	5.8	37	57	51	27	89
		1.5	5.8	38	58	51	27	90
Alum 50	--	--	7.4	11	-0.7	20	9	39
	Herc.	0.75	7.5	10	-0.7	21	15	47
		1.5	7.7	6	0.7	14	10	45
	Act.Si	10	7.7	5	4	24	4	40
	--	--	7.1	13	3	34	5	69
	Herc.	0.75	6.8	15	16	33	8	69
		1.5	7.1	10	3	34	16	72
	Act.Si	10	7.4	11	4	29	12	53
	--	--	7.4	23	54	42	8	86
200	Herc.	0.75	7.2	23	54	40	4	88
		1.5	7.0	21	47	39	4	87
	Act.Si	10	6.9	23	57	39	4	84
Commercial grade primary chemicals:								
FeCl ₃ 50 ^c	Herc.	0.75	5.5	32	50	--	28	--
Alum 100	Herc.	0.75	6.5	20	9	--	13	--

^aInitial values (for untreated influent control) for sample taken 12/12/74:

Total COD = 711 mg/l
 BOD₅ = 215 mg/l
 Color = 109 Pt-Co units
 Soluble OC = 87 mg/l
 BOD₅ = 122 mg/l.

^bHerc., Hercofloc 812.3; Act.Sci., activated silica.

^cAs Fe^{3+} .

of Fe^{3+} and when the pH of the influent was not above 9.0 (Figure 7). Sludge volumes, determined with separate jar tests and the Imhoff cone, were also markedly reduced by the addition of the Hercofloc 812.3 (Table 24) and for this reason it was included in all but one of the studies at this mill.

TABLE 21. JAR TESTS OF THE EFFECTS OF PRIMARY FLOCCULANTS AND POLYMERS ON pH AND CLARITY OF MOSINEE CLARIFIER INFLUENTS

Flocculant				Influent samples					
Primary, mg/l	Polymer, mg/l			1/16/75		3/5/75		3/11/75	
				pH	Clarity ^a	pH	Clarity ^a	pH	Clarity ^a
Fe^{3+}	25	--	--	--	--	--	--	6.8	0
	50	--	--	6.6	0	6.9	0	5.9	5
		Herc.	0.75	6.8	0	6.6	0	--	--
	100	--	--	5.0	0	5.7	4	4.2	4
		Herc.	0.75	5.6	3	5.6	4	4.3	4
	150	--	--	--	--	4.5	1	3.4	3
		Herc.	0.75	--	--	4.3	1	3.4	3
Alum ^b	100	--	--	--	--	9.0	0	--	--
		Herc.	0.75	--	--	8.6	0	--	--
	200	--	--	--	--	8.4	1	--	--
	300	--	--	--	--	7.2	4	--	--
Alum ^c	200	--	--	7.4	1	--	--	--	--
	300	--	--	7.1	5	--	--	--	--
	400	--	--	6.5	4	--	--	--	--
Alum ^d	200	--	--	7.0	1	--	--	--	--
	300	--	--	6.9	5	--	--	--	--
	400	--	--	6.5	4	--	--	--	--

^aClarity: 0 = untreated control

1-5 = partial to complete clearing of the supernatant after one hour settling.

^bAnalytical grade.

^cCommercial grade with precipitate in suspension.

^dCommercial grade decanted to remove the precipitate.

Tests on Combined Locks Mill Effluent

Since Mill F had been one of those in the preliminary jar test studies on the optimization of soluble BOD₅ removal, only a few additional tests were conducted prior to the pilot-scale field trials. Data from these tests (Table 25) substantiated the earlier findings (Tables 15 and 16) that ferric chloride, ferric sulfate and alum were all effective in removing total and soluble BOD₅ from this waste stream. We found, however, marked variations in the amounts of removal with the different concentrations and combinations of the flocculants used, apparently depending upon the amounts of spent cooking liquor in the mill effluent.

TABLE 22. JAR TESTS OF THE EFFECT OF FLOCCULANTS ON pH, BOD₅, COD, AND COLOR OF EFFLUENTS FROM MOSINEE CLARIFIERS^a

Flocculant		pH	Reduction, %			Soluble BOD ₅
Type	mg/l		BOD ₅	COD	Color	
From North Clarifier:						
FeCl ₃	50 ^b	5.1	61	72	65	39
	100	3.4	63	72	79	40
	150	3.0	64	68	85	38
Alum	100	6.0	43	56	42	26
	200	6.2	61	70	65	25
	300	6.2	61	70	68	26
Lime	200	9.9	25	32	28	-14
	300	11.1	33	48	42	-19
	500	11.6	41	55	42	0.8
Hercofloc						
812.3	0.75	8.8	12	4	7	-6
	1.5	8.6	15	11	4	3
From South Clarifier:						
FeCl ₃	50 ^b	5.7	63	68	46	38
	100	3.8	65	70	70	39
	150	3.1	59	64	75	38
Alum	100	6.9	No flocculation			
	200	6.5	60	64	27	31
	300	5.6	62	66	46	26
Lime	200	11.3	No flocculation			
	300	11.6	43	44	2	-13
	500	12.0	43	50	11	3
Hercofloc						
812.3	0.75		No flocculation			
	1.5					

^aInitial values (control) of samples taken 11/21/74:

Soluble BOD (mg/l) North=124 South=130

Total BOD (mg/l) North=214 South=240

COD (mg/l) North=628 South=612

Color (units) North=108 South=63.

^bAs Fe³⁺.

TABLE 23. EFFECT OF pH ON JAR TEST FLOCCULATION
OF MOSINEE CLARIFIER INFLUENT^a

Primary flocculant (mg/l)	Final pH	BOD ₅ reduction, %		Reduction in suspended solids, %	
		Total	Soluble		
Fe ³⁺	50	10.7	-3	-5	22
	100	10.3	-5	-3	55
	150	9.9	1	6	72
	200	9.4	--	8	50
Alum	200	10.8	-0.2	1	35
	300	10.6	-7	4	18
	400	10.4	4	12	2
	500	10.2	2	7	15
	600	10.1	2	5	30
Influent adjusted to pH 8 with sulfuric acid prior to jar test:					
Fe ³⁺	50	7.2	6	11	75
	100	6.8	6	4	72
Alum	200	7.5	-9	5	76
	300	7.3	-5	-7	84
	400	7.1	-8	20	80

^aInfluent sample of 2/11/75 had an initial pH of 11.2.

The effect of these spent liquors and other mill discharges on the overall efficiency of the clarifier is discussed in Section VII.

LABORATORY SURVEY OF SOURCES OF SOLUBLE BOD₅ IN MILL SYSTEMS

In a mill system with multiple sewers there are certain streams that carry the bulk of the BOD and COD. Some of the BOD and COD can be more easily removed from concentrated streams than from diluted waste, and some substances may alter the properties of others or interfere with their removal. Therefore, isolation and treatment of these more concentrated streams would be a logical way to improve the removal of BOD₅ by the clarifiers and thereby reduce the BOD₅ load on the out-plant treatment system. Importantly also, the degree of recycling of the process water could be substantially increased.

Separate Sewer Discharges

In our study samples from the separate sewer discharges were obtained from two of the mills and analyzed for various types of solids, for soluble and total BOD₅, as well as soluble and total COD components (Tables 26 and 27).

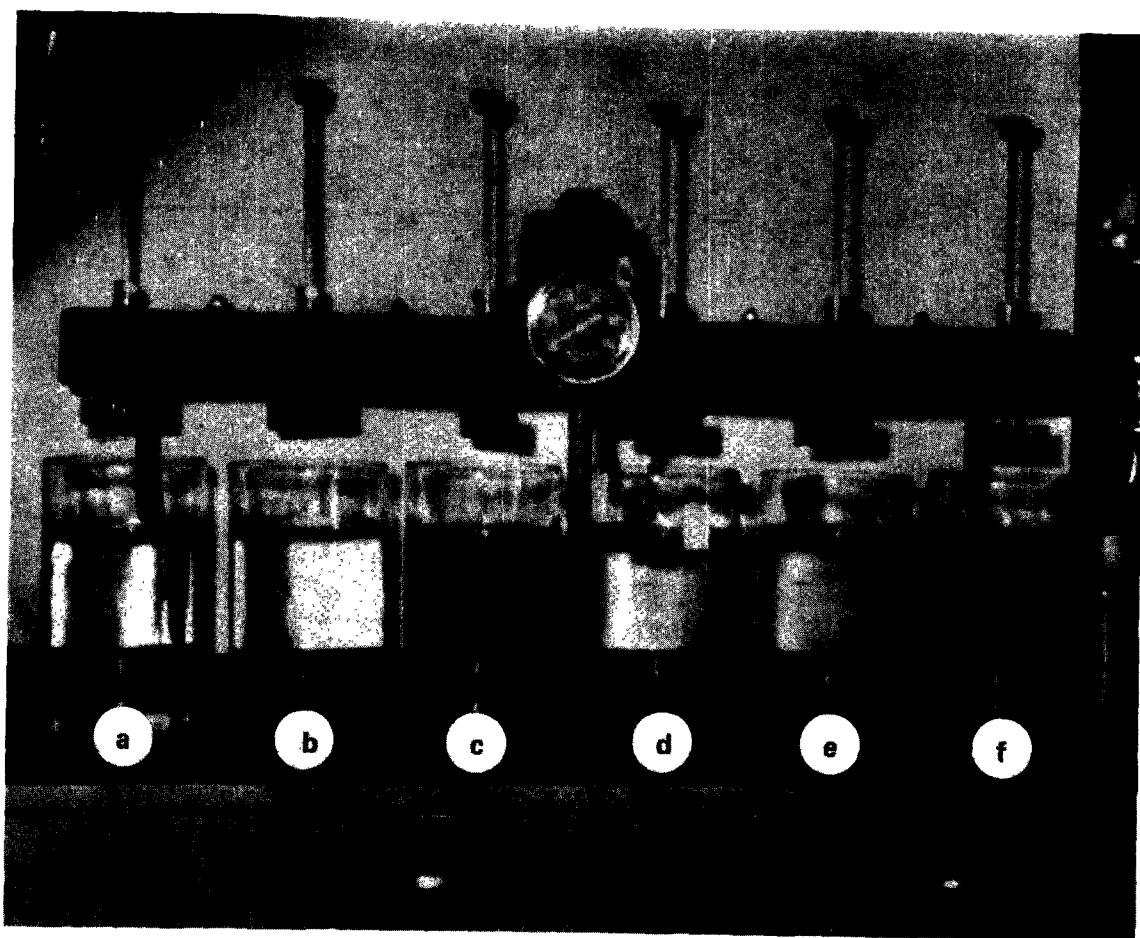


Figure 7. In jar tests with Mosinee mill effluent, pH 8.5, ferric chloride and ferric sulfate at 25 and 50 mg/l of Fe^{3+} (a), (b), (d), and (e), precipitated more solids than when they were used at a higher concentration, 100 mg/l of Fe^{3+} (c) and (f).

If one or more of the high BOD₅ streams (the discharges from the CM sewer in Mill F or the pulp mill, soda recovery or fifth stage brownstock washer sewers in Mill K) could be treated separately by flocculation, reverse osmosis, ultrafiltration or some other process, the overall efficiency of the treatment plant would increase, there would be less of a load on secondary facilities, and there would be a greater potential for water reuse (details discussed in Section VII).

Breakdown of Fibers

Another source of soluble BOD₅ was fibers: saccharides and other microbial nutrients are released during the beating of pulp or during the recycling of fibers in water recovery systems.

In order to study this release of soluble BOD₅, a beater test was arranged with a sample of unbleached sulfite pulp in a laboratory beater using

a conventional 1-1/2 pound (0.68 kg) test with 12 pounds (5.5 kg) on the bed-plate. One-liter samples were removed at half-hour intervals during the 90-minute test period and freeness, total solids, total and soluble BOD₅, and total and soluble COD were analyzed on each sample (Table 28).

TABLE 24. VOLUME OF SLUDGE FROM MOSINEE CLARIFIER INFLUENTS
TREATED WITH VARIOUS FLOCCULANTS AND POLYMER

Flocculant				Sludge volume, ml/l	Final pH	Clarity ^b 0-5
Primary, mg/l	Polymer, ^a mg/l					
Influent 12/21/74:						
Fe ³⁺	50	None	--	122	5.4	4
	50	Herc.	0.75	115	5.5	5
Alum	100	None	--	64	6.2	2
	100	Herc.	0.75	54	6.5	2
Influent 12/31/74:						
Fe ^{3+c}	50	None	--	92	6.3	4
	50	Herc.	0.75	80	6.2	5
Fe ^{3+d}	50	None	--	96	6.3	5
	50	Herc.	0.75	85	6.3	5
Influent 1/16/75:						
Fe ³⁺	50	None	--	36	6.6	0
	50	Herc.	0.75	30	6.8	0
	100	None	--	48	5.0	0
	100	Herc.	0.75	60	5.6	3
Alum	300	None	--	96	6.3	4
	300	Herc.	0.75	80	6.3	5

^aHerc., Hercofloc 812.3.

^bClarity: 0 = control (no apparent flocculation)
5 = clear supernatant.

^cAnalytical reagent grade of FeCl₃.

^dCommercial grade, 42°Be, of FeCl₃.

Soluble BOD₅ and soluble COD markedly increased as the beating progressed and the fibers were fibrillated, releasing materials which became microbial nutrients in the BOD₅ test.

We ran several flocculation tests on portions of the filtrate from a 90-minute beaten sample (D in Table 28). This sample was passed through a 0.45-μm filter to remove fibers and insoluble BOD₅ and COD components. Ferric chloride was again the best "single" flocculating agent (51 percent removal

TABLE 25. REMOVAL OF BOD₅ FROM EFFLUENTS OF COMBINED LOCKS
MILL BY FLOCCULANTS AND POLYMERS

Flocculant				Effluent 4/23 ^b		Effluent 4/24 ^c	
Primary, mg/l		Polymer, ^a mg/l		BOD ₅ removal, %		BOD ₅ removal, %	
				Total	Soluble	Total	Soluble
FeCl ₃ ^d	10	None	--	No flocculation		--	--
	25	None	--	No flocculation		--	--
	50	None	--	--	--	18.9	15.5
	50	H812.3	0.75	--	--	18.5	14.4
	50	N73C32	1.0	--	--	30.6	26.3
	75	None	--	38.3	30.9	29.7	20.1
	75	N73C32	1.0	36.9	21.8	27.5	23.7
	75	H813.2	0.75	--	--	26.1	18.6
	100	None	--	42.0	30.4	--	--
Fe ₂ (SO ₄) ₃ ^d	25	None	--	No flocculation		--	--
	37.5	None	--	No flocculation		--	--
	50	None	--	No flocculation		36.9	27.8
	50	H812.3	0.75	--	--	26.6	16.0
	50	N73C32	1.0	--	--	29.3	20.1
	75	None	--	26.1	20.6	22.5	9.8
	75	H812.3	0.75	--	--	38.7	28.4
	75	N73C32	1.0	--	--	32.0	35.6
Ferri-floc ^d	75	H812.3	0.75	--	--	26.6	14.4
	75	N73C32	1.0	--	--	20.7	15.5
Alum	50	None	--	No flocculation		--	--
	100	None	--	No flocculation		--	--
	200	None	--	--	--	8.1	13.9
	300	None	--	--	--	25.2	10.3
Lime	200	H812.3	--	No flocculation		--	--
	200	N73C32	--	No flocculation		--	--
None	--	H812.3	0.75	--	--	5.4	-6.7

^aH812.3, Hercofloc 812.3; N73C32, Nalco 73C32.

^b4/23 BOD₅: Total = 274 mg/l
Soluble = 220 mg/l.

^c4/24 BOD₅: Total = 222 mg/l
Soluble = 194 mg/l.

^dAs Fe³⁺.

TABLE 26. SOURCES OF SOLUBLE AND TOTAL COD AND BOD₅ IN EFFLUENTS OF MILL F^a

Source	Flow, mgd	pH	Solids				COD				BOD ₅					
			Suspended		Dissolved		Total		Soluble		Total		Soluble		Total	
			mg/l	% Total	mg/l	% Total	mg/l	% Total	mg/l	% Total	mg/l	% Total	mg/l	% Total	mg/l	% Total
Main sewer	3	7.63	860	51.9	796	48.1	1656	309	29.4	1052	119	47.4	251			
CM sewer	1.3	7.75	2322	59.2	1598	40.8	3920	1284	69.8	1838	585	100.5	582			
Wrapper room	1.2	7.58	620	61.1	394	38.9	1014	172	17.1	1006	35	24.0	146			
No. 6 sewer	0.95	7.60	1618	69.9	698	30.1	2316	122	8.8	1394	28	15.5	181			
Clarifier influent	7.4	7.63	972	46.0	1140	54.0	2112	453	30.5	1486	190	52.9	359			

TABLE 27. CHEMICAL, BIOLOGICAL, AND PHYSICAL ANALYSES OF VARIOUS
PROCESS STREAMS WITHIN THE MOSINEE MILL (MILL K)

Source	pH	Total, mg/l		Soluble, mg/l ^a		Color ^b	Suspended solids ^c	
		COD	BOD ₅	OC	BOD ₅		0.45 μ m	5 μ m
Digester sewer	11.8	2971	635	741	775	4000	239	98.5
Pulp mill sewer	11.2	4460	1624	1099	1074	4880	260	71
5th Stage brownstock washer	10.7	4865	1349	1402	1156	4150	130	94
High density sewer	9.7	553	158	138	144	920	120	26
Foul evaporator condensate	8.5	871	762	197	624	100	22	34
Digester blowdown foul condensate	8.2	1485	964	389	953	562	2	15
Soda recovery sewer	10.1	8328	4162	2077	3705	4200	636	184
Clarifier influent	8.0	920	181	74	106	92	1004	686

^aPassing through a 0.45 μ m Metrical filter.

^bCo-Pt units at 465 nm (NCASI Method).

^cCollected on filters of 0.45 and 5 μ m pore size.

of soluble BOD₅) (Table 29). We added cellulose powder (500 mg/l, Whatman, Standard grade) to provide particles of high surface area and enhance flocculation (No. 3 series in Table 29); it slightly increased the removal of soluble BOD₅ (1-9 percent). At pH 7.7 with alum, the removal was 2 percent better than at pH 4.2 (2A versus 1A). The addition of cellulose powder and a pH of 7.7 further increased (to 9 percent) the soluble BOD₅ that was removable with 200 mg/l alum. A combination of cellulose, lime and alum at pH 10.7 (4C) was 23 percent better than lime alone at pH 11.8 (1C) or lime and alum without cellulose (2C) at pH 10.7 (29 percent increase). Additional work on the effect of these high BOD₅ streams on the efficiency of clarifiers was done later in the study and is discussed in greater detail in Section VII.

TABLE 28. RELEASE OF SOLIDS, SOLUBLE COD,
AND BOD₅ BY BEATING^a

Sample no.	Beating, min	Freeness, ml ^b	24 Hr solids, g/l	Soluble COD		Soluble BOD ₅	
				mg/l	Increase, %	mg/l	Increase, %
A	0	750	0.29	334	--	77	--
B	30	370	0.32	396	18.6	77	0
C	60	100	0.35	416	24.6	118	53.2
D	90	30	0.38	462	38.3	128	66.2

^a1-1/2 lb beater method with 5.5 kg load on the bed plate.

^bCanadian standard.

ALTERNATE METHODS FOR REDUCTION OF BOD₅

Ultrafiltration is a process for the separation of soluble low and high molecular weight (or size) components into two separate streams through the use of semiselective membranes under low pressure (less than 300 psig or 21 kg/sq cm). We used ultrafiltration in two trials with effluents from Mill F.

In the first trial a sample of the total mill discharge to the clarifier was processed through a Westinghouse module using a polysulfone membrane that had high pH and temperature limits (pH 11.5 and 95°C). Removal of 59-65 percent of the soluble BOD₅ was attained in the permeate (that portion of the solution passing through the membrane). The permeate apparently contained low molecular weight components, such as acetic acid, that had not been removed by flocculating agents (Table 30, Part A). The flocculating agents, lime with the polymers Nalco 609 or Dow PAA (polyacrylamide) did not remove additional soluble BOD₅ from the permeate of the total mill effluent.

The second trial (Table 30, Part B) was conducted with a sample of the CM sewer effluent, which had been shown in previous work to contain 33 percent of the soluble BOD₅ in 18 percent of the flow going to the clarifier.

Ultrafiltration without additives removed 69 percent of the soluble BOD₅, and activated carbon did not remove any more BOD₅. Apparently the membrane was the controlling factor in the removal of soluble BOD. The carbon did not adsorb any of the transferrable components probably because its adsorptive capacity was used up by larger, more heavily charged molecules.

TABLE 29. JAR TESTS OF VARIOUS FLOCCULATION TREATMENTS
OF FILTERED 90-MINUTE BEATER SAMPLES^a

Treatment and sample	Flocculant		pH	Soluble COD		Soluble BOD ₅	
	Type	mg/l		mg/l	Reduction, %	mg/l	Reduction, %
1. Flocculant added:							
A	Alum	200	4.2	458	2.1	105	0.0
B	FeCl ₃	200	2.7	256	45.3	51	51.0
C	Lime	200	11.8	449	4.0	98	5.8
2. Above samples treated with alum and flocculated:							
A	Alum	200	<u>7.7</u>	336	28.2	102	1.9
C	Alum	200	10.7	449	4.0	109	0.0
3. Cellulose powder (500 mg/l) added to No. 1 samples:							
A	Alum	200	4.2	400	14.5	95	8.6
B	FeCl ₃	200	2.7	248	47.0	50	51.9
C	Lime	200	11.8	422	9.8	90	13.5
D	Control	None	--	468	--	104	--
4 Alum added to No. 3 samples:							
A	Alum	200	<u>7.7</u>	355	22.0	88	15.4
C	Alum	200	10.7	406	13.2	74	28.8

^aInitial values: pH = 6.7
Soluble COD = 462 mg/l
Soluble BOD₅ = 128 mg/l.

TABLE 30. SOLUBLE COD AND BOD₅ IN MILL F EFFLUENTS TREATED WITH FLOCCULANTS AND REVERSE OSMOSIS OR ULTRAFILTRATION

Stream	Flocculants		Membrane treatment	Sample	Soluble COD		Soluble BOD ₅	
	Type	mg/l			mg/l	Reduction, %	mg/l	Reduction, %
A. Clarifier influent	None	--	UF	Feed	433	--	220	--
	Lime +			Permeate	136	68.6	78	64.5
	Nalco 609	300	UF	Feed	382	--	180	--
		0.5		Permeate	138	63.9	73	59.4
B. CM sewer	Dow PAA	10.0	UF	Feed	433	--	206	--
				Permeate	138	68.1	73	64.6
	None	--	UF	Feed	1095	--	528	--
	Activated carbon	200	UF	Permeate	292	73.3	162	69.3
				Feed	901	--	426	--
				Permeate	218	75.8	137	67.8
	None	--	UF + RO	Feed	1095	--	506	--
				Perm. UF	392	64.2		
				Perm. RO	58	94.7	38	92.5
	None	--	RO	Feed	1196	--	522	--
				Permeate	98	91.8	57	89.1
	None	--	UF + RO	Feed	1039	--	489	--
	None	--		Perm. UF	306	70.5		
	A/C	200		Perm. RO	36	96.5	31	93.7
	FeCl ₃	100	UF	Feed	795	--	508	--
	(as Fe ³⁺)			Permeate	297	62.6	180	64.6

The ultimate value of ultrafiltration might be in concentrating the high molecular weight soluble BOD₅ components and removing them from process streams. It has been demonstrated elsewhere (21) that ultrafiltration could be carried to a concentration of 25-35 percent solids without complications from osmotic pressure buildup which directly affects RO flux rates and concentrations. This would be sufficiently high for final disposal by discharge into the strong pulping liquor streams for evaporation and utilization or burning. Still another use for ultrafiltration is in reducing the buildup of high molecular weight solubles in recycled process water within the mill; this could reduce water consumption and the volume of overflow to the out-plant clarifier.

Reverse osmosis, similar to ultrafiltration but operating at higher pressures (400-800 psig or 28-56 kg/sq cm) with tighter membranes which reject smaller molecules, was tried both as a possible treatment method and as a further refinement for the permeate from the ultrafiltration process (see Table 30). The soluble BOD₅ removal of 89 percent for reverse osmosis alone was increased to 92 and 94 percent, respectively, by either the ultrafiltration pretreatment or the addition of activated carbon to the reverse osmosis feed. The advantageous use of activated carbon in the reverse osmosis feed, which had been pretreated by ultrafiltration, substantiates the previous conclusion that the high molecular weight materials of the ultrafiltration feed were utilizing or plugging all of the available adsorptive sites on the carbon.

Ferric chloride was added to the ultrafiltration feed in order to develop a floc and possibly increase membrane rejection and soluble BOD₅ removal. Ferric chloride actually worked in reverse and increased the transfer of soluble BOD₅ through the membrane. This loss of membrane rejection reduced the removal of the soluble BOD₅ components by 4 percent. Subsequent tests indicated that the ferric ion did not damage the membrane: after the module was washed with detergent, it gave salt (NaCl) rejection comparable to those for a new membrane.

SECTION VI

PILOT SCALE CLARIFIER STUDIES

GENERAL

The information from jar test studies of the effluents from the Mosinee and Combined Locks mills were used to prepare a scheme for the treatment of these mill effluents with a pilot-scale clarifier.

This clarifier had been developed at The Institute of Paper Chemistry under Project 3029, jointly sponsored by member companies of the Institute, the Environmental Technology Corporation (ENCOTEC) and the Upper Great Lakes Regional Commission (12). The stainless steel cone of the clarifier had a center height of 1.3 meters (4.25 feet) and a diameter of 1.1 meters (3.5 feet). The inlet was downflow through a 5.1-cm (2-inch) stainless steel pipe with an opening 40 cm (1.25 feet) from the bottom of the cone. It was equipped with an overflow weir which discharged into a 5.1-cm (2-inch) trough around the entire circumference of the top.

This section of the report covers the initial laboratory "shakedown" studies, the on-site studies at the mill in Mosinee, Wisconsin from January 15 to April 4, 1975, and the on-site studies at the mill in Combined Locks, Wisconsin from April 8 to June 26, 1975.

The problems encountered and some of the solutions developed for the correction of these problems are discussed. Data are given and discussed for the removal rates attained for suspended solids, total and soluble BOD₅ and color.

TRIALS WITH THE PILOT CLARIFIER UNDER LABORATORY CONDITIONS

Three thousand gallons of Mosinee clarifier influent were delivered by truck to the Institute early in January 1975 and were used to check the operation of the clarifier system (Figure 8) without the samplers or the submersible pump (P-1).

The system consisted of the following items and arrangement:

1. A tank (T-1) provided a constant supply of waste to be treated.
2. A feed control pump (P-2) maintained a constant feed rate.
3. A 35-liter (9-gallon) reactor tank (T-2) with a high speed mixer provided rapid mixing of the waste with the primary flocculating agent and permitted gravity flow to the balance of the stream.
4. The flow from the reactor tank was into an open pipe extending to the bottom of the flocculator tank (T-3). If polymer was to be added, it was introduced at the top of this open pipe,

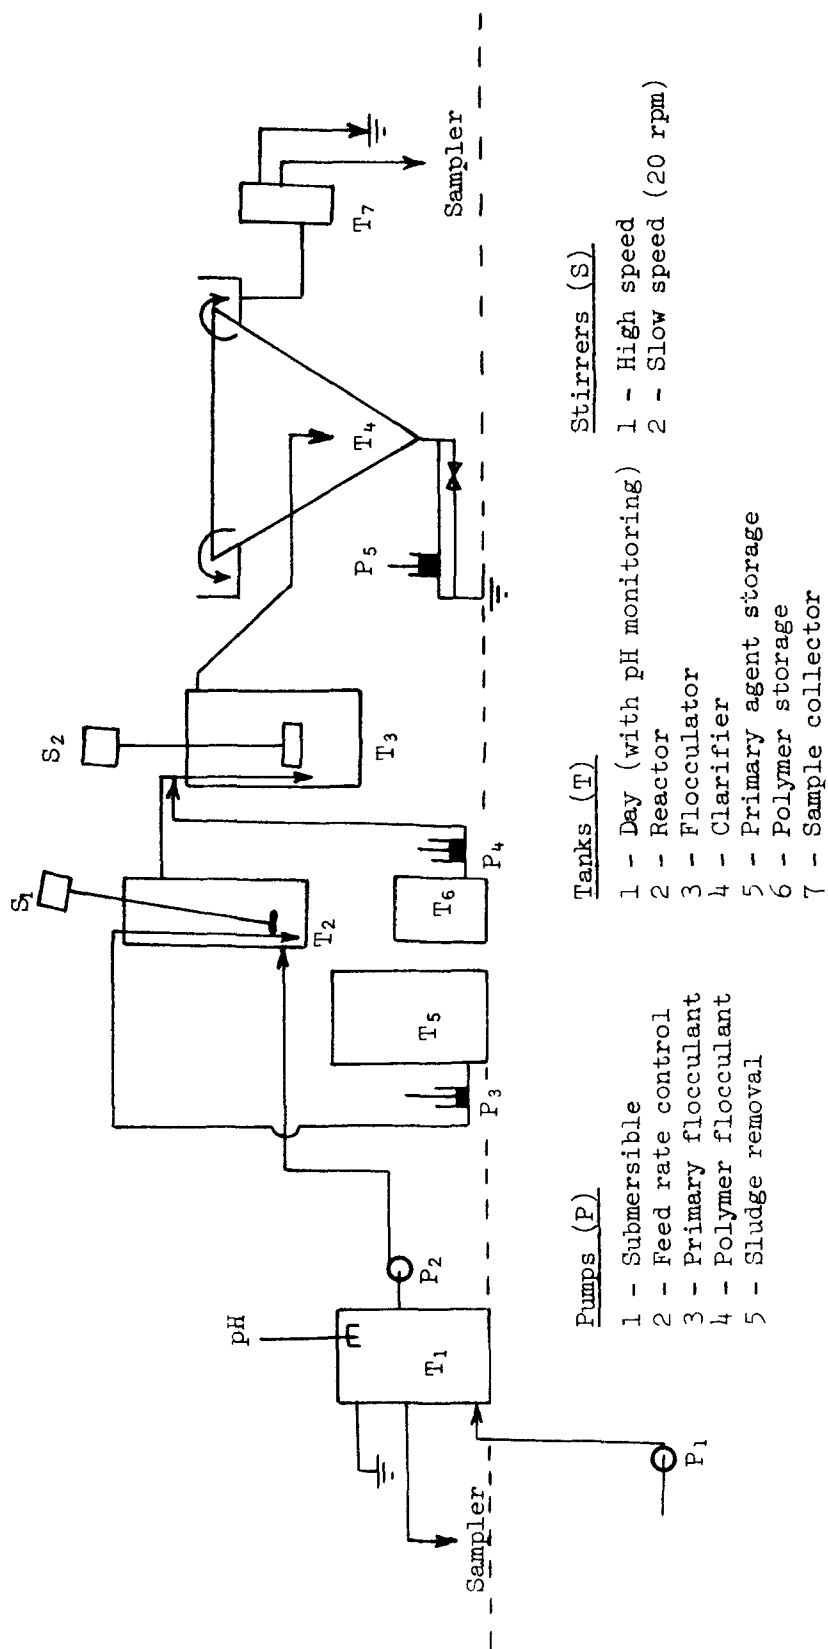


Figure 8. Schematic of pilot-scale clarifier installation.

- into a quiescent zone approximately one-quarter of the distance down the pipe in order to provide adequate mixing without excessive turbulence or floc dispersion. In the center of this tank was mounted a slow speed (20 rpm = 1.6 fps peripheral velocity) paddle that mixed without excessive shear.
5. The overflow from the flocculator tank passed downflow into the clarifier (T-4), with the flow from the weir trough into a small sampling pot (T-7) and then to the sewer.
 6. In these laboratory studies the sludge was removed from the bottom of the clarifier by gravity flow through a vented overflow pipe (not shown) that could be raised and lowered to control the rate of flow. Both gravity flow and a pumping system were used in the field trials and are discussed in the following part of this section.
 7. The flocculating agents were stored in small tanks (T-5,6) and were metered into the system with tubing pumps (P-3,4).

We used this equipment to do a brief laboratory study of the effects of waste flow and sludge removal rates, at a constant level of flocculating agent(s), on the quality of the discharge produced. An excellent quality discharge (Table 31) appeared to be produced if the waste feed and the sludge discharge rate resulted in an overflow rate of 140-150 liters per square meter per day (400-425 gallons per square foot per day). The removal also appeared to be dependent upon the type of sludge blanket developed in the clarifier. Best results were obtained with the level at least five centimeters (2 inches) from the top to prevent floc carryover, but not less than one meter (3 feet) from the bottom; i.e., 60 cm (2 feet) above the waste inlet. This arrangement seemed to promote the development of larger floc particles and a filtration effect to markedly enhance the quality of the discharge. These parameters were, therefore, selected for the operation of the unit during the field trials.

EQUIPMENT AND OPERATION AT MOSINEE PAPER CORPORATION

The IPC system was to be operated in parallel with the two mill clarifiers and was, therefore, installed in the waste treatment plant in a concrete building. This building was immediately adjacent to the two commercial clarifiers and was unheated, except for heat from the incoming waste stream.

Due to the arrangement of the waste stream flow pattern, it was necessary to use a submersible pump (P-1 in Figure 8), mounted in the waste treatment trench immediately downstream from the bar and traveling screens, to lift the waste to floor level (2-2.5 meters or 6-8 feet) at a rate of 19-30 liters (5-8 gallons) per minute.

The flow from the submersible pump was directed into the bottom of a 190-liter (50-gallon) stainless steel tank (T-1) for supplying a centrifugal feed pump (P-2) with the excess overflowing to the sewer near the influent sampler. This tank also contained the pH recording equipment.

The feed pump (P-2) maintained a waste flow of 11.4 liters per minute (3 gpm) into the reactor tank (T-2), and the only other modification of the

equipment, over that described in the laboratory trials, was the installation of a pump in the sludge removal line during some of the trials.

TABLE 31. LABORATORY EVALUATION OF PILOT-SCALE CLARIFIER^a

Over-flow _b rate	Sludge removal, %	Flocculant, mg/l		% Removal of			
		Primary Fe ³⁺	Polymer H812.3	Suspended solids	Color	Total BOD ₅	Soluble
369	20	87	1.3	99	55	24	8
395	13	64	0.78	99	79	34	17
406	10	61	0.77	99	--	29	9
425	10	52	0.77	97	46	36	10
526	15	51	0.77	19	49	19	13
579	12	51	0.77	-52	49	5	16
587	10	50	0.77	-29	48	0	0
632	14	50	0.75	-35	49	9	9

^aInitial (control) values: Suspended solids = 234 mg/l
Total BOD₅ = 134 mg/l
Soluble BOD₅ = 114 mg/l
Color = 130 units.

^bOverflow in gallons/square foot/day based on surface area of clarifier.

SAMPLING AT MOSINEE PAPER CORPORATION

During the first part of the mill study, influent and effluent samples were taken with two Model WM-5-24R refrigerated Sigmamotor samplers (Sigmamotor, Inc. of Middleport, New York) set to take individual samples hourly around the clock. In order to reduce the analytical load, these were composited into 12-hour samples daily.

It soon became apparent that the rapid changes in mill discharge (Table 32 and Figure 9) would not permit such an infrequent sampling scheme. A third sampler, a CVE refrigerated unit (Quality Control Equipment Company of Des Moines, Iowa) capable of taking small samples at short intervals (1-60 minutes) for compositing in a 4-liter (1-gallon) bottle, was placed in the influent stream. This unit was set to take 40-ml samples at 15-minute intervals and the 12-hour composites were compared with those from one of the Sigmamotor units taking 400-ml aliquots from the same influent.

Poor correlation was evident (Table 33) and a second trial was made. This was with four samplers in the following arrangement:

- a. The two Sigmamotor samplers on the influent and effluent streams set at 30-minute intervals, taking 24 400-ml samples in 12 hours.

- b. The CVE sampler on the influent line taking a 40-ml sample every 10 minutes.
- c. A polystaltic tubing pump (Buchler Instruments of Fort Lee, New Jersey) set to take 9 ml per minute continuously was used on the effluent line.

TABLE 32. ANALYSIS OF INDIVIDUAL SAMPLES
TO ESTABLISH RANGE^a

No.	pH	Milligrams/liter		
		Suspended solids	Total BOD ₅	Soluble BOD ₅
1	10.12	210	241	203
2	10.07	628	206	178
3	9.57	494	166	138
4	9.63	145	155	138
5	9.11	85	129	116
6	9.48	144	135	114
7	8.86	265	143	140
8	9.40	152	163	140
9	9.19	97	148	140
10	9.30	76	127	117
11	9.78	94	138	135
12	9.60	115	132	124
13	9.59	267	148	118

^aSamples taken at hourly intervals (start 10 a.m. 1/16/75).

Analytical comparisons were excellent (Table 34) and indicated that the Sigmamotor samplers could be used to take representative samples if the 30-minute cycle was used.

In order to compensate for the "system holdup time" of 90 minutes, the samples were composited to obtain representative samples from the same 12-hour test period. This was readily accomplished by compositing the individually numbered bottles in groups so that those from the effluent were three bottles "behind" those for the influent.

Samples of the mill clarifier influent and effluent were taken at 7:30 a.m. daily by the mill staff and analyzed by both mill and IPC personnel.

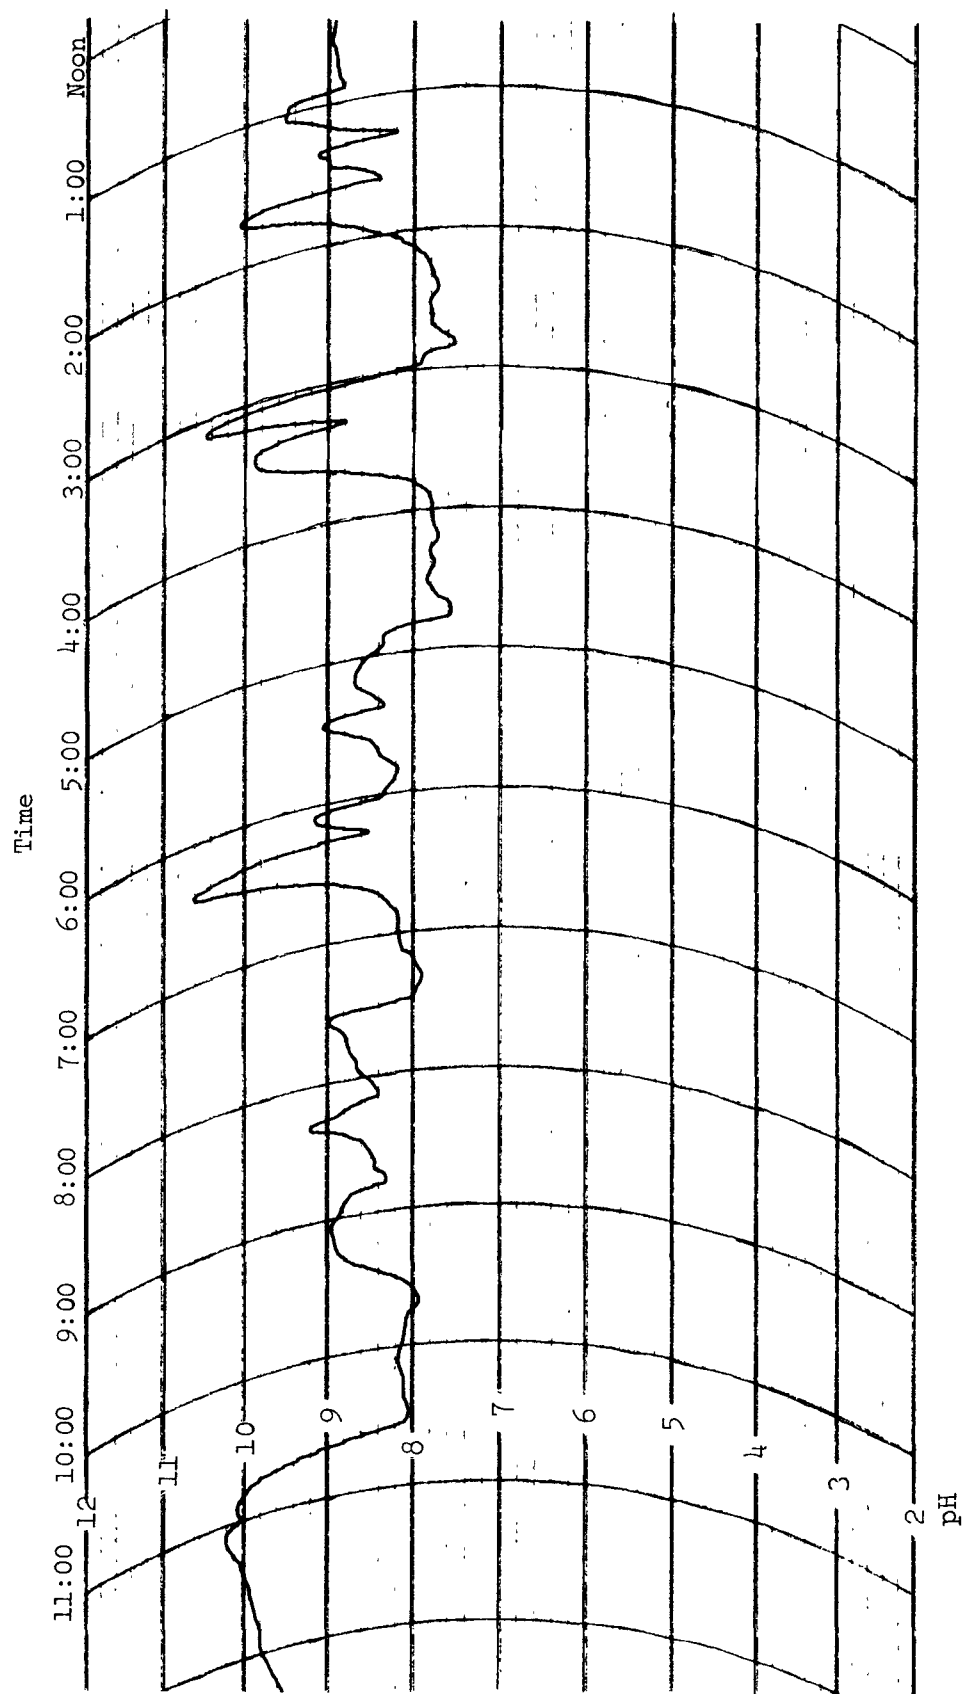


Figure 9. Variation in pH of Mosinee mill effluent entering pilot-scale clarifier.

TABLE 33. ANALYSIS OF SPECIAL AND REGULAR SAMPLES
OF CLARIFIER INFLENT, TRIAL NO. 1^a

No.	pH		Mg/l						Pt-Co	
	Special	Regular	Suspended solids		Total BOD ₅		Soluble BOD ₅		Special	Regular
			Special	Regular	Special	Regular	Special	Regular		
1	7.22	7.85	219	189	162	190	88	93	38	78
2	7.82	8.75	182	136	177	244	109	138	115	130
3	8.05	7.73	221	126	130	128	102	88	119	133
4	8.40	8.51	210	199	124	158	108	117	170	204
5	7.48	8.40	257	240	104	140	84	95	67	168
6	7.35	7.61	213	169	98	142	76	88	45	74
7	7.35	7.11	213	198	120	88	94	86	60	82

^aSpecial sample: A composite of 40-ml samples taken with a CVE sampler every 15 min for 12 hours; regular sample: a composite of 400-ml samples taken with a Sigmamotor sampler every hour for 12 hours.

TABLE 34. ANALYSIS OF SPECIAL AND REGULAR SAMPLES OF CLARIFIER INFLUENT, TRIAL NO. 2^a

Sample No.	pH		Total BOD ₅ , mg/l		Soluble BOD ₅ , mg/l		Color (Pt-Co units)	
	Special	Regular	Special	Regular	Special	Regular	Special	Regular
AA-1	8.08	8.09	197	180	162	148	268	273
AA-2	7.41	7.22	174	173	120	124	95	145
BB-1	4.41	4.67	128	122	116	107	42	45
BB-2	3.69	3.61	94	86	90	83	65	52
AA-3	7.61	7.40	183	165	142	135	120	122
AA-4	7.19	7.20	140	139	110	104	50	68
BB-3	3.99	3.96	111	106	101	98	22	55
BB-4	3.30	3.32	95	89	90	86	50	70

^aAll samples composited on a 12-hour basis.

^bA and B: A composite of 400-ml samples taken by Sigmamotor samplers at 30-minute intervals on influent and effluent.

AA: A composite of 40-ml samples taken by a CVE sampler at 10-minute intervals on influent.

BB: Continuous sample taken by a polystaltic pump at 9 ml/min from the effluent.

No. 1 & 3: 7:00 a.m. to 7:00 p.m.

No. 2 & 4: 7:00 p.m. to 7:00 a.m.

Mill: 7:30 a.m. composite.

For analysis all samples for BOD₅ were stored at 4°C (40°F) and the others were maintained at room temperature.

TESTING SCHEDULE AT MOSINEE CORPORATION

In order to establish a comparison between the mill and IPC clarifiers, the first trial was the operation of the pilot unit under conditions as near those of the mill as practical. Since we were not attempting to develop optimum clarification at high hydraulic loadings, but merely to study the increased removal of the soluble BOD₅ from the waste stream while operating under different chemical treatment conditions, it was not necessary to show that we could exactly duplicate mill operation. Rather, it was more important to show that any increase in BOD₅ removal was due to the chemical additives and not to the clarifier design alone.

We developed a "base line" by operating the IPC unit with Hercofloc 812.3 at 0.75 mg/l and with a waste flow rate of 11.4 liters/min (3 gpm) in parallel with the two mill clarifiers. The Hercofloc addition duplicated mill treatment. If a 10 percent sludge withdrawal could be maintained, the pilot clarifier overflow would be 1.6 liters per sq cm per day (400 gallons per sq ft per day), approximately one-half that of the commercial unit.

The efficiency for removal of BOD₅ in the small unit was slightly less than for the mill units under the same conditions and time period. This indicated that the design of the IPC clarifier did not promote more removal and that any increases found in later trials using chemical additive would be directly attributable to the chemical treatment.

Following the development of the base line, other chemical treatment schemes based on the laboratory studies were tested:

- A. Base line using 0.75 mg/l Hercofloc 812.3.
- B. Alum at 200 mg/l plus 0.75 mg/l Hercofloc 812.3.
- C. Ferric chloride at (100 mg/l as Fe³⁺) plus 0.75 mg/l Hercofloc 812.3.
- D. Ferric sulfate (50-100 mg/l Fe³⁺) without the polymer.
- E. A second base-line study with the Hercofloc.
- F. Sulfuric acid for pH adjustment only.
- G. Sulfuric acid for pH adjustment plus the Hercofloc.
- H. Ferrous sulfate (100 mg/l Fe²⁺) plus 0.75 mg/l Hercofloc.

The original plan was to have tests of two weeks' duration. Unfortunately, the several periods of problem and solution development we encountered early in the study delayed the program and resulted in shortened test periods (for F, G, and H, above) near the end of the study. Also, throughout almost the entire trial period, the Mosinee mill was on a reduced work week (4 days), which limited the operation of the small clarifier to the period between 9:00 a.m. Tuesday and 4:00 a.m. Saturday, thereby limiting the number of samples per week.

RESULTS AND DISCUSSION OF WORK AT MOSINEE

In our first attempt to establish the base line, we immediately encountered three problems:

The first problem related to the submersible, centrifugal sump pump installed in the waste trench. It had a small 2.5-cm (1-inch) inlet hole in the baseplate and due to the high fluid velocity in the waste trench, an "aspirator" effect developed across the inlet when the pump was vertically mounted, and we were unable to pump sufficient waste. Mounting the pump at a 90° angle pointed downstream increased the aspiration effect, while mounting it pointed upstream resulted in rapid plugging of the inlet hole with pitch and debris not removed by the bar or traveling screens. This problem also extended to the centrifugal pump used for feed control.

The second problem was due to the high suspended solids content of the Mosinee waste. A centrifugal pump was the only available pump that was considered suitable for control of the flow at the 11.4 liters per minute (3 gpm) rate. A one-half inch Eastern centrifugal pump was, therefore, used to control the rate of waste fed to the clarifier unit, and at first the rate was controlled with a 1/2-inch valve on the pressure side of the pump. This rapidly plugged with pitch and fibers and resulted in erratic flow patterns.

The third problem developed in the gravity sludge removal system. Settling of the high suspended solids content rapidly overwhelmed the available space in the clarifier and resulted in solids carryover, even in the absence of chemical agents, other than the Hercofloc 812.3.

In order to reduce these problems:

1. A conical screen (20 mesh), 18 inches long by 7 inches in diameter, was installed on the submersible pump. When installed with the apex of the cone mounted upstream, the pumping action was excellent and the cone was somewhat self-cleaning. When mounted with downstream orientation, which should increase the self-cleaning aspect of the cone shape, the flow was reduced below acceptable levels. Periodic cleaning, with high pressure water, was required to maintain an adequate supply to the system.

2. The centrifugal feed pump was fitted with a smooth-bore orifice plate for flow control and with periodic cleaning this provided better flow control.

3. A multihead tubing pump (Brosites) was installed in place of the gravity system for sludge removal. In the last four trials a throttled centrifugal pump was tried in this position and found to work the best of any of the schemes attempted.

Although none of these worked perfectly and problems were encountered from time to time, failure of the system could be minimized with careful cleaning and operation procedures.

Data for the trials with the various flocculating agents and for the base lines are summarized in Table 35. The more detailed analysis of the individual samples are in Appendix B (Figures B-1 to B-10, Tables B-1 to B-5). These data were first used to establish confidence limits, and the following summary was developed.

1. Both the initial and final trials (A and E of Table 35) with 0.75 mg/l Hercofloc 812.3 indicated, as previously noted, that the IPC unit was equal to or slightly less efficient than the mill clarifiers in removing suspended solids, soluble BOD₅ and color.

2. The reason for the marked difference noted in the total BOD₅ reductions for the mill clarifier during the second trial is unknown; throughout the study period there had been a slow, progressive increase in the efficiency of the mill clarifier in removing BOD₅; i.e., from 14 to 35 percent between Trials A and H. This was not readily traceable to changes in the concentration of BOD₅ going to the clarifiers during this period, since these were on the average 161, 120, 138, 181, 161, 211, 114 and 178 mg/liter for Trials A to H, respectively.

3. Alum with polymer and without pH adjustment, as predicted by the laboratory trials, did not increase the removal of the BOD₅ components but did markedly increase the efficiency of removal of suspended solids and color.

4. The ferric ion, both as chloride and sulfate salts, was an excellent flocculating agent for removing BOD₅, the chloride form being more effective than the sulfate for suspended solids. The chloride could have been better because the final pH was nearer to the optimum for the Fe³⁺ produced flocs (pH 4-5).

5. Ferrous ions, at the level of 100 mg Fe²⁺/l, appeared to reduce the efficiency of the system even with the addition of polymer. While this level of ion was below that which would be theoretically required by the Schulze-Hardy rule, which states that the concentration of the counterion required to collapse the double layer and produce rapid flocculation is inversely proportional to the 6th power of the valence, it was the highest level practical during our trials due to the low solubility of the commercial grade ferrous sulfate. Based on the effectiveness of the ferric ion at 100 mg/l, the level of ferrous ion theoretically required would have been approximately 1100 mg/liter.

6. The use of sulfuric acid to decrease the pH was one process under consideration by the mill for use in the large clarifiers. A trial was, therefore, designed to test this procedure for the removal of some of the components from the waste stream in the small system; but due to the mechanical difficulties we had encountered earlier in the trial period, only a short period was available near the end of the study. Although the data were insufficient to provide reliable comparisons with mill operation, laboratory studies have shown that pH reduction to below 4.5 resulted in marked reduction in suspended solids and total BOD₅, with little effect on the soluble BOD₅ level in the effluent.

TABLE 35. VARIOUS TREATMENTS OF MOSINEE MILL EFFLUENT
IN PILOT-SCALE AND MILL CLARIFIERS

Clarifier Unit	Effluent quality				Suspended solids	Removal, %		
	Suspended solids, mg/l	BOD ₅		Color units		Total	BOD ₅	
		Total, mg/l	Soluble, mg/l				Soluble	Color
A. Both units with Hercofloc 812.3 at 0.75 mg/l:								
IPC	86	146	129	76	70	17	14	28
Mill	58	137	129	74	80	14	13	28
B. IPC unit with 200 mg/l alum + Hercofloc 812.3 at 0.75 mg/l, and mill unit with Hercofloc 812.3 at 0.75 mg/l:								
IPC	22	96	92	21	88	19	18	81
Mill	59	98	85	89	72	18	17	46
C. IPC unit with ferric chloride (100 mg/l Fe ³⁺) and Hercofloc, and mill unit with Hercofloc only:								
IPC	16	89	80	80	90	34	23	71
Mill	62	111	91	102	72	22	8	30
D. IPC unit with ferric sulfate (50-100 mg/l Fe ³⁺) and Hercofloc, and mill unit with Hercofloc only:								
IPC	44	105	94	48	78	34	24	68
Mill	66	133	116	156	66	26	10	2
E. Second base line with both units using Hercofloc 812.3 at 0.75 mg/l:								
IPC	40	137	118	157	80	13	8	7
Mill	56	116	103	118	78	29	10	13
F, G, & H. Insufficient data to provide good comparisons.								

These trials, with ferric, ferrous, and aluminum ions, and especially with the iron salts, have shown that an increase in clarifier efficiency (12 percent for total BOD₅, 15 percent for soluble BOD₅, and up to 66 percent for color) could be attained with the Mosinee waste. The sulfate form might be preferable to the chloride, particularly if the sludge were to be burned, because it is less corrosive.

One of the principal practical observations we made in the field study at this mill was on the effect of strong digester room spent liquors and washes on clarifier performance. Visual, analytical, and other evidence showed that heavy slugs and spills of these wastes — some of which lasted several hours — adversely affected clarification. A single program of grab sample collection was undertaken to help indicate the sources of strong process waters. The analytical data from the study of that one set of grab samples are summarized in Table 27, previously described, and showed the relative strength of the various soluble materials in these samples. The effects of these streams will be discussed in greater detail in Section VII.

EQUIPMENT AND OPERATION AT COMBINED LOCKS, APPLETON PAPERS DIVISION OF NCR

The clarifier equipment that had been used in the Mosinee field trials was cleaned and transferred to Combined Locks on April 7, 1975. Since it was again to be operated in parallel with the mill system, it was placed in the treatment plant building which was immediately adjacent to the two mill clarifiers. A tee was installed in the main influent line to these two clarifiers and this stream was fed into the 50-gallon day tank (T-1 in Figure 8). This eliminated the need for the submersible pump. At Mosinee we had encountered some difficulty with uneven flow over the weir of the small clarifier. Although the unit had three leveling legs, the top rim was not level around the entire periphery. Spot overflow occurred; the floc subsequently "streamed" at these points and efficiency decreased.

An adjustable leveling device for the top of the clarifier at Combined Locks was made of small strips of slotted plastic installed along the entire overflow edge. Carefully manipulated (up and down), these could be used to establish an overflow around the entire circumference. This helped to maintain a smooth top on the sludge blanket and virtually eliminated spot overflow except when the strips were disturbed during the weekly cleanup.

Two other basic changes were made for operation at the Combined Locks mill to provide better control. The high fiber content of this waste stream overwhelmed the sludge disposal system on the IPC clarifier. In order to reduce the fiber content and still retain in the influent the fine particles required for good floc formation and BOD₅ removal, we installed a side hill screen with 60-mesh wire over the top of the day tank. Later, when we encountered difficulties in maintaining a clean surface in the base-line study (A), we changed this to a Hydrasieve (C. E. Bauer, Springfield, Ohio) with 0.010 inch slots (Figure 10).

A centrifugal pump with electrical speed control was used to control the sludge level in the clarifier and the hose was clamped on the outlet side.

This was changed to run at low speed with the hose clamp removed, and the time of operation was controlled with a timed ON/OFF switch (Trial D). This permitted relatively close control of the sludge blanket level that had varied both with the "quality" of the waste fed to the system as well as with the type of flocculating agent.

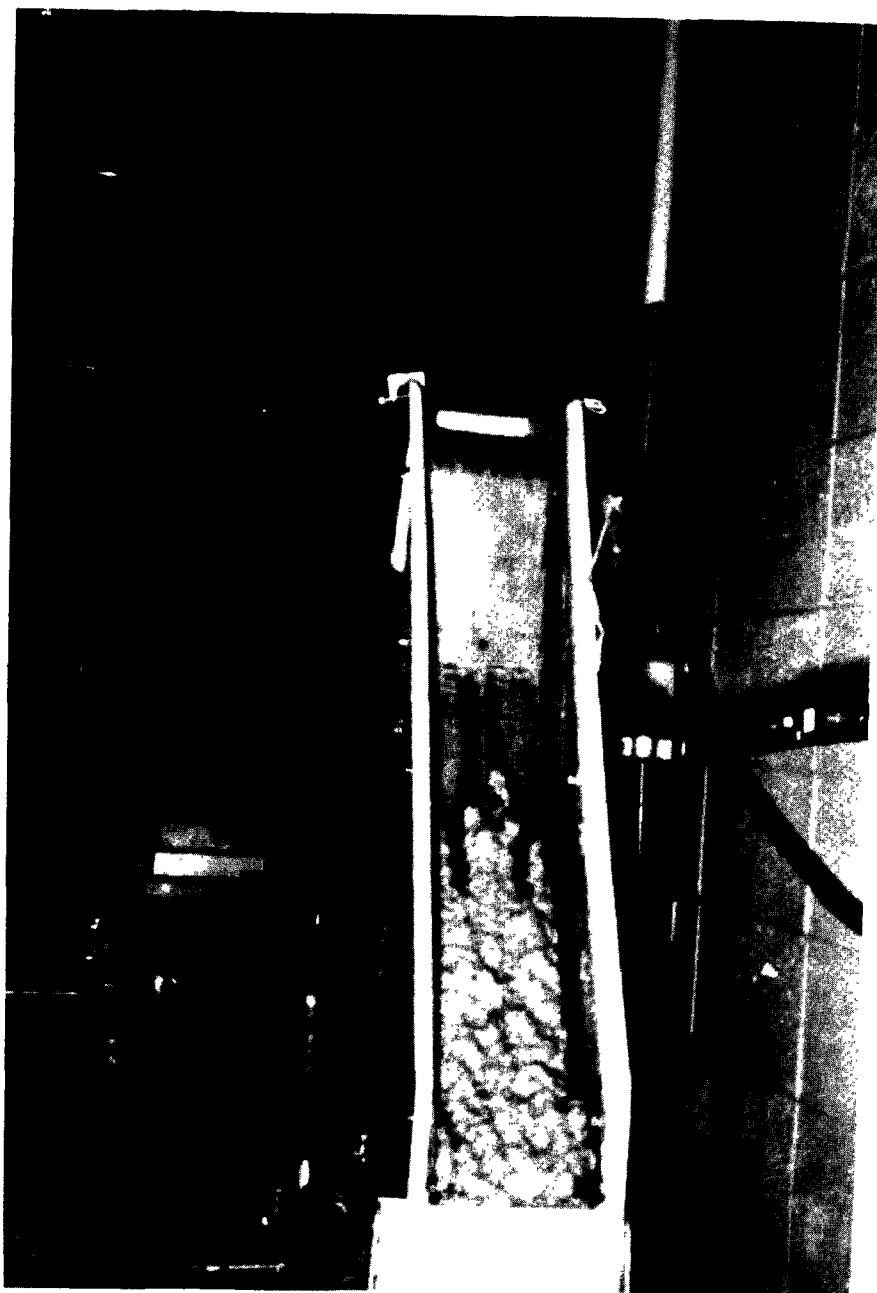


Figure 10. Bauer Hydrasieve used to remove the longer fibers from the Combined Locks mill effluent

Since the level of the sludge blanket in the clarifier was apparently very important to the efficiency of the system, thought should be given to provision of a sensing type of control system for any future work with this unit.

SAMPLING AT COMBINED LOCKS

The two Sigmamotor samplers were used on the influent and effluent streams. Comparisons were again made with these two samplers, the CVE sampler and the polystaltic pump. The Sigmamotor samplers were set to take 400-ml samples every 30 minutes, the CVE sampler a 50-ml influent sample every 8 minutes, and the tubing pump a continuous 9 ml/min sample of the effluent. Samples from each were composited every 12 hours.

Data in Table 36 indicate that representative samples were taken by the Sigmamotor samplers set at the 30-minute sampling frequency. To provide for the "system hold-up" we used the same "lag period" in compositing that we used at Mosinee. Samples of the mill clarifier effluent were taken by the mill staff every morning and were analyzed at the IPC laboratories for comparison with those from the small unit. The mill had no provisions for taking 24-hour composites of the mill clarifier influent, so the influent values for the IPC clarifier for the same test period were averaged for comparison of percentage removal values for total and soluble BOD₅ and color. Since the Hydrasieve removed considerable quantities of fiber from the influent processed by the IPC unit, the removal of suspended solids could not be compared with that of the mill system.

TESTING SCHEDULE AT COMBINED LOCKS

The Combined Locks clarifier operates without chemical additives and depends upon gravity sedimentation for clarification. The "base-line" trial (Trial A) of the IPC unit was, therefore, made without chemicals. This was followed by trials:

- B. Ferric chloride at 75 mg/l Fe^{3+} .
- C. Ferric chloride at 75 mg/l Fe^{3+} with 0.75 mg/l Nalco 73C32.
- D. Ferric sulfate at 100 mg/l Fe^{3+} .
- E. Alum at 300 mg/l.
- F. Alum at 300 mg/l with 0.75 mg/l Hercofloc 812.3.
- G. A second base-line study with no chemical additives.

Because the IPC system was not automatically controlled and because clarifier influent quality changed rapidly on Saturdays and Sundays, we usually limited our trials to 8:00 a.m. Monday through 7:00 a.m. Saturday; several trials, however, extended through the weekend.

RESULTS AND DISCUSSION

The Hydrasieve, cleaned frequently, provided good influent for the IPC clarifier. The basic problems at this site were with plugging of the influent line between the mill main line and the 50-gallon per day tank and with the removal of sludge from the small clarifier to maintain proper sludge-

TABLE 36. ANALYSIS OF SPECIAL AND REGULAR SAMPLES OF THE CLARIFIER INFILTRANT OF THE COMBINED LOCKS MILL^a

Day	Sample no.		pH		Suspended solids, mg/l		Total BOD ₅ , mg/l		Soluble BOD ₅ , mg/l		Color	
	Special ^b	Regular ^c	Special ^b	Regular ^c	Special ^b	Regular ^c	Special ^b	Regular ^c	Special ^b	Regular ^c	Special ^b	Regular ^c
	DD-1	DD-2	DD-1	DD-2	DD-1	DD-2	DD-1	DD-2	DD-1	DD-2	DD-1	DD-2
2	DD-1	D-1	8.59	8.50	62	71	291	273	270	275	170	170
	DD-2	D-2	7.68	7.70	77	74	304	296	250	251	237	237
3	DD-1	D-1	8.00	7.89	333	324	382	351	254	264	228	216
	DD-2	D-2	7.94	7.90	220	201	370	344	244	247	203	222
4	DD-1	D-1	7.78	7.70	134	104	275	285	211	216	285	287
	DD-2	D-2	7.89	7.72	191	182	280	256	224	210	240	258
5	DD-1	D-1	7.80	7.89	68	60	224	227	198	202		192
	DD-2	D-2	7.80	7.71	105	97	264	256	221	201	200	
8	DD-1	D-1	--	8.68	--	47	--	--	--	196	--	155
	DD-2	D-2	8.01	7.90	40	37	201	197	170	184	--	150
9	DD-1	D-1	8.31	8.20	59	51	250	250	214	218	--	183
	DD-2	D-2	8.03	8.01	42	41	264	286	259	228	--	170
10	DD-1	D-1	7.65	7.82	19	19	148	162	138	140	--	105
	DD-2	D-2	7.62	7.55	44	44	214	208	186	176	--	150
11	DD-1	D-1	7.71	7.62	70	66	234	240	216	211	--	217
	DD-2	D-2	7.82	7.71	35	37	272	282	249	238	--	302
12	DD-1	D-1	7.62	7.50	19	19	128	140	125	128	85	75
	DD-2	D-2	7.85	7.67	20	18	166	162	170	154	87	83
13	DD-1	D-1	7.73	7.65	32	44	264	270	256	254	225	200
	DD-2	D-2	7.68	7.71	41	31	284	286	255	271	210	205
14	DD-1	D-1	7.63	7.58	65	38	252	243	235	250	241	255

^aAll samples were composited on a 12-hour basis.

^bSpecial samples: 50 ml taken by a CVE vacuum sampler at 8-min intervals.

^cRegular samples: 400 ml taken by a Sigmamotor sampler at 30-min intervals.

blanket levels. The first remained a recurring problem throughout the study. The sludge blanket was fairly adequately maintained with the installation of the time-controlled centrifugal pump.

Data from these trials (Tables C-1 to C-7 and Figures C-1 to C-14 in Appendix C) were checked for validity (mathematical confidence limits) on the IPC computer. Averaged data for the seven trials are given in Table 37 and are summarized as follows:

1. The first base line (Trial A) showed that the IPC clarifier removed slightly more total BOD₅ than the mill unit did, but removed equal amounts of soluble BOD₅ and no color. In the second base line (Trial G) at the end of the series the units operated at equal efficiency.
2. Ferric ion, either as the chloride or sulfate salt (Trials B and D) provided excellent removal for total and soluble BOD₅ as well as color.
3. The addition of the polymer Nalco 73C32 (Trial C) to the ferric chloride slightly reduced the efficiency for total and soluble BOD₅ removal but had no effect on the color removal.
4. Alum, as predicted by the laboratory jar tests, did not appear as effective as the ferric ion in removing BOD₅ but was equivalent to it in reducing color.
5. The addition of the Hercofloc 812.3 polymer to the 300 mg/l alum markedly increased the removal of total BOD₅ to well above the level achieved with the other flocculating agents but had no effect on the reduction of the soluble BOD₅.

The high "negative" soluble BOD₅ removal in the two IPC base-line trials (Appendix C-1 and C-7), as well as throughout the test period for the mill clarifier, could not be explained. This finding, however, did correlate with the darker color of the sludge from the mill clarifiers (lighter fibrous material was in the influent waste stream) and might indicate development of both color and soluble BOD₅ from the "particulate matter" during clarification.

Spent liquor entering the influent system through spills or deliberate discharges had the same deleterious effect in this study at Combined Locks as it did at Mosinee. This, according to the Combined Locks mill staff, has been one of the causes of clarifier upsets that have occasionally plagued their operation. Operation of the pulp and paper mill under strict control of spills and similar discharges (i.e., good housekeeping) has minimized these upsets.

In our laboratories we studied the effect of the various sewer discharges on clarification, and the data developed in these studies are discussed in detail in Section VII.

TABLE 37. CLARIFIER STUDY — COMBINED LOCKS PAPER CORPORATION
AVERAGE EFFLUENT QUALITY AND REMOVAL
VALUES FOR IPC AND MILL CLARIFIERS

Clarifier	Effluent quality				Removal, % ^a		
	Suspended solids, mg/l	BOD ₅		Color units	BOD ₅		Color
		Total, mg/l	Soluble, mg/l		Total	Soluble	
A. Both units without chemical flocculating agents:							
IPC	46	232	190	205	22.1	8.6	-20.6
Mill	48	254	188	227	13.3	8.3	-33.5
B. IPC unit with ferric chloride (75 mg/l Fe ³⁺), and mill using no chemical treatment:							
IPC	45	169	147	112	40.1	25.8	32.5
Mill	74	214	187	207	24.1	5.6	-24.7
C. IPC unit with ferric chloride (75 mg/l Fe ³⁺) + Nalco 73C32 (0.75 mg/l), and mill using no chemical treatment:							
IPC	66	196	168	92	34.4	20.4	31.8
Mill	46	214	209	199	28.4	1.0	-47.4
D. IPC unit with ferric sulfate (100 mg/l Fe ³⁺), and mill using no chemical treatment:							
IPC	37	136	129	77	41.9	25.4	18.1
Mill	50	166	152	130	29.0	12.1	-38.3
E. IPC unit with alum (300 mg/l), and mill using no chemical treatment:							
IPC	60	205	197	123	32.6	13.2	31.7
Mill	54	240	216	241	21.0	4.8	-33.9
F. IPC unit with alum (300 mg/l) + Hercofloc 812.3 (0.75 mg/l), and mill using no chemical treatment:							
IPC	85	237	208	129	50.9	13.3	30.3
Mill	56	262	212	229	30.9	11.7	-23.8
G. Both units without chemical flocculating agents (gravity sedimentation only):							
IPC	50	239	214	252	27.8	-1.4	-26.6
Mill	52	236	208	254	28.7	1.4	-27.6

^aMill did not sample influent; values are based on average of IPC influent.

SECTION VII

JAR TESTS WITH INDIVIDUAL SEWER DISCHARGES

GENERAL

In Section V of this report, the BOD₅ sources making up the total discharge of the mill to the clarifier were listed and briefly discussed. In the field studies (Section VI) we had noted a marked decrease in the efficiencies of both the mill and IPC clarifiers when larger than usual amounts of spent liquor were in the waste stream being processed.

In this section we detail and discuss the studies made on the efficiency of the soluble BOD₅ removals realized when individual sewer streams were treated. These individual sewer effluents were also used to make a "synthetic" mill effluent by compositing each on the basis of its volume to the overall volume of the total mill discharge.

Using these same individual streams, we prepared various composites, omitting one stream at a time, to determine the effect the omission had on the overall efficiency of BOD₅ removal by clarification.

Ferric chloride (25, 50, 75, 100, and 150 mg/l Fe³⁺), alum (50, 100, 150, 200, 250, and 300 mg/l) and combinations of these two primaries with 0.75 mg/l of either Hercofloc 812.3 or Nalco 73C32 were used with each stream and composite.

Values for total BOD₅ and, when time permitted, soluble BOD₅ for the treated samples were compared with untreated (settled) control samples for the determination of BOD₅ removal.

TESTS ON MOSINEE INDIVIDUAL SEWER SAMPLES

Some of the mill discharge streams, especially the "high density," pulp mill and paper machine sewers, could be effectively treated with the proper concentration of the primary flocculants (Figures 11 and 12, Legends 1-11) or primary flocculant-polymer combinations (Legends 12-23). These bar graphs display that in others, such as the foul evaporator condensate, soda recovery wastes, and digester room wastes, the BOD₅ level was not substantially affected by any of the flocculating agents. Those bars shown below the zero line in the lower section of the figures indicate negative removal of BOD, probably due to prolonged holding time. These waste flows should be treated by routes other than clarification (i.e., steam stripping of the condensates).

In our earlier work with the individual streams we found that toxic materials were in some samples, and they interfered with the BOD₅ test (Table 38). Therefore, we could not make even good estimates of the concentration

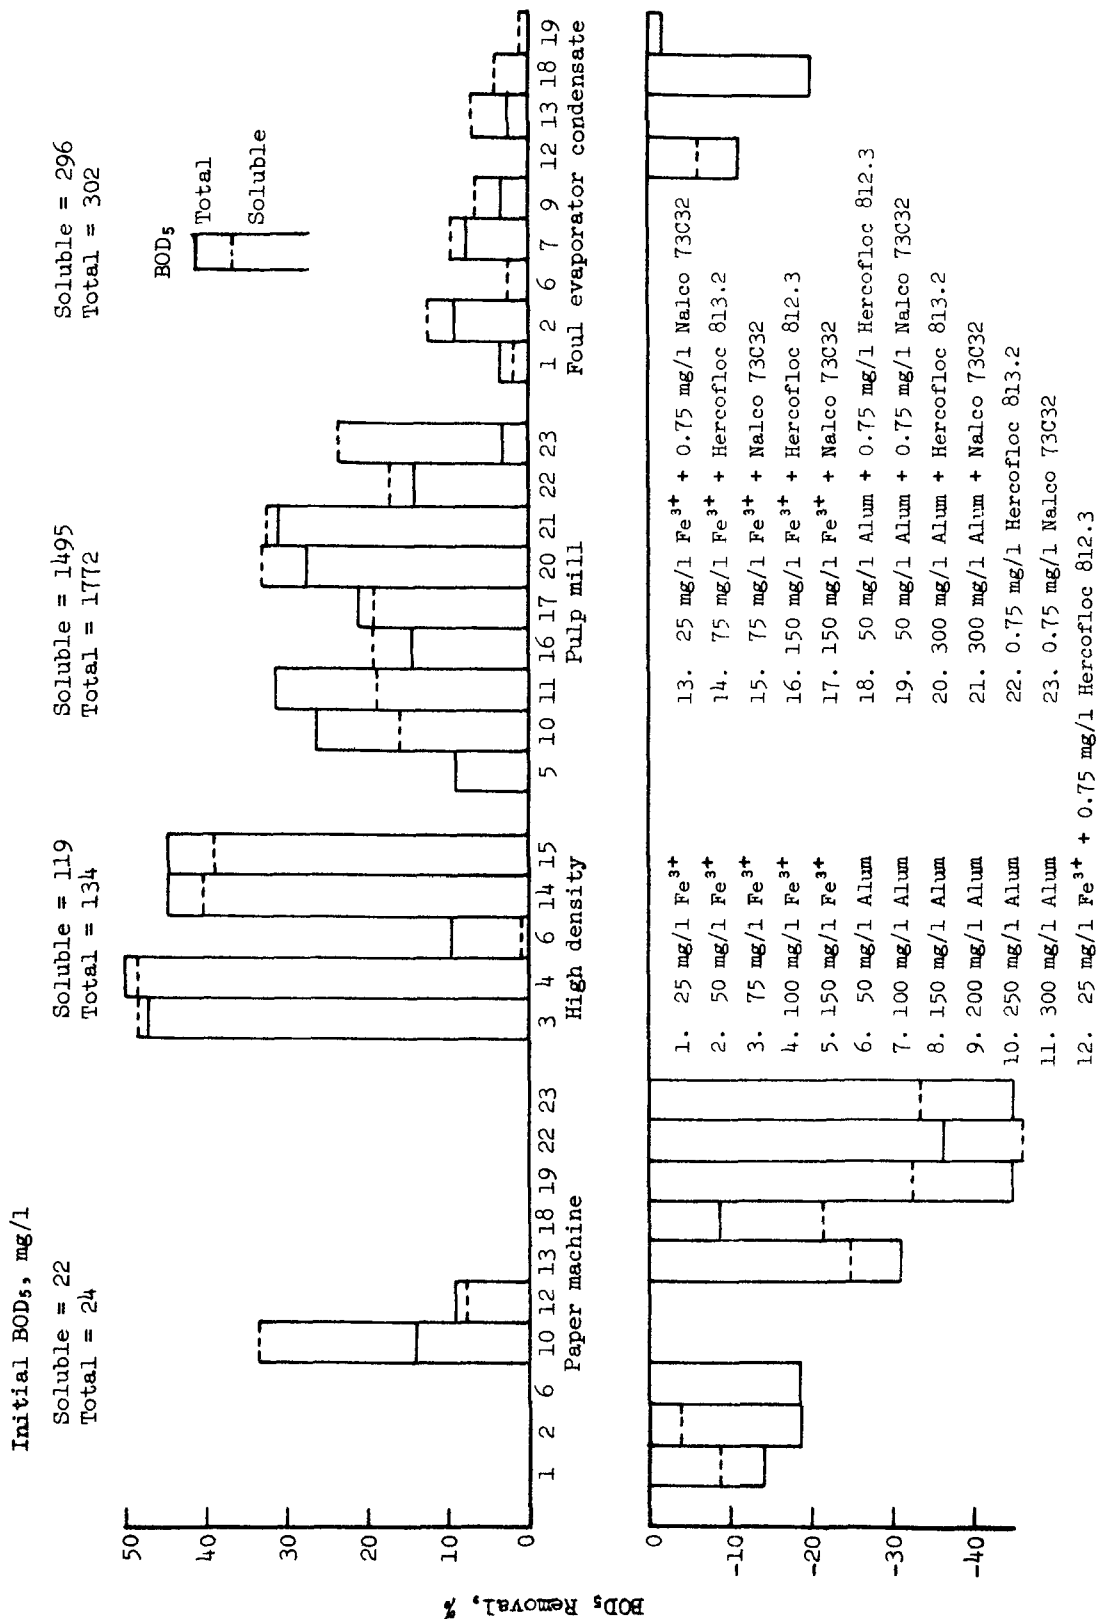


Figure 11. Jar tests on wastes from individual sewers in the Mosinee mill (paper machine, high density, pulp mill, and foul evaporator condensate).

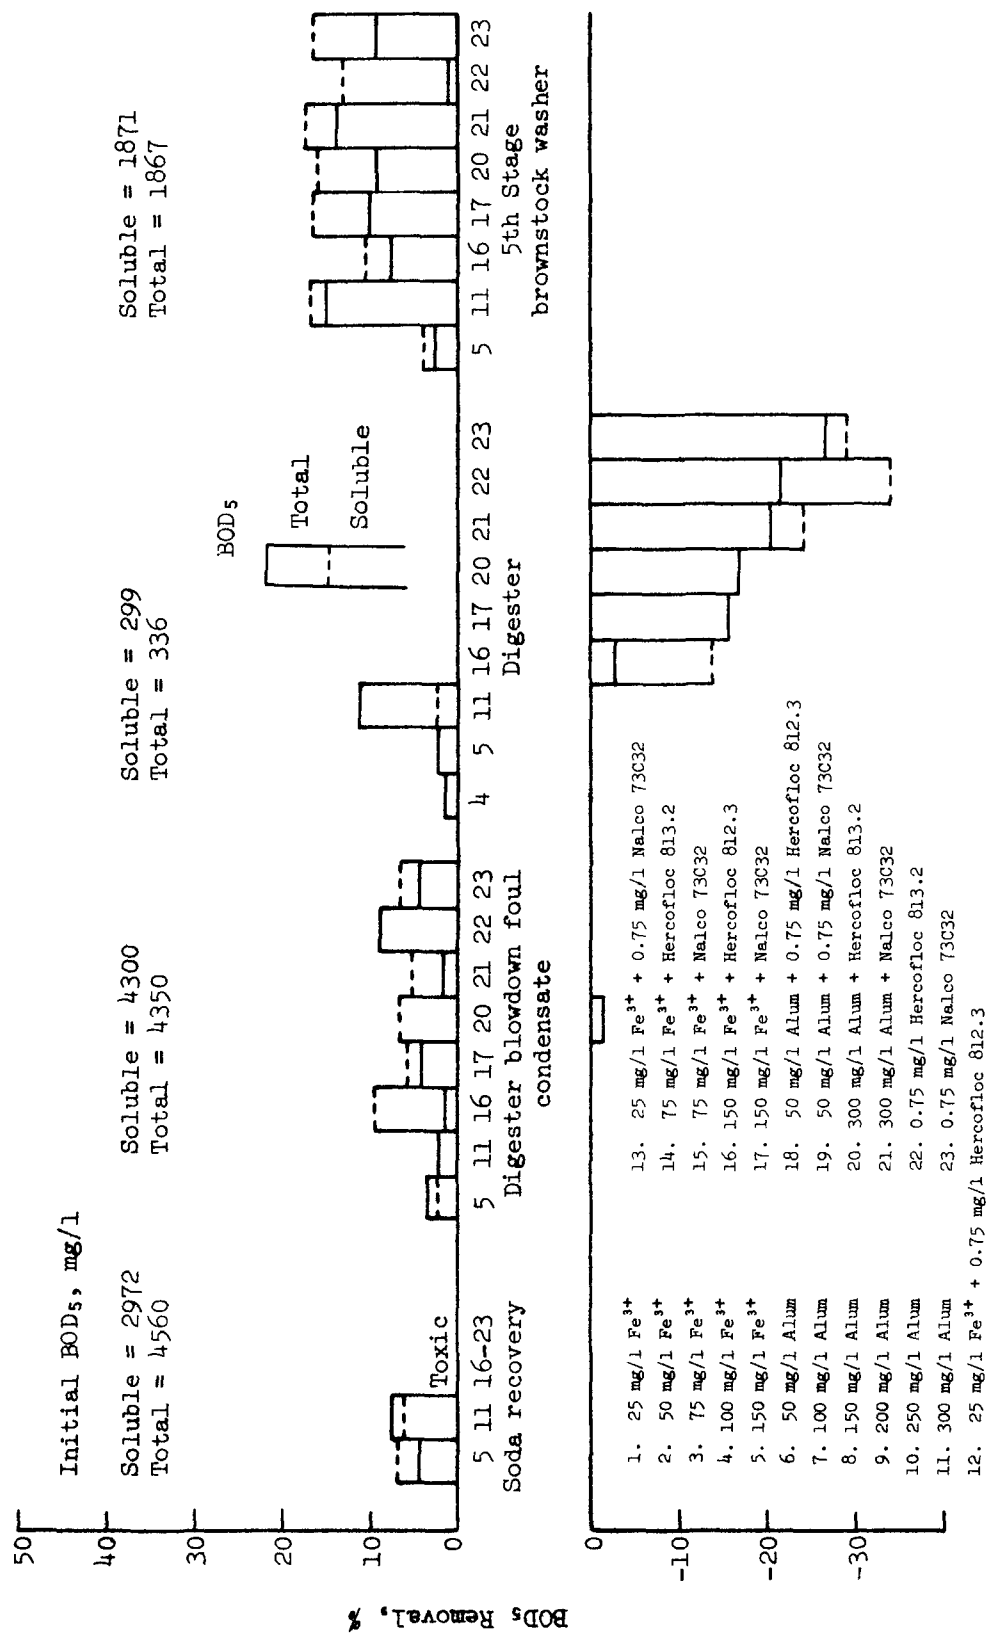


Figure 12. Jar tests on wastes from individual sewers in the Mosinee mill (continued)
(soda recovery, digester blowdown, foul condensate, digester, and 5th stage brownstock water).

TABLE 38. BOD OF INDIVIDUAL EFFLUENT STREAMS
AND TOTAL MILL EFFLUENT OF MOSINEE MILL

Source	Dilution	mg/l
Digester sewer	120	637
	600	633
Pulp mill sewer	150	1210
	300	1490
	600	1629
	1500	1620
5th Stage brownstock washer	300	940
	600	1089
	1000	1353
	2000	1340
High density sewer	30	141
	100	174
	150	172
Foul evaporator condensate	120	570
	300	762
	600	751
Digester blowdown foul condensate	300	1023
	600	1325
	750	1300
Soda recovery sewer	600	4236
	1500	4188
Total mill effluent	60	271
	150	280

of BOD₅ in these streams without careful dilution techniques. Excessive amounts of these same toxic agents would also interfere with the operation of a biological secondary treatment system and for this reason, if for none other, their presence in the total effluent should be held to a minimum or completely eliminated. Discharges into individual mill sewers were used to prepare a "synthetic" total mill effluent in the following volume relationships:

	Million gal/day	% of Total
Paper machine	10	77.9
High density	1.5	11.7
Pulp mill	0.6	4.6
Foul evaporator condensate	0.3	2.3
Soda recovery	0.28	2.2

Digester blowdown	0.07	0.6
Digester	0.05	0.4
5th Stage brownstock washer	<u>0.035</u>	<u>0.3</u>
Total	12.835	100.0

To find the conditions for maximal BOD₅ reduction when individual wastes were omitted from the system, we made combinations of seven of these eight wastes and treated them also in jar tests. Data in Figure 13 indicate that higher levels of BOD₅ removal could be achieved with less chemical if certain individual discharges were eliminated from the flow. That is:

1. The "total" effluent required 250 mg/l of alum for 17 percent reduction or 75 mg/l Fe³⁺ for 42 percent reduction in BOD₅.
2. With the soda recovery sewer flow eliminated, a 250 mg/l alum level resulted in 26 percent reduction and the Fe³⁺ at 50 mg/l resulted in a 51 percent removal of BOD₅.
3. The absence of the pulp mill sewer from the total flow, with all other flows present, permitted a 60 and 63 percent reduction in the BOD₅ concentration in the waste stream for 100 mg/l alum and 50 mg/l Fe³⁺, respectively.

When 1 percent v/v of the digester room waste was added to a mixture of wastes having relatively good clarification characteristics (paper machine and high density wastes), higher concentrations of flocculating agent were needed to produce an effluent of adequate discharge quality (Figure 14).

Attempts to calculate BOD₅ balances for these various discharge combinations, and to correlate these with the actual BOD₅ values obtained, was apparently hindered by some interaction(s) between these wastes. This could have been due to changes in the toxicity of the mixtures for the microorganisms in the BOD₅ test.

The difficulty in calculating material balances for the total or soluble BOD₅ of the individual streams and composites is due to the fact that all of the initial BOD₅ values for these samples were on "settled" jar samples. Settling removes BOD₅ and the removed BOD could not be accounted for in the calculations of BOD₅ balances. In these samples, the interaction of the adsorbing character of fibers and particles with the dispersing character of the various mixtures could markedly affect BOD₅ removal during the settling step, thereby modifying the "initial" BOD₅ of the mixture. The importance of this interaction in the overall flocculation-clarification process should be investigated further in any attempt to improve the process.

TESTS ON INDIVIDUAL STREAMS FROM COMBINED LOCKS MILL

The five streams making up the bulk of the flow to the clarifiers at Combined Locks - from the main, "CM," wet room, Number 5 and Number 6 sewers - were tested individually for the removal of BOD₅ in jar tests with ferric chloride, alum and combinations of these with either Hercofloc 812.3 or Nalco 73C32. We also prepared a composite "total" mill effluent and composites lacking individual sewer outfalls, as we did with the Mosinee wastes.

Initial BOD₅ Values, mg/l

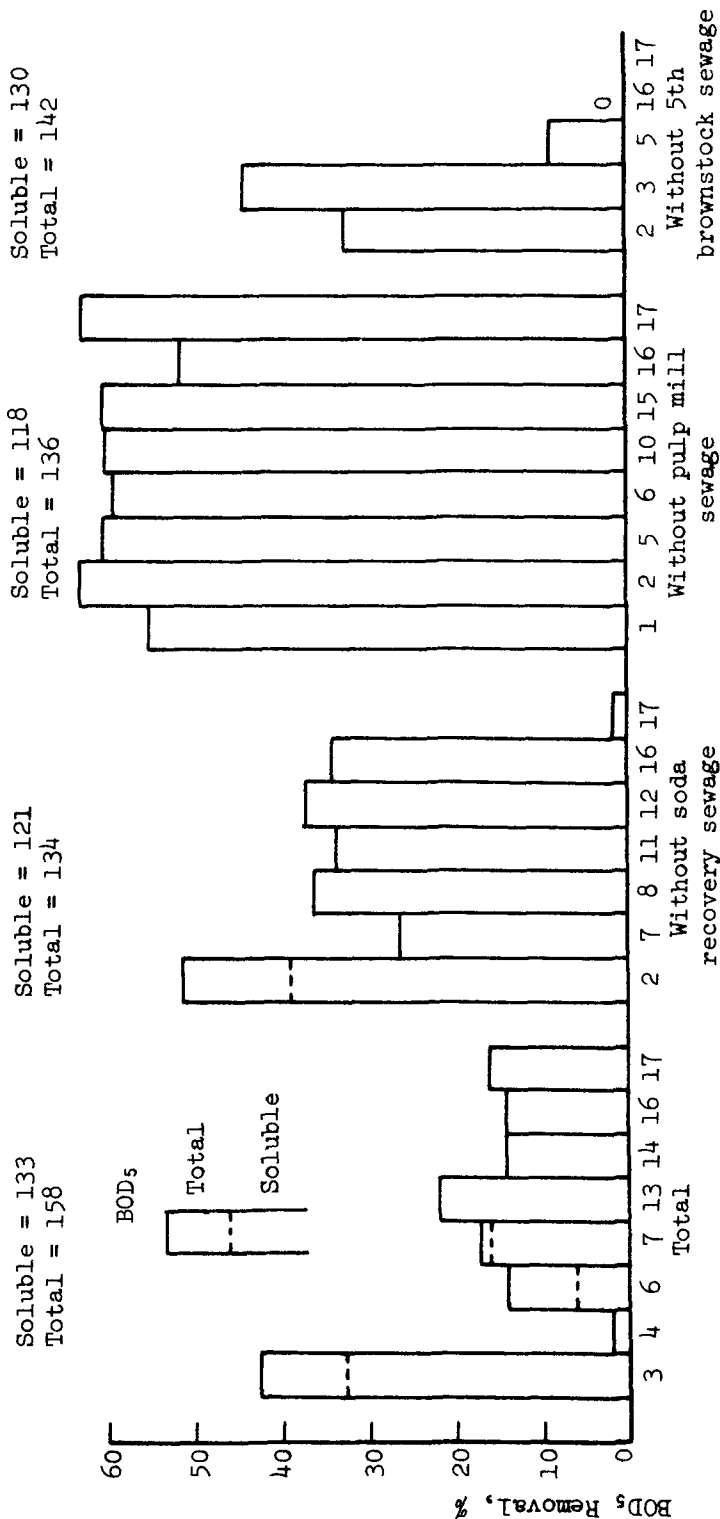


Figure 13. Jar tests on special composites of Mosinee individual waste streams.

As predicted by our earlier work, those streams having low spent liquor content, i.e., Number 5 and main sewers, had good supernatant quality (Figure 15). The BOD₅ removal was good with relatively low concentrations of Fe³⁺ or alum (Figure 16).

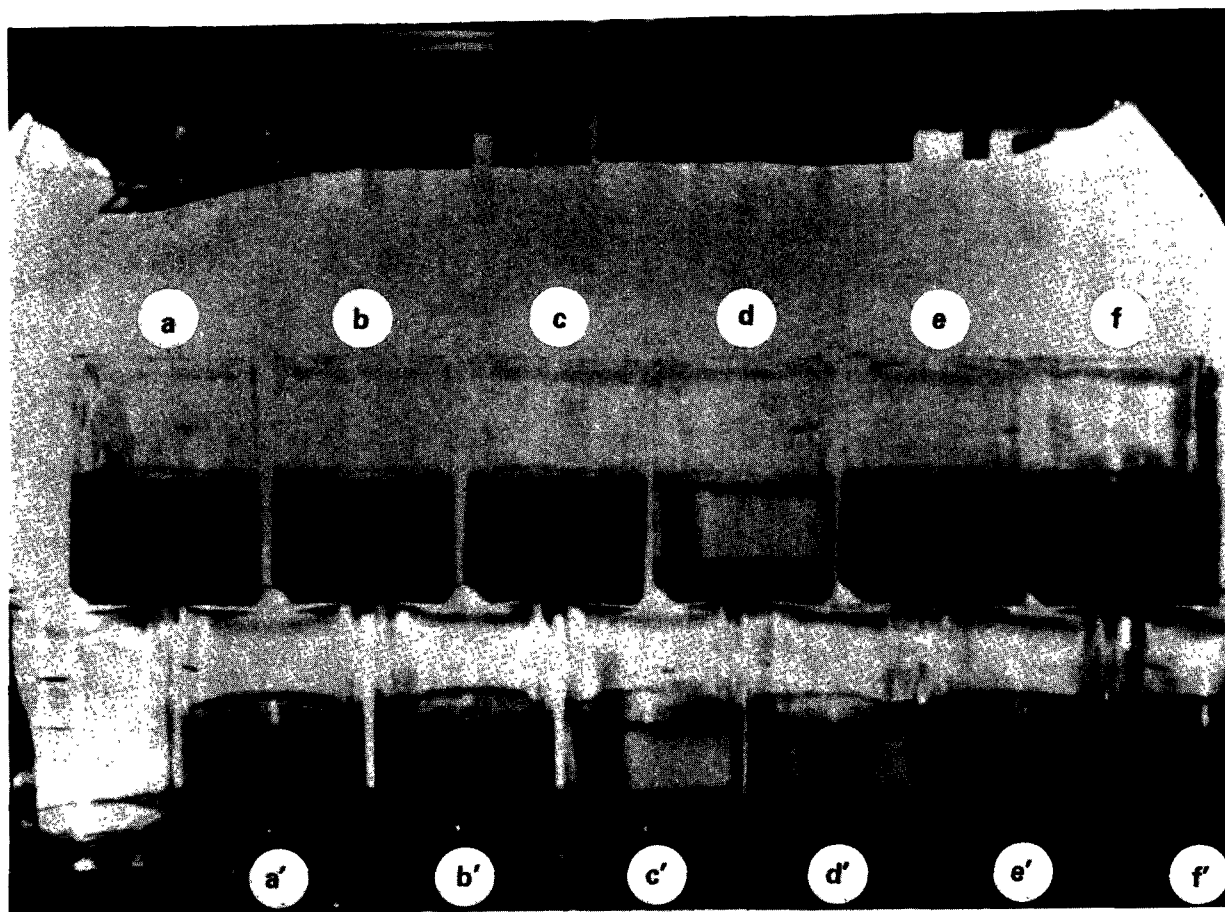


Figure 14. Jar tests show mixed effluents with addition of, left to right, 25, 50, 75, 100, and 150 mg/l Fe³⁺; the control, no addition, is jar f. A Mosinee effluent was used composed of: (bottom row) paper machine and high density sewer effluent, and (top row) the above with 1 percent v/v digester room effluent.

The chemical concentrations of ferric chloride and alum required to effectively remove both suspended solids (for high supernatant clarity) and BOD₅ was higher for the "total" effluent than for the various composite streams (Figure 17). As the individual streams were removed from the system, the quantity of flocculants was reduced, especially for those mixtures without the "CM," wet room or Number 6 sewers. The Number 5 sewer stream had good removal characteristics, with low chemical requirements, as an individual stream, and omitting it from the mixture did not appear to enhance the BOD₅ removal.

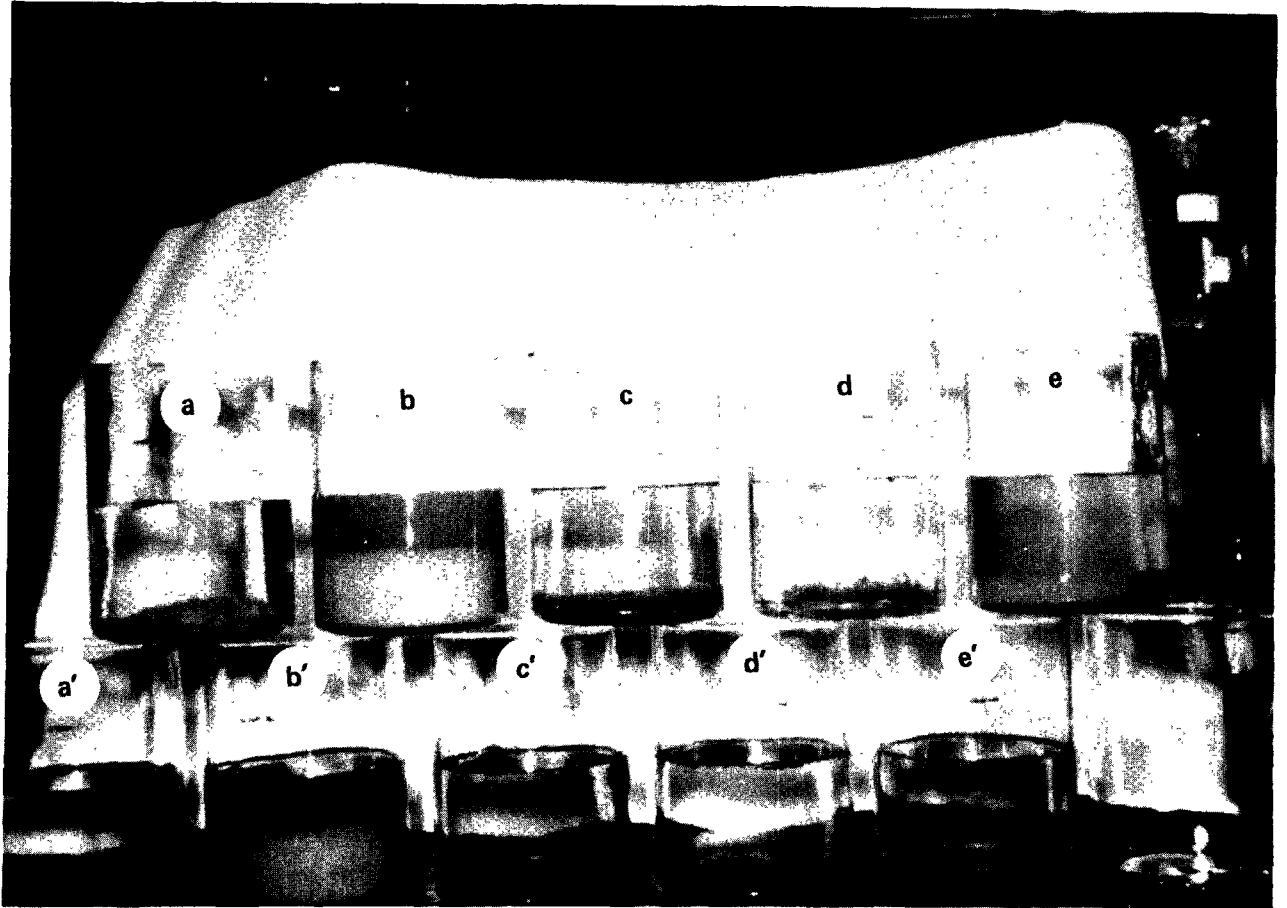


Figure 15. Jar tests with Combined Locks individual sewer effluents, a-e (main, "CM," wet room, machine No. 5 and machine No. 6). Top row: with 25 mg/l Fe^{3+} ; bottom row: with 20 mg/l alum. Control wastes did not settle without additives and are not shown.

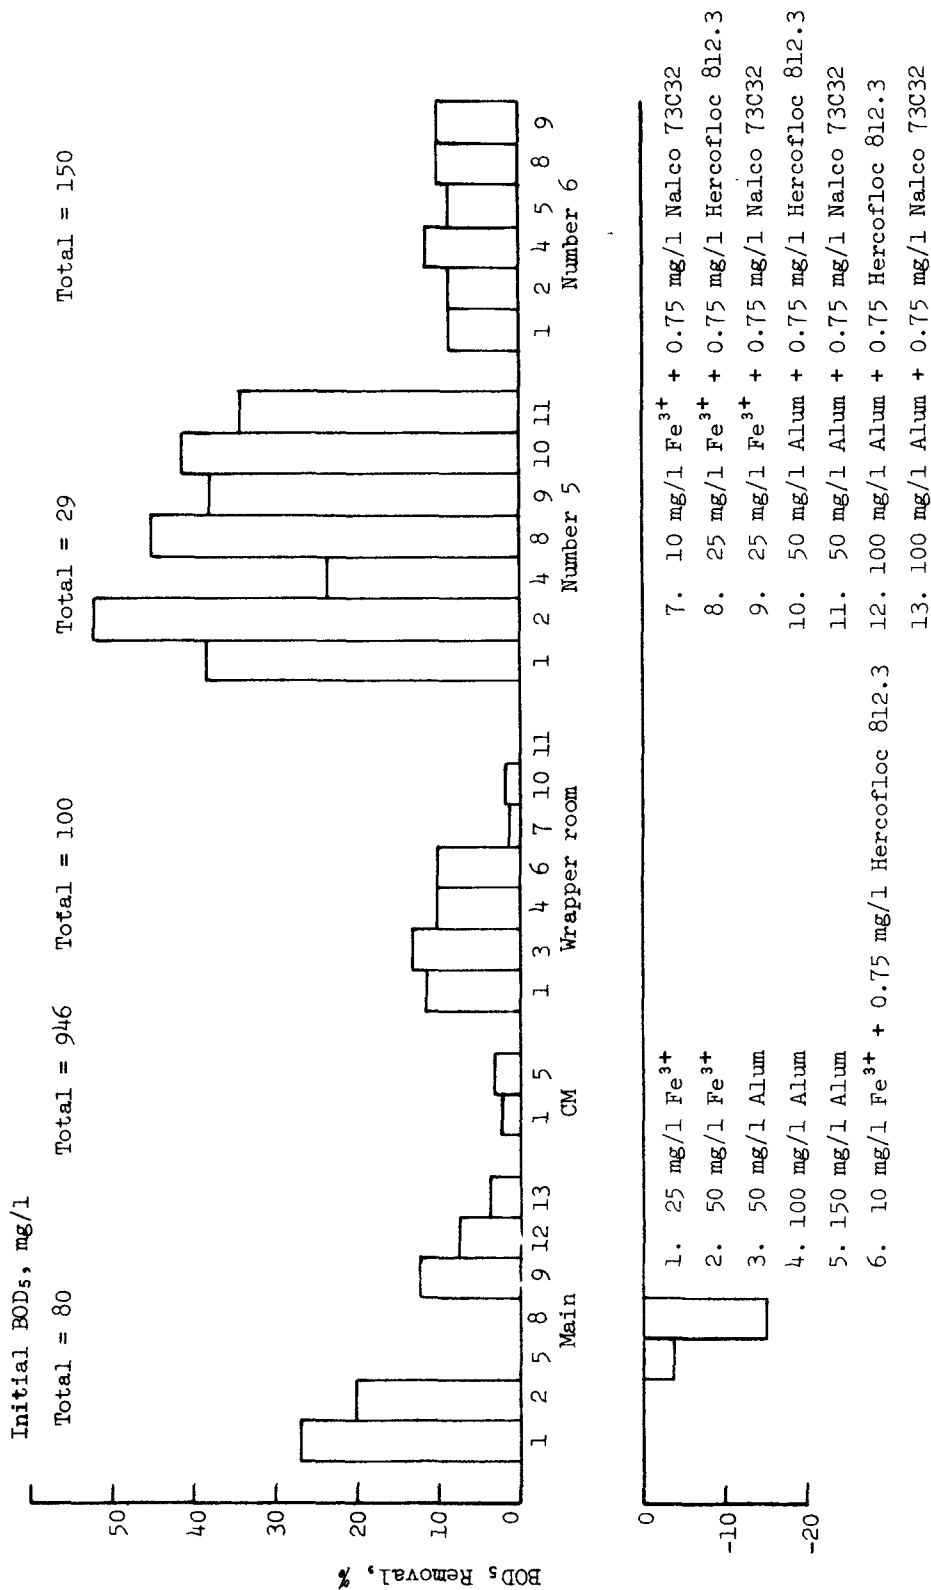


Figure 16. Jar tests on wastes from individual sewers in the Combined Locks mill.

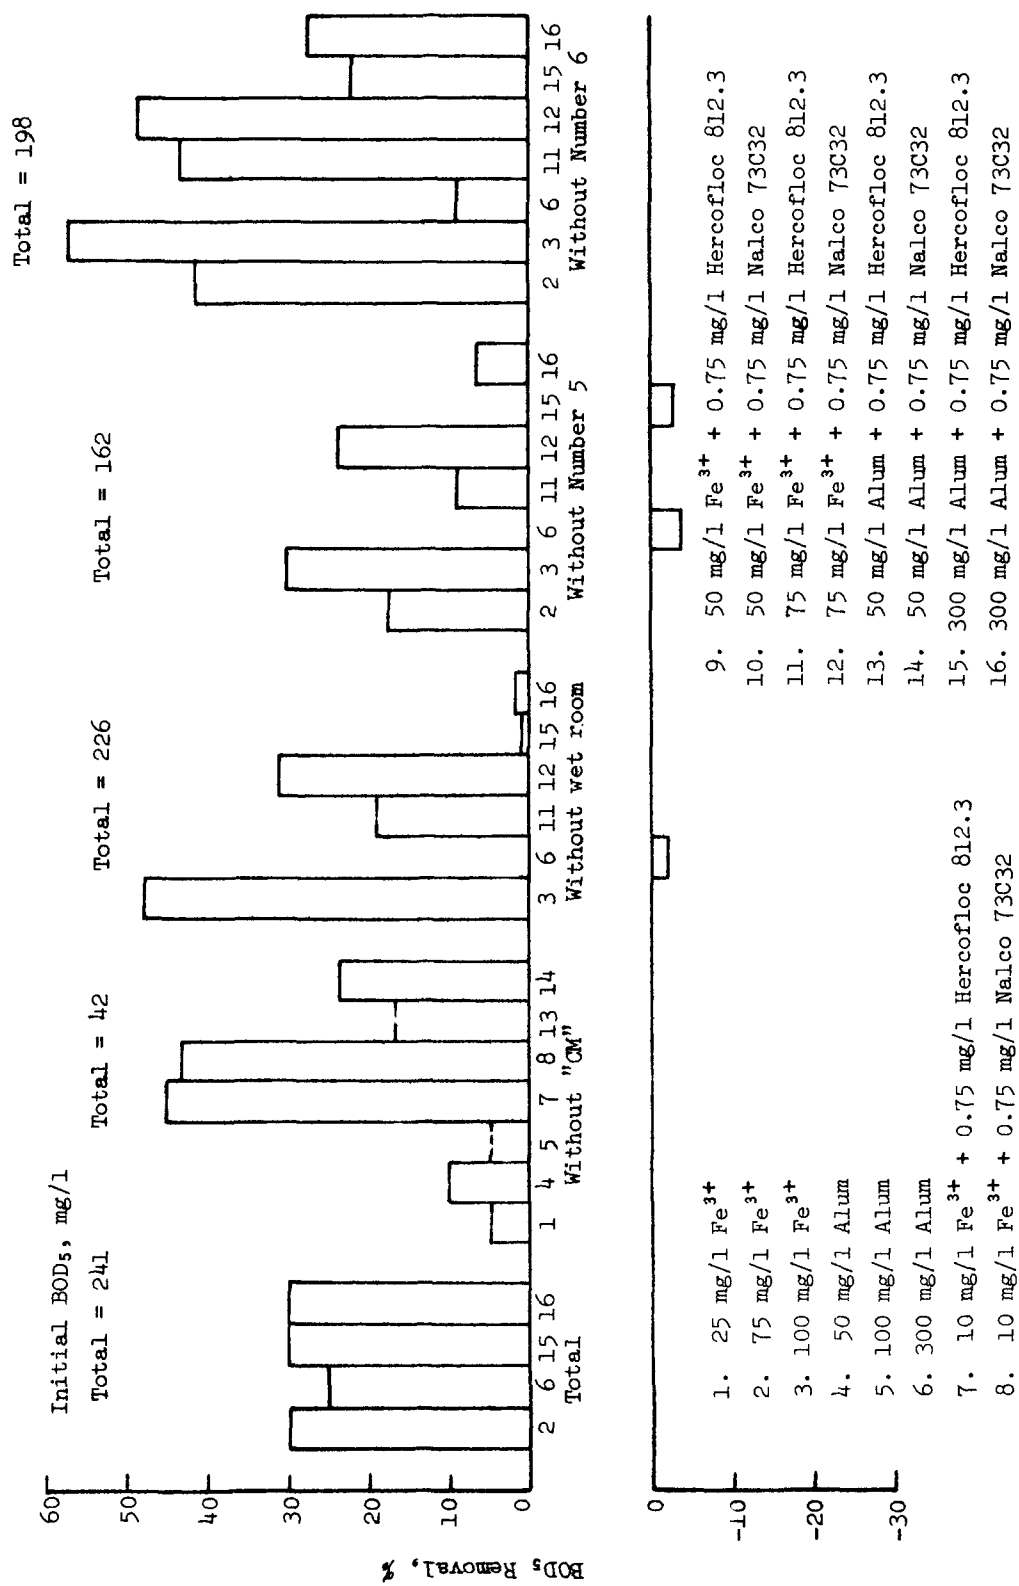


Figure 17. Jar tests on special composites of Combined Locks individual waste streams.

SECTION VIII

DISCUSSION OF THE MECHANISMS OF SOLUBLE BOD₅ REMOVAL

The studies with jar and pilot-scale clarifiers have readily confirmed that substantial quantities (as much as 20 to 50 percent) of the soluble BOD₅ are removed in clarifiers by coagulation aids and that the removal can be a significant factor in the treatment of pulp and paper mill waste waters.

Our data show that, at least to some extent, the reactions leading to improved BOD₅ removal can be optimized in well operated and controlled clarifier systems. Several studies were made in an attempt to better define the mechanism for reduction of soluble BOD₅ during the treatment of process waters in primary clarifiers.

It had been evident from the beginning of the study that some of the soluble BOD₅ could be removed from the waste stream by several processes (membrane, ion-exchange) and that no one mechanism could be credited for the entire effect.

GEL CHROMATOGRAPHY STUDIES

The components responsible for the soluble BOD₅ in clarifiers can be divided into two classes, wood-derived chemicals and additives. The wood derived chemicals include degraded cellulose, hemicellulose, hemicellulose degradation products (reducing sugars, acetic acid, methanol and uronic acids), extractives and in small, perhaps minor amounts, metabolites common to living tissues (adipic acid, oxalacetic acid, etc.). Additives used in papermaking include starches, polysaccharides, gums, latexes, resins, dyes, etc. Some mills will also have organic solvents such as methanol, acetone, etc., which are biodegradable. The organic solutes that pass the 0.45- μ m filter probably comprise colloids, low molecular weight polymers, oligomers, monomers and simple organic compounds.

To better understand the removal of soluble BOD₅ by coagulation, we treated the effluent from a chemimechanical mill (Combined Locks mill) with the various flocculating agents. Using gel chromatography we measured molecular size distribution before and after flocculation and clarification.

Samples were filtered on a 0.45- μ m filter prior to chromatography. The gel chromatography was carried out on Sephadex G-50, a gel which excludes (allows no equilibration with the gel pores) molecular weights 10,000 and above and includes (allows complete equilibration with the gel pores) molecular weights of 500 and below. Molecular weights between 500 and 10,000 are fractionated according to the number of pores with which the molecules equilibrate.

Figure 18 shows the TOC (total organic carbon) of 2 ml of a tenfold concentrate as it elutes from a 1 x 55-cm column. The second curve shows that after flocculation with 70 mg/l ferric chloride not only are large molecular weight residues removed, but also low molecular weight molecules. The curves in Figure 19 were obtained when a similar sample (1-ml sample of fivefold concentrate) was fractionated on Sephadex LH 20 (mol. wt. 5000 to 200) before and after coagulating with 10 mg/l of Nalco 73C32, a cationic polyelectrolyte and analyzed for aldoses by the phenol-sulfuric acid test (8). The low molecular weight peak almost disappeared.

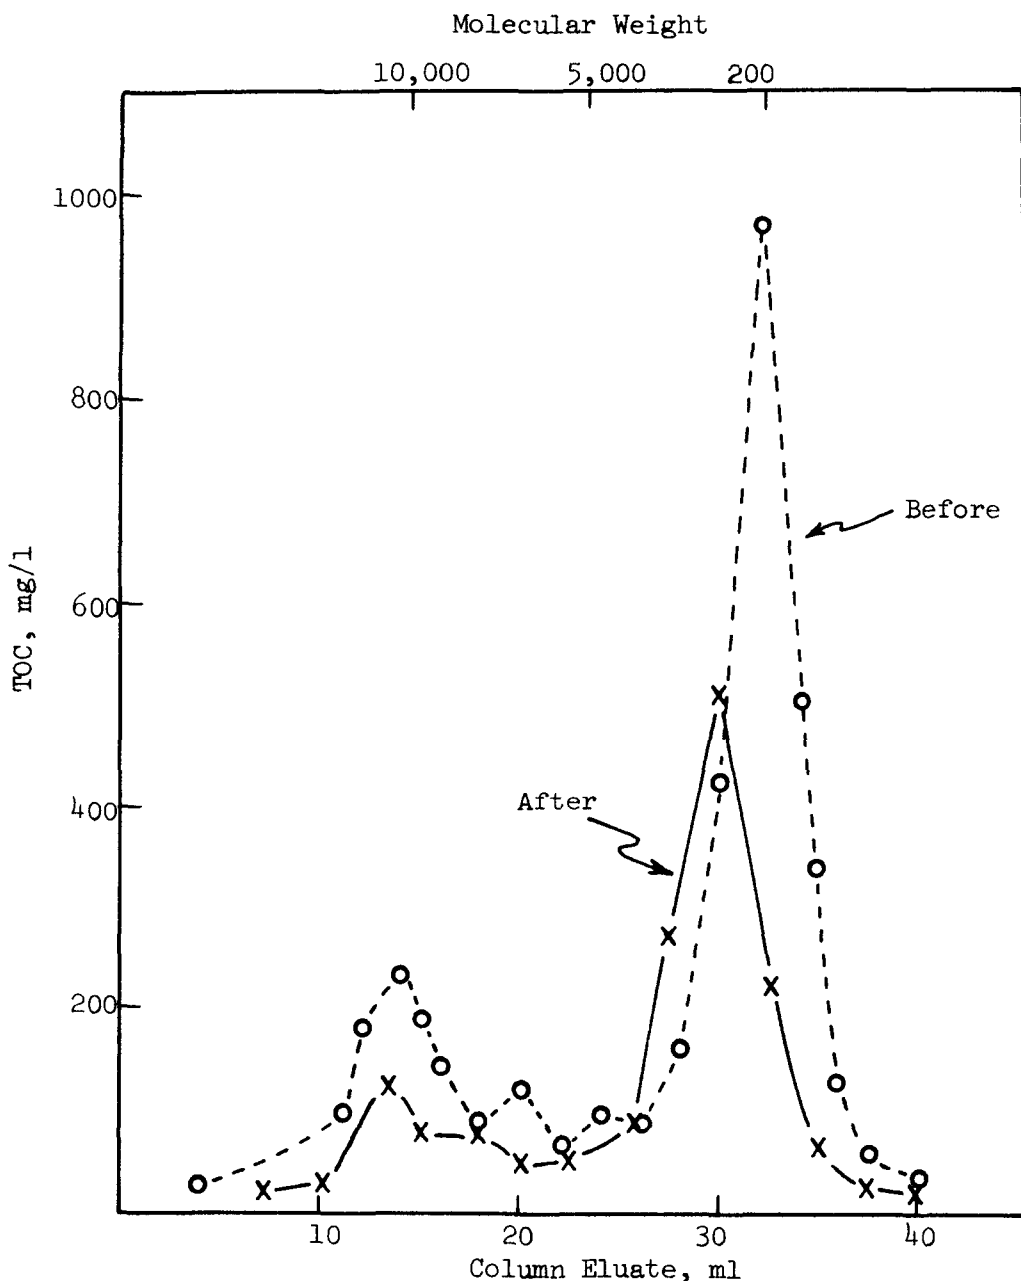


Figure 18. TOC and molecular weight distribution of gel-chromatographed chemimechanical mill effluent before and after coagulation with 70 mg/l Fe^{3+} as ferric chloride.

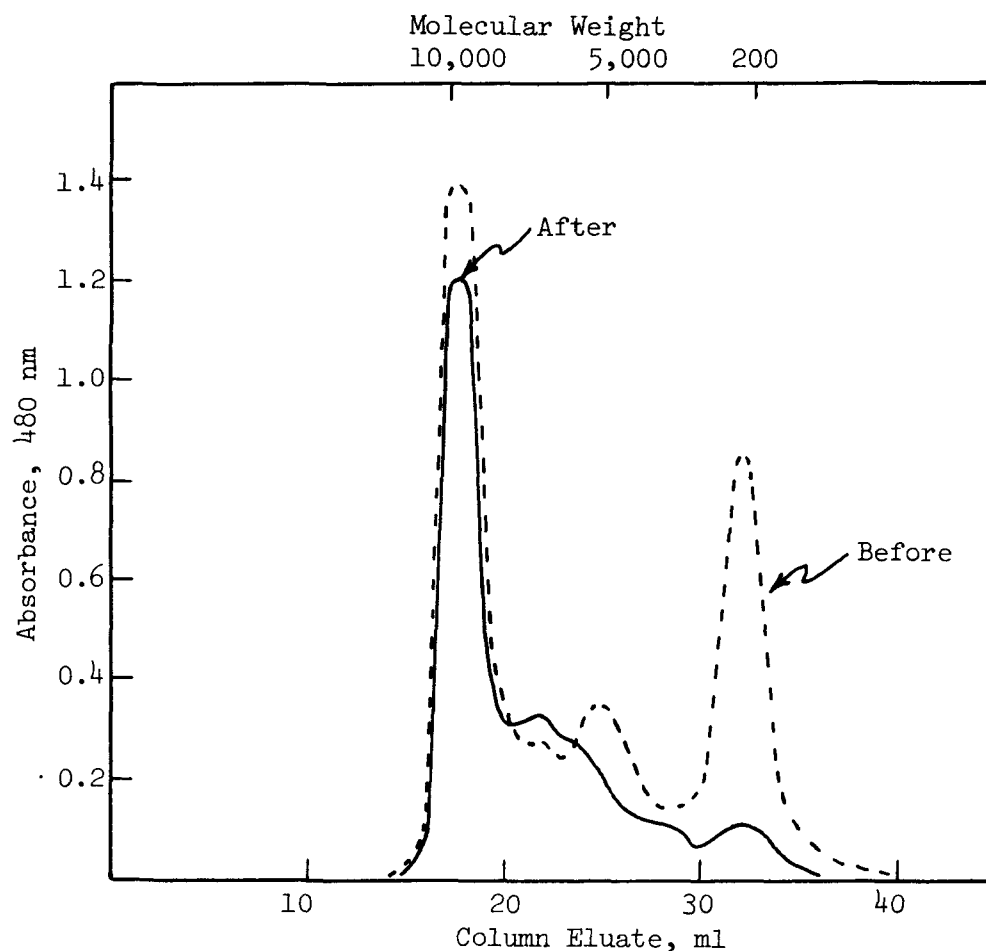


Figure 19. Phenol sulfuric acid test for aldoses and molecular weight determination of gel-chromatographed chemi-mechanical mill effluent before and after coagulation with 10 mg/l Nalco 73C32. One-ml samples of eluate were analyzed.

The phenol-sulfuric acid test measures aldoses and polymers of aldoses when borate interference is observed. The solutions analyzed in this report showed enough borate sensitivity to indicate the test was responding primarily to aldoses and polymers of aldoses and not to noncarbohydrate aldehydes.

When a sample fractionated on Sephadex G-50 was divided into three fractions corresponding to high, medium and low molecular weights and analyzed for TOC, aldose and BOD₅, the results summarized in Table 39 were obtained. The percentage change for the soluble BOD₅ was not as great as that observed for the aldoses or TOC. Apparently not only low molecular weight biodegradable materials were removed but also low molecular weight nonbiodegradable organics.

Das and Lomas explored the different mechanisms of the flocculation of cellulose fines with the cationic polymer polyethylenimine (2). They were

able to show that bridging (the adsorption of two sections of a polymer to two colloids) was a significant part of the cellulose fines flocculation. Such a mechanism could also occur with the other polyelectrolytes and with ferric chloride which hydrolyzes and polymerizes to a polyelectrolyte (14). The mechanisms for the coagulation of cellulose fines involved collapse of their double layer followed by adsorption and bridging. Lower molecular weight residues were generally difficultly adsorbed. Their participation in coagulation probably depends on salt formation and chelation. Such salt formation by hydrolyzed iron can be demonstrated with gel chromatography. Figure 20 shows the elution curve for a mixture of ferrous ammonium sulfate and sodium gluconate. The complexes absorb ultraviolet light and are, therefore, detectable with the UV absorptiometer at 280 nm. Iron values were obtained by the o-phenanthroline test. Because the curve shows that at a pH of 2.0, most of the iron elutes from Sephadex LH-20 and G-15 (fractionation range 150 to 10,000) in the highest molecular weight fraction, the complexes probably have molecular weights of 10,000 and above. Figure 21 shows the distribution of the complexes when the pH of the solution was 7.0. At higher pH more of the iron was in the lower molecular weight fractions.

TABLE 39. REMOVAL OF DIFFERENT MOLECULAR WEIGHT FRACTIONS OF ORGANIC RESIDUES BY FLOCCULATION

Effluent treatment	Sample ^a			
	UNF	HMW	MMW	LMW
Phenol-sulfuric acid test; total absorbance, 480 nm				
Filtered	--	7.5	3.9	5.2
Flocced ^b and filtered	--	3.0	2.4	2.5
Reduction, %	--	59.9	38.6	51.9
TOC, mg/l				
Filtered	3424	774	457	2301
Flocced ^b and filtered	2150	320	272	1387
Reduction, %	43.9	58.6	40.5	39.7
BOD ₅ , mg/l				
Filtered	3840	552	487	2689
Flocced ^b and filtered	3080	379	368	2131
Reduction, %	19.8	31.3	24.4	20.7

^aUNF, unfractionated; HMW, high molecular weight (10,000 and above); MMW, middle molecular weight (500-10,000); LMW, low molecular weight (500 and below).

^bFlocced with ferric chloride, 70 mg/l Fe.

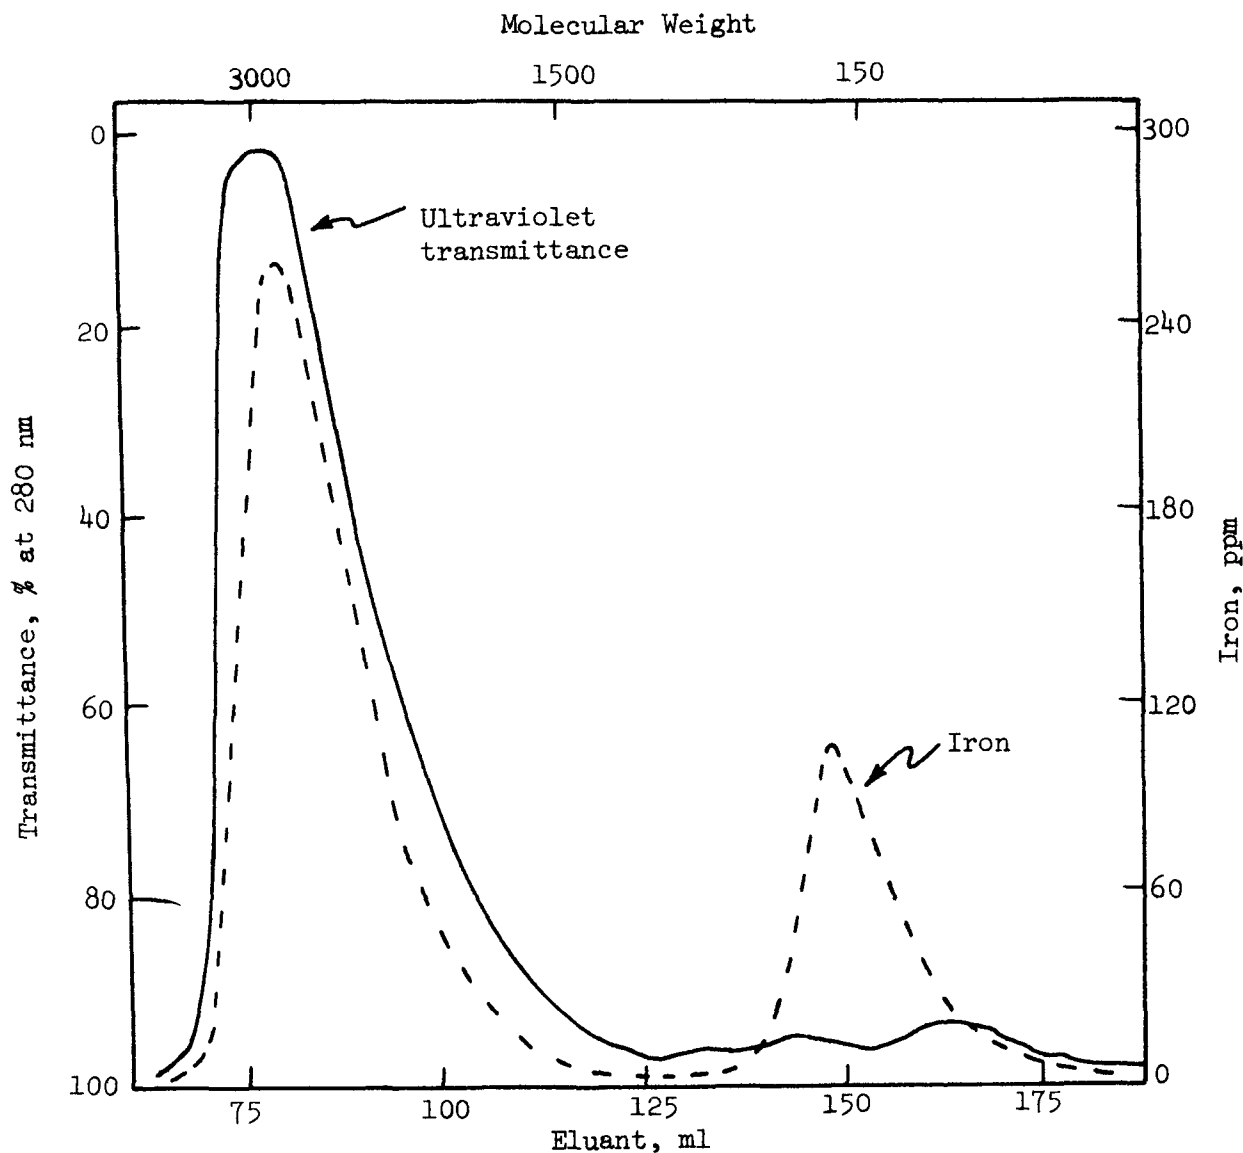


Figure 20. Ultraviolet light transmittance profile and molecular weight distribution of a gel-chromatographed solution of sodium gluconate and ferrous ammonium sulfate, pH 2.

If these biodegradable low molecular weight residues which participate in the coagulation are carboxylic acids, then the mechanism for their removal could be the complexing and/or chelating of the Fe^{3+} of the ferric chloride. As the ferric chloride hydrolyzes, more and more insoluble oligomeric forms of the hydroxide are formed. Whether or not the iron system would flocculate the low molecular weight residues without concomitant flocculation of polymers and/or suspended solids was not determined.

The types of carboxylic acids which might be derived from wood and form complexes with iron include the Krebs cycle acids (citric, adipic, oxalacetic, etc.), oxalic, aldonic, and uronic acids, and aromatic acids. Since little ultraviolet absorption was found associated with the low molecular

weight gel chromatography fractions, aromatic residues have not been considered in this phase of the study.

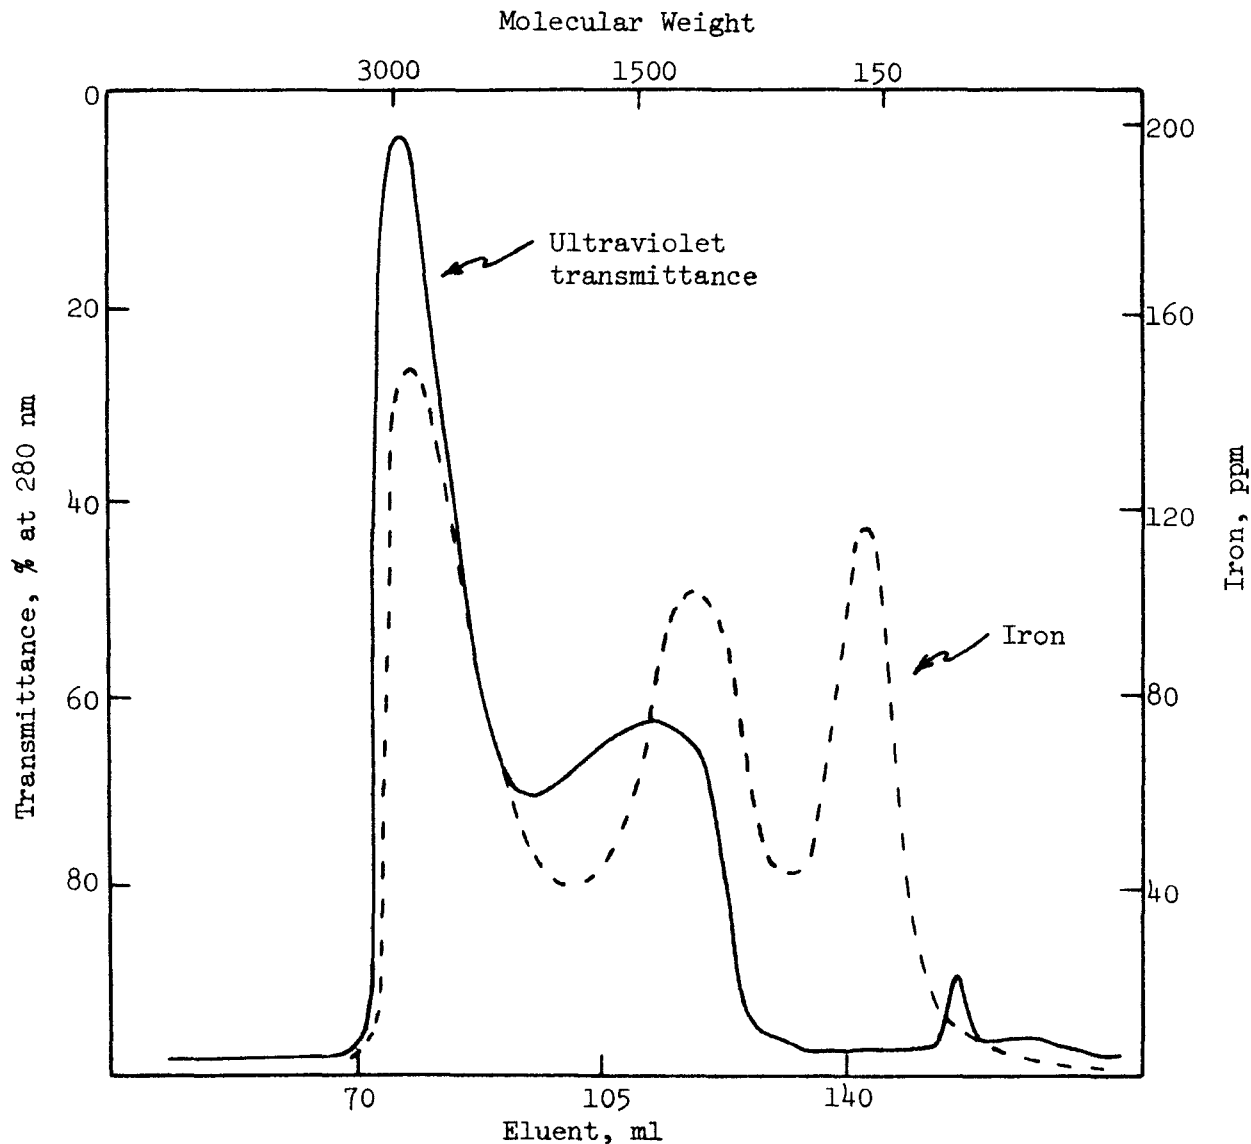


Figure 21. Transmittance and molecular weight distribution of a gel-chromatographed solution of sodium gluconate and ferrous ammonium sulfate, pH 7.0.

The sewer to the Combined Locks clarifier has five principal tributaries two of which gave aldose test responses strong enough for analysis by gel chromatography after the effluent was concentrated fivefold. The column elution curves are shown for the digester room effluent and the paper mill effluent (Figure 22). The digester room effluent showed predominantly high molecular weight residues and the paper mill effluent, low molecular weight residues.

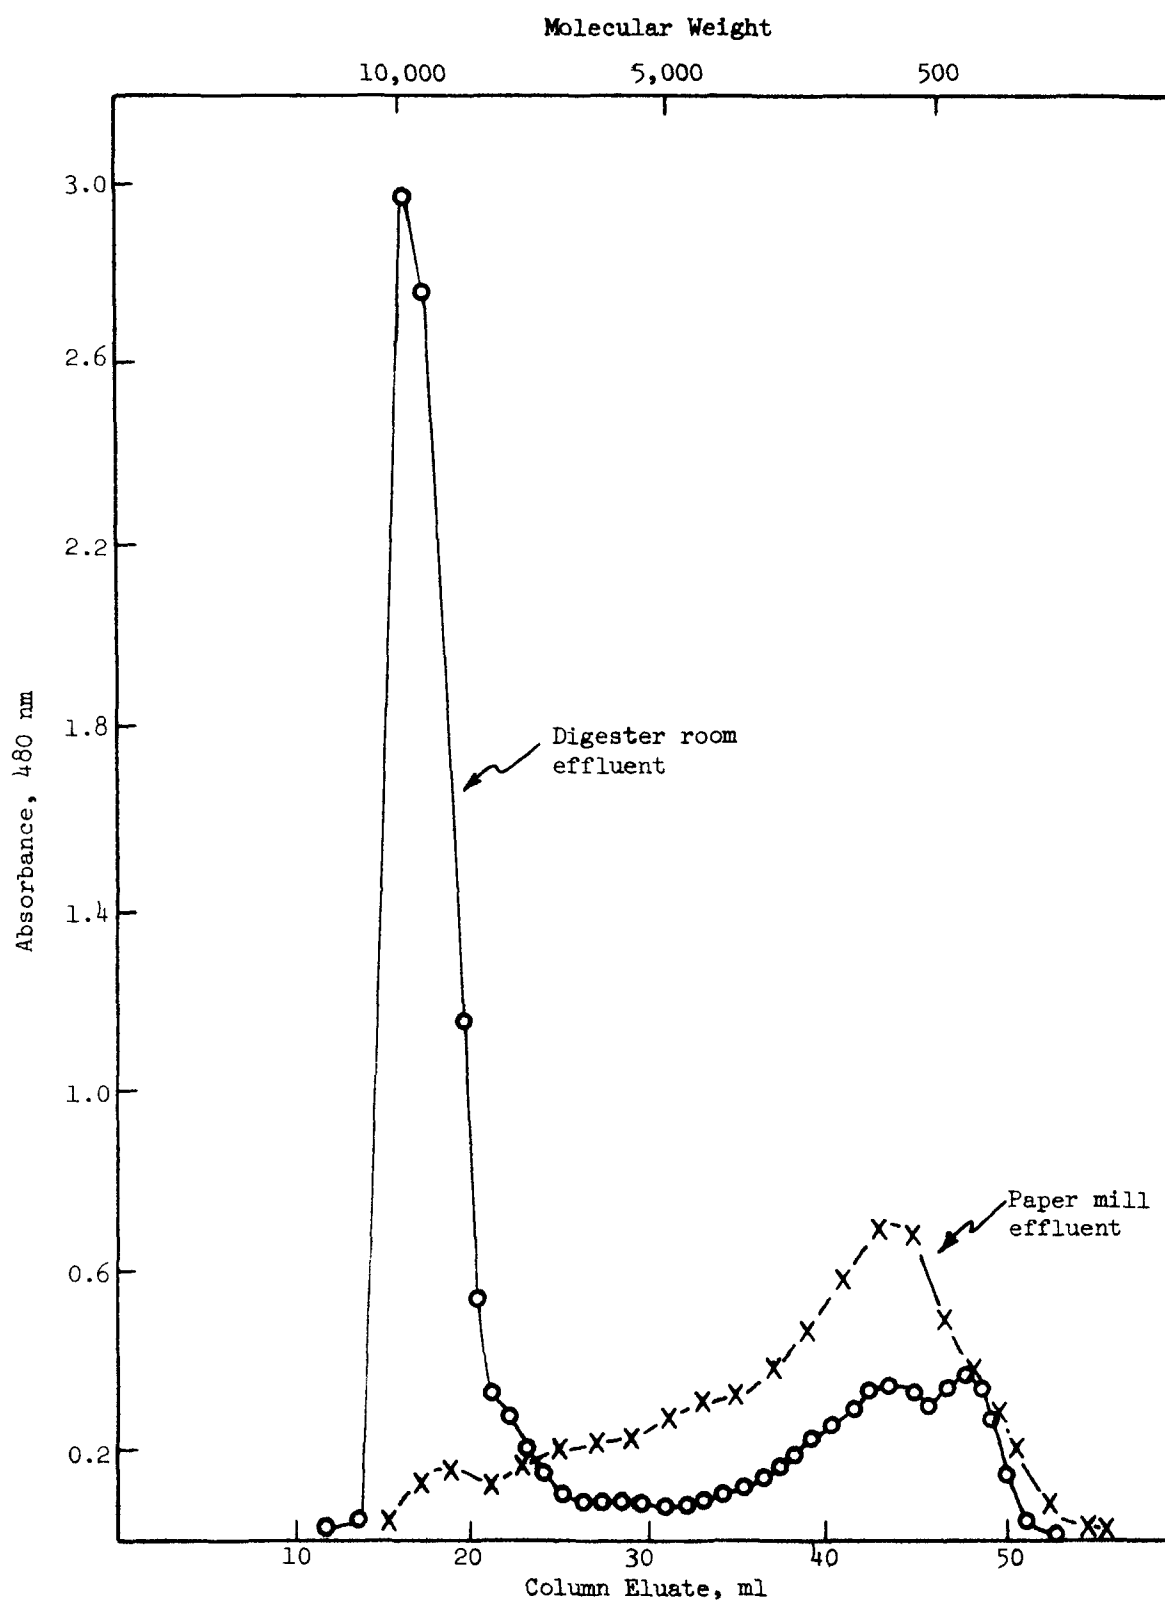


Figure 22. Phenol sulfuric acid test for aldoses and molecular weight distribution of gel-chromatographed chemimechanical pulp mill effluents.

Since this particular mill uses starch as one of its additives, one of the aldoses could be glucose and/or related starch degradation products.

STUDIES ON INFLUENT AND EFFLUENT SAMPLES FROM THE FIELD TRIALS

Clarifier influent and effluent samples from the two trials, at Mosinee and Combined Locks mills, were sent to the Analytical Section of the Institute for carbohydrate and weak acid determinations. Data are given in Table 40 for the results of these analyses on samples from high, intermediate and low soluble BOD₅ removal levels during clarification.

The carbohydrates were determined by gas chromatography after acid hydrolysis and derivative formation (15). The weak acids were determined by passing the sample through a cation-exchange resin column and conductimetrically titrating it with 0.1N sodium hydroxide.

No consistent correlation was apparent between the soluble BOD₅ and the carbohydrate removals, indicating that in the high soluble BOD₅ removals some precursor(s), in addition to other than the oligo- and polysaccharides, were being removed by flocculation and clarification.

There was slight correlation between the soluble BOD₅ and weak acid removal values for these samples, particularly those from the Mosinee study.

STUDIES WITH MODEL COMPOUNDS

On a modest scale we screened model organic compounds for removal from solution by flocculation in order to learn more about the chemical nature of susceptible compounds.

The compounds were selected on the following basis:

1. Those compounds having at least some structural relation to substances found in mill effluents, either as atypical compounds or "families of compounds" (16-18);
2. Those compounds with some BOD₅ without marked "toxic" effects; and
3. Compounds having sufficient solubility so that gas chromatography, total organic carbon or some other convenient analytical procedure could be used to monitor the results of jar tests.
4. Removals of TOC from pure solutions were early recognized to be critically affected by pH. This variable was evaluated carefully and the interesting and probably important results provided in the following figures are discussed with the realization that the highest levels of TOC removal were often noted at pH levels outside the ranges normal for mill wastes or discharged to treatment systems.

The jar tests were made with added fiber in the form of unbleached kraft pulp which had been disintegrated in an Oster blender for 5 minutes to provide a surface area for adsorptive bridging. Fibers had increased the removal of BOD₅ in some of our earlier work (Section V). This effect was confirmed with two runs with hydroxybenzoic acid and p-methylbenzoic acid with Fe³⁺

TABLE 40. REMOVAL OF CARBOHYDRATES AND WEAK ACIDS FROM MOSINEE AND COMBINED LOCKS
WASTE STREAMS BY PILOT-SCALE CLARIFICATION^a

Total BOD ₅ , mg/l		Soluble BOD ₅ , mg/l		Carbohydrates, mg/l		Weak acids, meq/g ^b		Removal, %			
								BOD ₅ ^c		Carbo- hydrates	
Influent	Effluent	Influent	Effluent	Influent	Effluent	Influent	Effluent	T	S		Weak acids
Mosinee Samples											
158	83	117	78	8.0	4.2	4.7	0.12	48	33	48	97
160	90	136	90	9.0	5.6	2.1	0.16	44	34	43	92
148	122	108	92	5.7	8.7	4.6	3.0	18	15	-53	35
147	120	110	98	5.5	6.4	2.9	1.4	18	11	-16	52
150	136	112	108	15.8	4.8	1.8	1.8	9	4	70	0
94	92	79	76	4.8	9.4	2.9	1.2	2	4	-8	59
Combined Locks Samples											
226	114	107	82	10.5	18.4	3.1	1.7	50	23	-75	45
180	84	104	78	22.9	31.0	1.5	1.2	53	25	-35	20
386	239	234	216	46.8	62.2	3.2	2.3	38	8	-33	28
267	240	211	202	19.7	24.8	3.7	3.3	10	4	-26	11

^aSamples were from high, medium, and low BOD₅ removal levels during clarification.

^bMilliequivalents/gram of solids.

^cT, total; S, soluble.

(as FeCl_3) at various pH's, with and without the addition of fibers (Figure 23). TOC analyses were used to monitor changes in chemical concentrations of the model compounds before and after clarification.

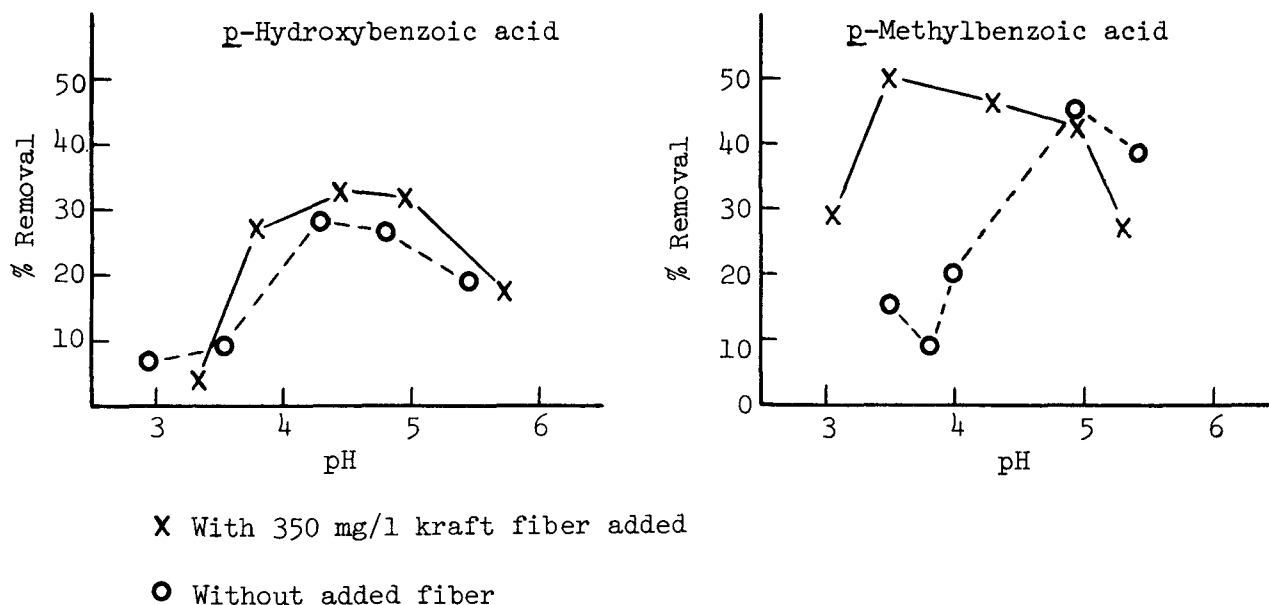


Figure 23. Effect of pulp fibers on removal of soluble compounds with 100 mg/l Fe^{3+} (as FeCl_3) at various pH's. —, 350 mg/l kraft fiber added; ----, no fiber added.

Solutions were made from an amount of the model compound calculated to give a TOC level of 90-95 mg/l in the final volume to be used in the study. This was first dissolved in approximately 4 liters of distilled water; the correct amount of blended fiber was added (350 mg/l final volume), and the volume was brought to either seven or nineteen liters (final volume), depending upon whether one or two sets of jars were to be used for the evaluation.

One liter of the mixture containing the model compound and fibers was added to each of six jars. Five of the jars were treated with flocculating agent (various concentrations) and the sixth was used as an untreated "control." All jars were settled, sampled and filtered (0.45 μm). TOC was determined on the filtrates from the "control" and the five treated samples. All "removal" values are based on a comparison with the TOC concentration of the "control" after filtration. In this way the adsorption of the model compound on the fibers without flocculant addition could be monitored. In all tests the adsorption onto fibers of the controls was less than 8 percent (based on weight calculation), except for the arrowroot starch and dextrose which were found to be 65 and 24 percent, respectively.

Ferric chloride and alum were the primary flocculants used. Alum (Table 41) did not remove significant amounts of model compounds except polygalacturonic acid (87 percent removed at 200 mg/l alum concentration). The highest removal of model compounds obtained with lime up to 500 mg/l was 2 percent.

TABLE 41. TOC REMOVAL FROM SOLUTIONS OF
MODEL COMPOUNDS TREATED IN JAR
TESTS WITH ALUMINUM SULFATE^a

Compounds	Removal of TOC, %
3,4-Dihydroxycinnamic acid	0.0 ^e
Hydroxymalonic acid (tartronic acid)	1.0 ^e
Methylmalonic acid	1.0 ^e
D-Galacturonic acid	1.1 ^e
<u>p</u> -Hydroxybenzoic acid	2.2 ^e
Propanedioic acid (malonic acid)	2.6 ^e
<u>p</u> -Methylbenzoic acid	3.2 ^e
Dextrose	4.0 ^e
Isopentyl alcohol (isoamyl alcohol)	4.7 ^b
1,4-Butanedioic acid (succinic acid)	7.4 ^e
4-Hydroxy-3-methoxycinnamic acid (ferrulic acid)	8.3 ^e
3-Methoxy-4-hydroxy benzaldehyde (vanillin)	9.1 ^e
<u>trans</u> -Butenedioic acid (fumaric acid)	10.1 ^e
Arrowroot starch	11.4 ^d
<u>p</u> -Hydroxycinnamic acid	13.3 ^c
Benzylmalonic acid	34.4 ^e
Polygalacturonic acid	87.0 ^d

^aAll compounds were treated with all levels of alum.
Only the best removals are listed in this table.

^bAlum = 50 mg/l.

^cAlum = 100 mg/l.

^dAlum = 200 mg/l.

^eAlum = 300 mg/l.

Data for the TOC removed when other compounds were similarly tested are given in Figure 24a-e. These data are very complex, with low molecular weight short-chained compounds (acetic acid, ethyl acetate) being removed at a 20 percent level, 2-pentanol and tertiary amyl alcohol showing less than 5 percent removal and hexanedioic acid, 40 percent removal. Several aromatic carboxylic acids had high removals, while galactouronic acid reductions were less than 5 percent (Figure 24e).

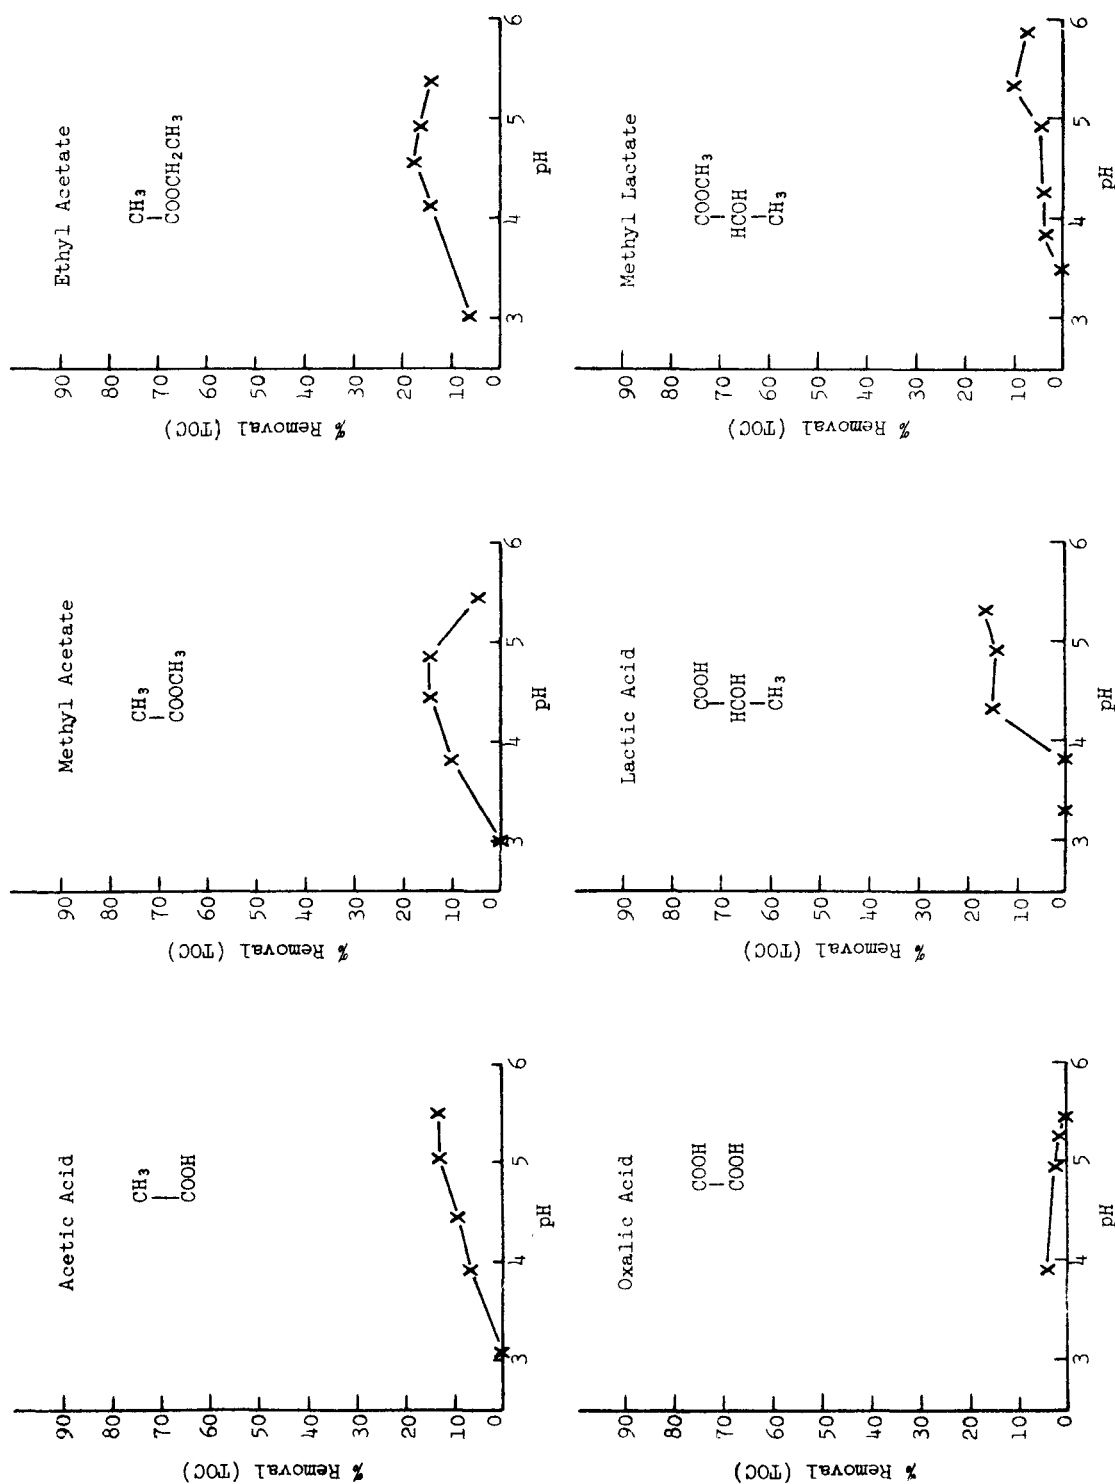


Figure 24a. Effect of kraft pulp fibers at 350 mg/l on removal of soluble compounds with 100 mg/l of Fe^{3+} (as FeCl_3) at various pH's (acetic acid, methyl acetate, ethyl acetate, oxalic acid, lactic acid, and methyl lactate).

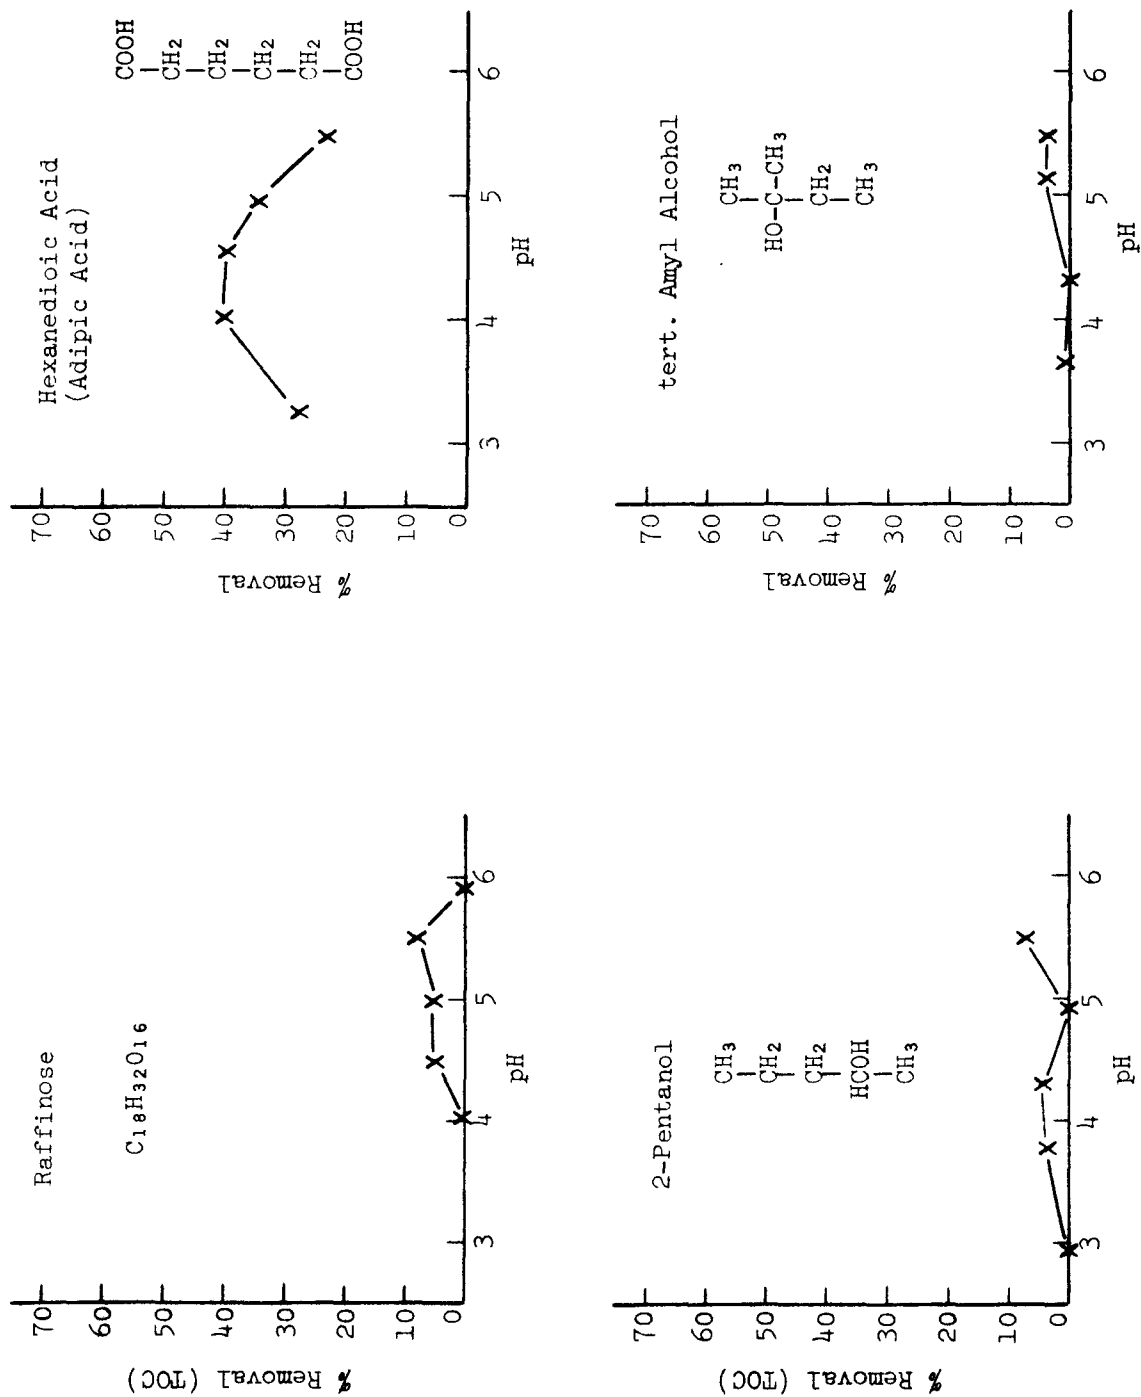


Figure 24b. Effect of kraft pulp fibers at 350 mg/l on removal of soluble compounds with 100 mg/l of Fe^{3+} (as $FeCl_3$) at various pH's (raffinose, hexanedioic acid, 2-pentanol, and tertiary amyl alcohol).

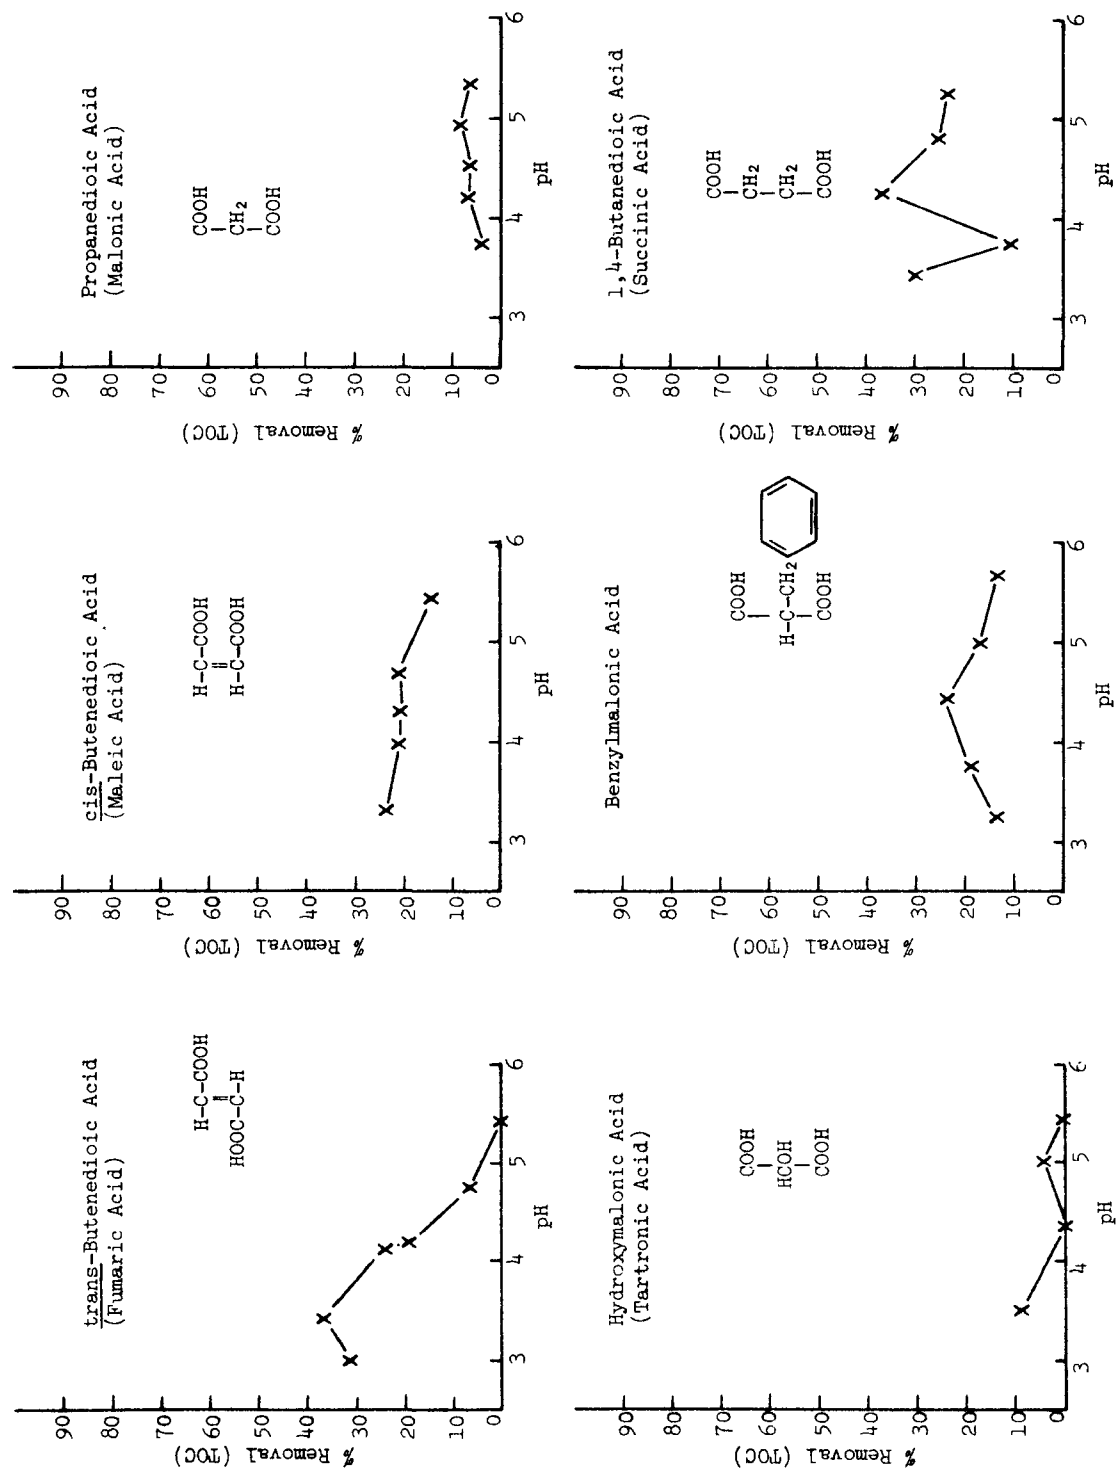


Figure 24c. Effect of kraft fibers at 350 mg/l on removal of soluble compounds with 100 mg/l of Fe^{3+} (as FeCl_3) at various pH's (trans-butenedioic acid, cis-butenedioic acid, propanedioic acid, hydroxymalonic acid, benzylmalonic acid, and 1,4-butanedioic acid).

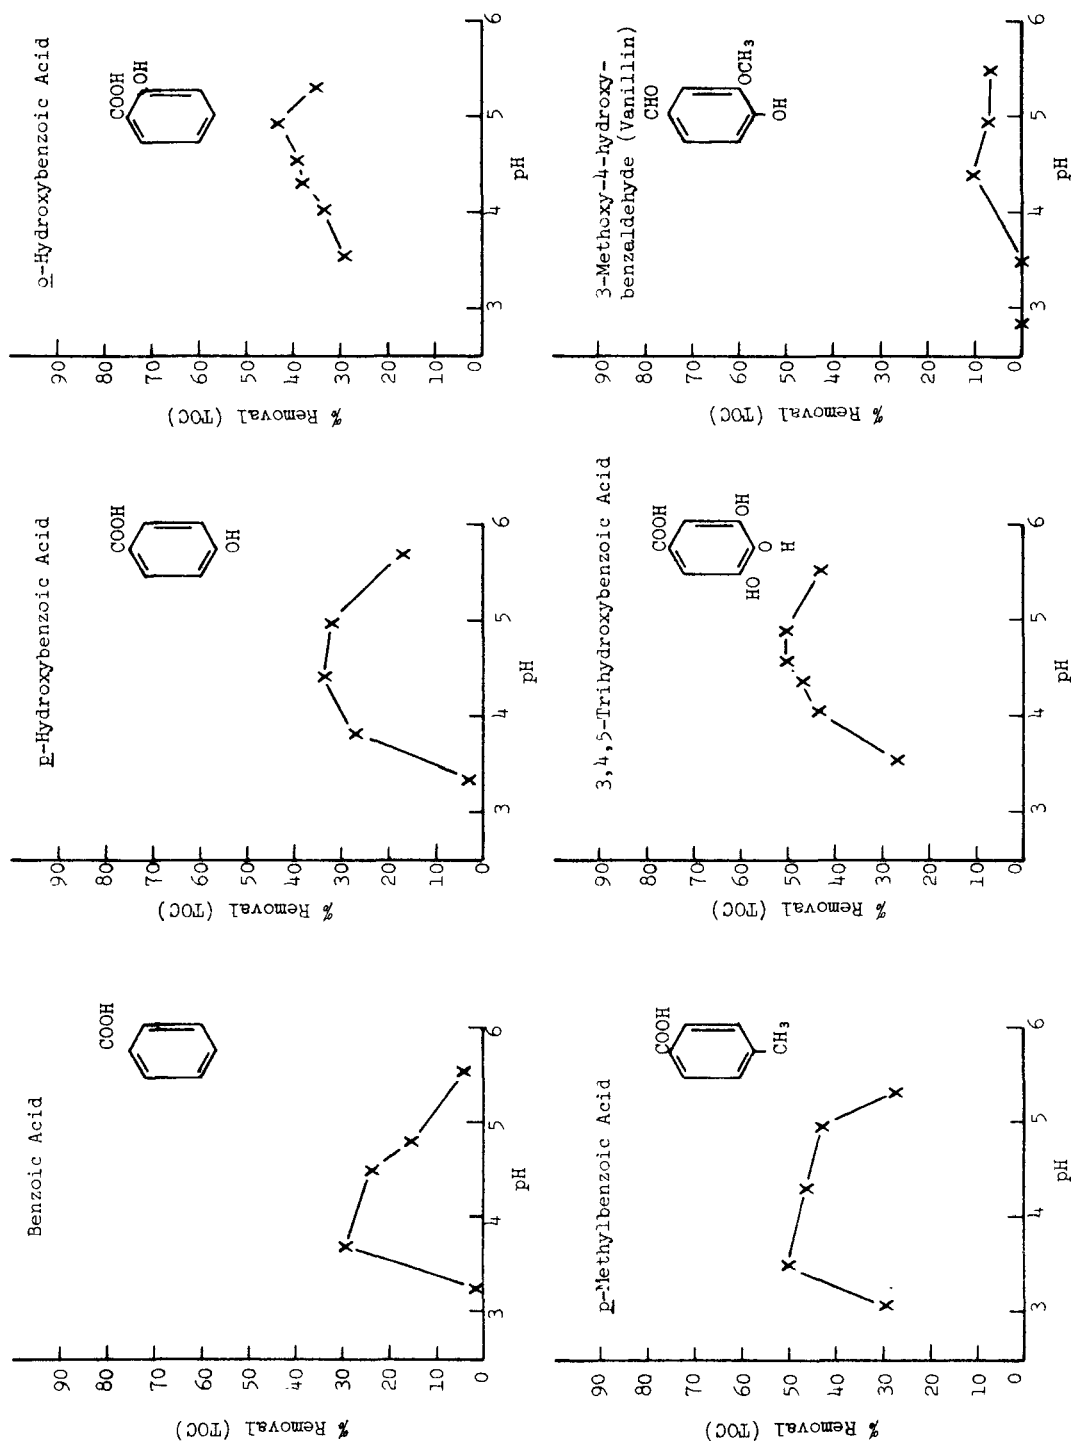


Figure 24d. Effect of kraft fibers at 350 mg/l on removal of soluble compounds with 100 mg/l of Fe^{3+} (as FeCl_3) at various pH's (benzoic acid, p-hydroxybenzoic acid, o-hydroxybenzoic acid, p-methylbenzoic acid, 3,4,5-trihydroxybenzoic acid, and 3-methoxy-4-hydroxybenzaldehyde).

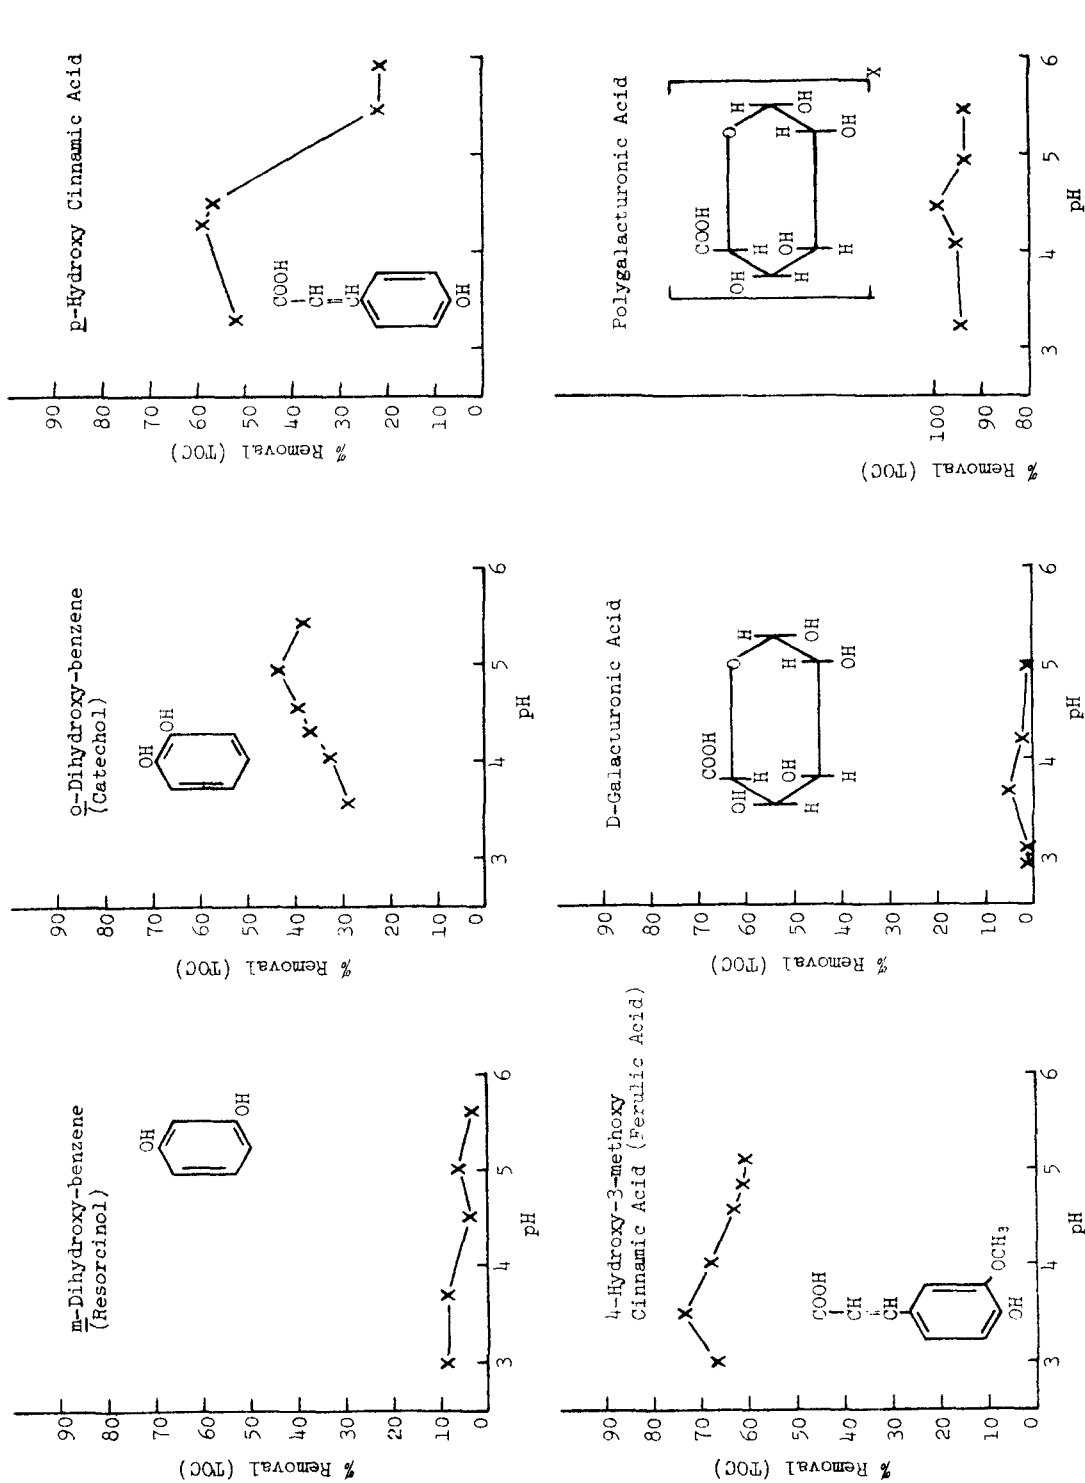


Figure 24e. Effect of kraft fibers at 350 mg/l on removal of soluble compounds with 100 mg/l of Fe^{3+} (as FeCl_3) at various pH's (*m*-dihydroxy-benzene, *o*-dihydroxy-benzene, *p*-hydroxy cinnamic acid, 4-hydroxy-3-methoxy cinnamic acid, D-galacturonic acid, and polygalacturonic acid).

Some of the greater reductions in TOC could be traced to the formation of insoluble salts with the ferric ion, such as for the 3,4,5-trihydroxybenzoic acid (Figure 24d). This would not account, however, for the removal of p-hydroxybenzoic acid from solution since the ferric salt is soluble. Nor would the esters and alcohols, which do not form salts, be removed by this reaction.

The water solubility of the compounds, however, roughly correlates with their removal from solution with Fe^{3+} (Table 42). The compounds group into two classes, those with greater than 10 percent solubility in water and those with less than or equal to 1.5 percent solubility; the former group tends to have removals of 15 percent or less and those in the second class tend to have removals of 25 percent or greater (Figure 25).

We must also consider not only reactions such as the cross-linking of starch phosphates with various cations and the increased complexing tendency observed for K^+ , Ca^{++} , Zn^{++} , Cu^{++} and Fe^{+++} that Wettstein, Neukom and Deuel (19) studied extensively but also the oxalate or salicylate complexes with aluminum or iron as discussed by Stumm and Morgan (14). Stumm and Morgan studied the formation of ferric-hydroxo-complexes and found that they tended to polymerize with other charged molecules at rather exact pH's. Such interactions might be occurring in our jar tests.


Additional work would be required to pinpoint the effects on soluble BOD_5 removal by the organic compound chain lengths or branching, the presence of phenolic or carboxylic groups and the solubility of the individual compounds, all of which appear to have some important relationship to the overall soluble BOD_5 removal mechanism.

TABLE 42. SOLUBILITY IN WATER OF VARIOUS MODEL COMPOUNDS AND THEIR REMOVAL IN JAR TESTS WITH Fe^{3+} AND PULP FIBERS^a

Reference No.	Compound ^a	Solubility, ^b %	Removal, ^a %
1	Acetic acid	Miscible	14
2	Methyl acetate	Soluble	15
3	Ethyl acetate	10	18
4	Oxalic acid	15	4
5	Lactic acid	Miscible	15
6	Methyl lactate	Decomp. in H ₂ O	10
7	Raffinose	15	8
8	Adipic acid	1.44	40
9	2-Pentanol	Soluble	5
10	Tertiary amyl alcohol	12	5
11	Fumaric acid	0.63	37
12	Maleic acid	Freely soluble	24
13	Malonic acid	66	8
14	Tartronic acid	Very soluble	9
15	Benzylmalonic acid	Not given; probably less than 1%	25
16	Succinic acid	8	37
17	Benzoic acid	0.3	30
18	<u>p</u> -Hydroxybenzoic acid	0.8	34
19	<u>o</u> -Hydroxybenzoic acid	0.2	43
20	<u>p</u> -Methylbenzoic acid	Slightly soluble	50
21	3,4,5-Trihydroxybenzoic acid	1.2	50
22	Vanillin	1	10
23	Resorcinol	50	8
24	Catechol	30	43
25	<u>p</u> -Hydroxycinnamic acid	Not given; probably less than 1%	58
26	Ferulic acid	?	73
27	D-galacturonic acid	Soluble	6
28	Polygalacturonic acid	?	99

^aModel compounds and % removal shown in Fig. 23-24e.

^bSolubility in water, from Merck Index, 7th edition.

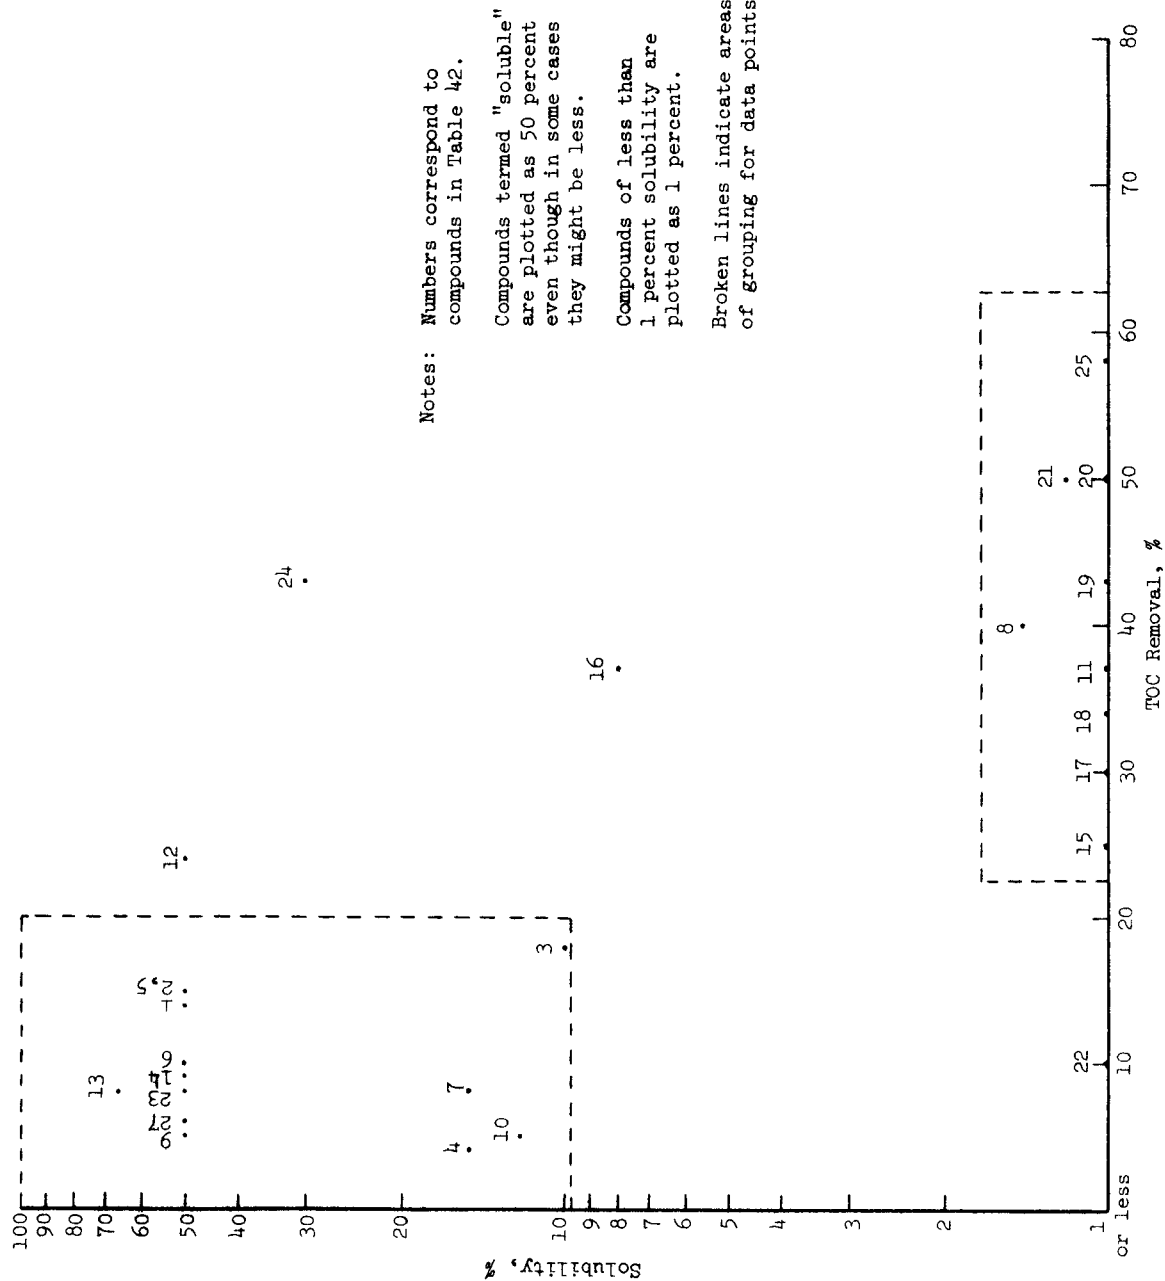

Notes: Numbers correspond to compounds in Table 42.

Compounds termed "soluble" are plotted as 50 percent even though in some cases they might be less.

Compounds of less than 1 percent solubility are plotted as 1 percent.

Broken lines indicate areas of grouping for data points.

Figure 25. The model compounds shown in Figures 23-24e cluster in two groups on the basis of solubility in water and removability with Fe^{3+} .

SECTION IX

AREAS FOR COST REDUCTIONS

This research study on the mechanisms for the BOD₅ removal in clarifiers was not intended to cover comparative process economics. However, evaluation of the data obtained in the laboratory and practical observations in the field studies indicate that improvements in the clarification process will reduce costs. Studies on the flows from individual process sewers demonstrated that treatment which removes soluble BOD₅ prior to the clarifier is likely also to reduce the overall cost for the total system of treatment.

SEPARATION OF FLOWS ADVERSELY AFFECTING CLARIFICATION EFFICIENCY

There are several ways to reduce costs, and careful control of the quality of the in-flow to the clarifier is one of them. Proper clarifier performance (reduction of suspended solids, COD, BOD₅, etc.) is dependent upon sedimentation and flocculation properties of the influent flow. The input of lignin and other pulping and bleaching constituents having colloidal and dispersant properties is of particular concern. The reduction or elimination of flows containing such materials, and particularly the containment and separate treatment of large spills of them, should substantially improve the clarification efficiency and should have high priority in programs for cost reduction in waste treatment. Revised handling should produce the following substantial economies:

1. The capital investment for a clarification system will be less when the clarifier size is reduced;
2. Reagent and other operating charges will be less as clarifier efficiency improves;
3. Clarifier performance in all categories, including the amount of BOD₅ removal, should be greatly improved;
4. Although no measurements were undertaken in this study, sludge dewatering, sludge volume and sludge disposal problems were apparent and should be subject for further development;
5. Needs and costs for subsequent (secondary biological) treatment may be significantly reduced in terms of capital cost and operating charges, and the need for secondary clarification may also be reduced.

OPTIMIZING THE TYPE AND AMOUNT OF CHEMICAL ADDITIVE

This project also showed the importance of optimizing the amounts and types of flocculating agents for various clarifier inflows. Different chemical additives are needed for different mills. Process fluctuations and changes affecting clarifier performance were apparent within the short term of each mill field trial.

Operating experience may make possible the development of routines for addition of chemicals when the effluents change. The rising trend toward development and use of computerized systems to control the manufacture of pulp and paper may logically extend to automated changes during effluent treatment.

Of the two mill clarifiers used in the field studies, one was utilizing chemical additives routinely and the other clarifier was well equipped to use flocculating chemicals. Capital costs for additional chemical feeding and mixing equipment would not be a major expense. Operating charges for the chemical additives that we used was about 3¢ to 10¢ per 1000 gallons of clarifier inflow (Table 43). Since these chemicals might logically replace less efficient additives already being used, cost could be considerably less in actual practice. The efficient use of chemicals would, moreover, be expected to give a return in reduced overall waste treatment costs. The actual cost of chemical additives to remove soluble BOD₅ cannot be adequately assessed short of detailed engineering cost studies to fit the situations in each mill.

TABLE 43. CHEMICAL COSTS FOR CLARIFICATION

Type of flocculant	Required, mg/l	Cost, ^a ¢/1000 gallons
Fe ³⁺ ^b	25	2.72
	50	5.44
	100	10.88
Alum ^c	100	3.13
	200	6.26
	300	9.39

^aAddition of 0.75 mg/l Hercofloc 812.3 would add 0.5¢.

^bAs ferric chloride (FeCl₃•6H₂O) at \$90/ton.

^cAluminum sulfate•16 H₂O at \$75/ton.

SECTION X

REFERENCES

1. Gehm, H. State of the Art Review of Pulp and Paper Waste Treatment. Environmental Protection Technology Series, EPA-R2-73-184, 1973.
2. Das, B. S., and H. Lomas. Flocculation of Paper Fines. I. Adsorption of a Flocculation by Polyelectrolytes. II. Study of the Nature of the Solid Surface and Soluble Impurities. Pulp Paper Mag. Can. 74(8): 95-100, 1973.
3. Williams, D. G. Minimizing Chemical and Fines Buildup in White Water by Chemical Means. Tappi, 56(12):144-7, 1973.
4. Back, E. L. Note on Dissolution of Wood Material During Pressurized Refining and Water Pollution Consequences. Svensk Papperstid. 77(11): 394-6, 1974.
5. Standard Method for the Examination of Water and Waste Water. 13th Edition, APHA Method 219, 1971.
6. Standard Method for the Examination of Water and Waste Water. 13th Edition, APHA Method 220, 1971.
7. Hodge, J. E., and B. T. Hofreiter. In: Methods in Carbohydrate Chemistry, Whistler and Wolfgram, Academic Press, New York, 1962. 388 p.
8. Collins, J. W., A. A. Webb, and L. A. Boggs. Characterization of lignin and Carbohydrate Residues Found in Bleach Effluents. Tappi, 54(1):105-110, 1971.
9. Chamberlain, N. S., and R. J. Keating. Water Technology in the Pulp and Paper Industry. TAPPI Monograph Series No. 18:45-7, 1957.
10. Gould, M., H. Lundgren, and J. Walzer. Primary Treatment by a Flotation System. Tappi 9th Annual Environmental Conference, Houston, Texas, May 15-17, 1972.
11. Jensen, W., and E. Meloni. Use of Waste Chemicals in Kraft Mill Effluent Treatment. Paper World Research and Development Number, 1974.
12. Lueck, B. F., and B. McCuaig. Continued Study of Advanced Waste Treatment Systems for Combined Municipal and Pulp and Paper Wastes. The Institute of Paper Chemistry, Report No. 5 for Project 3029, Upper Great Lakes Regional Commission Assistance No. 103201183, July, 1974. pp. 45-54.

13. Wiley, A. J., G. A. Dubey, and I. Q. Bansal. Reverse Osmosis Concentration of Dilute Pulp and Paper Effluents. The Institute of Paper Chemistry, Environmental Protection Agency, Washington, DC. Publication Number 10204EEL 02/72, February 1972. 358 p.
14. Stumm, W., and J. J. Morgan. Chemical Aspects of Coagulation. Jour. AWWA, 54(8):971-92, 1962.
15. Borchardt, L. G., and C. V. Piper. A Gas Chromatographic Method for Carbohydrates as Alditol-Acetates. Tappi, 53(2):257-61, 1970.
16. Hrutfiord, B. F., T. S. Friberg, D. F. Wilson, and J. R. Wilson. Organic Compounds in Pulp Mill Lagoon Discharges. Tappi 12th Annual Environmental Conference, Denver, Colorado, May 12-14, 1975.
17. Brauns, F. E. The Chemistry of Lignin, Academic Press, New York, 1952. 804 p.
18. Brauns, F. E., and D. A. Brauns. The Chemistry of Lignin, Supplement Volume, Academic Press, New York and London, 1960. 804 p.
19. Wettstein, F., H. Neukom, and H. Deuel. Cation Exchange Equilibrium with Starch Phosphate. Helv. Chem. Acta 44:1949, 1961.
20. National Council for Air and Stream Improvement Technical Bulletin 253, Dec., 1971.
21. Collins, J. W., L. A. Boggs, A. A. Webb, and A. J. Wiley. Tappi 56(6): 121-3, 1973.

SECTION XI

GLOSSARY

Alum — Aluminum sulfate.

BOD — Biochemical oxygen demand is based on the oxygen requirement of living organisms while utilizing components of the waste stream for growth and/or reproduction.

BOD₅ — The biochemical oxygen demand in a 5-day test period at 20°C.

CM — Chemimechanical pulping; this is based on a short chemical cook followed by mechanical refining to separate the fibers in the softened chips.

COD — Chemical oxygen demand is the measurement of the oxygen equivalent of that portion of the organic matter in a sample that is susceptible to oxidation by strong chemical oxidants (e.g., chromic acid).

Colloid — A phase dispersion to such a degree that the surface forces become an important factor in determining its properties. General particles of colloid dimension are 0.001 to 1 micron.

Gel chromatography — A column chromatographic technique which fractionates molecules on the basis of molecular weight.

Hemicellulose — That fraction of plant stems which is made up of carbohydrate polymers other than cellulose.

Molecular exclusion — The mechanism of fractionation of molecules during gel chromatography. Larger molecules are restricted from diffusing into the gel matrix, thus taking less time to travel through the gel than smaller molecules.

Permeate — That portion of a solution passing through a membrane during reverse osmosis or ultrafiltration.

Reverse osmosis (RO) — Osmosis in reverse flow through a semipermeable membrane when external pressure in excess of the osmotic pressure is applied.

Soluble — As used in this report is that portion of the solution (solvent and solute) passing through a 0.45 μ m filter under 100 psig nitrogen pressure.

Zeta potential — That portion of the total potential drop between the surface of the solid and the suspending liquid that is contributed by the charge potential between the liquid adhering to the wall of the particle and the movable liquid.

SECTION XII

APPENDICES

APPENDIX A: COMPANIES AND AGENCIES SUPPORTING PHASE I STUDIES

Bergstrom Paper Company

Hammermill Paper Company

Hoerner Waldorf Corporation

Kimberly-Clark Corporation

The Mead Corporation

NCR-Appleton Papers Division

Nekoosa Edwards Paper Company, Inc.

Potlatch Corporation

The Proctor & Gamble Company

Scott Paper Company

Wausau Paper Mills Company

Department of Natural Resources, State of Wisconsin
U.S. Environmental Protection Agency

TABLE B-1. CLARIFIER STUDIES WITH HERCOFLOC 812.3 (0.75 mg/l) AT MOSINEE PAPER CORPORATION

Date	Day	Composite ^a	Influent (A)				Effluent (B)				% Reduction					
			pH	Sus. Sol., mg/l	BOD ₅ , mg/l		Color Units	pH	Sus. Sol., mg/l	BOD ₅ , mg/l		Color Units	Sus. Sol.	BOD ₅		Color
					Total	Soluble				Total	Soluble			Total	Soluble	
Due to Mechanical Difficulties - No "Sets of Samples" were taken from 1/15 - 2/5/75 (1st to 22nd day)																
2/6	23	1	7.70	167	96	72	45	7.59	45	85	88	52	73.0	11.4	-22.2	-13.5
		2	7.62	202	127	120	93	7.90	50	120	108	97	75.2	5.5	10.0	-4.1
		M	7.82	196	116	96	97	7.61	41	94	87	52	79.1	19.0	9.4	46.4
		Mill ^b	--	218	90	--	--	--	56	51	--	--	74.3	43.3	--	--
2/7	24	1	7.90	273	111	110	93	7.91	74	121	106	74	72.9	-9.0	3.6	20.4
		2	7.81	211	137	131	103	7.82	45	113	92	74	78.7	17.5	29.8	28.2
		M	7.52	266	132	123	82	7.61	44	113	99	63	83.4	14.4	19.5	23.2
		Mill ^b	--	260	84	--	--	--	56	63	--	--	78.5	25.0	--	--
2/11	28	1	7.60	358	372	179	374	9.73	101	365	246	5040	71.8	-1.9	-37.4	-124.7
		2	7.50	359	177	142	86	8.40	153	149	150	118	57.4	15.8	-5.6	-37.2
		M	9.20	257	262	254	1580	9.09	53	222	217	1420	79.4	15.3	14.6	10.1
		Mill ^b	--	249	249	--	--	--	71	195	--	--	71.5	21.7	--	--
2/12	29	1	7.39	416	152	122	50	7.40	106	134	127	45	74.5	11.8	-4.1	10.0
		2	7.70	344	188	142	144	6.88	97	143	124	56	71.8	23.9	12.7	61.1
		M	8.40	502	174	166	38	7.59	88	141	144	81	82.5	19.0	13.2	-53.1
		Mill ^b	--	338	141	--	--	--	66	114	--	--	80.5	19.1	--	--
2/13	30	1	8.53	364	138	120	56	8.29	114	124	126	63	68.7	10.1	-5.0	-12.5
		2	8.69	256	204	162	284	8.38	131	162	142	168	48.8	20.6	12.3	40.8
		M	8.21	290	152	129	104	7.89	85	130	120	115	70.5	14.5	7.0	10.6
		Mill ^b	--	160	111	--	--	--	73	108	--	--	54.4	2.7	--	--
2/14	31	1	8.40	228	170	114	63	8.12	73	111	114	49	68.0	34.7	0	22.2
		2	8.21	266	150	127	48	8.19	49	120	125	38	81.6	20.0	0	15.6
		M	8.12	289	128	97	86	7.70	37	124	110	59	72.8	2.9	-13.4	31.4
		Mill ^b	--	210	99	--	--	--	57	75	--	--	72.8	24.2	--	--

^aComposites

A1 - from 7:30 a.m. to 7:30 p.m.

A2 - from 7:30 p.m. to 7:30 a.m.

B1 and B2 - Two hours after A's to allow for holding time

M - 24-hour mill composite (7:30 AM) analyzed in Appleton labs.

^bSame as (M) analyzed at mill.

TABLE B-2. CLARIFIER STUDY WITH ALUM (200 mg/l) PLUS HERCOFLOC 812.3 (0.75 mg/l) AT MOSINEE PAPER CORPORATION

Date	Day	Composite ^a	Influent (A)				Effluent (B)				% Reduction			
			pH	Sus. Sol., mg/l	BOD ₅ , mg/l		pH	Sus. Sol., mg/l	BOD ₅ , mg/l		Sus. Sol.	BOD ₅		Color
					Total	Soluble			Total	Soluble		Total	Soluble	
2/18	35	1	9.40	188	112	108	8.01	10	78	80	94.7	30.4	25.9	96.3
		2	8.78	54	130	106	5.80	8	77	85	85.2	40.8	19.8	100.0
		M	9.29	342	128	652	8.58	61	74	76	82.2	42.2	40.2	85.1
		Mill ^b	--	464	81	--	--	64	66	--	86.2	18.5	--	--
2/19	36	1	8.51	213	146	128	7.32	4	104	98	98.1	28.8	23.4	90.6
		2	9.11	222	190	174	8.65	0.5	108	107	99.9	43.2	38.5	95.5
		M	8.80	218	150	112	7.72	63	136	108	71.1	9.3	3.6	47.2
		Mill ^b	--	234	99	--	--	74	69	--	68.4	30.3	--	--
2/20	37	1	7.30	119	103	73	8.55	15	92	94	87.4	10.7	-28.8	72.5
		2	8.11	136	139	117	6.80	18	90	88	86.8	35.2	24.8	95.2
		M	8.41	153	116	99	7.78	40	102	78	73.8	12.1	21.2	26.5
		Mill ^b	--	216	159	--	--	62	135	--	71.3	15.1	--	--
2/21	38	1	7.83	278	116	112	8.19	44	104	99	84.2	10.3	11.6	26.8
		2	8.08	289	140	127	7.62	70	126	106	75.8	10.0	16.5	44.4
		M	7.59	206	112	88	7.39	55	104	87	73.3	7.1	-1.1	-32.1
		Mill ^b	--	204	129	--	--	58	108	--	71.6	16.3	--	--
2/26	43	1	7.41	221	114	112	8.84	60	100	94	72.8	12.3	16.1	90.2
		2	7.58	176	113	94	8.71	7	113	98	96.0	0	4.2	100.0
		M	7.54	215	140	96	7.40	60	104	84	72.1	25.7	8.3	51.6
		Mill ^b	--	283	114	--	--	79	105	--	82.2	7.9	--	--
2/27	44	1	7.55	155	108	108	6.90	24	96	92	84.5	11.1	14.8	81.7
		2	7.78	153	100	104	6.68	18	87	85	88.2	13.0	18.3	90.2
		M	7.65	180	110	104	7.25	62	86	93	65.6	21.8	10.6	37.8
		Mill ^b	--	248	96	--	--	57	75	--	77.0	21.9	--	--
2/28	45	1	7.53	82	96	95	6.55	9	84	83	89.0	12.5	12.6	64.5
		2	7.70	130	94	92	6.20	15	83	80	88.5	11.7	13.0	85.0
		M	7.32	201	86	89	7.25	71	78	71	64.7	9.3	20.2	27.9
		Mill ^b	--	121	108	--	--	30	36	--	75.2	66.7	--	--

^aComposites

A1 - from 7:30 a.m. to 7:30 p.m.

A2 - from 7:30 p.m. to 7:30 a.m.

B1 and B2 - Two hours after A's to allow for system holding time

M - 24-hour mill composite (7:30 AM) analyzed in Appleton labs.

^bMill - same as (M) analyzed by mill.

TABLE B-3. CLARIFIER STUDY WITH FERRIC CHLORIDE (100 mg/l Fe³⁺) PLUS HERCOFLOC 812.3 (0.75 mg/l) AT MOSINEE PAPER CORPORATION

Date	Day	Composite ^a	Influent (A)				Effluent (B)				% Reduction			
			pH	Sus. Sol., mg/l	BOD ₅ , mg/l		pH	Sus. Sol., mg/l	BOD ₅ , mg/l		Sus. Sol.	BOD ₅		Color
					Total	Soluble			Total	Soluble		Total	Soluble	
3/4	49	1	7.85	189	190	93	78	18	70	72	90.5	63.2	22.5	42.3
		2	8.75	136	244	138	130	30	124	106	77.9	49.2	23.2	76.9
		M	8.00	204	226	102	162	74	110	84	63.7	51.3	17.6	13.6
		Mill ^b	--	230	135	--	--	66	72	--	71.3	46.7	--	--
3/5	50	1	7.73	126	128	88	133	28	86	78	77.8	32.8	11.4	74.4
		2	8.51	199	158	117	204	83	83	78	58.3	47.5	33.3	86.8
		M	7.62	207	148	108	204	37	122	92	82.1	17.6	14.8	23.5
		Mill ^b	--	190	135	--	--	42	105	--	77.9	22.2	--	--
3/6	51	1	8.40	240	140	95	168	22	86	75	90.8	38.6	21.0	83.9
		2	7.61	169	142	88	74	6	88	76	96.4	38.0	13.6	83.8
		M	7.80	276	122	91	98	63	106	82	76.9	13.1	9.9	24.5
		Mill ^b	--	264	107	--	--	49	77	--	81.4	28.0	--	--
3/7	52	1	7.11	198	88	86	82	4	80	78	98.0	9.1	9.3	67.1
		2	7.31	213	94	76	56	2	92	79	99.1	2.1	-3.9	66.1
		M	7.22	204	91	74	100	75	96	70	63.2	-7.0	5.7	40.0
		Mill ^b	--	224	105	--	--	65	81	--	71.0	22.8	--	--
3/11	56	1	8.89	182	102	82	170	8	73	66	95.6	28.4	19.5	91.2
		2	7.81	209	114	98	60	5	78	77	97.6	31.6	21.4	68.3
		M	7.70	197	102	81	111	65	109	87	67.0	-6.8	-7.4	-6.0
		Mill ^b	--	264	111	--	--	51	93	--	80.7	16.2	--	--
3/12	57	1	7.69	228	170	144	126	9	120	79	96.0	29.4	45.1	76.2
		2	7.19	22	109	102	38	4	70	71	81.8	35.8	30.4	28.9
		M	7.70	258	130	100	71	45	94	94	82.6	27.7	6.0	46.5
		Mill ^b	--	236	132	--	--	39	81	--	83.5	38.6	--	--
3/13	58	1	8.26	220	160	136	192	12	90	90	94.5	43.8	33.8	72.9
		2	7.99	199	161	127	174	13	100	99	94.0	37.9	22.0	70.1
		M	7.82	206	140	114	222	81	121	112	60.7	13.6	1.8	45.0
		Mill ^b	--	294	141	--	--	57	126	--	80.1	10.6	--	--
3/14	59	1	7.10	192	122	101	115	15	92	83	92.2	24.6	17.8	67.0
		2	7.29	128	128	102	159	4	86	81	96.9	32.8	20.6	78.6
		M	7.41	245	142	110	126	59	129	110	75.9	9.2	0	14.3
		Mill ^b	--	176	144	--	--	59	108	--	66.5	25.0	--	--

^aComposites -- all on 60-minute cycle

A1 -- from 7:30 a.m. to 7:30 p.m.

A2 -- from 7:30 p.m. to 7:30 a.m.

B1 and B2 -- Two hours after A's to allow for system holding time

M -- 24-hour mill composite analyzed at Appleton labs.

^bMill -- same as (M) analyzed by mill.

TABLE I-4. CLARIFIER STUDY WITH FERRIC SULFATE AND HERCOFLOC AT MOSINEE PAPER CORPORATION

Date	Day	Composite ^a	Influent (A)				Effluent (B)				% Reduction					
			pH	Sus. Sol., mg/l	BOD ₅ , mg/l Total	Color Soluble Units	pH	Sus. Sol., mg/l	BOD ₅ , mg/l Total	Color Soluble Units	Sus. Sol.	Total	BOD ₅ Soluble	Color		
D. Ferric Sulfate (50-100 mg/l Fe ⁺³)																
3/18	63	1	8.01	187	192	138	332	6.16	126	124	101	38	32.6	35.4	26.8	88.6
		2	7.28	214	147	110	82	6.32	105	120	98	38	51.4	18.4	10.9	53.6
		M ^b	7.41	359	221	131	126	7.30	57	144	132	211	84.1	34.8	-0.8	-67.5
		Mill ^b	--	246	195	--	--	--	51	93	--	--	75.2	52.3	--	--
3/19	64	1	7.62	286	158	130	118	5.30	22	100	95	38	92.3	36.7	26.9	67.8
		2	7.22	202	136	116	111	4.56	18	93	88	45	91.1	31.6	24.1	59.4
		M ^b	7.40	178	146	113	108	7.01	73	121	106	163	59.0	17.1	6.2	-50.9
		Mill ^b	--	226	122	--	--	--	60	110	--	--	73.4	9.8	--	--
3/20	65	1	8.09	191	180	148	273	4.67	55	122	107	45	71.2	32.2	27.7	83.5
		2	7.22	168	173	124	145	3.61	10	86	83	52	94.0	50.3	33.1	64.1
		M ^b	7.07	149	186	144	163	7.11	74	140	122	160	50.3	24.7	15.3	1.8
		Mill ^b	--	175	140	--	--	--	59	86	--	--	66.3	38.6	--	--
3/21	66	1	7.40	200	165	135	122	3.96	8	106	98	55	96.0	35.8	27.4	54.9
		2	7.20	178	139	104	68	3.32	7	89	86	70	96.1	36.0	17.3	-2.9
		M ^b	7.33	224	170	116	90	7.19	62	126	106	90	72.3	25.9	8.6	0
		Mill ^b	--	218	120	--	--	--	54	60(?)	--	--	75.2	50.0(?)	--	--
E. Base Line (Hercofloc 812.3 at 0.75 mg/l)																
3/25	70	1	11.01	341	119	91	52	11.02	68	102	90	45	80.0	14.3	1.1	13.5
		2	7.91	190	134	104	31	7.81	23	112	112	31	88.0	16.4	-7.7	0
		M ^b	8.95	241	132	100	56	8.26	61	88	86	52	74.7	33.3	14.0	7.1
		Mill ^b	--	278	93	--	--	--	63	63	--	--	77.3	32.2	--	--
3/26	71	1	7.99	239	170	146	41	7.80	36	170	114	41	84.9	0	21.9	0
		2	8.06	182	138	127	34	7.78	24	112	112	34	86.8	18.8	11.8	0
		M ^b	7.81	262	--	114	38	7.51	46	125	112	38	84.0	0	1.8	0
		Mill ^b	--	300	92	--	--	--	50	47	--	--	83.3	48.9	--	--
3/27	72	1	8.32	137	172	130	103	8.41	51	182	128	100	62.8	-5.8	1.5	2.9
		2	8.13	235	146	130	192	8.14	39	125	124	296	83.4	14.4	4.6	-54.2
		M ^b	8.19	245	192	122	150	7.84	57	132	104	103	76.7	31.2	14.8	31.3
		Mill ^b	--	192	108	--	--	--	51	57	--	--	73.4	47.2	--	--
3/28	73	1	8.28	177	184	127	332	8.01	31	166	139	460	82.5	9.8	-9.4	-38.6
		2	8.51	189	150	134	328	7.99	48	125	124	251	74.6	16.7	7.5	23.5
		M ^b	9.21	253	158	120	318	8.32	62	120	110	278	75.5	24.0	8.3	12.6
		Mill ^b	--	260	117	--	--	--	43	120	--	--	83.5	-2.6	--	--

^aComposites - A1, A2, B1, and B2 on 30-minute cycle

A1 - from 7:30 a.m. to 7:30 p.m.

A2 - from 7:30 p.m. to 7:30 a.m.

B1 and B2 - 90 minutes allowed for system holding time

M - 24-hour mill composite analyzed at Appleton labs.

^bMill - same as (M) analyzed by mill.

TABLE B-5. CLARIFIER STUDY WITH SULFURIC ACID, SULFURIC ACID PLUS POLYMER, AND FERROUS SULFATE PLUS POLYMER AT MOSINEE PAPER CORPORATION

Date	Day	Composite ^a	Influent (A)			Effluent (B)			% Reduction		
			pH	Sus. Sol., mg/l	BOD ₅ , mg/l	Color Units	pH	Sus. Sol., mg/l	BOD ₅ , mg/l	Color Units	% Reduction
					Total	Soluble		Total	Soluble		Total
F. Sulfuric Acid (pH adjustment only)											
4/1	77	1	8.61	270	320	176	6.51	193	248	150	92
		2	8.53	332	201	151	6.19	113	143	112	52
		M ^b	9.72	307	211	177	9.51	50	140	125	318
		Mill	--	302	--	--	--	62	--	--	--
4/2	78	1	7.61	331	148	124	6.18	131	114	98	41
G. Sulfuric Acid + Polymer											
78		2	7.91	294	120	102	5.65	57	88	76	23
		M ^b	7.79	260	114	102	7.40	68	109	92	81
		Mill	--	266	--	--	--	36	--	--	--
H. Ferrous Sulfate (100 mg Fe²⁺/l) + Polymer											
4/3	79	1	7.70	271	150	126	5.19	183	106	92	322
		2	8.72	177	144	114	7.61	169	148	106	45
		M ^b	8.19	227	140	120	7.30	83	104	96	168
		Mill	--	224	--	--	--	52	--	--	--
4/4	80	1	8.61	222	172	137	5.34	117	144	94	136
		2	7.62	184	138	112	5.59	164	90	78	207
		M ^b	7.40	275	216	136	7.19	57	143	108	185
		Mill	--	356	--	--	--	45	--	--	--

^aComposites - A1, A2, B1, and B2 on 30-minute cycle

A1 - from 7:30 a.m. to 7:30 p.m.

A2 - from 7:30 p.m. to 7:30 a.m.

B1 and B2 - 90 minutes allowed for system holding time

M - 24-hour mill composite analyzed at Appleton labs.

^bMill - Same as (M) analyzed by mill.

Figure B-1. BOD₅ reduction during clarification with Hercofloc

A. Base-Line Study (Hercofloc 0.75 mg/l) - Mosinee

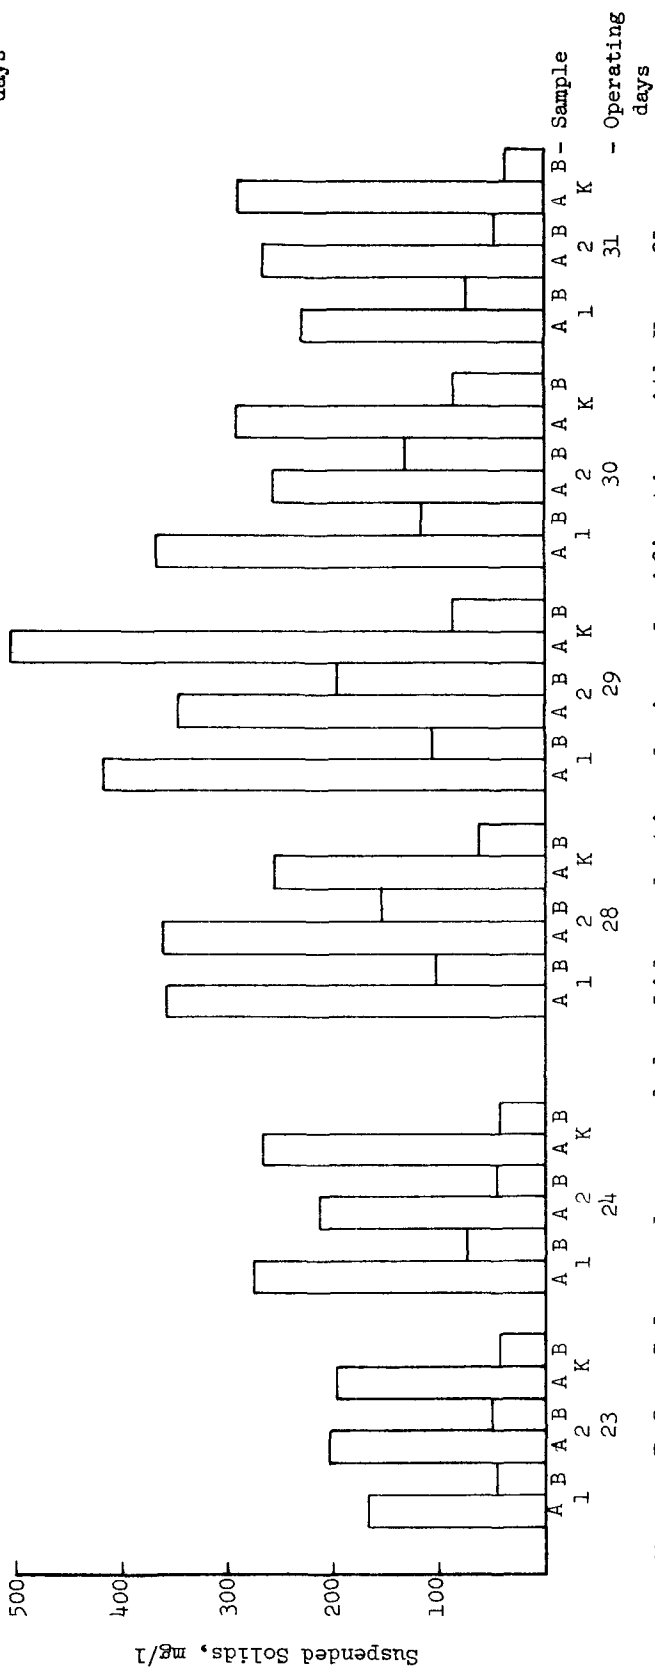
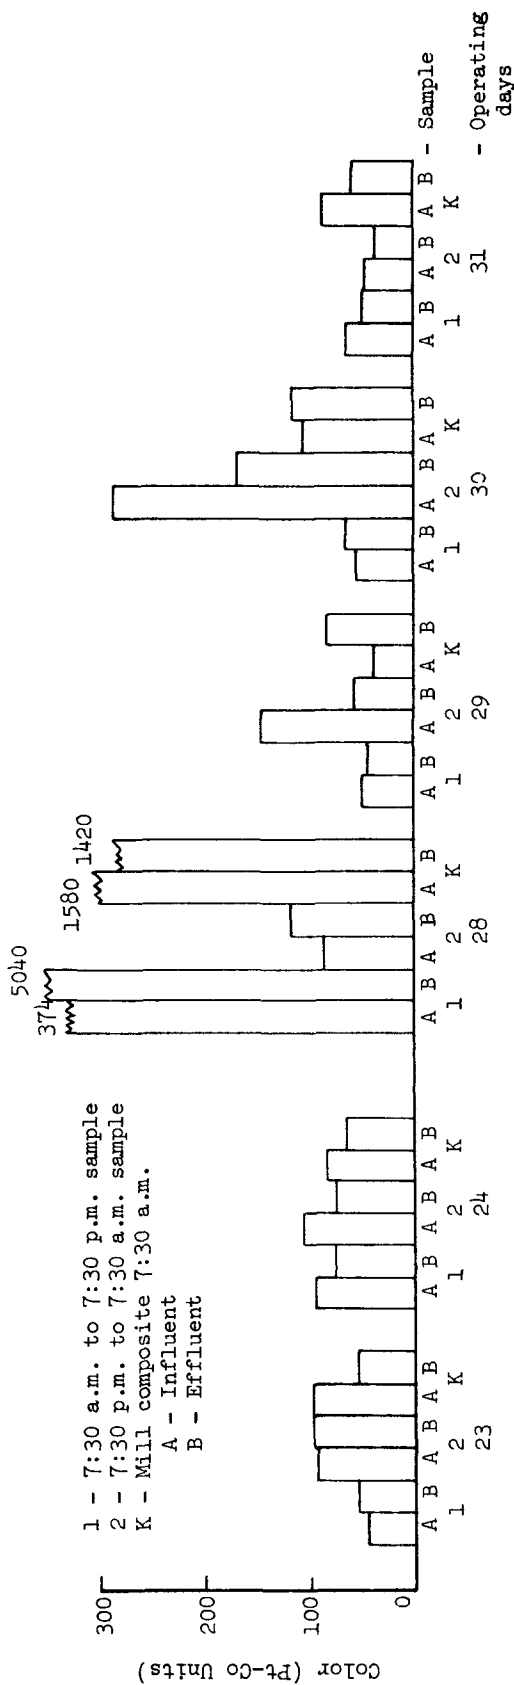


Figure B-2. Color and suspended solids reduction during clarification with Hercofloc.

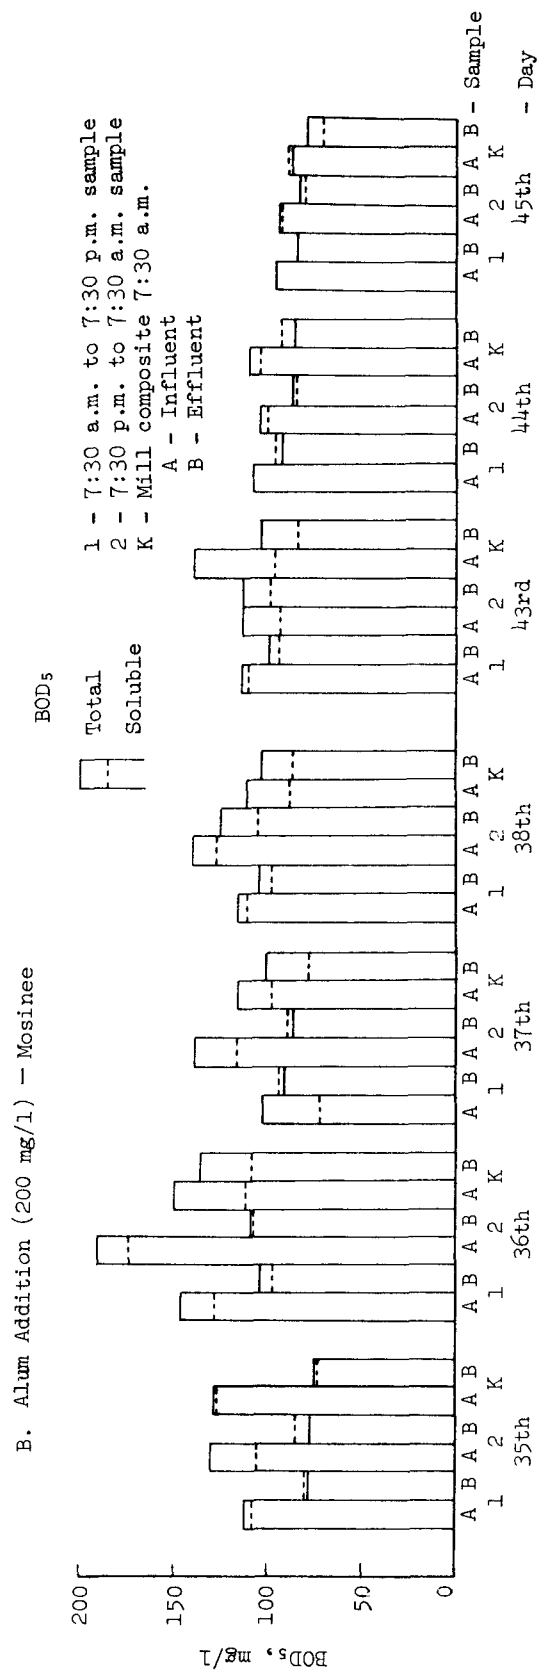


Figure B-3. BOD₅ reduction during clarification with alum.

B. Alum Addition (200 mg/l) - Mosinee

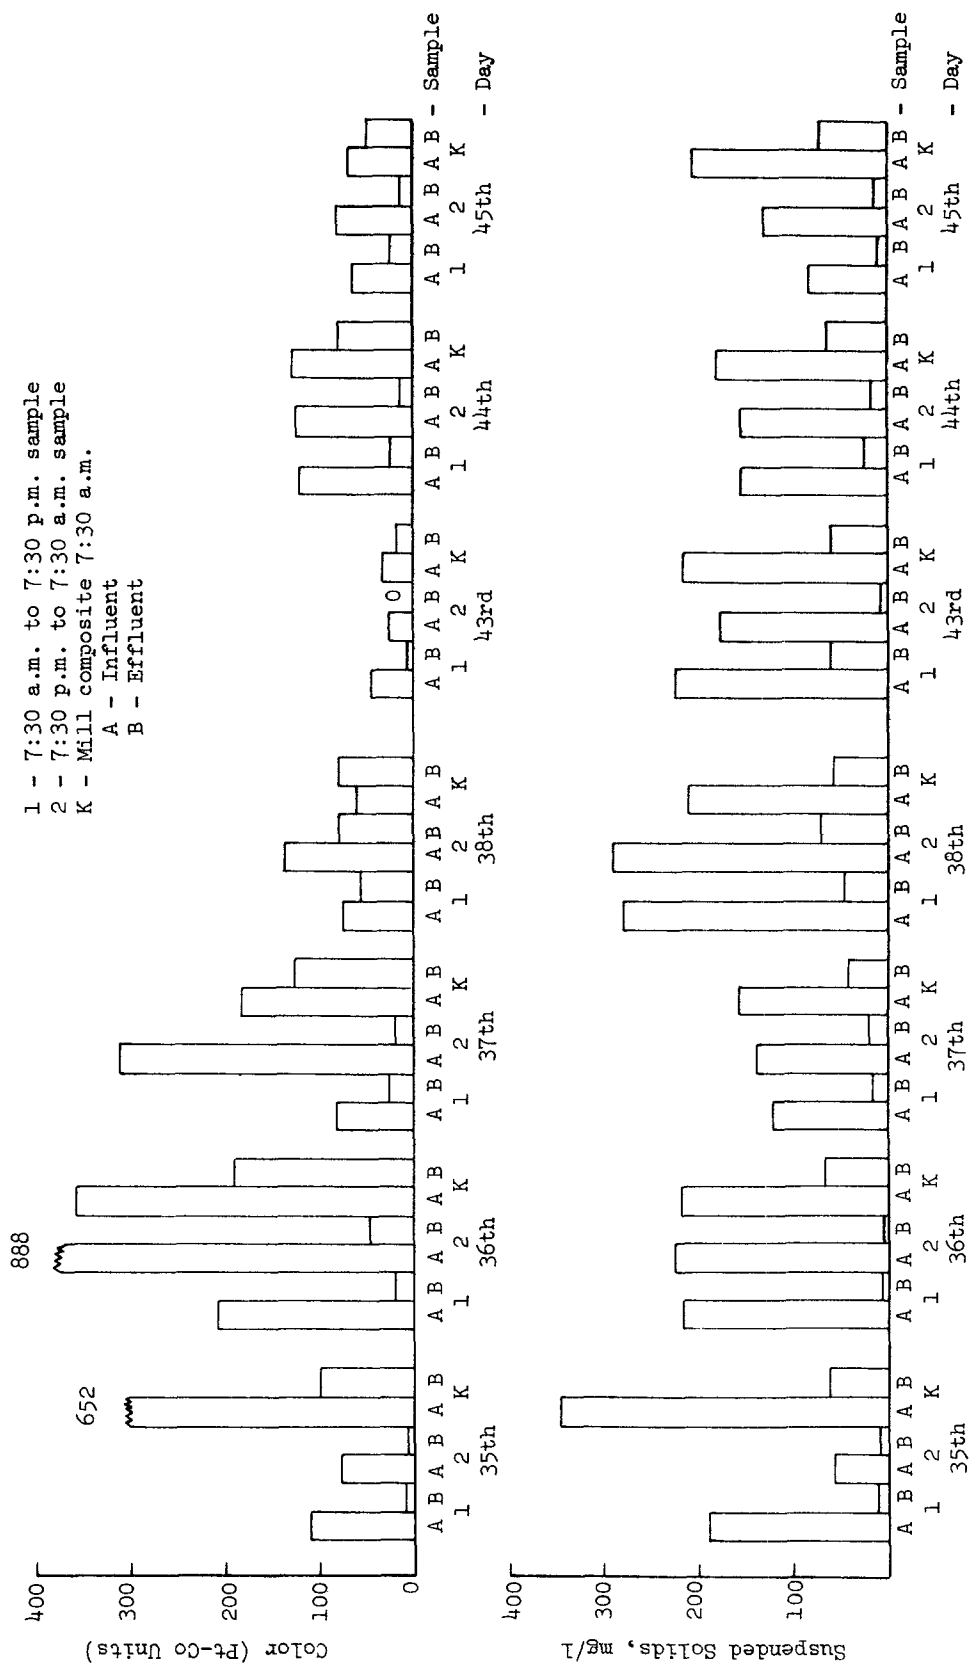


Figure B-4. Color and suspended solids reduction during clarification with alum.

BOD₅

Total

Soluble

1 - 7:30 a.m. to 7:30 p.m. sample
 2 - 7:30 p.m. to 7:30 a.m. sample
 K - Mill composite 7:30 a.m.

A - Influent
 B - Effluent

49th 50th 51st 52nd 56th 57th 58th 59th Sample

BOD₅, mg/l

Figure B-5. BOD₅ reduction during clarification with ferric chloride.

C. Ferric Chloride Addition (100 mg/l Fe^{+3}) — Mosinee

- 1 - 7:30 a.m. to 7:30 p.m. sample
- 2 - 7:30 p.m. to 7:30 a.m. sample
- K - Mill composite 7:30 a.m.

A - Influent
B - Effluent

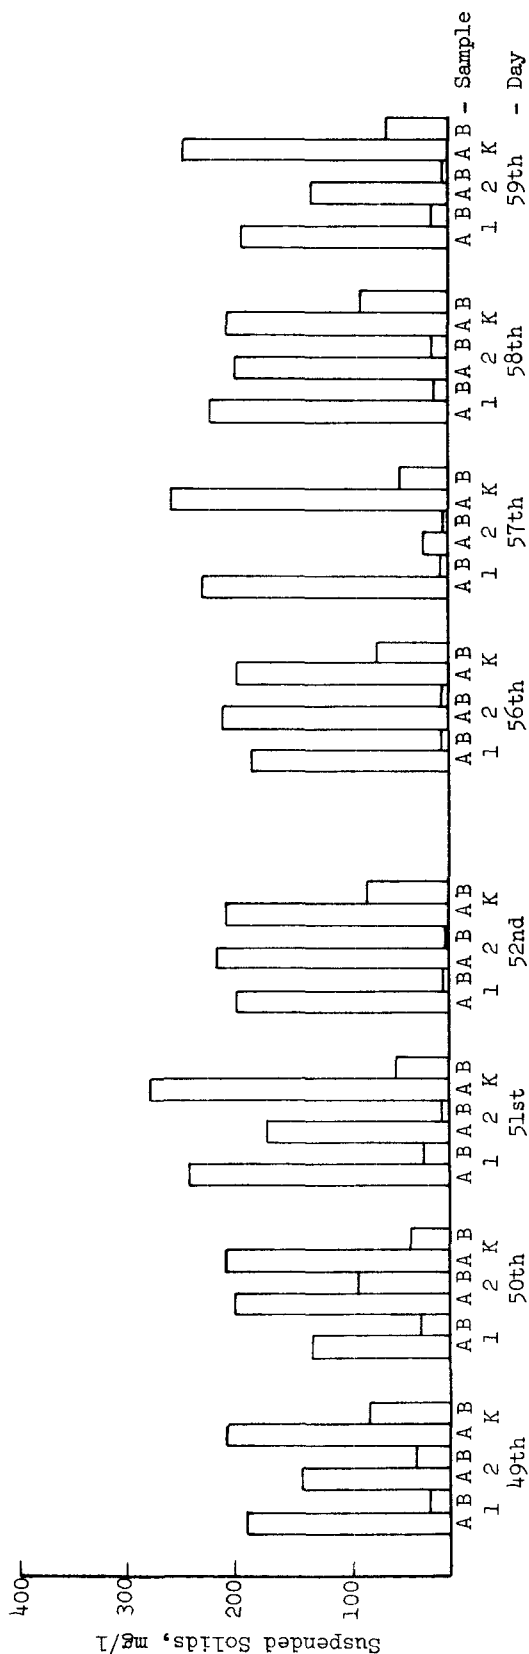
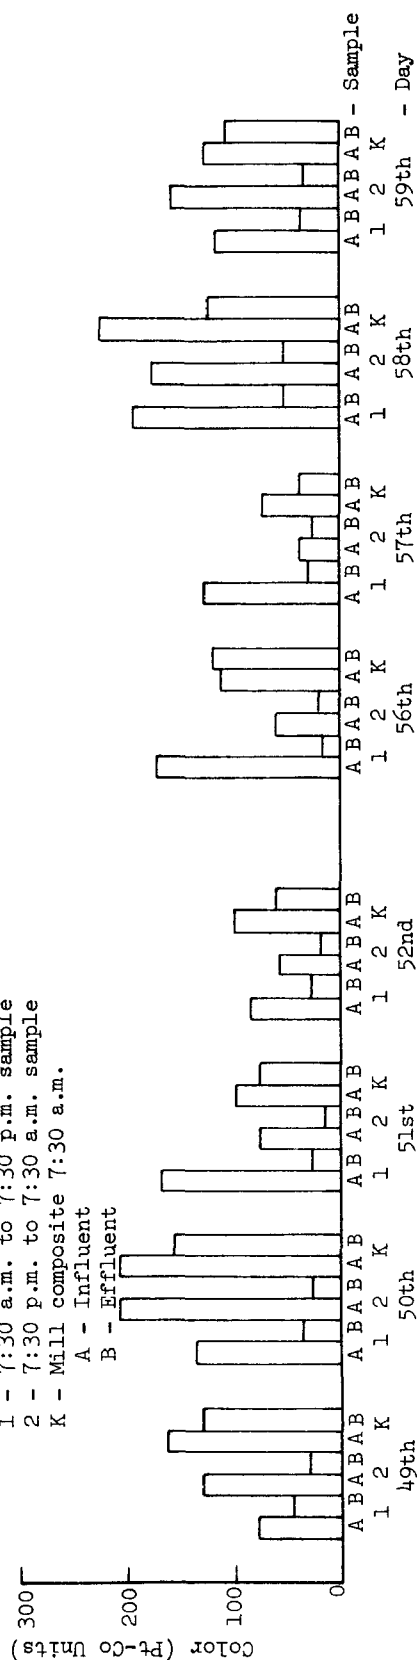


Figure B-6. Color and suspended solids reduction during clarification with ferric chloride.

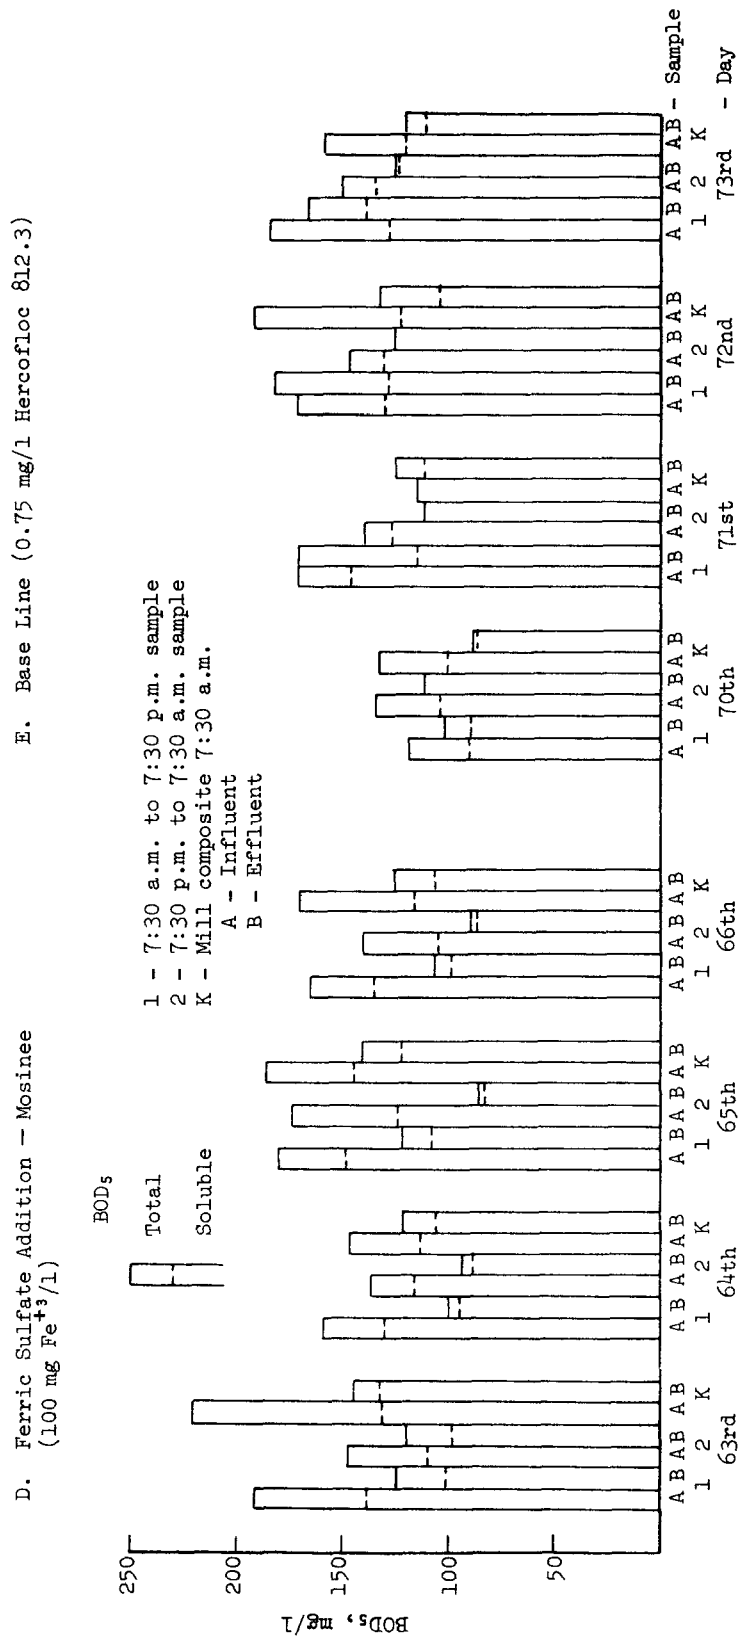


Figure B-7. BOD₅ reduction during clarification with ferric sulfate.

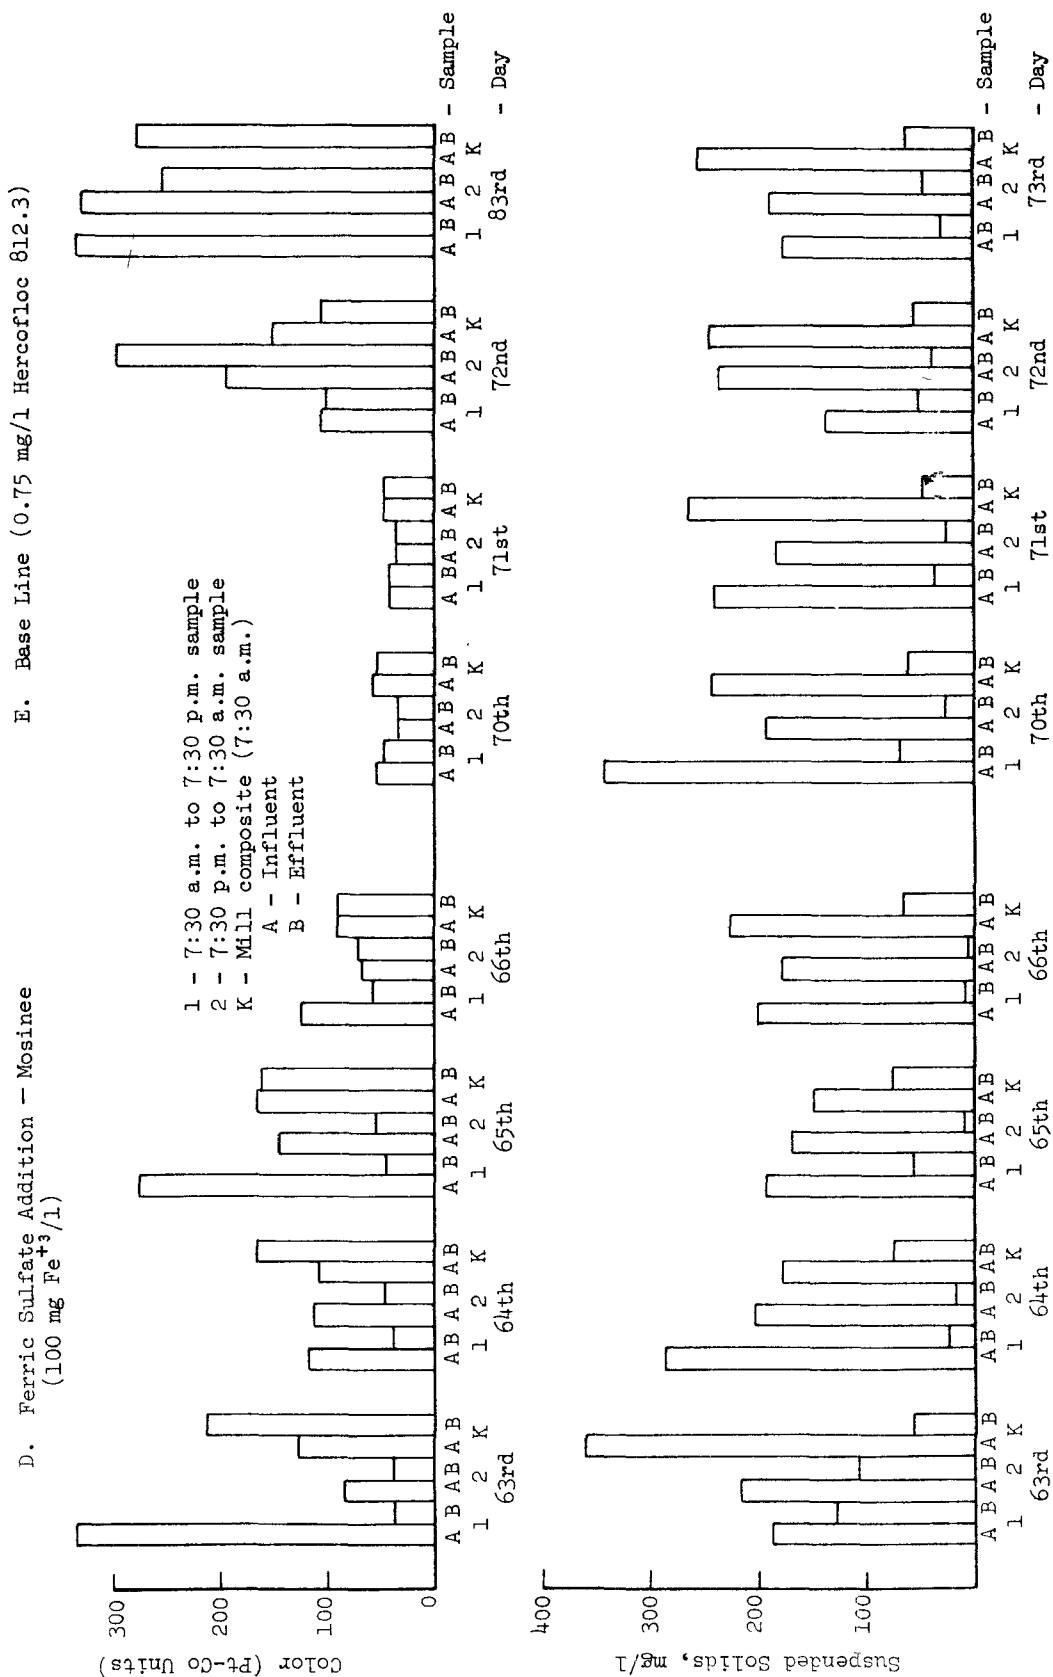


Figure B-8. Color and suspended solids reduction during clarification with ferric sulfate.

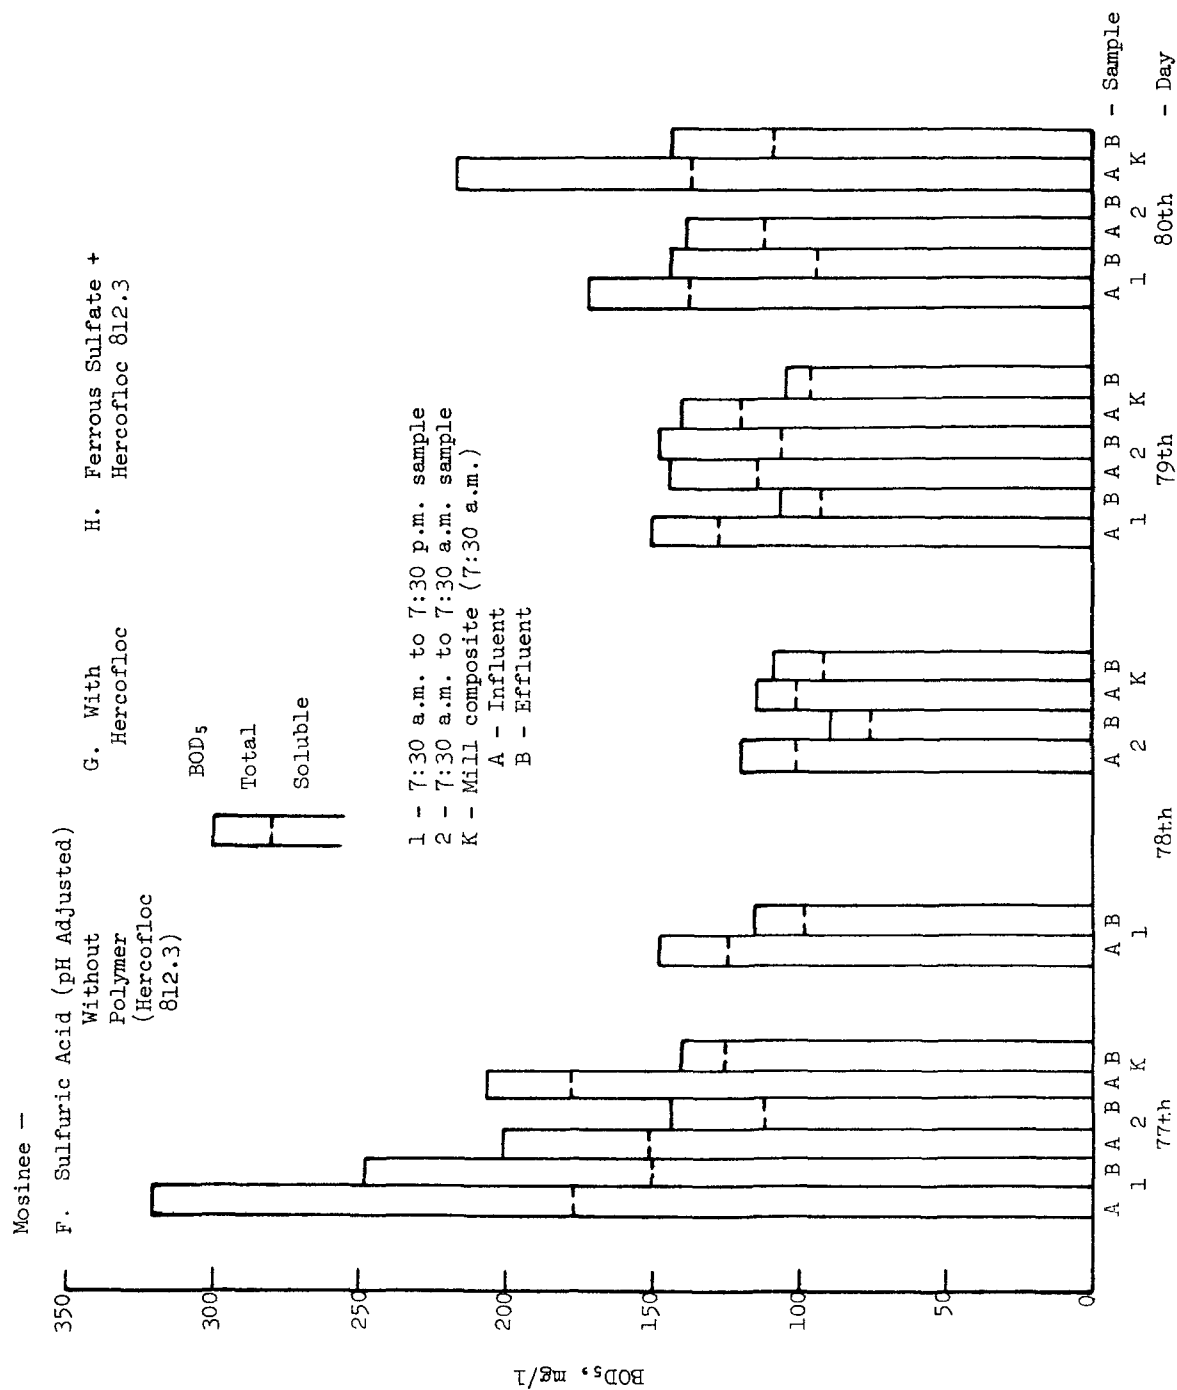


Figure B-9. BOD₅ reduction during clarification with sulfuric acid, Hercofloc, or ferrous sulfate plus Hercofloc.

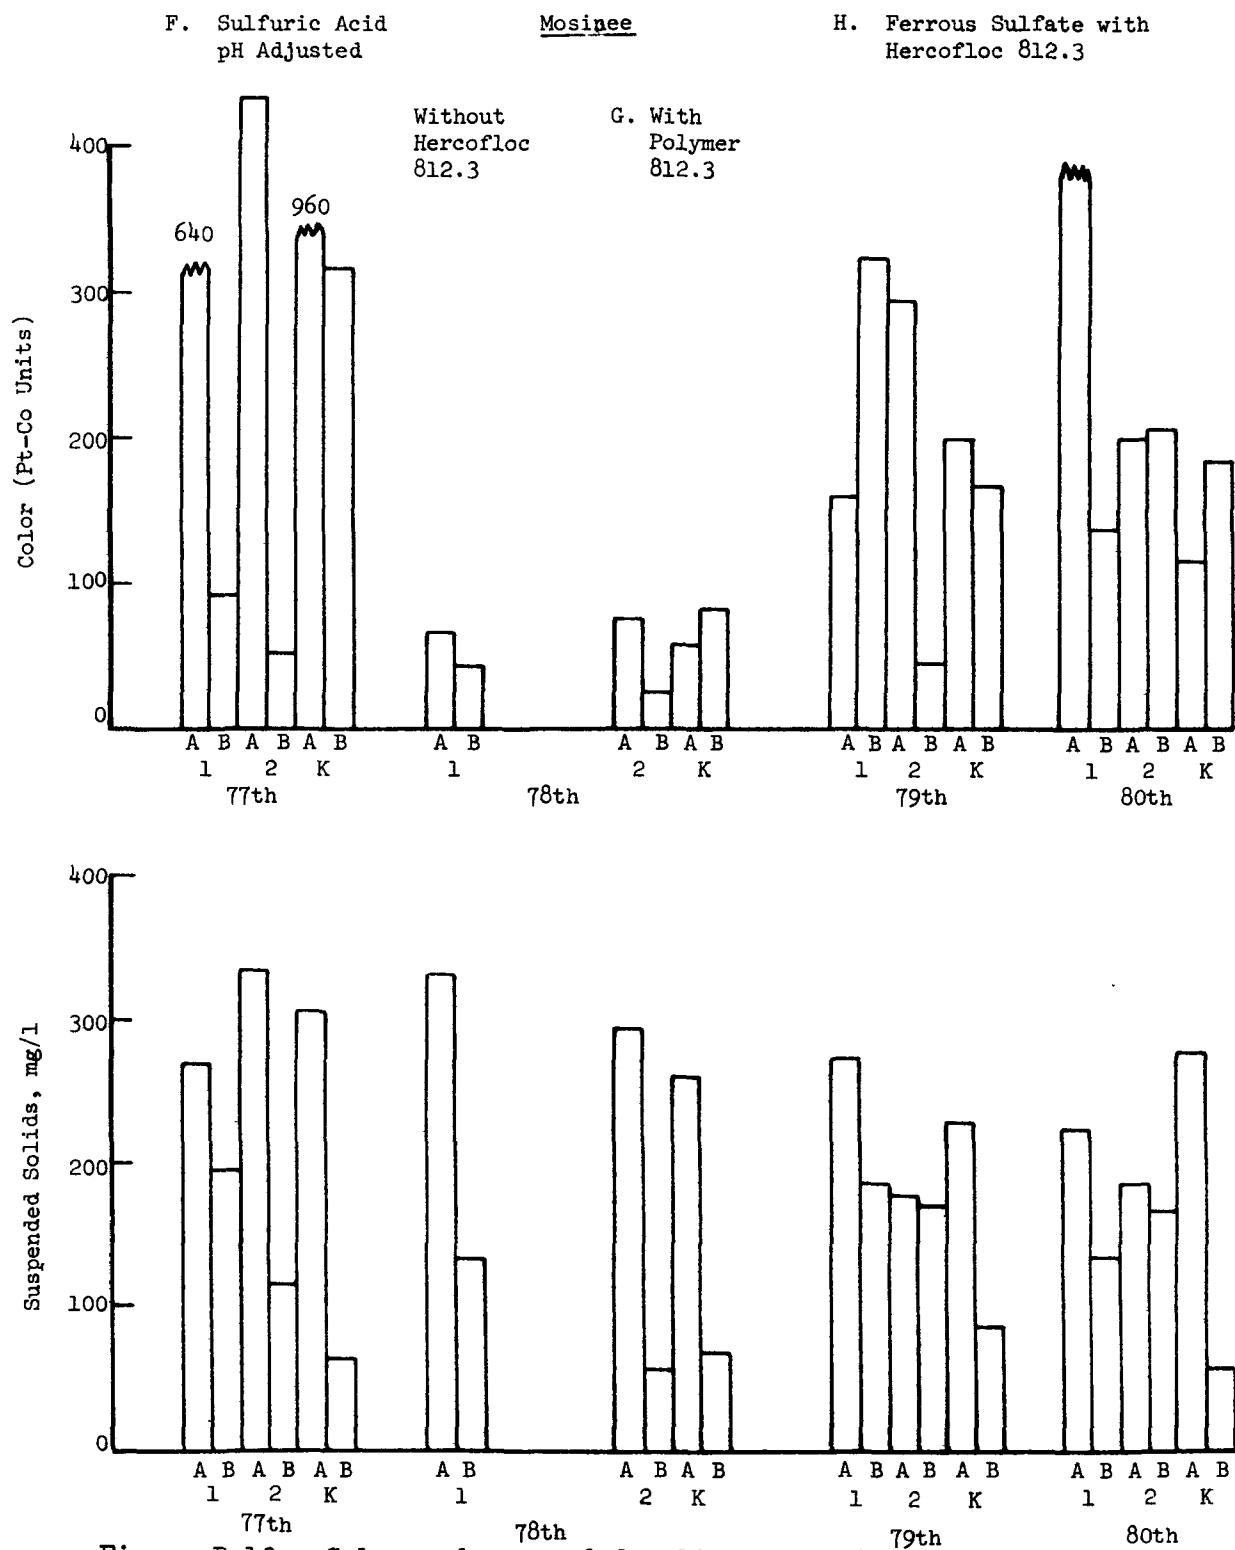


Figure B-10. Color and suspended solids reduction during clarification with sulfuric acid, Hercofloc, or ferrous sulfate plus Hercofloc.

TABLE C-1. CLARIFIER STUDY AT COMBINED LOCKS - BASE LINE (GRAVITY CLARIFICATION AFTER 0.010-INCH SIEVE) WITHOUT ADDITIVES^{a,b}

Day	Composite	Influent (C)					Effluent (D)					% Reduction				
		pH	Sus. Sol. mg/l	BOD ₅ , mg/l Total	Sol. Sol. mg/l	Color Units	pH	Sus. Sol. mg/l	BOD ₅ , mg/l Total	Sol. Sol. mg/l	Color Units	Sus. Sol.	Total	BOD ₅ Soluble	Color	
5	2	8.30	805	294	196	162	7.71	97	256	201	192	88.0	12.9	-2.6	-18.5	
10	1	7.65	578	243	124	98	7.82	19	162	140	105	96.7	33.3	-12.9	-7.1	
	2	7.45	749	312	190	122	7.55	44	208	176	150	94.1	33.3	7.4	-22.9	
	M	-	664	278	157	110	7.91	54	234	159	145	91.9	15.8	0	-31.8	
11	1	7.58	758	267	202	125	7.62	66	240	211	217	91.3	10.1	-4.4	-73.6	
	2	7.71	814	322	233	215	7.71	37	282	238	202	95.4	12.4	-2.4	-40.5	
	M	-	786	294	218	170	7.69	48	236	209	255	93.9	19.7	4.1	-50.0	
12	1	7.35	621	176	127	100	7.50	19	140	128	75	96.9	20.4	0	25.0	
	2	7.52	547	204	142	112	7.67	18	162	154	83	96.7	20.6	-8.4	26.0	
	M	-	584	190	134	106	7.38	29	147	135	111	95.0	22.6	0	-4.5	
13	1	7.65	638	352	268	175	7.65	44	270	254	200	93.1	23.3	5.2	-14.3	
	2	7.60	643	355	252	185	7.71	31	286	271	205	95.2	19.4	-7.5	-9.8	
	M	-	640	354	260	180	No Sample									
14	1	7.55	584	373	254	183	7.58	38	243	250	255	93.5	34.8	1.6	-39.3	
17	1	7.40	541	300	216	195	7.40	72	222	220	230	86.7	26.0	-1.8	-17.9	
	2	7.45	599	363	232	187	7.50	49	242	214	295	91.8	33.3	7.8	-57.8	
	M	-	570	332	224	191	7.32	55	209	198	255	90.4	27.0	11.6	--	
18	1	7.60	506	236	148	126	7.68	31	164	147	155	93.9	30.5	0.6	-23.0	
	2	7.65	622	377	286	218	7.70	55	277	241	244	91.2	26.5	15.7	-11.9	
	M	-	564	306	217	172	7.55	51	201	190	292	91.0	34.3	12.4	-69.8	
19	1	7.59	415	217	138	204	7.58	36	181	162	196	91.3	16.6	-17.4	3.9	
	2	7.62	435	380	319	322	7.59	76	374	338	377	82.5	1.6	-5.6	-17.1	
	M	-	425	298	228	263	7.60	51	268	238	302	88.0	10.1	-4.2	-14.8	

^aValues in parentheses are volatile suspended solids.

^bUnderscored values are based on average of IFC influent samples.

TABLE C-2. CLARIFIER STUDY AT COMBINED LOCKS - FERRIC CHLORIDE (75 mg/l Fe³⁺) WITHOUT POLYMER^{a,b}

Day	Composite ^c	Influent (C)				Effluent (D)				% Reduction					
		pH	Sus. Sol., mg/l	BOD ₅ , mg/l Total	Color Units	Sol. Sol., mg/l	pH	Sus. Sol., mg/l	BOD ₅ , mg/l Total	Color Units	Sol. Sol., mg/l	Sus. Sol.	Total Soluble	Color	
22	1	7.35	455 (337)	301	195	208	5.08	28 (24)	188	167	244	93.8 (93.2) ^d	37.5	14.4	-17.3
	2	7.38	562 (422)	332	246	252	6.10	181 (133) ^d	224	178	126	67.8 (68.5) ^d	32.5	27.6	50.0
	M	--	--	316	220	230	7.22	61 (46)	232	212	266	--	26.6	3.6	-15.6
23	1	7.48	646 (472)	325	224	244	3.92	32 (18)	168	170	178	95.0 (96.2)	48.3	24.1	27.0
	2	7.40	291 (210)	306	230	288	4.89	14 (10)	197	190	122	95.2 (95.2)	35.6	17.4	22.9
	M	--	--	316	227	266	7.41	213 (171)	304	233	296	--	3.8	-2.6	-11.3
29	1	8.42	570 (415)	342	214	155	5.21	22 (17)	172	155	133	96.1 (95.9)	49.7	27.6	14.2
	2	7.79	606 (428)	311	195	152	4.69	20 (16)	180	156	145	96.7 (95.3)	42.1	20.0	4.6
	M	--	--	326	204	154	7.40	49 (32)	216	216	185	--	33.7	5.9	-20.2
30	1	7.75	600 (408)	320	242	178	5.18	107 (71)	208	167	126	82.2 (82.6)	35.0	31.0	29.2
	2	7.89	584 (388)	297	242	181	5.04	17 (10)	197	179	145	97.1 (97.4)	33.6	26.0	19.9
	M	--	--	308	242	180	7.90	51 (31)	248	220	218	--	19.5	9.1	-21.1
31	1	7.91	621 (437)	272	186	126	4.91	18 (14) ^d	144	128	112	97.1 (96.8) ^d	47.0	31.2	11.1
	2	8.06	570 (422)	238	186	118	5.23	140 (99) ^d	188	144	52	75.4 (76.5) ^d	21.0	22.6	55.9
	M	--	--	255	186	122	7.42	62 (35)	191	166	170	--	25.1	10.8	-39.3
32	1	7.79	502 (374)	239	168	111	5.04	20 (16)	131	120	52	96.0 (95.7)	45.2	28.6	53.2
	2	7.99	346 (248)	209	148	126	5.05	10 (9)	120	100	41	97.1 (96.4)	42.6	32.4	67.5
	M	--	--	224	158	118	7.68	45 (29)	143	122	165	--	36.2	22.8	-39.8
33	1	8.20	466 (309)	226	107	68	5.32	8 (2)	114	82	38	98.3 (99.4)	49.6	23.4	44.1
	2	7.69	494 (371)	238	194	118	5.12	12 (6)	134	126	52	97.6 (98.4)	43.7	35.0	55.9
	M	--	--	232	150	93	7.50	36 (24)	163	140	150	--	29.7	6.7	-61.3

^aValues in parentheses are volatile suspended solids.
^bUnderscored values are based on average of IPC influent samples.

^cComposites

1 - 7:30 a.m. to 7:30 p.m. samples.

2 - 7:30 p.m. to 7:30 a.m. samples.

M - Mill composite analyzed in IPC lab.

^dSludge carry-over due to failure of sludge pump.

TABLE C-3. CLARIFIER STUDY AT COMBINED LOCKS - FERRIC CHLORIDE (75 mg/l Fe³⁺)
PLUS MALCOLYTE 73C32 (0.75 mg/l)^{a, b}

Day	Composite ^c	Influent (C)				Effluent (D)				% Reduction			
		pH	Sus. Sol., mg/l	BOD ₅ , mg/l Total Soluble	Color Units	Sol. Sol., mg/l	pH	Sus. Sol., mg/l	BOD ₅ , mg/l Total Soluble	Color Units	Sol. Sol., mg/l	% Reduction	
												Total	Color
36	1	8.10	424 (292)	220	126	591	5.54	4 (3)	106	30	630	51.8	50.0
	2	7.72	258 (193)	255	152		5.26	28 (18)	121	90		52.5	0
	M	--	--	238	139		7.78	41 (30)	142	105	633	40.3	--
37	1)												
	2) Failure of Sludge Pump												
	M)												
38	1	7.99	389 (254)	188	106	593	6.30	30 (25)	124	87	619	34.0	-40.8
	2	8.31	521 (361)	318	238		6.57	77 (48)	198	108		37.7	43.2
	M	--	--	253	172		7.89	44 (26)	186	191	779	26.5	--
39	1 ^d	8.18	590 (403)	355	266		6.70	81 (48)	249	93		29.9	41.9
	2 ^d	8.53	702 (456)	409	286		6.80	106 (64)	265	85		35.2	47.8
	M	--	--	382	276		7.85	53 (30)	272	233		28.8	--
40	1 ^d	7.65	606	314	237	819	6.75	81	263	105	874	16.2	34.4
	2 ^d	7.75	431	336	280		5.15	130	246	83		26.8	48.1
	M	--	--	325	258		7.48	45	258	262	803	20.6	--

^aValues in parentheses are volatile suspended solids.

^bUnderscored values are based on average of IPC influent samples.

^cComposites

1 - 7:30 a.m. to 7:30 p.m. samples.

2 - 7:30 p.m. to 7:30 a.m. samples.

M - Mill composite analyzed in IPC lab.

^dHeavy floc carry-over due to sludge pump troubles.

TABLE C-4. CLARIFIER STUDY AT COMBINED LOCKS - FERRIC SULFATE (100 mg/l Fe³⁺)^a

Day	Composite ^b	Influent (C)			Effluent (D)			% Reduction								
		pH	Sus. Sol., mg/l	$\frac{\text{BOD}_5, \text{mg/l}}{\text{Total Soluble}}$	Color Units	Sol. Sol., mg/l	pH	Sus. Sol., mg/l	$\frac{\text{BOD}_5, \text{mg/l}}{\text{Total Soluble}}$	Color Units	Sol. Sol., mg/l	Sus. Sol., mg/l	$\frac{\text{BOD}_5, \text{mg/l}}{\text{Total Soluble}}$	Color		
44	1	8.80	353	262	223	118	780	4.90	37	177	174	92	663	89.5	32.4	22.0
	2	7.70	196	304	230	150		4.85	66	194	194	168		66.3	36.2	15.6
	M	--	--	283	226	--		7.50	56	219	210	178	788	--	22.6	7.1
45	1	7.60	384	292	222	123	848	4.51	10	157	152	75	815	97.4	46.2	31.5
	1A	7.60	374	252	201	108	743	4.72	87	178	164	108	854	76.7	29.4	18.1
	2	5.87	430	304	242	123		3.78	60	166	154	83		86.0	45.4	36.4
46	1	8.03	408	180	104	50		7.55	65	218	197	168	740	--		
	2	8.18	431	150	62	30		4.53	14	84	78	38		96.6	53.3	25.0
	M	--	--	165	83	--		4.88	24	54	46	20		94.4	64.0	25.8
47	1	7.62	373	133	81	30		7.75	43	112	95	55		--	32.1	-14.4
	2	7.35	337	234	192	115		5.02	14	69	66	15		96.2	48.1	18.5
	M	--	--	184	136	--		5.05	22	148	132	98		93.5	36.8	31.2
								7.12	36	114	108	117		--	38.0	20.6

^a Underscored values are based on average of IPC influent samples.

^b Composites

1 - 7:30 a.m. to 7:30 p.m. samples

2 - 7:30 p.m. to 7:30 a.m. samples.

M - Mill composite analyzed by IPC lab.

TABLE C-5. CLARIFIER STUDY AT COMBINED LOCKS -- ALUM (300 mg/l)^a

Day	Composite ^b	Influent (C)				Effluent (D)				% Removal			
		pH	Sus. Sol., mg/l	BOD ₅ , mg/l Total	Color Units	pH	Sus. Sol., mg/l	BOD ₅ , mg/l Total	Color Units	Sus. Sol.	BOD ₅ Total	Solubles	Color
50	1	7.57	436	310	226	168	29	178	180	93.3	42.6	20.4	32.7
	2	N.G.	Sample Pump Failed				103	202	190	--	--	--	--
	M	--	--	--	--	7.23	43	188	170	--	--	--	--
51	1	7.42	542	332	226	155	16	198	195	97.0	40.4	13.7	14.8
	1A	7.12	544	332	234	113	249 ^c	216	202	54.2 ^a	39.2	13.7	-13.3
	2	7.53	488	368	270	208	26 ^c	244	226	94.6	38.8	16.3	-41.8
	M	--	--	<u>344</u>	<u>243</u>	--	49	248	230	--	27.9	5.3	--
52	1A	7.59	437	317	242	200	37	200	197	91.5	36.9	18.6	11.5
	1B	7.75	419	336	213	215	140	180	174	66.6	46.4	18.3	58.1
	2	7.62	289	367	296	255	35	242	246	87.9	34.0	16.9	40.0
	M	--	--	<u>340</u>	<u>250</u>	--	75	284	246	--	15.0	2.0	--
53	1	7.86	283	222	166	223	116	154	140	59.0	30.6	15.7	83.0
	2	7.79	293	268	202	168	24	163	164	91.8	39.2	18.8	13.7
	M	--	--	<u>245</u>	<u>184</u>	--	58	258	218	--	-5.0	-18.5	--
54	1	7.65	406	240	165	113	22	204	200	94.6	15.0	-21.2	54.0
	2	7.58	373	272	236	168	26	236	228	93.0	13.2	3.4	37.5
	2A	7.80	181	281	250	168	147	258	224	18.8	8.2	10.4	63.1
	M	--	--	<u>264</u>	<u>217</u>	--	47	222	216	--	15.9	0.5	--

^aUnderscored values are based on average of IPC influent samples.

^bComposites

1 - 7:30 a.m. to 7:30 p.m. samples

2 - 7:30 p.m. to 7:30 a.m. samples

M - mill composite analyzed by IPC lab.

^cHeavy floc carry-over due to sludge pump troubles.

TABLE C-6. CLARIFIER STUDY AT COMBINED LOCKS WITH AND WITHOUT ALUM (300 mg/l)
PLUS HERCOPLOC 812.3 (0.75 mg/l)^a

Day	Composite ^b	Influent (C)				Effluent (D)				% Reduction			
		pH	Sus. Sol., mg/l	BOD ₅ , mg/l Total Soluble	Color Units	pH	Sus. Sol., mg/l	BOD ₅ , mg/l Total Soluble	Color Units	Sus. Sol.	Total	BOD ₅ Soluble	Color
57	1	7.76	466	342	256	136	38	252	234	120	26.3	8.6	11.8
	2	7.52	446	396	294	192	40	285	248	156	28.0	15.6	18.8
	M	--	--	<u>369</u>	<u>275</u>	--	48	307	276	238	16.8	0	--
58	1	7.49	670	308	188	184	54	185	180	164	39.9	4.2	10.9
	1A	7.59	495	386	234	172	118	239	216	200	38.1	7.7	-16.3
	2	7.52	561	320	210	207	63	242	218	246	88.8	-3.8	-18.8
	M	--	--	<u>338</u>	<u>211</u>	--	56	236	218	254	30.2	-3.3	--
Alum pump failed													
71	1	8.31	1164	553	362	239	187	383	310	101	30.7	14.4	57.7
	2	8.32	431	377	276	262	130	236	228	74	69.8	17.4	71.8
	M	--	--	<u>467</u>	<u>319</u>	--	56	320	279	254	31.5	12.5	--
72	1	8.60	2340	527	347	234	70	260	239	106	97.0	31.1	54.7
	2	8.49	471	372	200	140	91	230	160	74	80.7	20.0	47.1
	M	--	--	<u>450</u>	<u>274</u>	--	76	304	260	212	--	5.1	--
73	1	8.20	527	272	156	117	58	122	114	82	89.0	26.9	29.9
	2	8.32	591	316	115	152	90	170	141	98	84.8	-22.6	35.5
	M	--	--	<u>294</u>	<u>136</u>	--	44	145	131	188	50.7	3.7	--

^a Underscored values are based on average of IPC influent samples.

^b Composites

1 - 7:30 a.m. to 7:30 p.m. samples.

2 - 7:30 p.m. to 7:30 a.m. samples.

M - Mill composite analyzed by IPC lab.

TABLE C-7. CLARIFIER STUDY AT COMBINED LOCKS - SECOND BASE LINE (GRAVITY SEDIMENTATION AFTER 0.010-INCH SIEVE) WITHOUT ADDITIVES ^a

Day	Composite ^b	Influent (C)				Effluent (D)				% Reduction			
		pH	Sus. Sol., mg/l	BOD ₅ , mg/l		pH	Sus. Sol., mg/l	BOD ₅ , mg/l		Sus. Sol.	Total	Soluble	Color
				Total	Soluble			Total	Soluble				
59	1	7.52	461	246	157	7.68	32	154	156	93.0	37.4	0.6	-28.7
	2	7.58	717	570	406	7.78	52	514	450	92.7	9.8	-10.8	-31.2
	M	--	--	408	282	7.45	50	312	292	--	23.5	-3.5	--
60	1	7.60	571	317	228	7.85	57	243	220	90.0	23.3	3.5	-37.8
	2	7.60	550	278	219	7.87	48	234	191	91.3	15.8	12.8	-60.4
	M	--	--	298	224	7.63	48	262	200	--	12.1	10.7	--
61	1	8.22	519	308	192	8.35	69	206	200	86.7	33.1	-4.2	-31.6
	2	8.25	520	410	264	8.42	60	302	275	88.5	26.3	-4.2	-36.3
	M	--	--	359	228	8.02	45	234	232	--	34.8	-1.8	--
65	1	9.25	654	334	209	9.30	81	225	204	87.6	32.6	2.4	-43.4
	2	9.13	505	326	204	9.12	47	208	202	90.7	36.2	1.0	-25.0
	M	--	--	330	206	8.75	57	222	200	--	32.7	2.9	--
66	1	8.98	478	381	258	8.88	44	276	246	90.8	27.6	4.6	-33.7
	2	7.85	546	423	261	7.93	42	298	250	92.3	29.6	4.2	-10.5
	M	--	--	402	260	7.85	59	272	234	--	32.3	10.0	--
67	1	8.58	523	266	116	10.17	38	168	139	92.7	36.8	-19.8	-7.9
	2	9.01	476	114	20	9.05	25	38	30	94.7	66.7	-50.0	0
	M	--	--	190	68	8.50	52	114	90	--	40.0	-32.4	--
68	1	9.14	555	165	12	8.90	3	36	32	99.4	78.2	-166.6	0
	M	--	--	--	--	8.75	30	63	38	--	--	--	--

^aUnderscored values are based on average of IPC influent samples.

^bComposites

1 - 7:30 a.m. to 7:30 p.m. samples

2 - 7:30 p.m. to 7:30 a.m. samples

M - Mill composite analyzed by IPC lab.

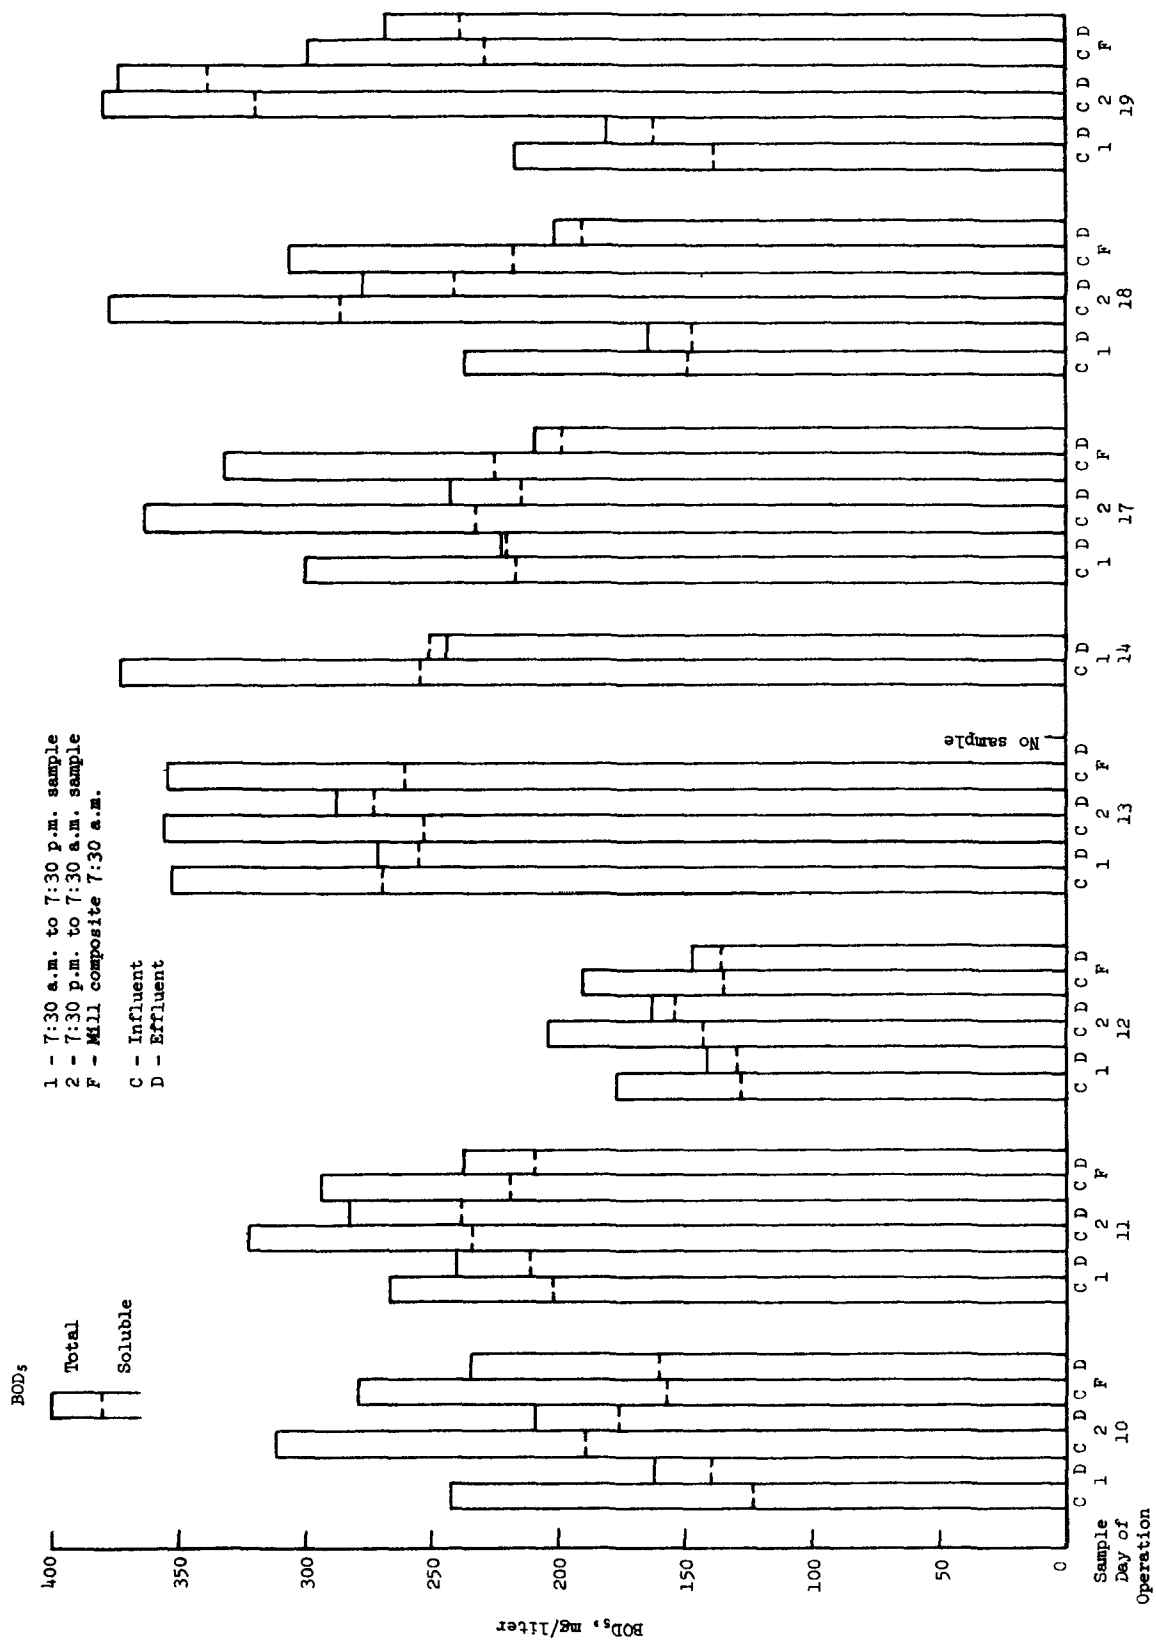


Figure C-1. Total and soluble BOD₅ in base-line study (no additives) at Locks Mill.

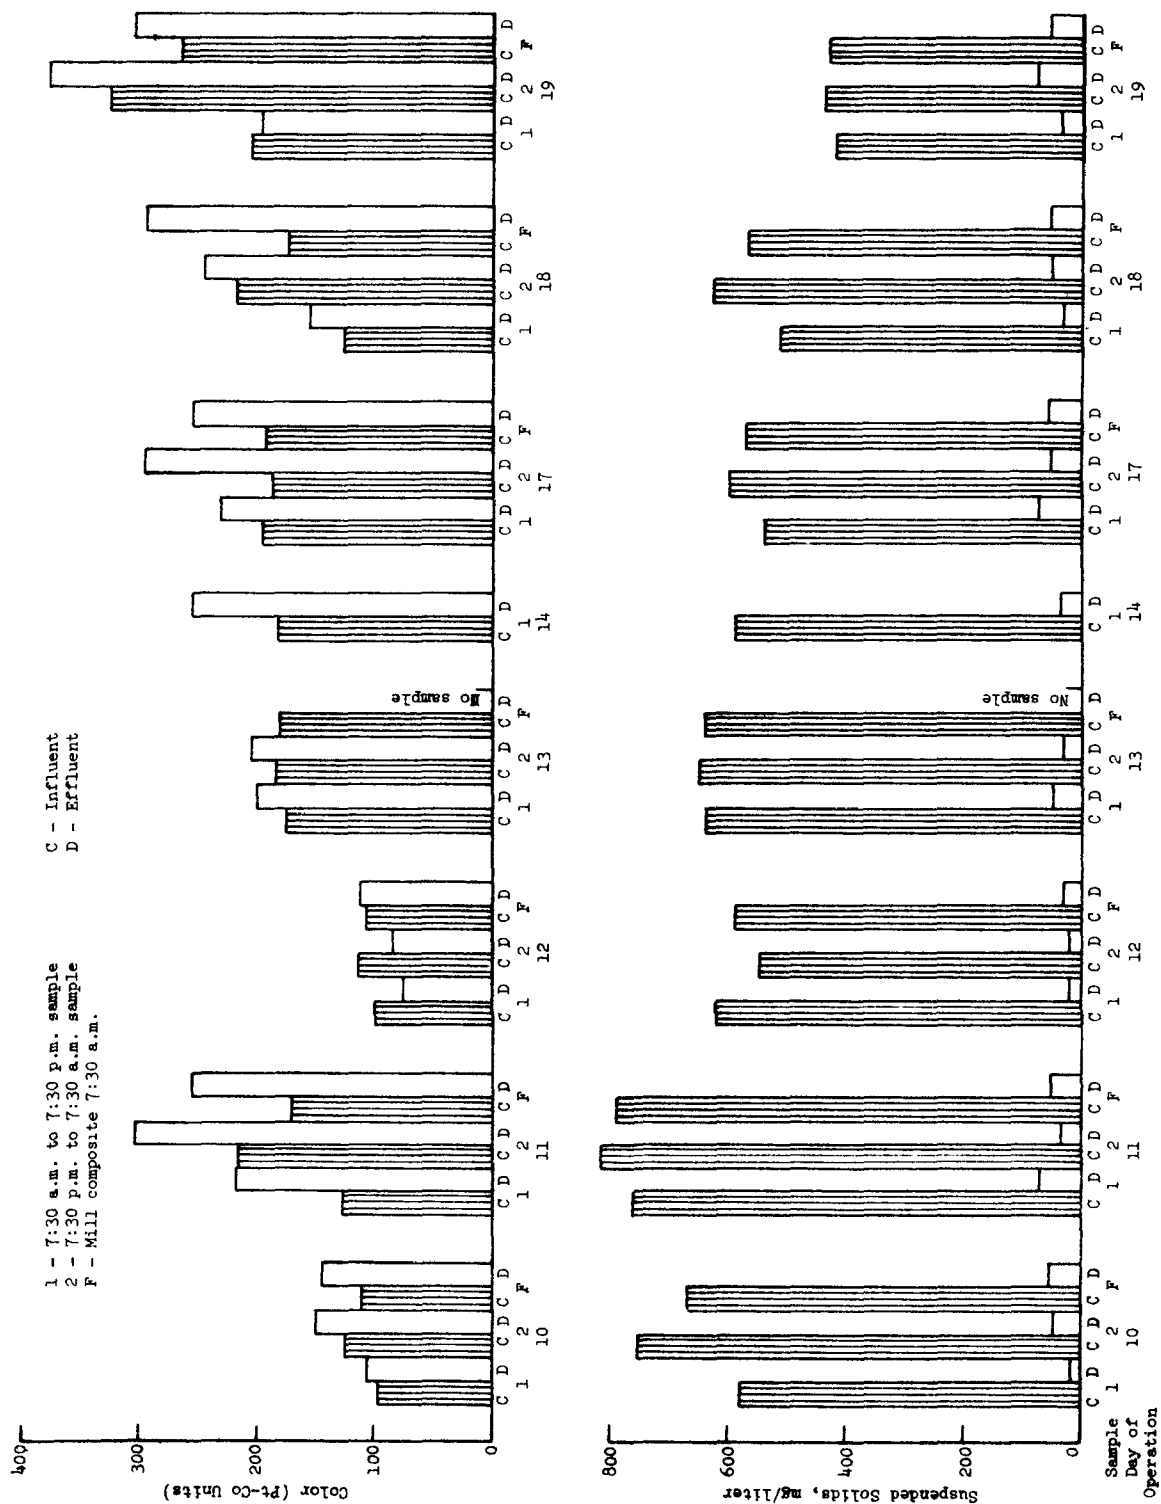


Figure C-2. Color and suspended solids in base-line study (no additives) at Locks Mill.

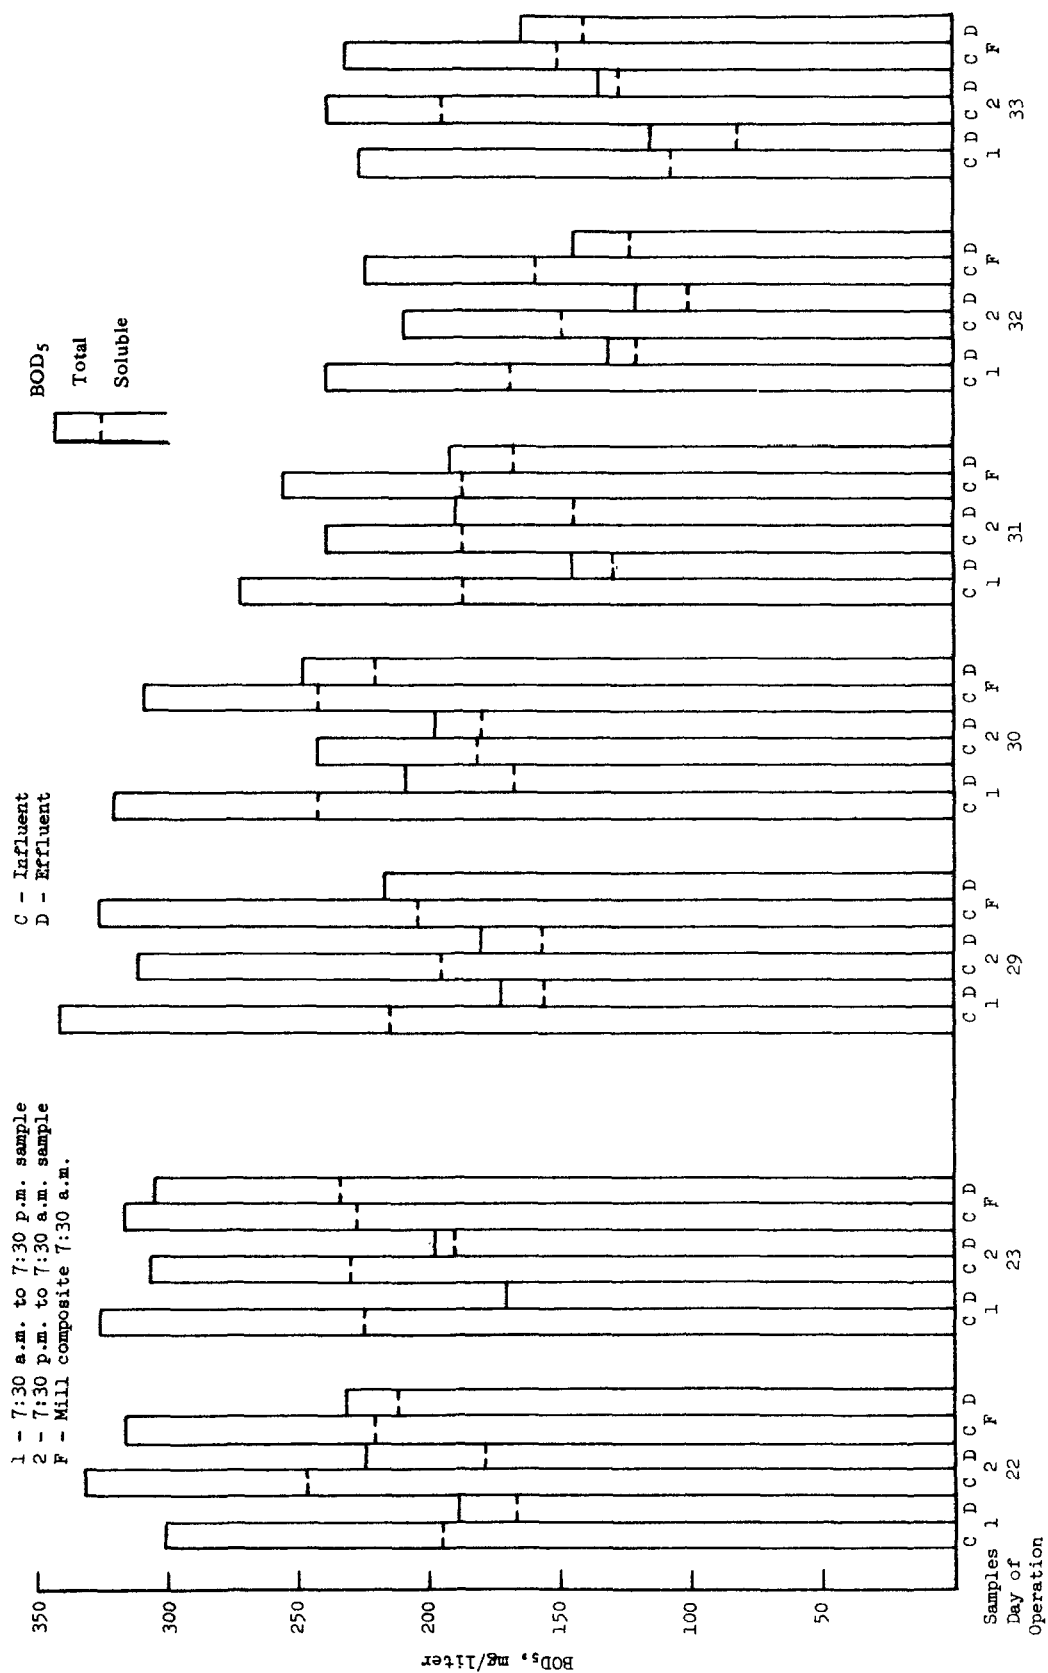


Figure C-3. Effect of ferric chloride - 75 mg Fe³⁺ (without polymer) on BOD₅ at Locks Mill.

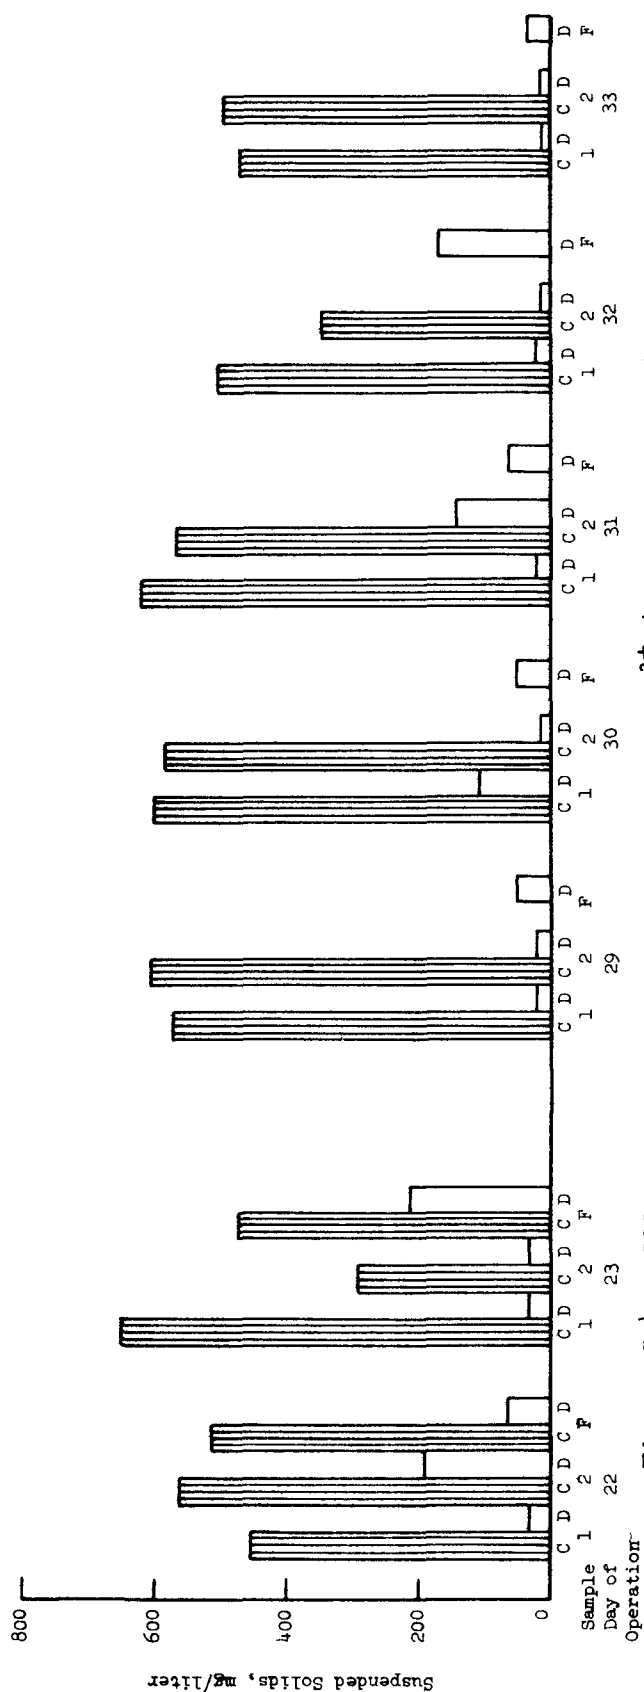
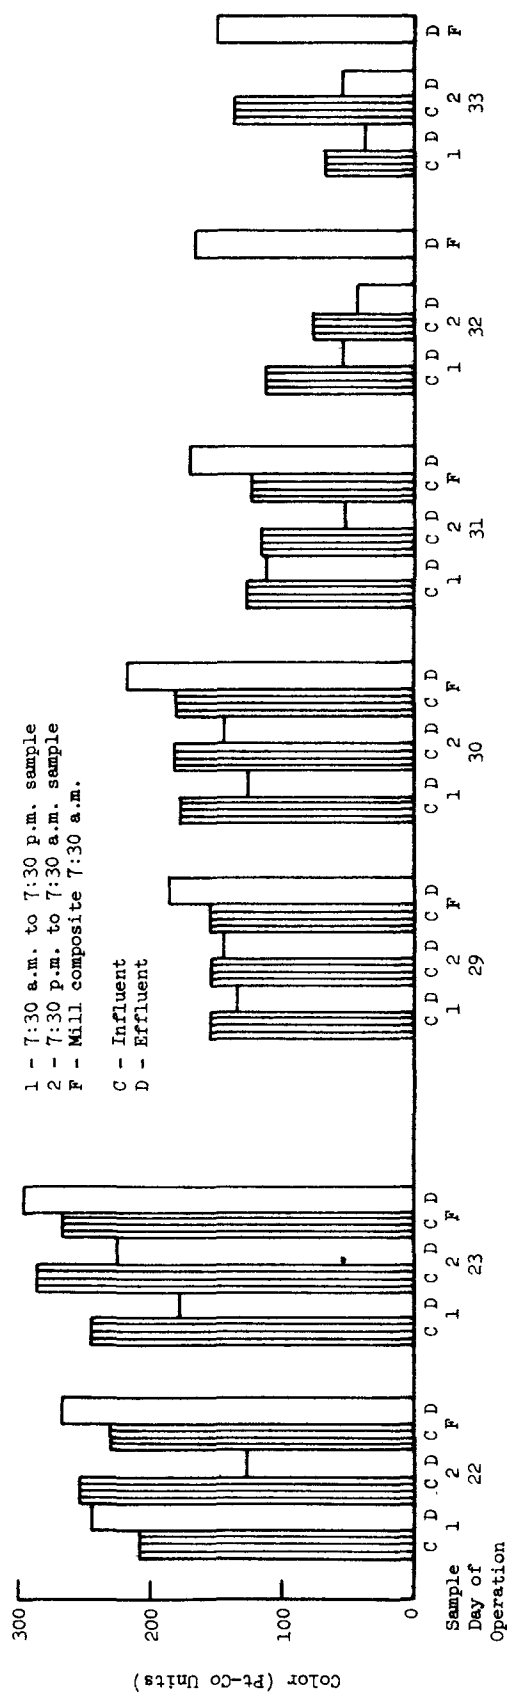


Figure C-4. Effect of ferric chloride - 75 mg Fe^{3+} (without polymer) on color and suspended solids at Locks Mill.

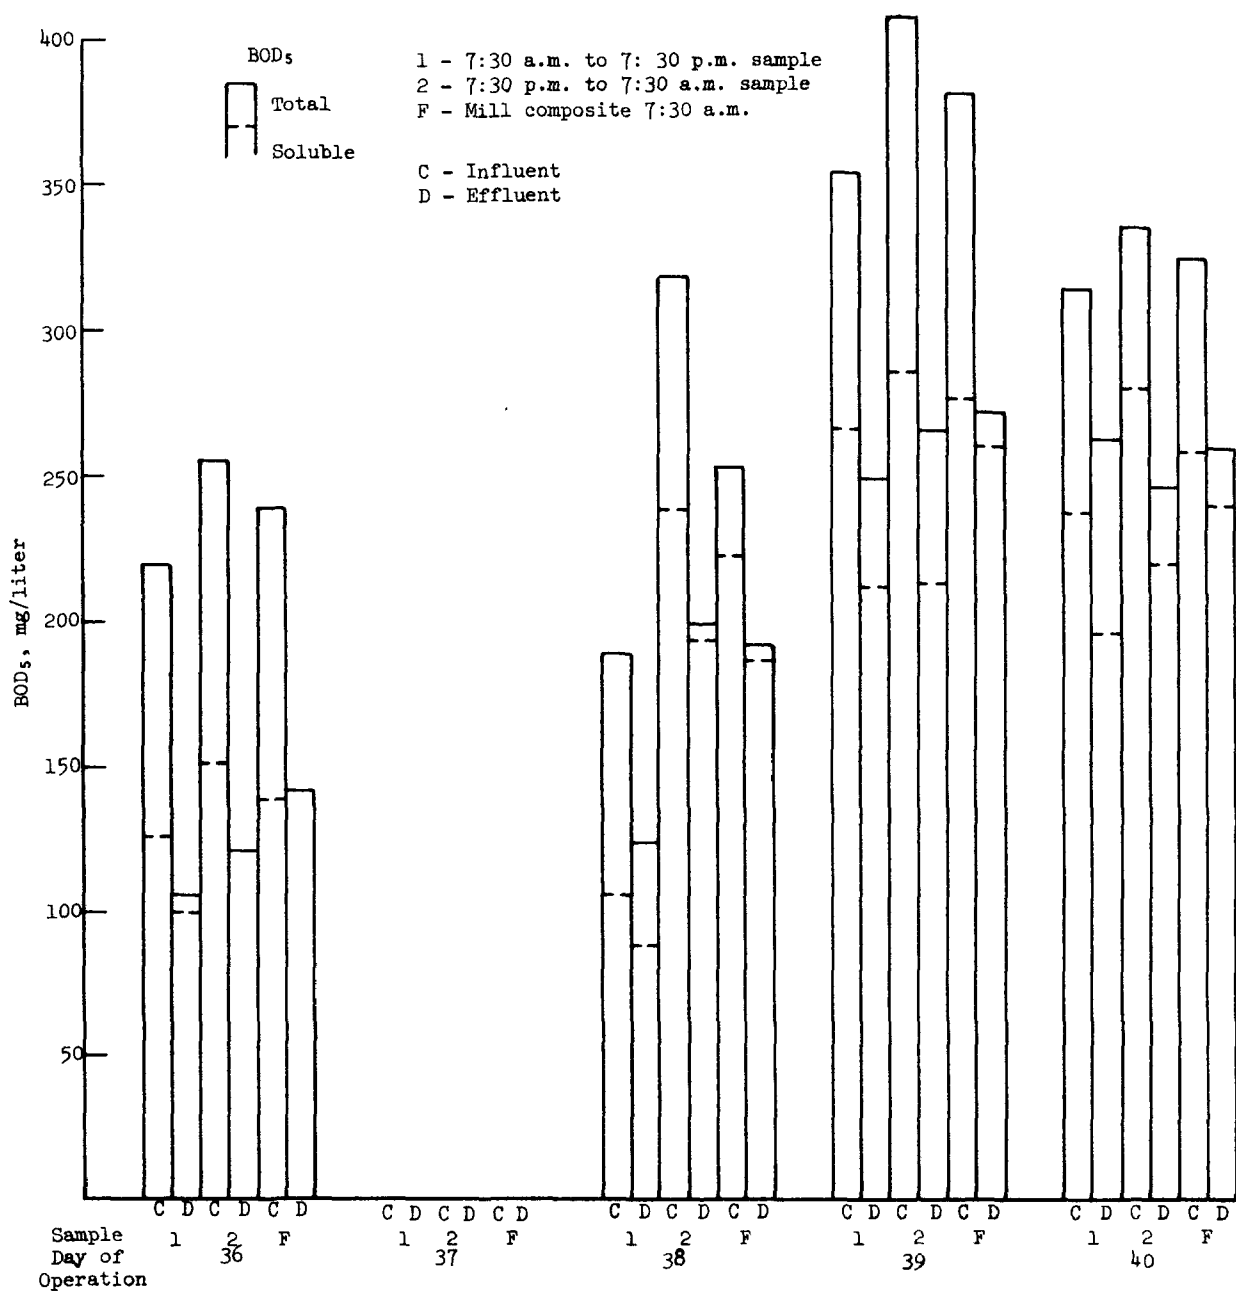


Figure C-5. Effect of ferric chloride (75 mg Fe³⁺/liter) + Nalcolyte 73C32 (1 mg/liter) on BOD₅ at Locks Mill.

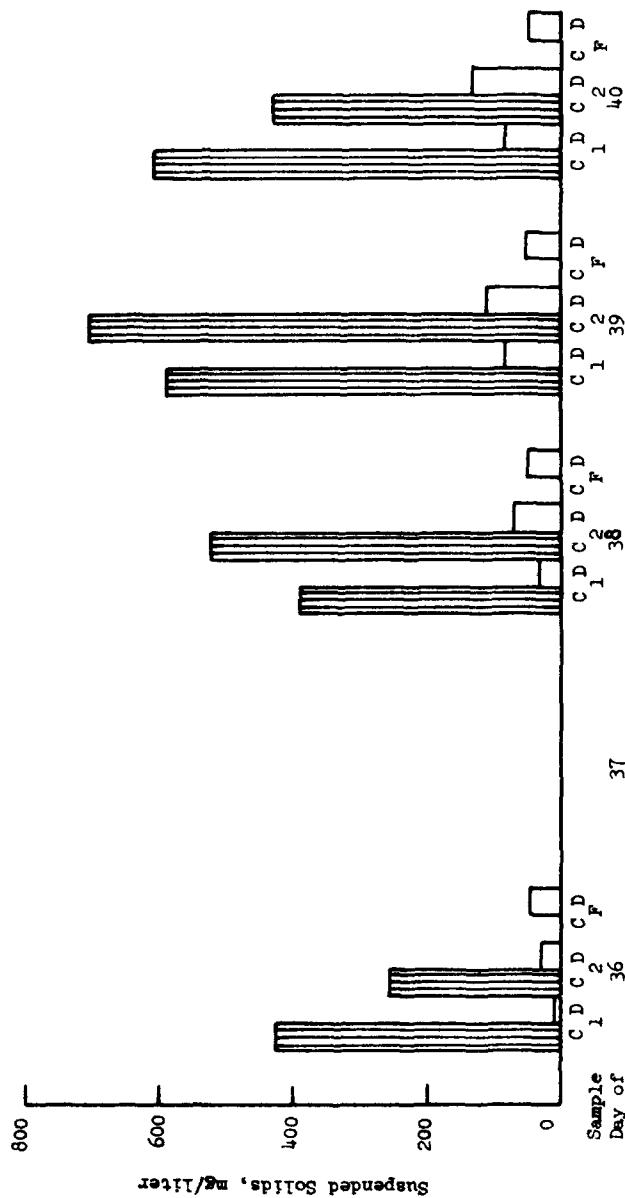
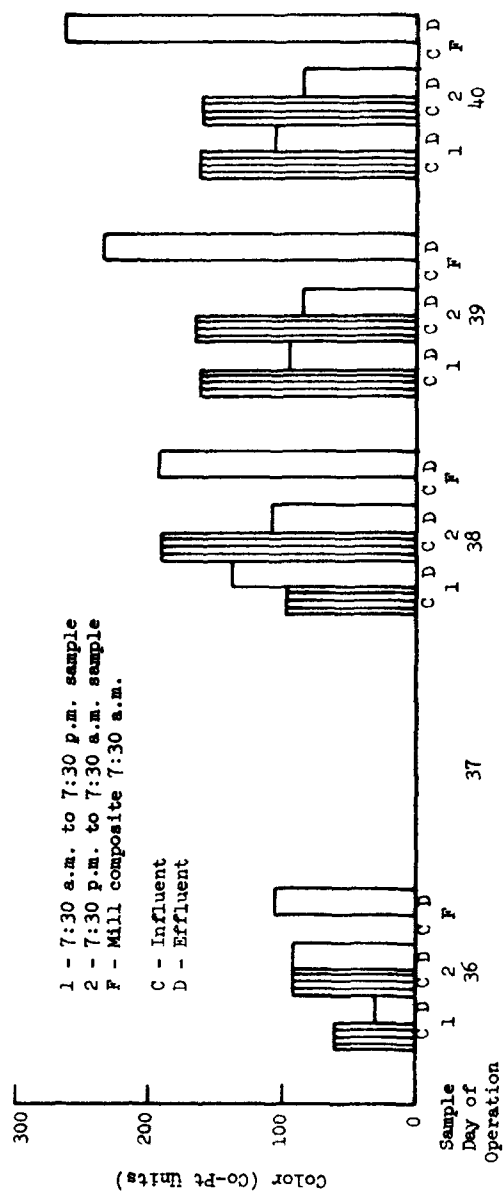


Figure C-6. Effect of ferric chloride (75 mg Fe³⁺/liter) + Nalcolyte 73C32 (1 mg/liter) on color and suspended solids at Locks Mill.

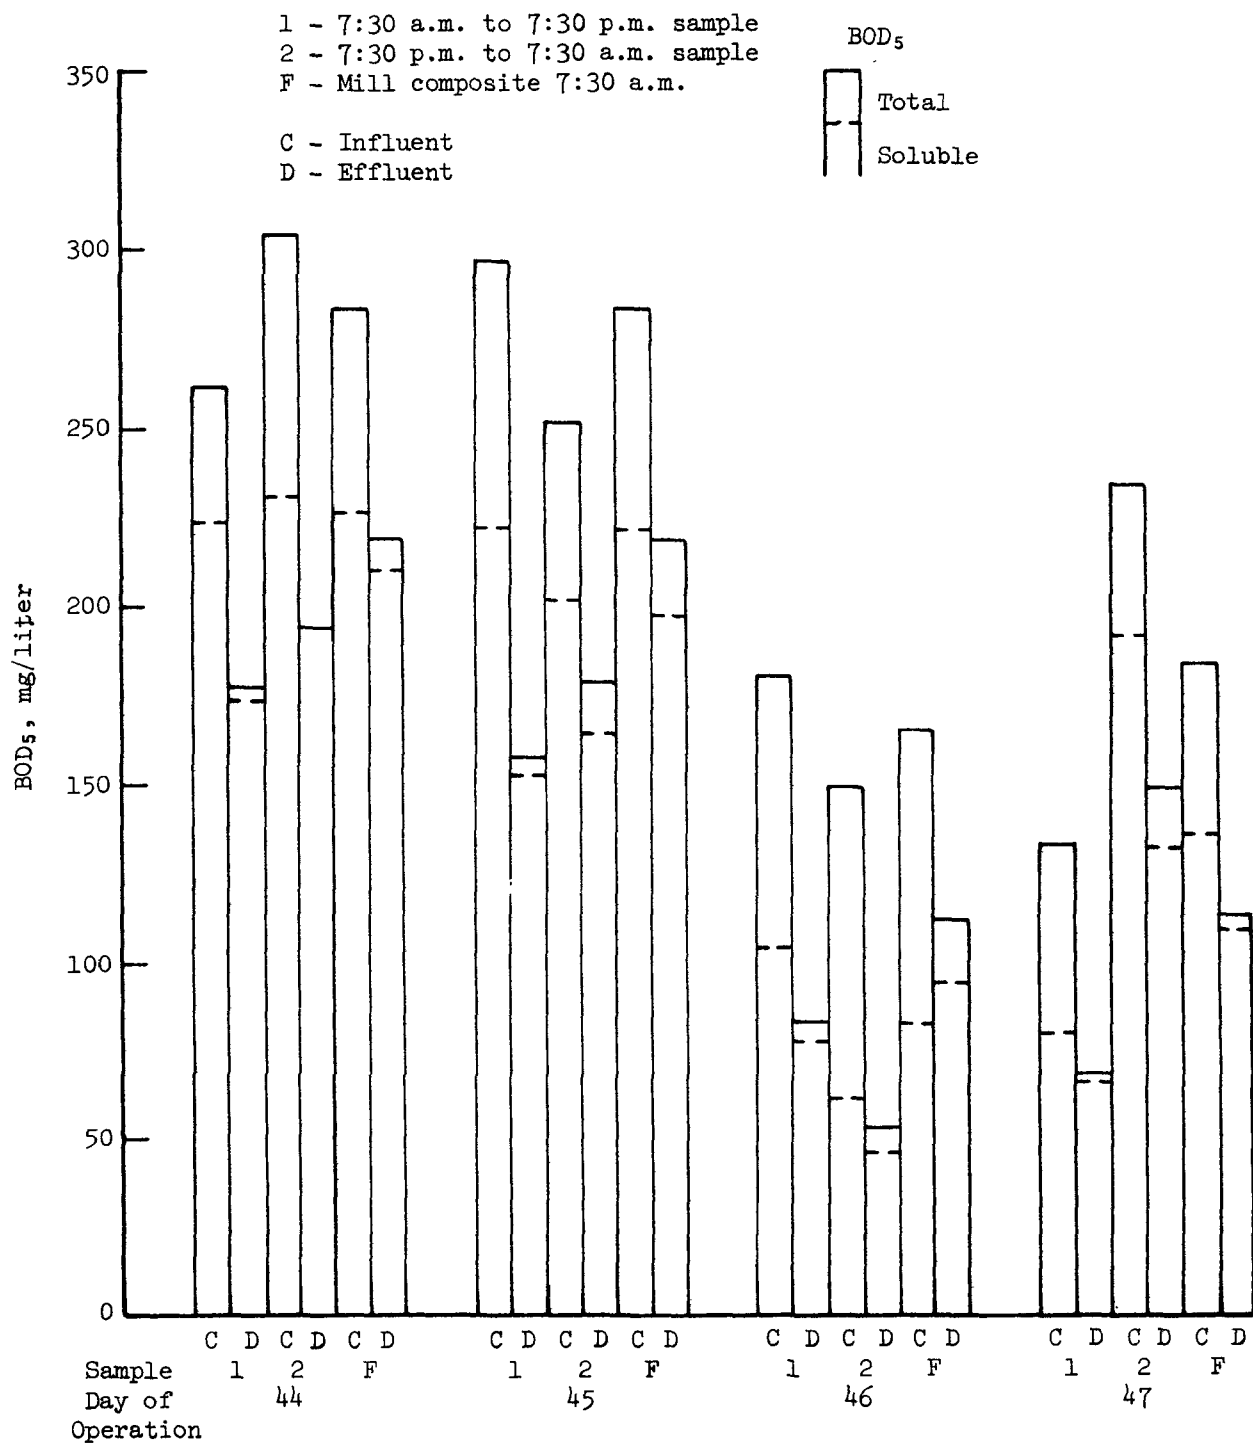


Figure C-7. Effect of ferric sulfate (100 mg Fe³⁺/liter) on BOD₅ at Locks Mill

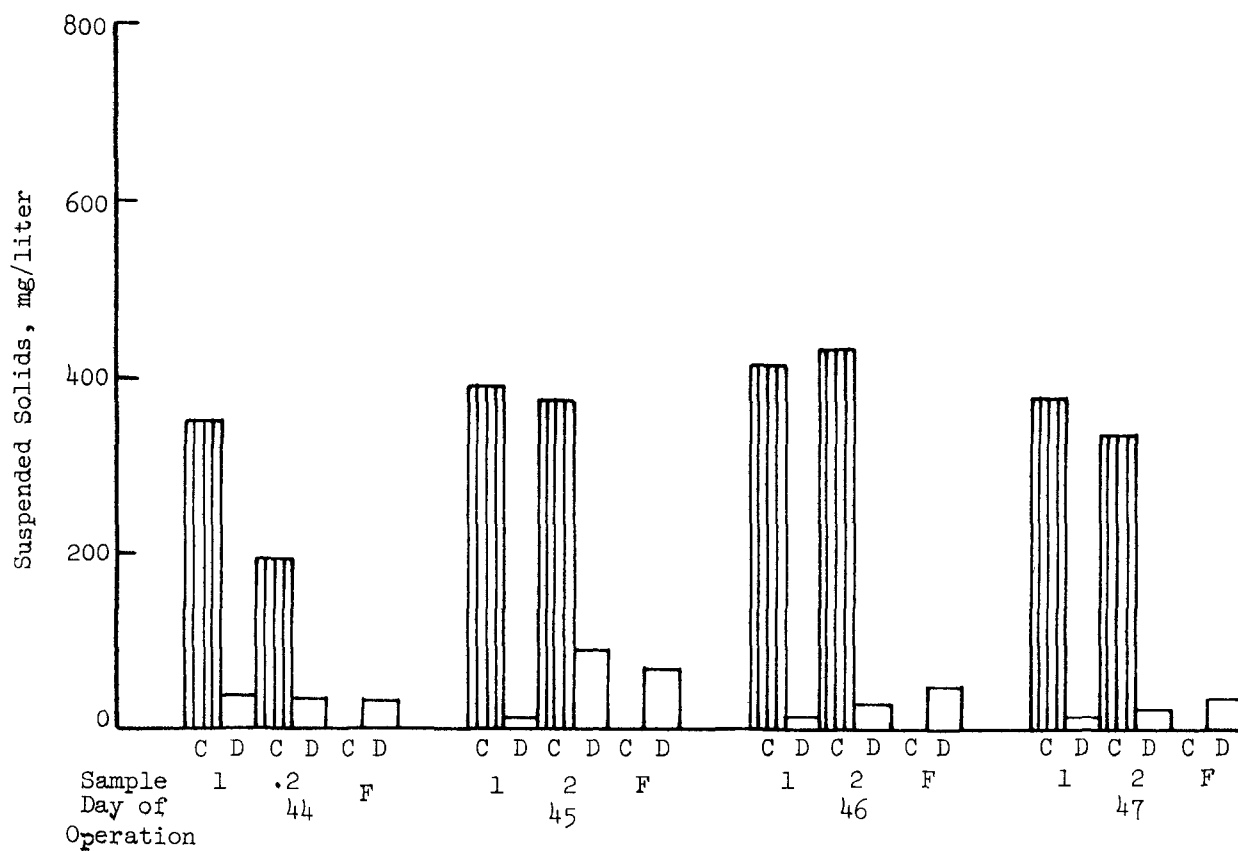
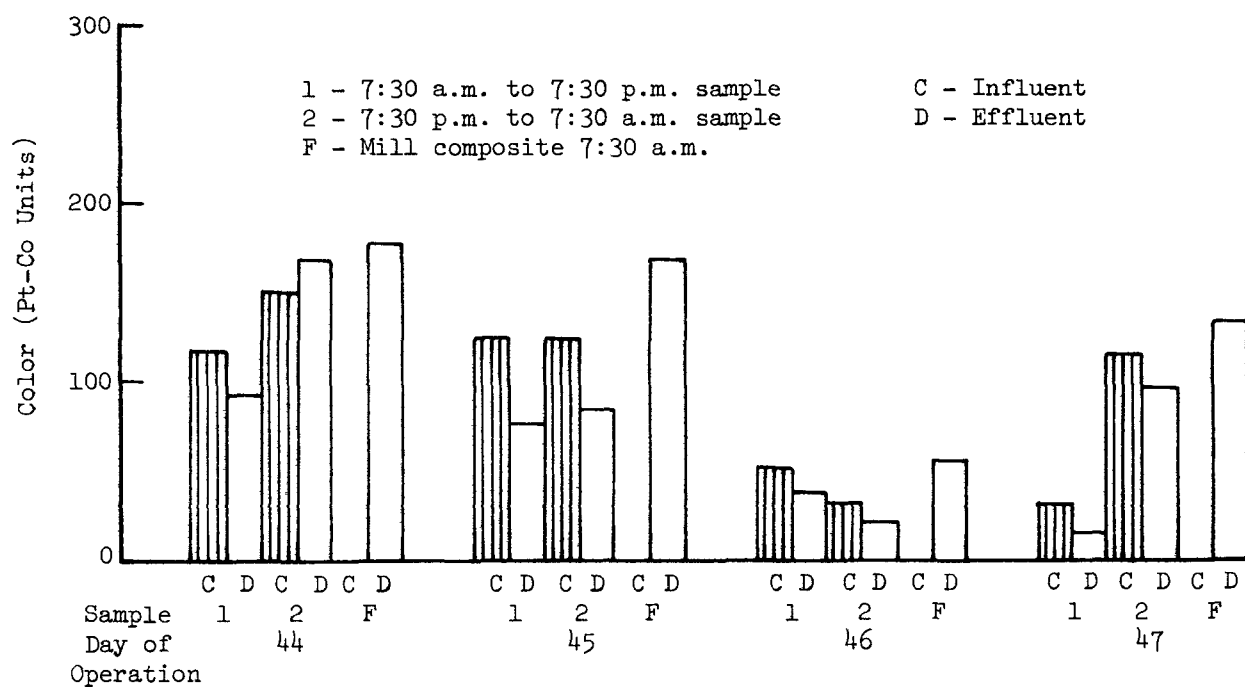


Figure C-8. Effect of ferric sulfate (100 mg Fe^{3+} /liter) on color and suspended solids at Locks Mill.

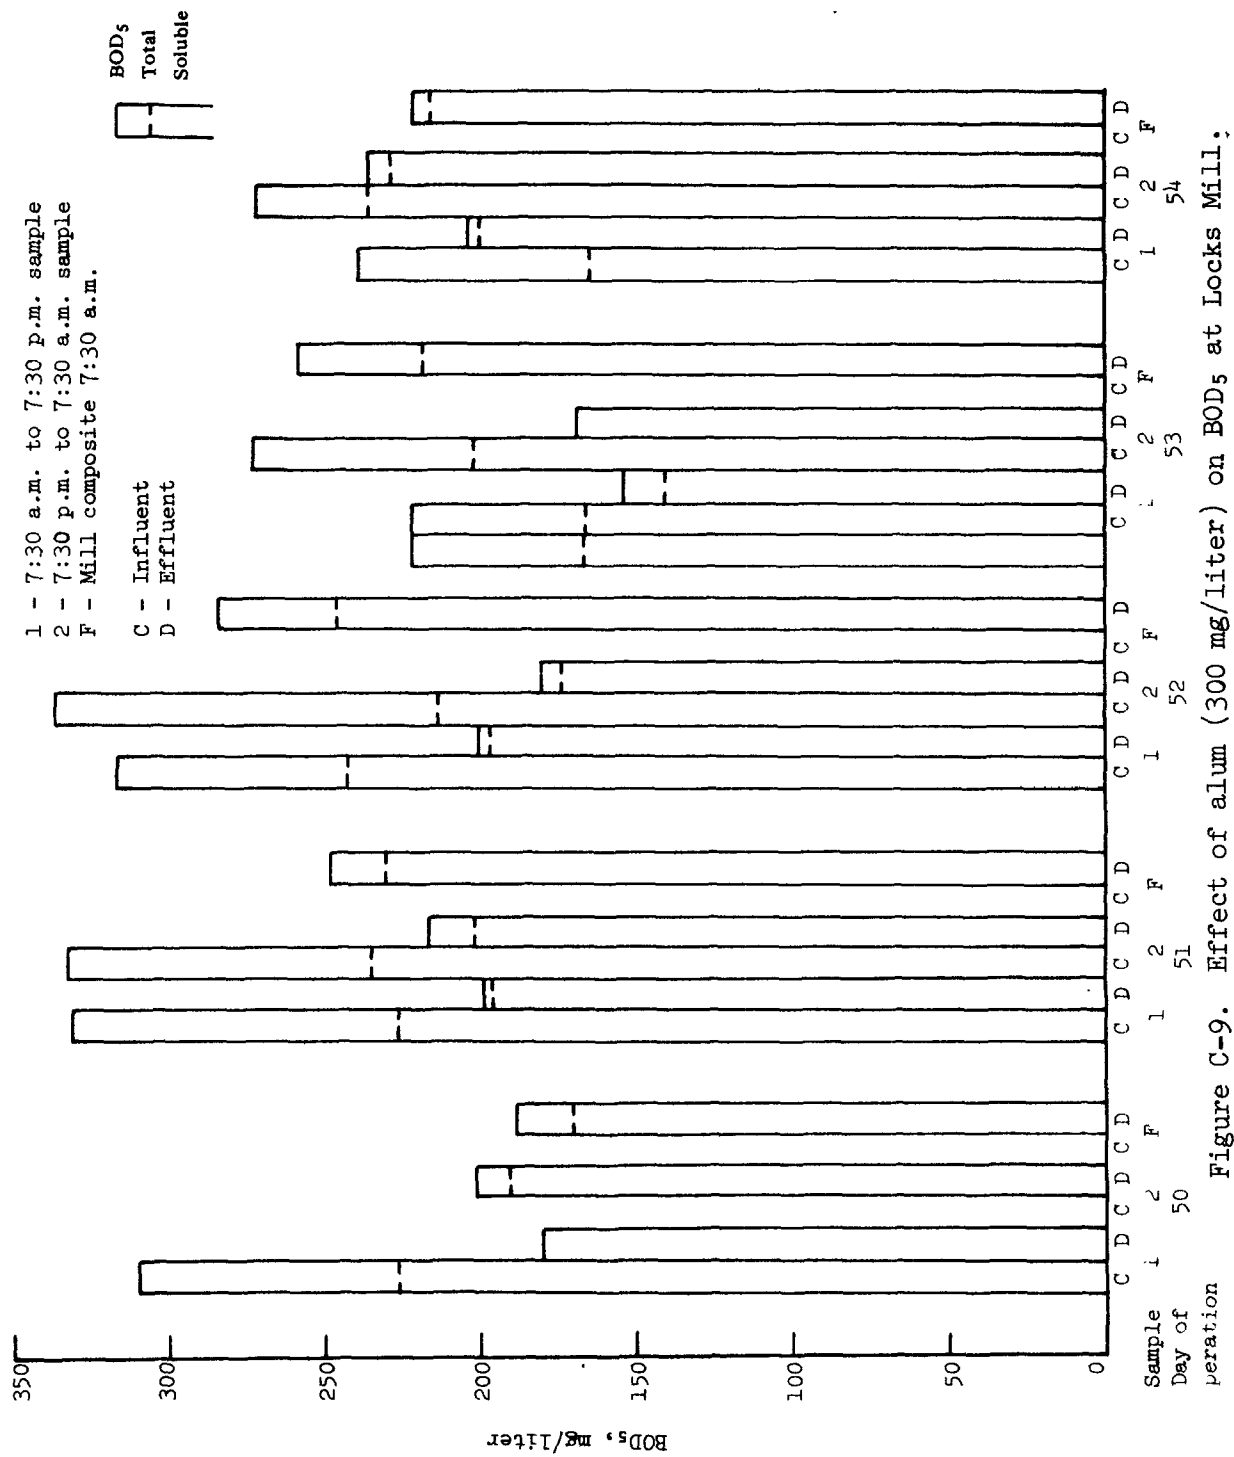


Figure C-9. Effect of alum (300 mg/liter) on BOD₅ at Locks Mill;

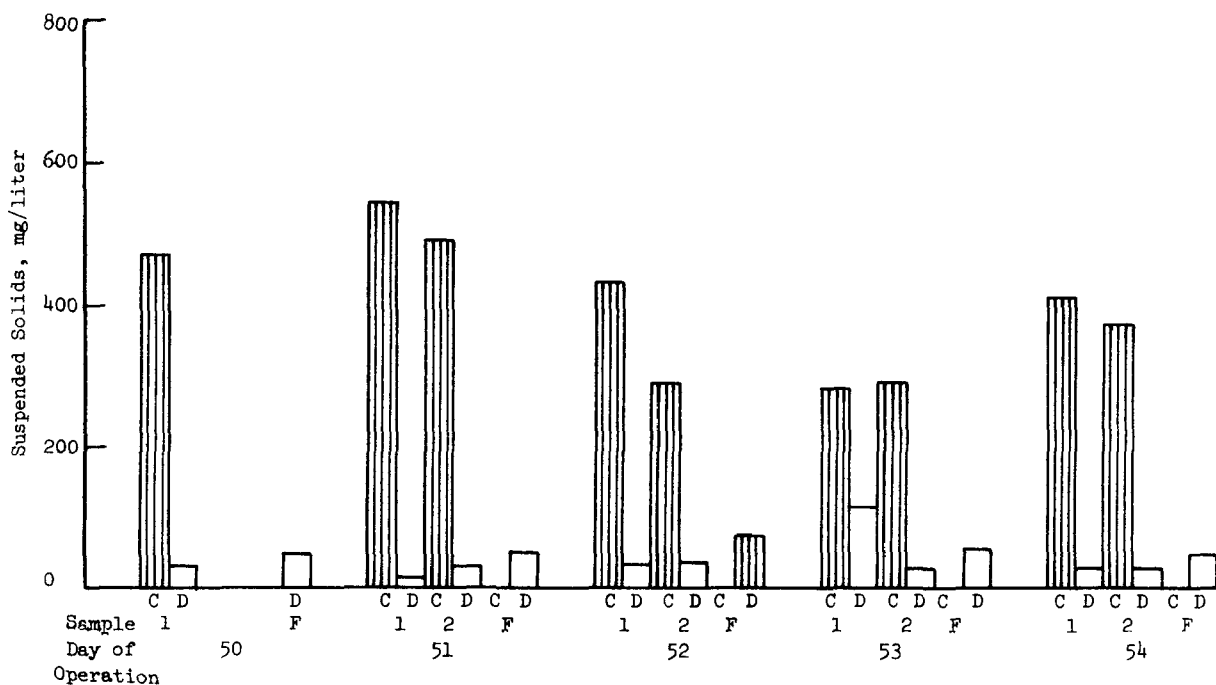
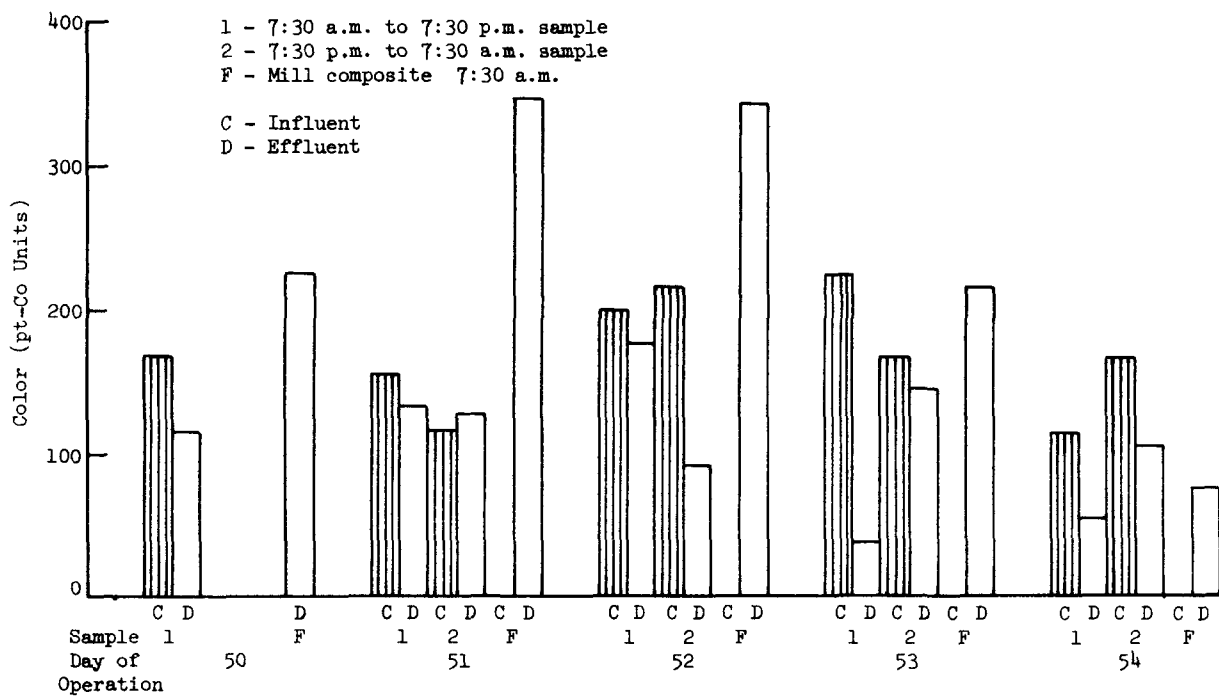


Figure C-10. Effect of alum (300 mg/liter) on color and suspended solids at Locks Mill.

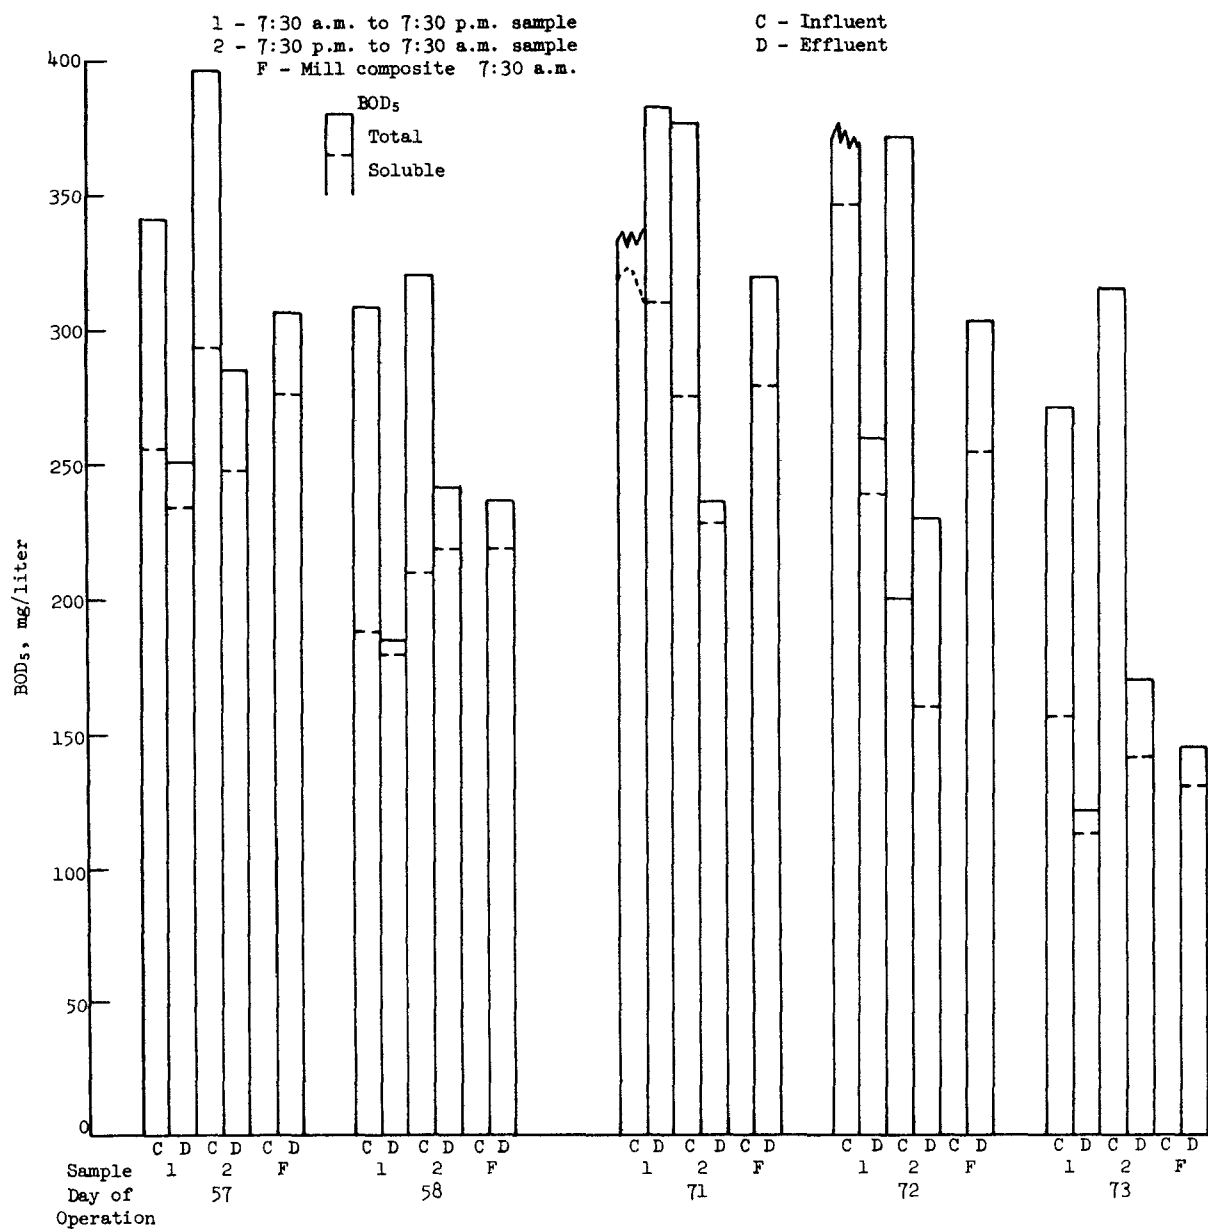


Figure C-11. Effect of alum (300 mg/liter) + Hercofloc 812.3 (0.75 mg/liter) on BOD₅ at Locks Mill.

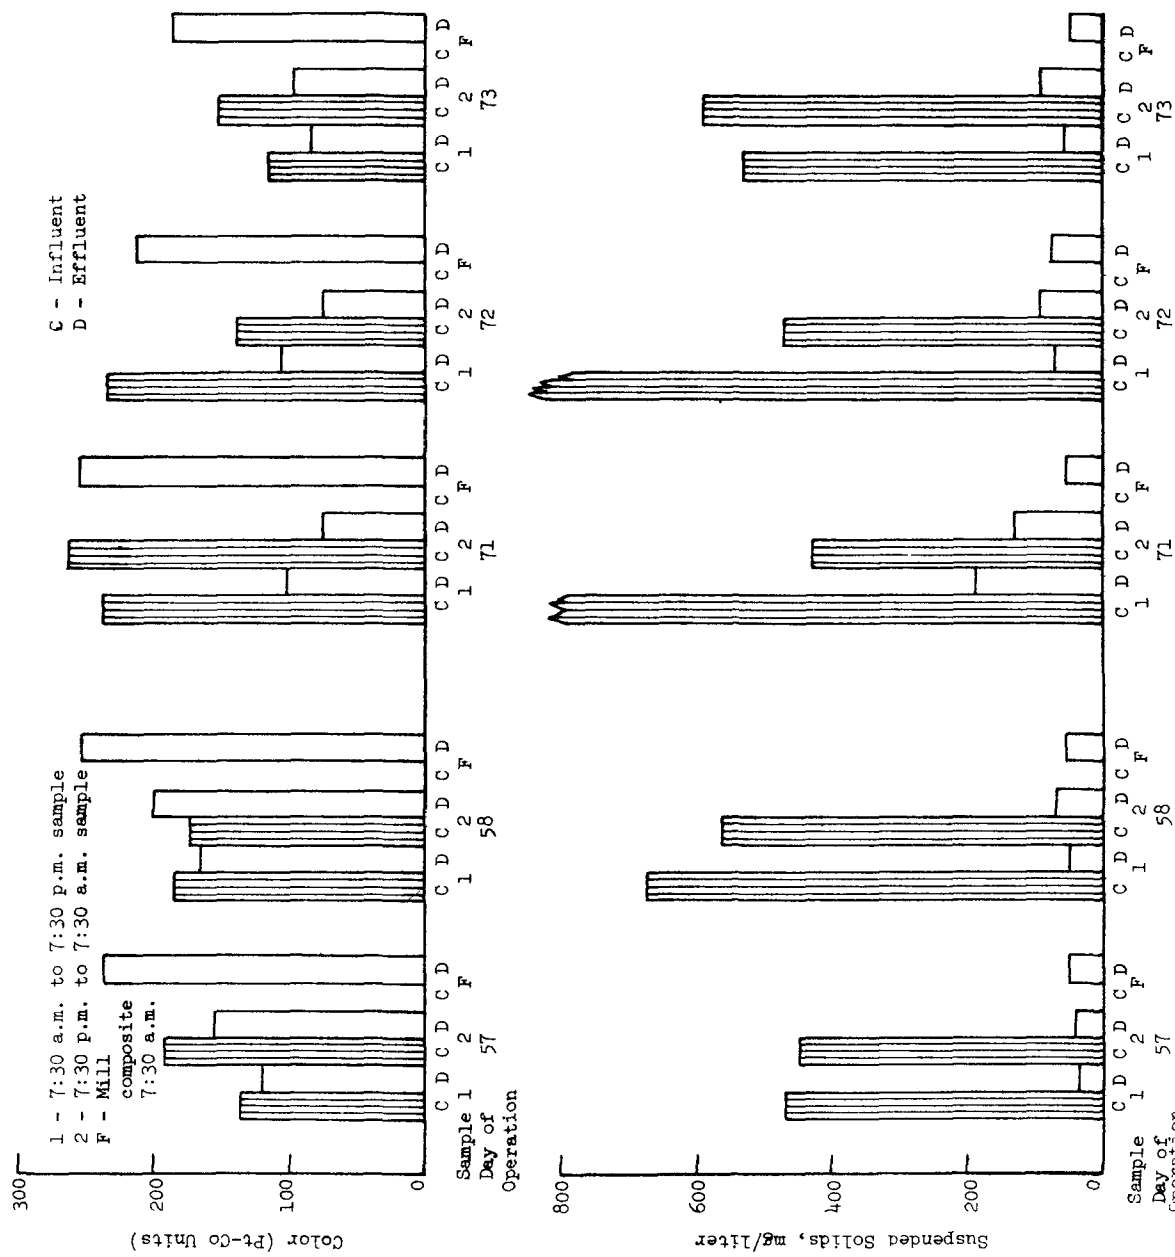


Figure C-12. Effect of alum (300 mg/liter) + Hercofloc 812.3 (0.75 mg/liter) on color and suspended solids at Locks Mill.

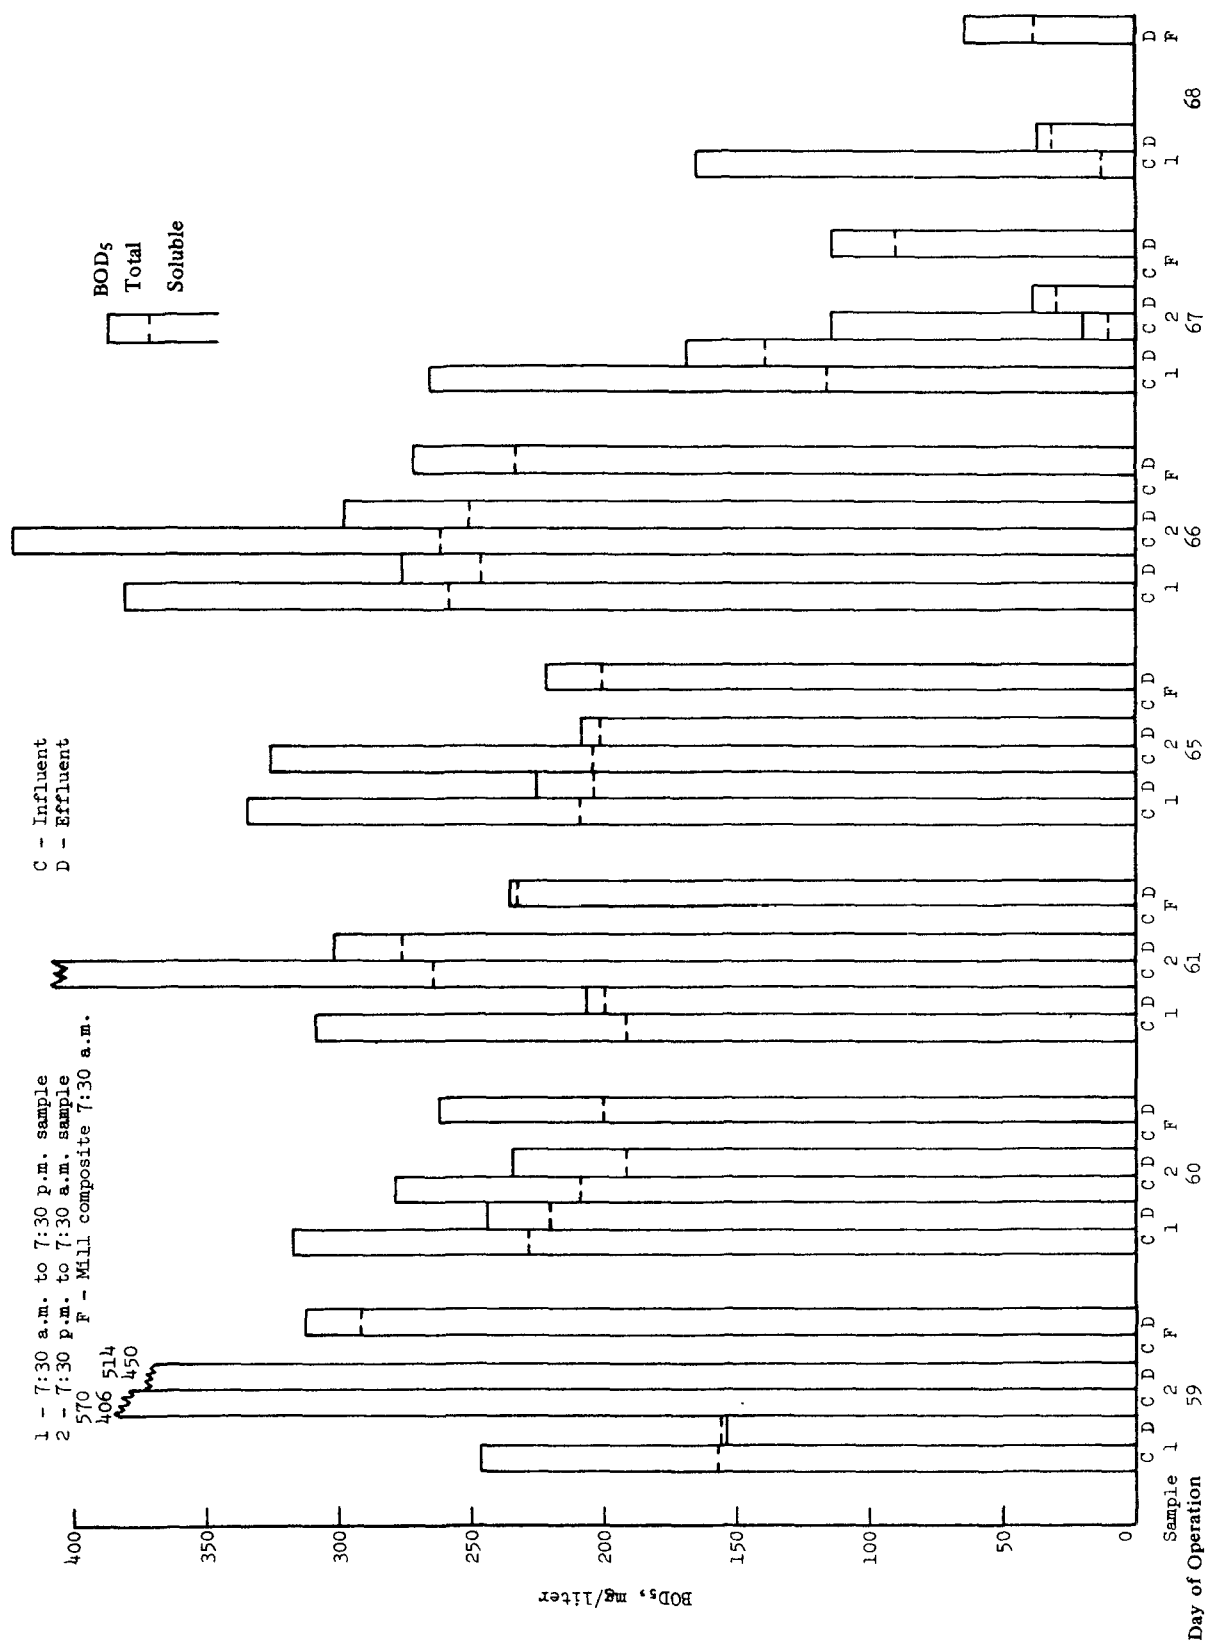


Figure C-13. Total and soluble BOD₅ in second base line (gravity sedimentation) at Locks Mill.

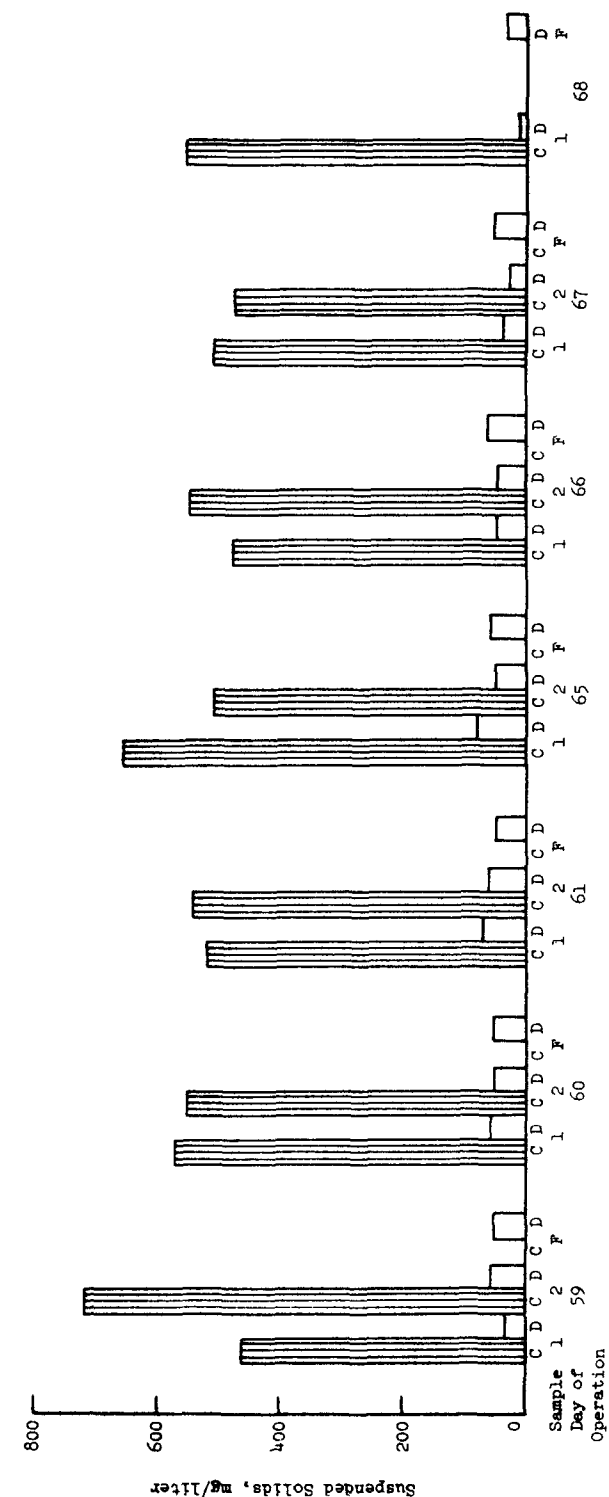
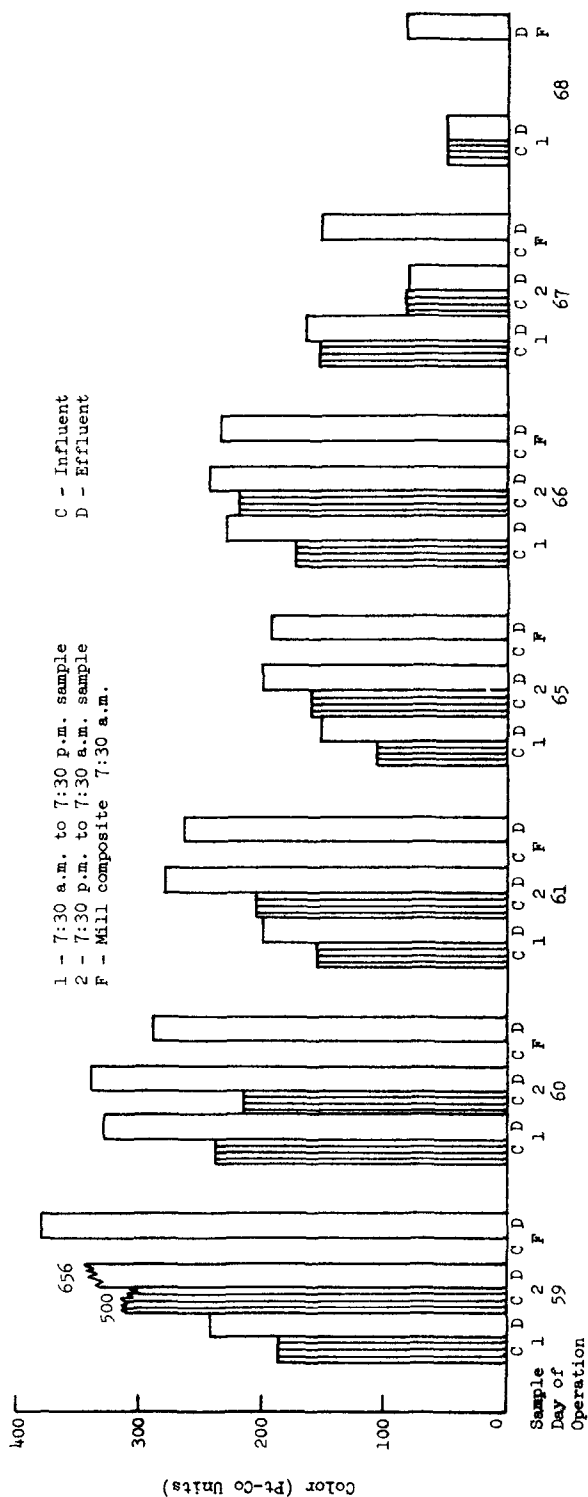


Figure C-14. Color and suspended solids in second base line (gravity sedimentation) at Locks Mill.

TECHNICAL REPORT DATA <i>(Please read Instructions on the reverse before completing)</i>		
1. REPORT NO. EPA-600/2-76-221	2.	3. RECIPIENT'S ACCESSION NO.
4. TITLE AND SUBTITLE REMOVAL OF SOLUBLE BOD ₅ IN PRIMARY CLARIFIERS		5. REPORT DATE September 1976 (Issuing Date)
		6. PERFORMING ORGANIZATION CODE
7. AUTHOR(S) George A. Dubey, Averill J. Wiley, John W. Collins		8. PERFORMING ORGANIZATION REPORT NO.
9. PERFORMING ORGANIZATION NAME AND ADDRESS Effluent Processes Group The Institute of Paper Chemistry Appleton, Wisconsin 54911		10. PROGRAM ELEMENT NO. 1BB610
		11. CONTRACT/GRANT NO. R-803119
12. SPONSORING AGENCY NAME AND ADDRESS Industrial Environmental Research Laboratory Office of Research and Development U.S. Environmental Protection Agency Cincinnati, Ohio 45268		13. TYPE OF REPORT AND PERIOD COVERED Final 7/20/74-9/30/75
		14. SPONSORING AGENCY CODE EPA-ORD
15. SUPPLEMENTARY NOTES		
16. ABSTRACT <p>This project was directed to evaluating means for increasing BOD removal from primary treatment systems treating pulp and paper wastes. An improved understanding of the optimal conditions for soluble and colloidal BOD removal should permit increasing efficiency in total organic removal.</p> <p>The initial phase surveyed 12 mills to obtain data on total and soluble BOD₅, COD, suspended solids and color removal from sedimentation systems. This data was used to select mill effluents for additional study. These laboratory studies showed that, with proper flocculating agents, soluble BOD removal could be markedly increased. Soluble BOD was defined as that organic load passing through a 0.45 µm filter.</p> <p>Measurement of sludge volumes and sludge dewatering characteristics produced from use of iron salts, alum and polymers was outside the objective of the study.</p> <p>Gel chromatography studies showed that low molecular weight biodegradable residues and colloidal materials were flocculated and removed. Studies with model compounds indicated that increased removal is apparently related to pH of the solution and to functional groups, chain length, branching and solubility of the compound.</p> <p>Chemical costs may range from 3¢ to 10¢ per 1000 gallons. Cost reduction and improved clarifier performance can be achieved by elimination of overflows and spills within the mill that are antagonistic to efficient sedimentation due to dispersant action.</p>		
17. KEY WORDS AND DOCUMENT ANALYSIS		
a. DESCRIPTORS	b. IDENTIFIERS/OPEN ENDED TERMS	c. COSATI Field/Group
Precipitation (chemistry) Coagulation Flocculating Oxygen demand	Primary treatment Water pollution control Pulp waste treatment Paper waste treatment Chemical degradation	13B
18. DISTRIBUTION STATEMENT Release to Public	19. SECURITY CLASS (This Report) UNCLASSIFIED	21. NO. OF PAGES 152
	20. SECURITY CLASS (This page) UNCLASSIFIED	22. PRICE

PENAL
AN EQU