





COMMONWEALTH OF VIRGINIA

WATER QUALITY STANDARDS SUMMARY

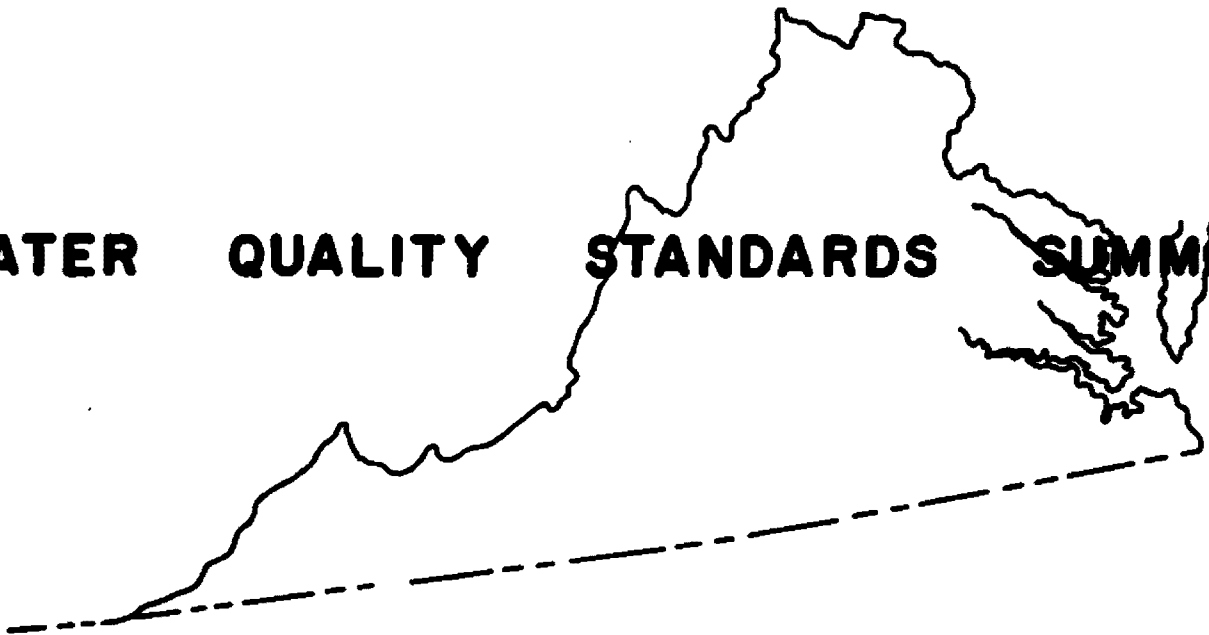

**MENTAL
AGENCY**

**VIRGINIA STATE
WATER CONTROL BOARD**



Water Quality Standards Summary

for

Interstate Waters

of the

Commonwealth of Virginia

U.S EPA Headquarters Library
Mail code 3404T
1200 Pennsylvania Avenue NW
Washington, DC 20460
202-566-0556

Environmental Protection Agency
Region III
Curtis Building, 6th & Walnut Streets
Philadelphia, Pennsylvania 19106

Virginia State Water Control Board
Post Office Box 11143
Richmond, Virginia 23230

LIBRARY
Environmental Agency, WPA
10002, New Jersey 08812

•

•

•

•

TABLE OF CONTENTS

<u>Introduction</u>	i
<u>Water Quality Standards</u>	
Section 1. Rules with State-Wide Application	1
Section 2. Rules with Specific Application Based On Climate, Geographic Area, or Uses	4
Section 3. Variance in Standards	6
Section 4. Application of Standards	6
Section 5. Key to Special Standards	7
Section 6. Designated Water Uses and Water Quality Criteria . .	16
<u>River Basins (Exhibits - See Section 7)</u>	
Section 6A. Big Sandy	19
Section 6B. Clinch River	25
Section 6C. Holston River	33
Section 6D. New River	41
Section 6E. Roanoke River	51
Section 6F. Chowan River	63
Section 6G. Shenandoah River	69
Section 6H. Rappahannock River	81
Section 6I. York River	89
Section 6J. James River (Lower)	95
Section 6K. James River (Middle)	101
Section 6L. James River (Upper)	109
Section 6M. Chesapeake Bay and Atlantic Ocean	119
Section 6N. Yadkin River	127
Section 6O. Albemarle Sound	131
Section 6P. Potomac River	135
<u>Implementation Plan</u>	145
<u>Appendix</u>	147
Glossary of Terms	147
<u>Figures</u>	iii
Figure I. Significant Interstate Waters of the Commonwealth of Virginia	iii
<u>Index</u>	1515
Stream Index	151

1

2

3

4

Summary of Water Quality Standards
for
Interstate Waters
of the
Commonwealth of Virginia

Introduction

In the Water Quality Act of 1965 Congress authorized the establishment of water quality standards for interstate (including coastal) waters. The purpose of these standards is to protect and enhance the quality and productivity of the Nation's interstate waters to serve a variety of beneficial uses, such as public water supply, recreation, protection of aquatic life, and industrial and agricultural uses. This publication summarizes the standards for the general information of the public and Federal, State, and local officials as to the uses and associated requirements for interstate waterways.

The Act, which amended the Federal Water Pollution Control Act, provided for the states to have the first opportunity to establish standards for their interstate waters, which were then subject to review and approval by the Secretary of the Interior. On December 2, 1970, the responsibility for administering the Water Quality Act of 1965, was transferred to the Administrator, Environmental Protection Agency.

All of the states, the District of Columbia, and the territories of Guam, Puerto Rico, and the Virgin Islands participated in this landmark effort to set standards. In the course of establishing the standards, public hearings were held by the states and other jurisdictions noted above to give the public an opportunity to participate in setting water quality objectives and standards.

The standards for interstate waters, which the Commonwealth of Virginia adopted March 28, 1967, were partially approved by the Secretary of the Interior on January 17, 1969.

The Commonwealth of Virginia adopted a policy to protect its high quality interstate waters, and amended their standards effective July 20, 1970. On February 22, 1971, the Administrator, Environmental Protection Agency, approved the amended standards excepting Section 1.01, accepting the 1967 General Criteria in its stead. (See Page 1, 1.01 (b), Approved Federal Standards for Virginia Interstate Waters).

The standards as approved are those applicable under the Act to the Interstate Waters of Virginia and are consistent with the protection of the public health and welfare, the enhancement of water quality and the purposes of the Federal Water Pollution Control Act as provided by Section 10(c)(3) of that Act. The standards consist of the Commonwealth of Virginia water quality standards effective July 20, 1971; the "description of waste sources" dated April 8, 1970 supplemented as described by the Industrial Waste Treatment Needs List and the Municipal Waste Treatment Needs List enclosed with the FY 71 State program plan; and the policies and statements set forth in the State Water Control Board transmittal letter to the Federal Water Quality Administration dated May 12, 1970 except that where on Page 3, Paragraph B-9 that letter refers to Section 62.1-44.15(14), is substituted.

The standards are now being implemented. However, there will be continuing research on water quality requirements for various beneficial uses and improved collection and evaluation of water quality data. As more information becomes available and experience with implementing standards is gained, the standards will be refined and improved to reflect this new knowledge.

Should more detailed information be required on any aspect of the standards, it may be obtained from the Commonwealth of Virginia State Water Control Board, P. O. Box 11143, Richmond, Virginia 23232; or the Environmental Protection Agency, Region III, 6th and Walnut Streets, Philadelphia, Pennsylvania, 19106.

SIGNIFICANT INTERSTATE WATERS OF THE COMMONWEALTH OF VIRGINIA

U.S. DEPARTMENT OF THE ARMY
ENGINEERING DISTRICT OF VIRGINIA
FALLS CHURCH, VIRGINIA

LEGEND
 --- INTERSTATE STREAM
 --- STATE STREAM
 --- RIVER
 --- LAKE
 --- DAM
 --- STATE BOUNDARY




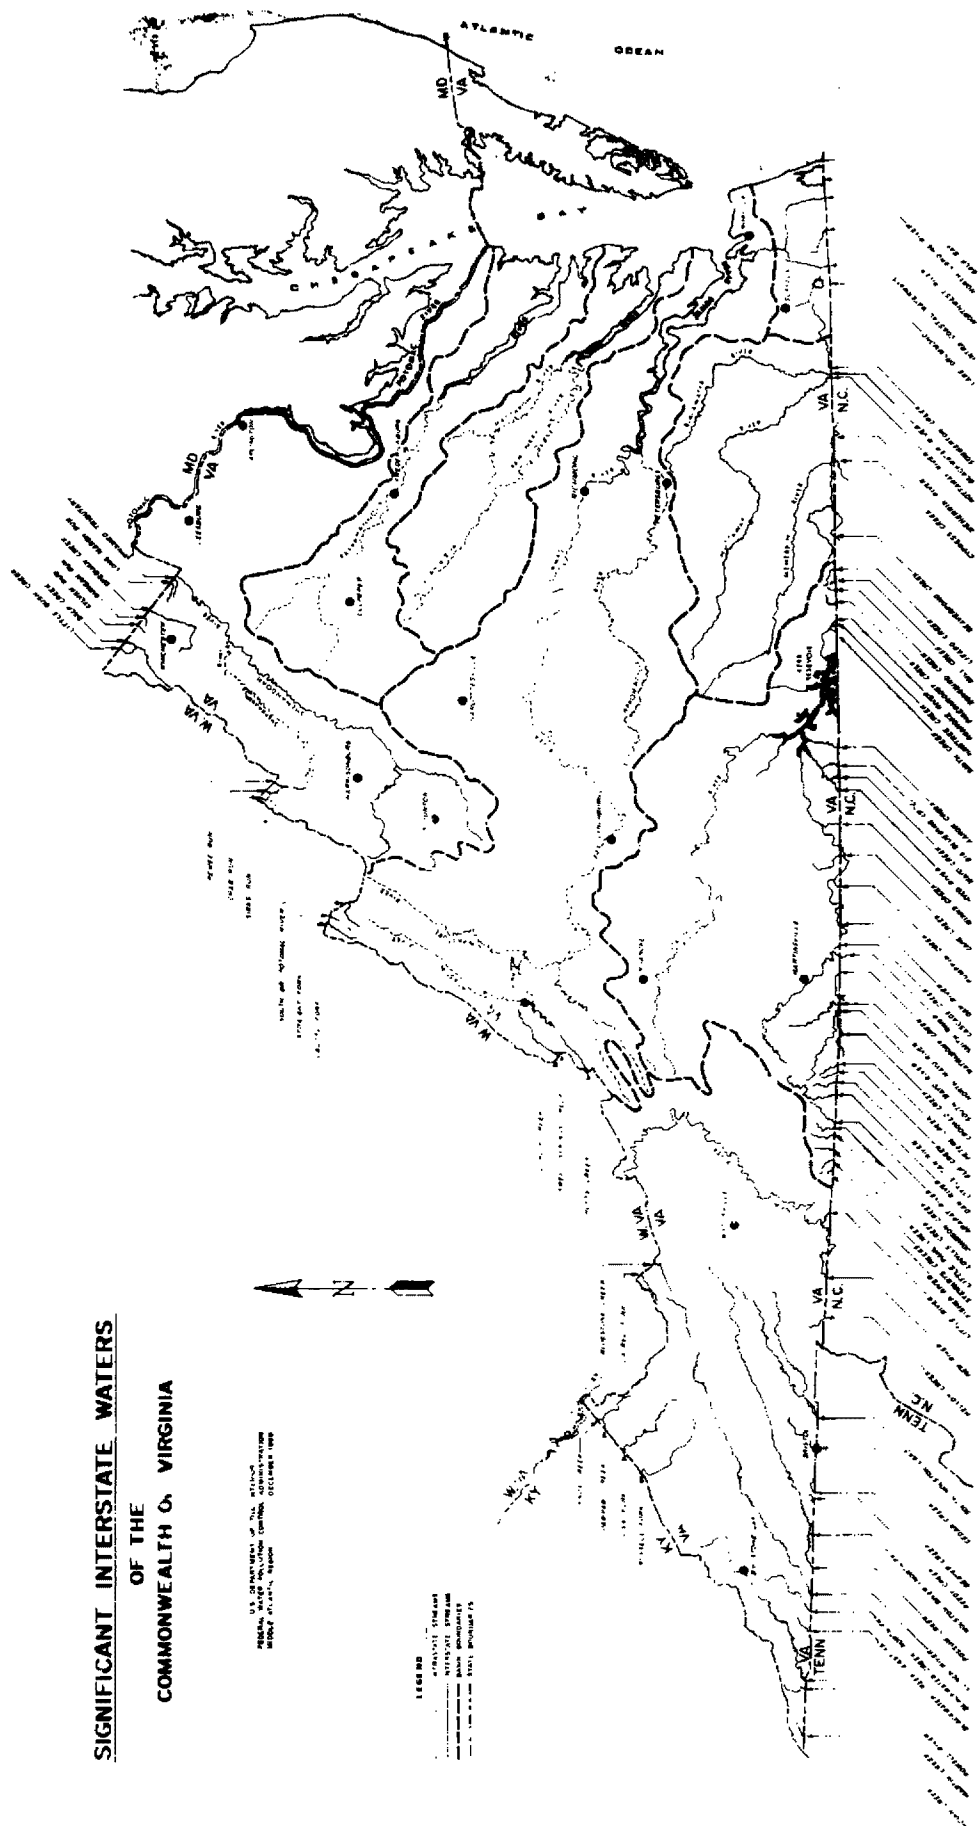



Figure 1.

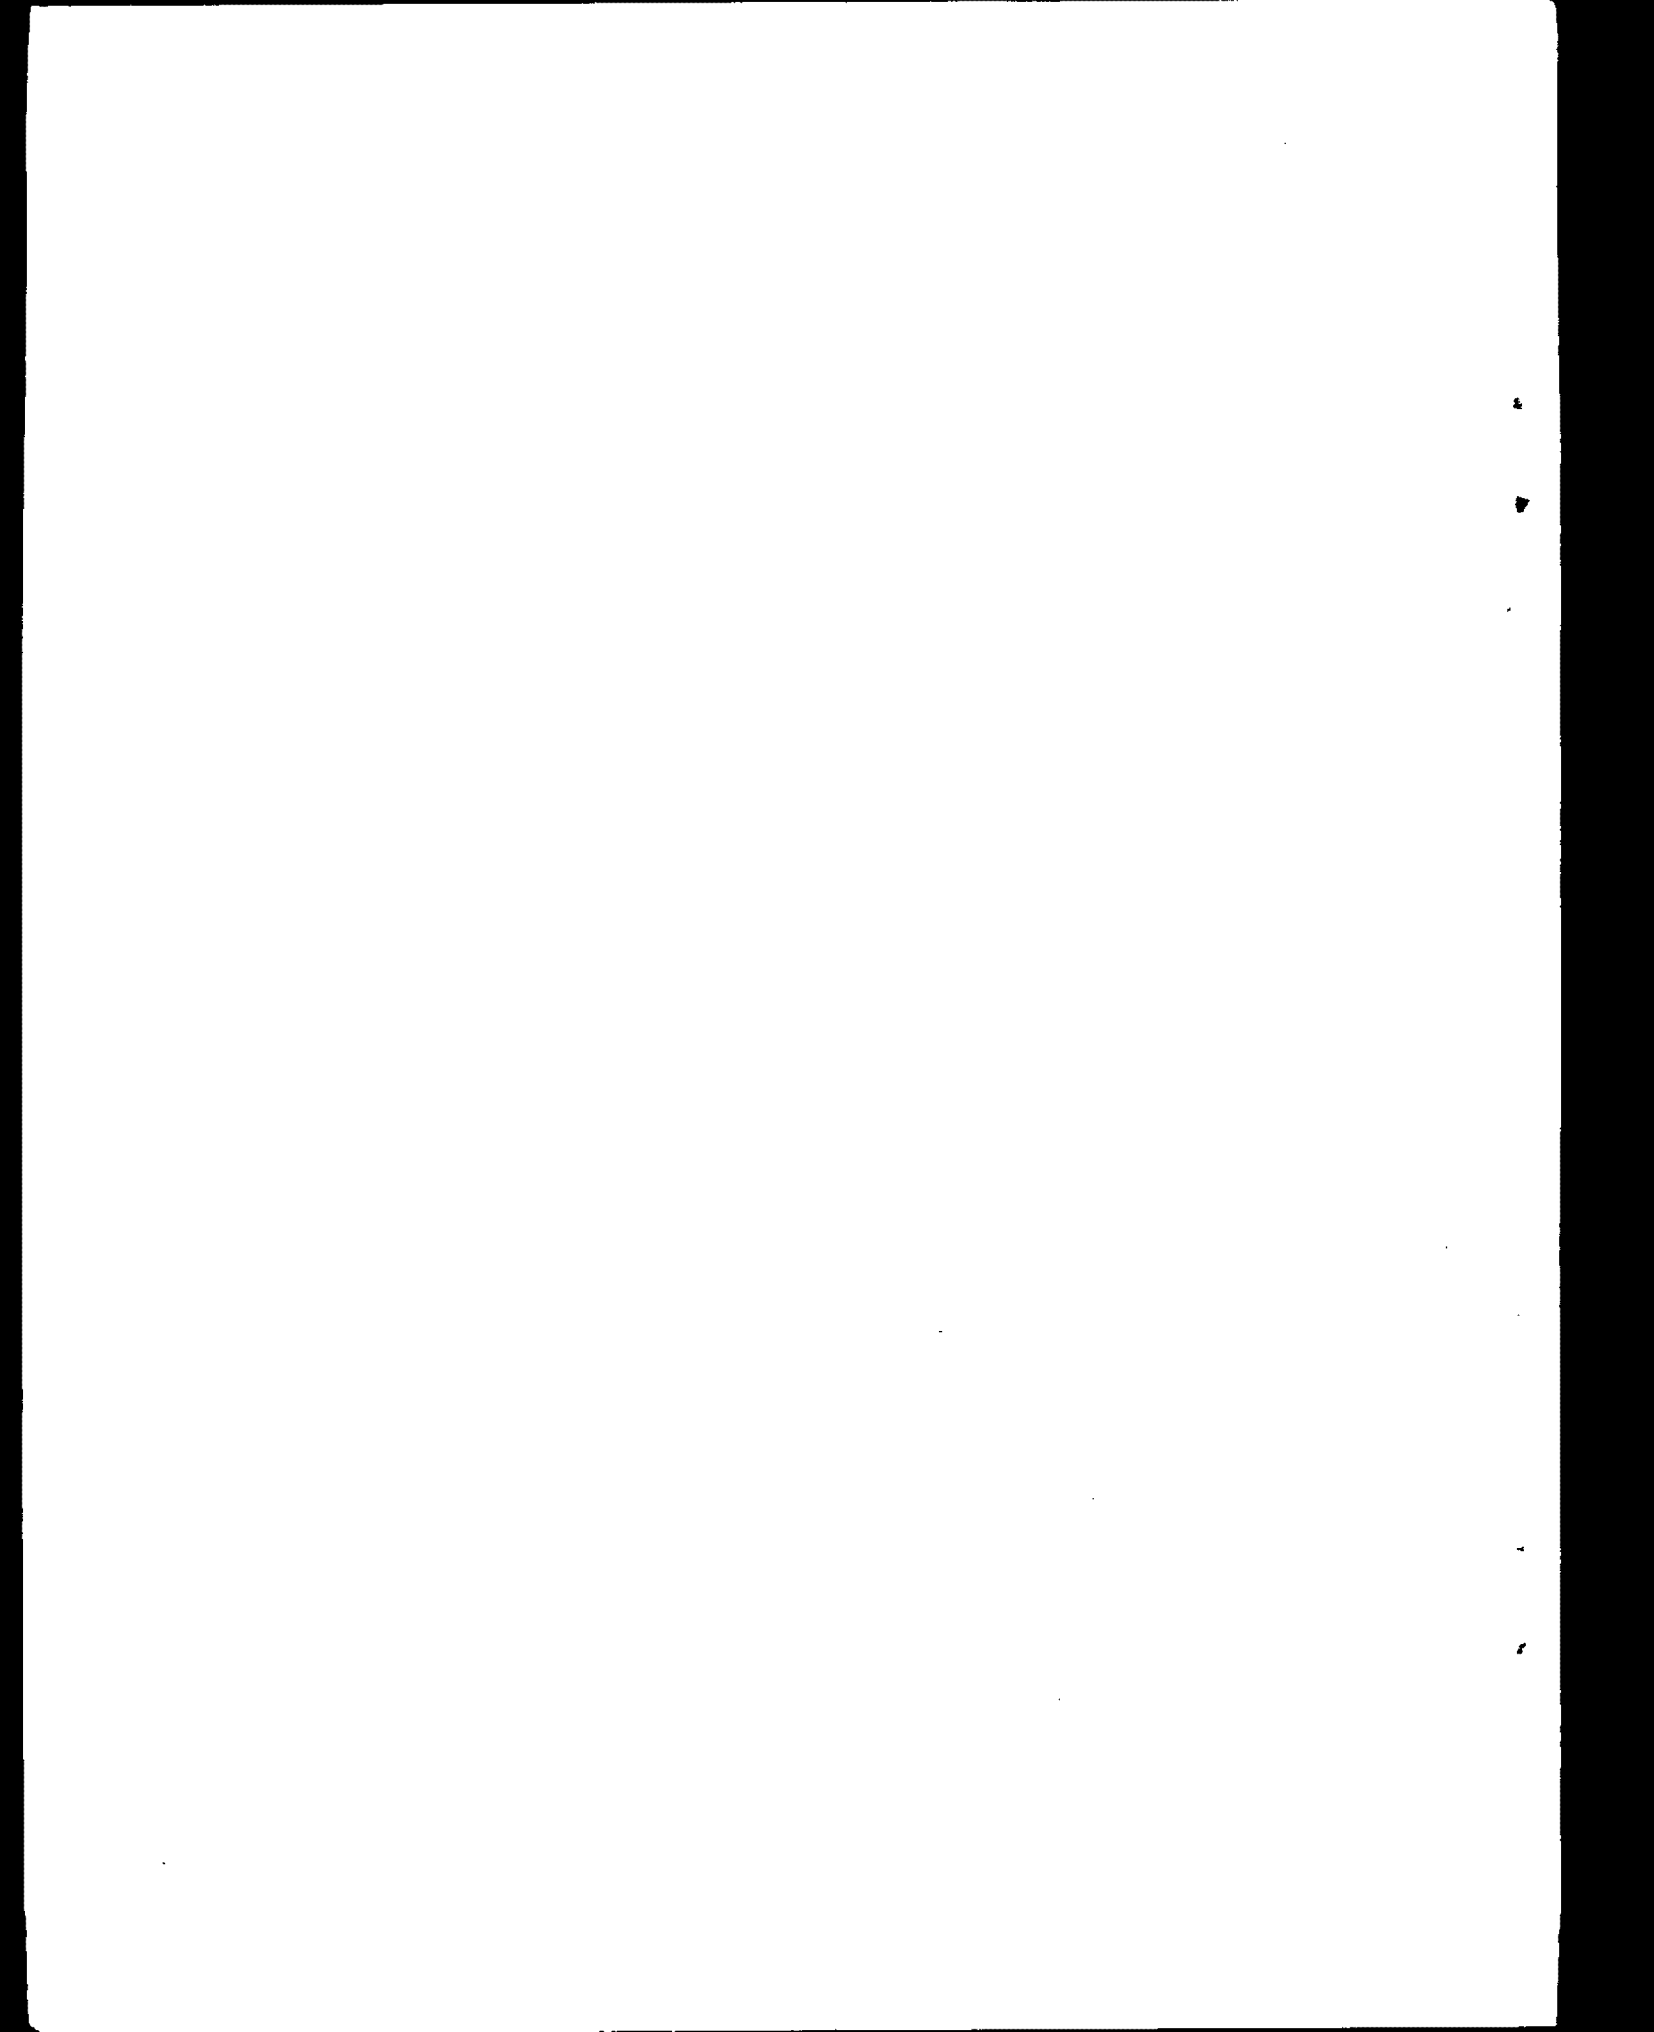

Water Quality Standards Summary
for
Interstate Waters
of the
Commonwealth of Virginia

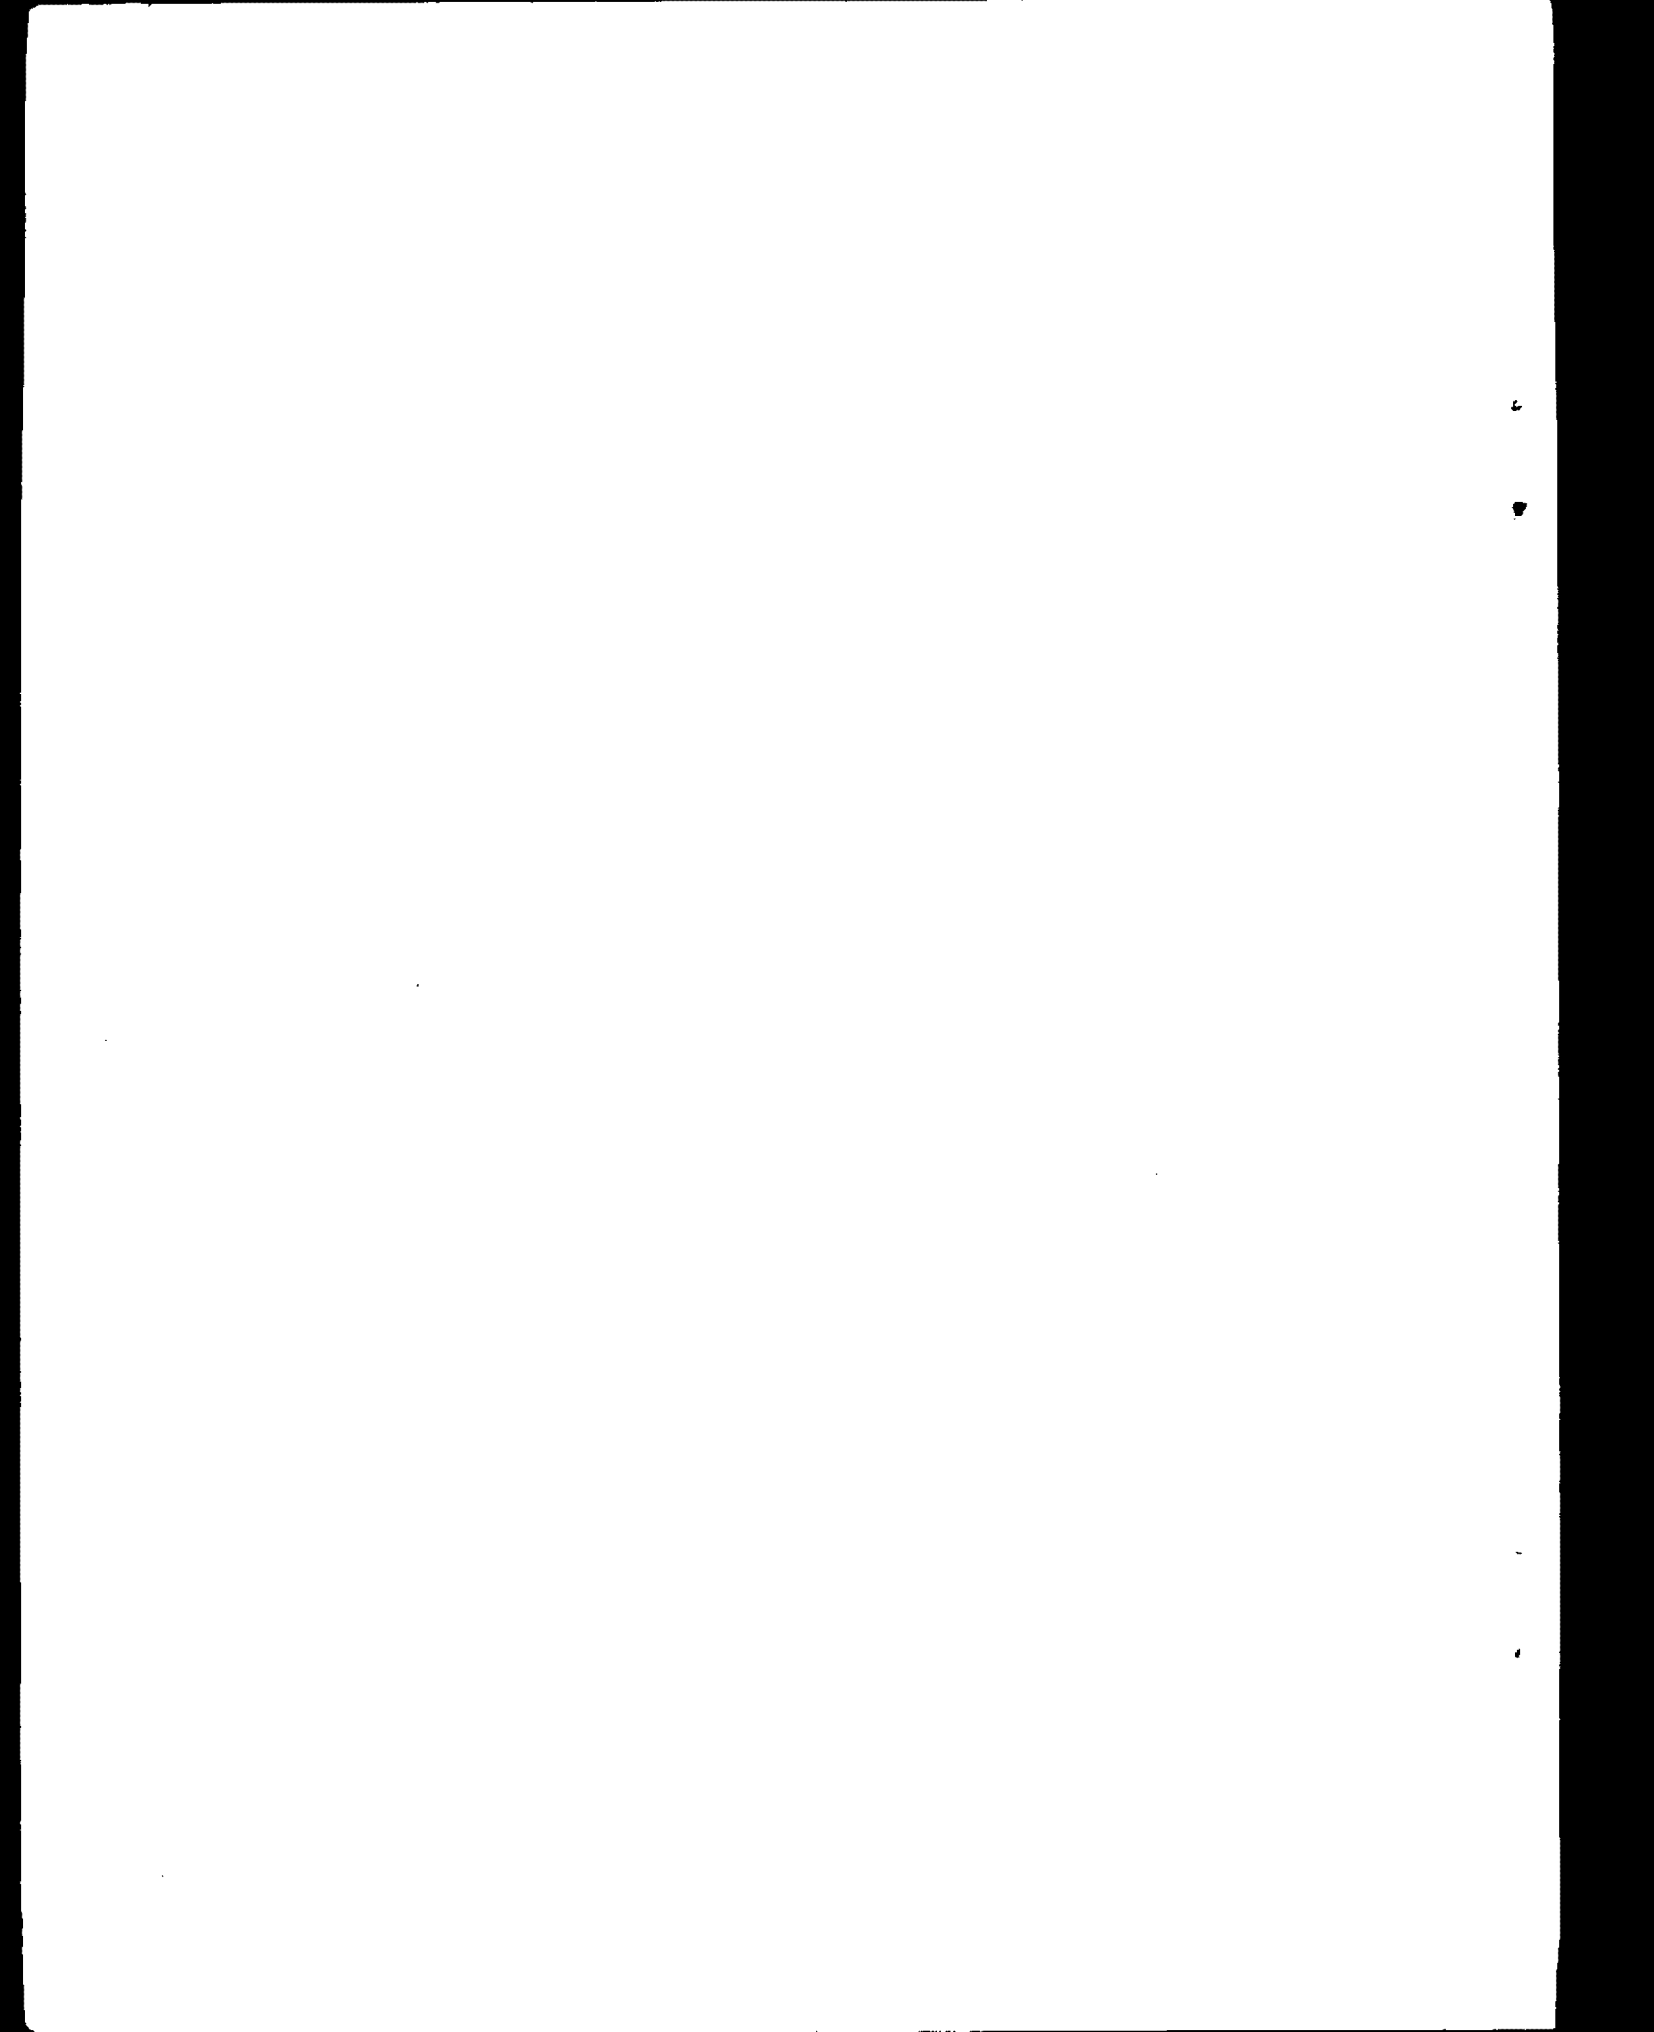

Water Quality Standards Summary
for
Interstate Waters
of the
Commonwealth of Virginia

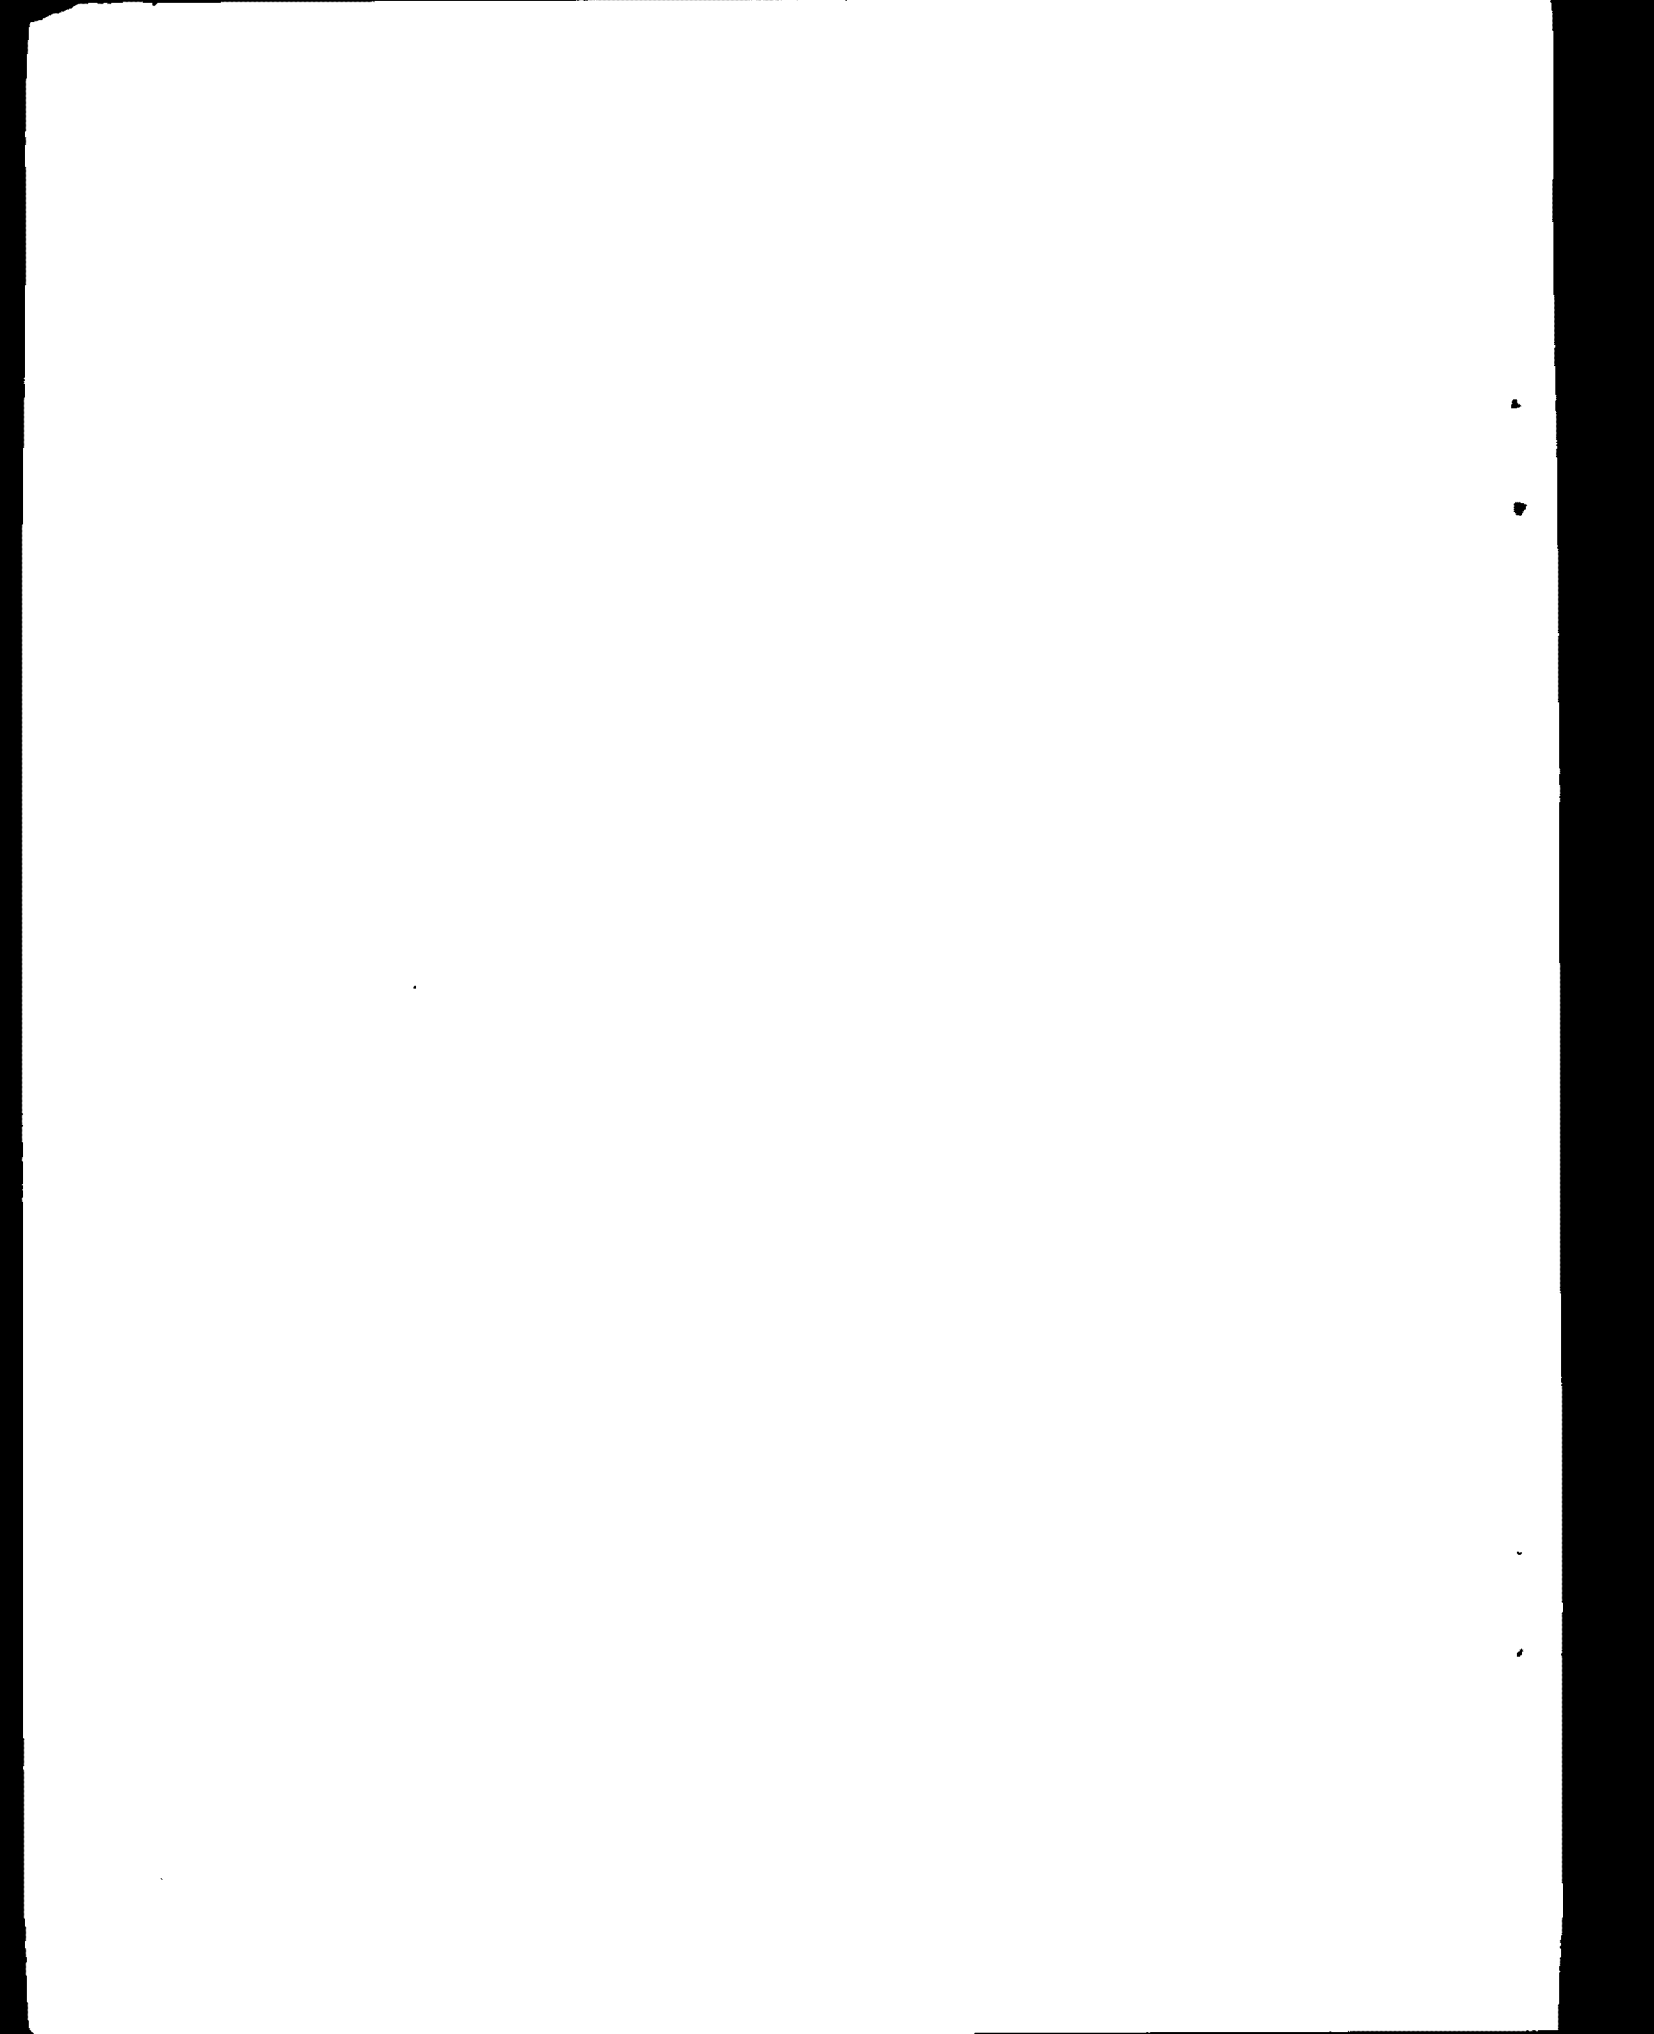

Water Quality Standards Summary

It is the public policy of the Commonwealth of Virginia that waters whose existing quality is better than the established standards as of the date on which such standards become effective will be maintained at high quality; provided that the Commonwealth of Virginia has the authority to approve any project or development which would constitute a new or an increased discharge of effluent to high quality water, when it has been affirmatively demonstrated that a change is justifiable to provide necessary economic or social development, and provided further, that the necessary degree of waste treatment to maintain high water quality will be required where physically and economically feasible. Present and anticipated use of such waters will not be precluded under the conditions of the aforesaid. In implementing this policy, the Administrator, Environmental Protection Agency, will be kept informed and will be provided with such information that he will need to discharge his responsibilities under the Federal Water Pollution Control Act.

Section 1. Rules with State-Wide Application

a. Stream standards will apply whenever flows are equal to, or greater than, the minimum mean 7-consecutive day drought flow with a 10-year return frequency.

b. In lakes and impoundments the temperature of the epilimnion, in those areas where important organisms are most likely to be adversely affected, shall not be raised more than 3°F, above that which existed before the addition of heat of artificial origin. The increase is to be based on the monthly average of the maximum daily temperature. Unless a special study shows that a discharge of heated effluent into the hypolimnion (or pumping water from the hypolimnion for discharging back into the same water body) will not produce adverse effects, such practice shall not be approved. Maximum temperatures consistent with the standards established for waters immediately above and below the lake or impoundment will be established for these waters.

c. Any tributary stream which is not named in a specific section description, or otherwise, shall carry the same classification and standards of quality assigned to the stream or section to which it is tributary.

d. General Criteria

1. The following paragraph, adopted by the Commonwealth of Virginia as part of the April 8-June 9, 1970 amendments submitted to the Administrator, Environmental

Protection Agency, was excepted from approval. As such, the statement is excluded as a Federal criterion but is enforceable as a State criterion applicable to all Virginia waters.

"All waters within this State shall at all times be free from all substances attributable to sewage, industrial wastes, or other wastes in concentrations or combinations which contravene established standards or interfere directly or indirectly with beneficial uses of such waters; except that limited zones will be permitted for the mixture of treated sewage, treated industrial wastes, and other waste effluents with receiving waters. The boundaries of mixing zones will be determined on a case by case basis. However, these zones shall generally occupy as small an area and length as possible, and shall not prevent free passage of fish or cause fish mortality."

2. The following criteria were approved by the Secretary of the Interior on January 17, 1969. Subsequently, an amendment was proposed as indicated in d(1) above, and with the exception cited, the following criteria remained in effect and enforceable as Federal criteria applicable to all interstate waters in Virginia.

"Free from substances attributable to sewage, industrial waste, or other waste that will settle to form sludge deposits that are slightly, putrescent or odorous, to such degree as to create a nuisance or to interfere directly or indirectly with specified uses of such waters;

Free from floating debris, oil, grease, scum, or other floating materials attributable to sewage, industrial waste, or other wastes that are unsightly to such degree as to create a nuisance or to interfere directly or indirectly with specified uses of such waters;

Free from materials attributable to sewage, industrial waste, or other waste which produce odor, or appreciably change the existing color or other conditions to such degree as to create a nuisance or interfere directly or indirectly with specified uses of such waters;

Free from high-temperature, toxic or other deleterious substances attributable to sewage, industrial waste, or other waste in concentrations or combinations which interfere directly or indirectly with specified uses of such waters; and

There shall be no sudden temperature changes that may affect aquatic life. There shall be no thermal barriers to the passage of fish. Essential spawning areas shall not be affected."

e. Public Water Supply

In addition to other standards established for the protection of public or municipal water supplies, the following standards will apply at the raw water intake point:

<u>Constituent</u>	<u>Concentration</u>
<u>Physical</u>	
Color (color units)	75
<u>Inorganic Chemicals</u>	
	<u>mg/l</u>
Alkalinity	30-500
Arsenic	0.05
Barium	1.0
Boron	1.0
Cadmium	0.01
Chloride	250
Chromium, hexavalent	0.05
Copper	1.0
Fluoride	1.7
Iron (filterable)	0.3
Lead	0.05
Manganese (filterable)	0.05
Nitrates plus nitrites	10 (as N)
Selenium	0.01
Silver	0.05
Sulfate	250
Total dissolved solids	500
(filterable residue)	
Uranyl ion	5
<u>Organic Chemicals</u>	
	<u>mg/l</u>
Carbon Chloroform extract (CCE)	0.15
Cyanide	0.20
Methylene blue active substances	0.5
Pesticides:	
Aldrin	0.017
Chlordane	0.003
DDT	0.042

Dieldrin	0.017
Endrin	0.001
Heptachlor	0.018
Heptachlor epoxide	0.018
Lindane	0.056
Methoxychlor	0.035
Organic phosphates plus Carbamates	0.1
Toxaphene	0.005
Herbicides:	
2,4-D plus 2,4,5-T, plus 2,4,5-TP	0.1
Phenols	0.001
<u>Radioactivity:</u>	<u>pc/l</u>
Gross Beta	1,000
Radium-226	3
Strontium-90	10

Section 2. Rules with Specific Application Based on Climate,
Geographical Area, or Uses.

a. Primary Classification of Waters Within the State

MAJOR CLASS	GEOGRAPHICAL AREA DESCRIPTION WATERS	D.O. mg/l Daily		pH	Temp. °F Rise Above Natural	Max.
		Min.	av.			
I	Open Ocean (Seaside of the Land Mass	5.0	--	6.0-8.5	4.0(Sept-May) 1.5(June-Aug)	-- --
II	Estuarine (Tidal Water - Coastal Zone to Fall Line	4.0	5.0	6.0-8.5	4.0(Sept-May) 1.5(June-Aug)	-- --
III	Free Flowing Streams (Coastal Zone & Piedmont Zone to the Crest of the Mountains	4.0	5.0	6.0-8.5	5	90
IV	Mountainous Zone	4.0	5.0	6.0-8.5	5	87
V	Put & Take Trout Waters	5.0	6.0	6.0-8.5	--	70
VI	Natural Trout Waters	6.0	7.0	6.0-8.5	--	70

b. Subclasses to Complement Major Water Class Designations

1. Subclass A.

Uses - Waters generally satisfactory for use as public or municipal water supply, secondary contact recreation, propagation of fish and aquatic life, and other beneficial uses.

Criteria - Coliform Organisms - Fecal coliforms (multiple-tube fermentation or MF count) not to exceed a log mean of 1000/100 ml. Not to equal or exceed 2000/100 ml. in more than 10% of samples.

Monthly average value not more than 5000/100 ml. (MPN or MF count). Not more than 5000 MPN/100 ml. in more than 20% of samples in any month. Not more than 20,000/100 ml. in more than 5% of such samples.*

2. Subclass B.

Uses - Waters generally satisfactory for use as public or municipal water supply, primary contact recreation (prolonged intimate contact; considerable risk of ingestion), propagation of fish and other aquatic life, and other beneficial uses.

Criteria - Coliform Organisms - Fecal coliforms (multiple-tube fermentation or MF count) within a 30 day period not to exceed a log mean of 200/100 ml. Not more than 10% of samples within a 30-day period will exceed 400/100 ml.

Monthly average not more than 2400/100 ml. (MPN or MF count). Not more than 2400/100 ml. in more than 20% of samples in any month. Not applicable during, nor immediately following periods of rainfall.*

* With the exception of the coliform standard for shellfish waters, the enforceable standards will be those pertaining to fecal coliform organisms. The MPN concentrations are retained as administrative guides for use by water treatment plant operators.

c. Shellfish Waters

1. Discharges of treated wastes, while not contravening established standards for shellfish waters may prevent the direct marketing of shellfish beds as a result of judgment factors employed by the State Department of Health. When the possibility of such condemnation arises as the result of proposals to discharge treated wastes, the Board will convene a public hearing to determine the socio-economic effect of the proposal before reaching a decision.
2. Samples for determining compliance with standards established for estuarine or open ocean waters will be collected at slack before flood tide or slack before ebb tide.
3. In open ocean or estuarine waters in specific areas where leased private or public shellfish beds are present, the following standard for coliform organisms will supplement the standard for Subclass A or B waters:

Not more than 70/100 ml of coliform organisms. Not more than 10% of the samples ordinarily greater than 230/100 ml (5-tube decimal dilution), or 330/100 ml (3-tube decimal dilution). Not to be so contaminated by radionuclides, pesticides, herbicides, or fecal material so that consumption of the shellfish might be hazardous.

Section 3. Variance in Standards.

a. The above standards notwithstanding, as a result of natural conditions, water quality may from time to time vary from established limits.

b. In accordance with the authority granted under Section 62.1-44.15(3a) of the State Water Control Law, Chapter 3.1, Title 62.1 Code of Virginia 1950 as amended by the 1970 General Assembly, the Board reserves the right at any time to modify, amend, or cancel any of the rules, policies, or standards set forth above.

Section 4. Application of Standards.

a. Based on climate, geographical location, or type (tidal, freeflowing, etc.), all waters will be assigned a major class I - VI and a Subclass A or B, to indicate the appropriate coliform standard.

Waters used for primary contact recreation will be assigned Subclass B. All other waters will be assigned Subclass A and will be suitable for secondary contact recreation and for use as a public water supply.

b. All water supplies will be assigned the standard for protection of water supplies set forth in Section 1e. In shellfishing areas, those waters over and adjacent to shellfish beds will be assigned a major class, the appropriate subclass, and the special shellfish standard set forth in Section 2c(3) on page 6.

c. All waters within this State will be satisfactory for fishing and secondary contact recreation.

Section 5. Special Standards.

a. In those sections of Class 1A, 1B, 1IA, and 1IB waters within this State where leased private, or public shellfish beds are present, the following bacterial standards shall be established in addition to other bacterial standards adopted for the protection of primary or secondary recreation:

Coliform organisms - The median MPN shall not exceed 70/100 ml, and not more than 10% of the samples ordinarily shall exceed an MPN of 230/100 ml for a 5-tube decimal dilution test (or 330/100 ml, where a 3-tube decimal dilution is used) in those portions of the area most probably exposed to fecal contamination during the most unfavorable conditions.

In addition, the shellfish area is not to be so contaminated by radionuclides, pesticides, herbicides or fecal material so that consumption of the shellfish might be hazardous.*

b. Temperature standard to be established for lakes and impoundments receiving thermal discharges:

In lakes and reservoirs, the temperature of the epilimnion, in those areas where important organisms are most likely to be adversely affected, shall not be raised more than 3°F. above that which existed before the addition of heat of artificial origin. The increase is to be based on the monthly average of the maximum daily temperature. Unless a special study shows that a discharge of a heated effluent into the hypolimnion (or pumping water from

* Based on National Shellfish Sanitation Program Manual of Operations

the hypolimnion for discharging back into the same water body) will be desirable, such practice shall not be approved.

c. Maximum temperature shall be 81°F., unless caused by natural conditions; the maximum rise above natural temperatures shall not exceed 5°F.

d. Chlorides not to exceed 800 mg/l at any time.

e. Chlorides not to exceed 40 mg/l at any time.

f. Chlorides not to exceed 8000 mg/l at any time.

g. Radiation standard:

1. radium-226 not to exceed 3 pc/l
strontium-90 not to exceed 10 pc/l

2. in the known absence of strontium-90 and alpha-emitting radionuclides, gross beta activity not to exceed 1000 pc/l

3. if the gross beta activity is in excess of this amount, a more complete radiochemical analysis is required to determine that the sources of radiation exposure are within the limits of the Radiation Protection Guides.

h. Objective for Nutrients - The cumulative total of nitrogen as N from all sources in the effluent shall not be greater than 0.5 mg/l at any time; phosphorus as P from all sources in the effluent shall not be greater than 1.0 mg/l at any time.

i. The State Water Control Board has directed and/or ordered the following:

1. That all existing discharges in accordance with h above shall substantially remove the nutrients in their effluents on or before such time as central facilities (The Hampton Roads Sanitation District Commission Chesapeake-Elizabeth System) become available or connect to central facilities, (i.e., The Chesapeake-Elizabeth System).

2. That it will consider approving small discharges to this watershed to facilitate the elimination of potential public health hazards provided central facilities (Chesapeake-Elizabeth System) are not available, and
3. That it will not allow additional significant new discharges to this watershed, which do not provide for nutrient removal facilities in accordance with h above.

j. Special Standard "t" amends the following criterion taken from Minute 73 of the proceedings of the Board at its meeting on July 11-12, 1966:

For discharge to the Chickahominy River and its tributaries below Bottoms Bridge, effluent quality obtainable with conventional secondary sewage treatment plants with approved plans is acceptable, except that the following specifications shall be met:

Constituent	Analysis Schedule	Concentration
1 Coliform Organisms	Every 3 hrs every other day	Most probable number median of 100 per 100 ml with no greater than 10% of the samples to exceed 1000 per 100 ml
2 Inorganic Nutrients	Once/week on a composite sample	Nitrate (as N) not to exceed .5 ppm. Total phosphate (as PO_4) not to exceed 1.5 ppm
3 Other Physical and Chemical Constituents	Other physical or chemical constituents not specifically mentioned will be covered by additional specifications as conditions detrimental to the streams arise. The specific mention of items 1 and 2 does not necessarily mean that the addition of other physical or chemical constituents will be condoned.	

In lieu of the above requirements, conventional secondary sewage treatment plants may ordinarily be used anywhere in the Chickahominy River Basin, provided holding ponds, capable of retaining the entire plant effluent during low flow critical conditions, are constructed. "Low flow" is construed to mean less than 15 cubic feet per second in the main stem of the Chickahominy River itself at the (1) point of waste discharge to the main stem, or (2) confluence of a tributary below the point of waste discharge to the tributary. Below Bottoms Bridge, holding ponds with at least 60-day retention capacity (August 14 to October 13) may be required, if in the opinion of the Board's staff it is deemed necessary.

k. Special Standard "t" amends the following criterion taken from Minute 73 of the proceedings of the Board at its meeting on July 11-12, 1966:

Constituent	Analysis Schedule	Concentration
1 Dissolved Oxygen	Once/2 hr, 24 hr/day, 7 days/wk on grab samples	7.5 ppm (90% sat. at 25°C) average during the day, with no individual sample less than 6.7 ppm (80% sat. at 25°C)
2 Bio-chemical Oxygen Demand 5-day at 20°C	Once/24 hr on composite sample (how collected) 7 days/week	6.0 ppm average, with not more than 5% of individual samples to exceed 8.0 ppm
3 Settleable Solids	Same as for Dissolved Oxygen	Not to exceed 0.1 ml/litter
4 Suspended Solids	Same as for bio-chemical oxygen demand	5.0 ppm average, with not more than 5% of individual samples to exceed 7.5 ppm
5 Ammonia Nitrogen	Same as bio-chemical oxygen demand on specially preserved samples	Not to exceed 2.0 ppm as N

Constituent	Analysis Schedule	Concentration (Cont'd)
6 Residual Chlorine	Same as for dissolved oxygen but once every hour	As required to meet MPN specifications and prevent damage to aquatic life in streams
7 Coliform Organisms	Every 4 hours, every other day	Most Probable Number Median of 100 per 100 ml with no greater than 10% of the samples to exceed 1000 per 100 ml
8 pH	Same as for dissolved oxygen	Not less than 6.0 and not greater than 8.0
9 Inorganic Nutrients	Once/week on a composite sample	Nitrate (as N) not to exceed .3 ppm. total phosphate (as PO_4) not to exceed .6 ppm (mean values in the Chickahominy)
10 Other Physical and Chemical Constituents	Other physical or chemical constituents not specifically mentioned will be covered by additional specifications as conditions detrimental to the stream arise. The specific mention of items 1 through 9 does not necessarily mean that the addition of other physical or chemical constituents will be condoned.	

In lieu of the above requirements, conventional secondary sewage treatment plants may ordinarily be used anywhere in the Chickahominy River Basin, provided holding ponds, capable of retaining the entire plant effluent during low flow critical conditions, are constructed. "Low flow" is construed to mean less than 15 cubic feet per second in the main stem of the Chickahominy River itself at the (1) point of waste discharge to the main stem, or (2) confluence of a tributary below the point of waste discharge to the tributary. Above Bottoms Bridge the holding ponds are to retain the entire plant effluent for at least 90 days (July 15 to October 13).

1. The following, from Minute 1 of the proceedings of the Board at its meeting on July 20-21, 1965, will also apply:

2. All known existing treated discharges containing bacteria shall be chlorinated sufficiently and continuously (100% of the time) to maintain a residual which will insure substantially complete removal of coliform organisms. This action is to be instituted immediately by all concerned owners.
3. All owners now discharging industrial wastes and sewage shall install facilities which will provide the maximum possible degree of biochemical oxygen demand (B.O.D.) removal; in addition, the effluent from such facilities shall contain a minimum of 5 mg/l of dissolved oxygen (D.O.).
4. All owners in the area (City of Suffolk, County of Nansemond, industrial establishments and individuals) shall immediately take steps to collect and treat, in accordance with items 2 and 3 above, the wastes that are now being discharged untreated, either directly or indirectly to the River and Shingle Creek and which now constitute a health hazard to the area.
5. The City of Suffolk, the County of Nansemond, and those private owners who are now discharging sewage and industrial wastes to these waters are to immediately initiate programs to formulate a plan, or alternative plans, for improving water quality in the River and Shingle Creek. Alternative plans may include conveying all wastes completely from out of this watershed for treatment and/or disposal. Only under exceptional circumstances will additional discharges of treated wastes into these waters be permitted.

m. Zinc (total) not to exceed 0.5 mg/l at any time.

n. The following from Minute 32 of the proceedings of the Board at its meeting on September 13, 1960, will also apply:

The concentration and total amount of impurities in Tuckahoe Creek and its tributaries of sewage origin shall be limited to those amounts from

which are now present in the stream from natural sources and from existing discharges in the watershed.

o. The following, from Minute 38 of the proceedings of the Board at its meeting on March 30, 1955, will also apply:

1. No sewage discharges, regardless of degree of treatment, should be allowed into the James River between Boshers and Williams Island Dams.

p. The following criteria from Minute 59 of the proceedings of the Board at its meeting on May 17-18, 1966, (amended April 8, 1970), will be applied to proposals for sewage treatment facilities which will discharge effluent to Williams and Upper Machodoc Creeks, King George County:

1. If raw sewage stabilization ponds are proposed, they shall be followed by a 15-day holding pond and chlorination facilities in duplicate;
2. If "conventional" sewage treatment facilities are proposed, they shall effect at least 85% removal of B.O.D. and shall be followed by a 15-day holding pond and chlorination facilities in duplicate;
3. Chlorination facilities are to be operated continuously during the entire year and chlorine residual of at least 2.0 ppm shall be maintained at all times;
4. In sewerage systems where pumping stations are found to be necessary, they shall be designed to prevent the discharge of raw sewage to State waters;
5. If, in the opinion of the staff, following consultation with the State Department of Health it is determined that more satisfactory water quality can thereby be maintained in the receiving stream, the holding pond shall be operated to provide for controlled flow discharge.

q. The following, from Minute 71 of the proceedings of the Board at its meeting on June 30-July 1, 1964, will also apply:

In the future no proposals resulting in the discharge of treated wastes to Aquia Creek will be approved, unless the following is provided:

- (A) At least 100 days' storage to allow complete elimination of discharges during the low-flow summer months or
- (B) Other treatment, based on sound engineering concepts (preferably with experimental data to show their feasibility), be provided for nutrient removal prior to discharge.

r. The following will also apply to the Occoquan Creek Watershed:

"The Board decided (1) to approve all plans, preliminary and final, for sewage treatment facilities involving effluent discharges to the Occoquan Creek watershed which had been forwarded to it on or before September 1, 1963, by the State Department of Health" (equivalent at that time to a total approved population of 50,000 persons on the watershed)" and (2) in the case of proposals received after September 1, 1963, for discharges of effluents from waste treatment facilities to Occoquan Creek watershed, approval will be given only after the Board is satisfied, on the basis of additional data to be collected by its staff in cooperation with the State Department of Health and such other agencies as may be able to render assistance, that water quality in the watershed will not be rendered unsatisfactory for present or future uses." (Reference Minute 76-- September 27, 1963)

"...Following considerable discussion, including the fact that Fauquier County had been severely limited in development as a result of past Board action with respect to the watershed, the Board decided that:

- (1) It was willing to permit the discharge of treated sewage effluent from an additional 25,000 persons with the stipulation that:

- (a) nutrient removal facilities be constructed in each case,
 - (b) some overall program of water surveillance be instituted by the owners,
 - (c) each new plant, if designed according to theoretical or experimental principles, be preceded by adequate pilot studies and that any such construction be in accordance with design backed up by such pilot study information and,
 - (d) each owner was to understand that nutrient removal facilities might not prevent eutrophication and other problems in the Occoquan impoundment and that in such cases each owner is to take such additional steps as are necessary to correct the situation.
- (2) Although it was willing to allocate that 25,000 population among the contending political subdivisions, all affected political subdivisions are to submit an acceptable, agreeable distribution of the 25,000 population minus a 6,000 population allocation granted to the Town of Warrenton as contained in Minute 57 from the proceedings of this meeting."
(Reference Minute 56--March 28, 1967.)

s. The following, from Minute 20 of the proceedings of the Board at its meeting on January 16, 1969, will also apply to the Powhatan Creek Watershed:

- 1. All proposals for treated waste discharges to the Powhatan Creek Watershed will in the future be approved only after:
 - (a) Engineering data has been submitted indicating the capability of the proposed treatment facilities to remove all phosphorus and nitrogen compounds.
 - (b) Owners with facilities existing at the time of this action will, in a period not to exceed 60 days, submit to the Board, engineering reports and pollution abatement schedules indicating the maximum concentrations of phosphorus and nitrogen compounds which they can remove from waste waters prior to discharge. No schedule

providing a time period exceeding three years will be approved. Modification or replacement of existing treatment facilities may be necessary.

2. It will entertain from owners in the area a proposal for development of:
 - (a) A central facility to treat all wastes at a point outside the Watershed, where phosphorus and nitrogen removal will probably not be necessary, or
 - (b) Treatment facilities inside the Watershed which include complete removal of all phosphorus and nitrogen compounds.
3. If the above plan is accompanied by a firm schedule leading to completion of sewage treatment facilities within a reasonable length of time, and it can be demonstrated that the financing for the facilities is available, the Board will consider allowing interim construction of sewage treatment facilities in the Powhatan Creek Watershed without the requirement of phosphorus and nitrogen compound removal.
- t. (Applicable to intrastate waters of the James River Basin in sections 4, 4a, 5, 5a, and 5b.)

Effluent standards for the entire Chickahominy Watershed above Walker's Dam; approved and adopted by the Board in Unanimous Letter Ballot 2144, completed February 22, 1971; are effective March 31, 1971.

<u>CONSTITUENT</u>	<u>CONCENTRATION</u>
1. Dissolved Oxygen	5.0 mg/l
2. Bio-chemical Oxygen demand 5-day at 20°	6.0 mg/l average, with not more than 5% of individual samples to exceed 8.0 mg/l
3. Settleable Solids	Not to exceed 0.1 mg/liter
4. Suspended Solids	5.0 mg/l average, with not more than 5% of individual samples to exceed 7.5 mg/l
5. Ammonia Nitrogen	Not to exceed 2.0 mg/l as N
6. Residual Chlorine	2 mg/l

<u>CONSTITUENT</u>	<u>CONCENTRATION</u>
7. Coliform Organisms	Fecal coliforms (Multiple-tube fermentation or MF count) within a 30-day period not to exceed a log mean of 200/100 ml. Not more than 10% of samples within a 30-day period will exceed 400/100 ml.
8. pH	Not less than 6.0 and not greater than 8.5
9. Total Phosphorus	Total phosphorus not to exceed 0.10 mg/l
10. Other Physical and Chemical Constituents	Other physical or chemical constituents not specifically mentioned will be covered by additional specifications as conditions detrimental to the stream arise. The specific mention of items 1 through 9 does not necessarily mean that the addition of other physical or chemical constituents will be condoned.

Section 6. Designated Water Uses and Water Quality Criteria

Through the public hearing process, the Commonwealth of Virginia has adopted the designated water uses and water quality criteria assigned to the individual streams listed in this section. The designated water uses and type stream assigned to specific streams or sections, appears under the "class" column. The major class is indicated by a roman numeral and the subclass is designated by a capital A or B. The key to the stream class is given in Section 2. In addition, certain stream zones are assigned additional criteria which is listed under "Special Standards". The key to these special standards, indicated by a letter is given in Section 5 where "Public Water Supply" appears, the criteria in Section 1e apply.

The stream zone to which these criteria apply is described under the column "Section". These numbered zones to which the criteria apply also appear on the companion exhibit for the river basin section.

For additional reference, a sketch of the State also precedes each subsection. This sketch shows where the applicable stream basin is located within the State.


The uses and criteria assigned to the interstate waters of Virginia are grouped by river basin. An index of subsections and river basins follows:

<u>Subsection</u>	<u>River Basin</u>
6A	Big Sandy
6B	Clinch River
6C	Holston River
6D	New River
6E	Roanoke River
6F	Chowan River
6G	Shenandoah River
6H	Rappahannock River
6I	York River
6J	James River--Lower
6K	James River--Middle
6L	James River--Upper
6M	Chesapeake Bay & Atlantic Ocean
6N	Yadkin River
6O	Albemarle Sound
6P	Potomac River


Water Quality Standards Summary


Section 6A


Big Sandy River Basin




Big Sandy River Basin
DWG 6A

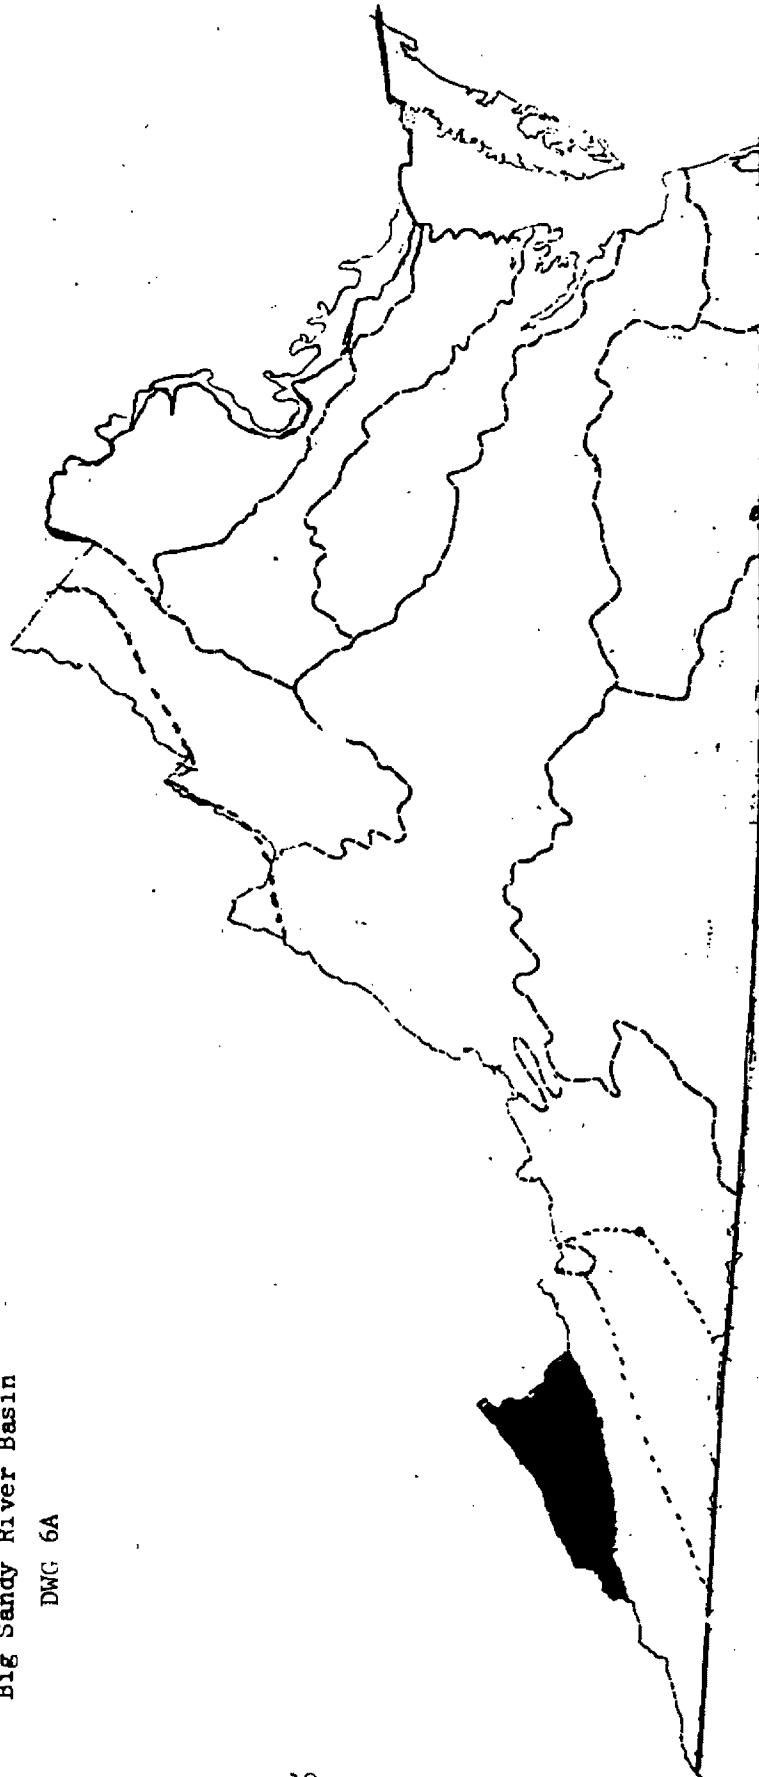

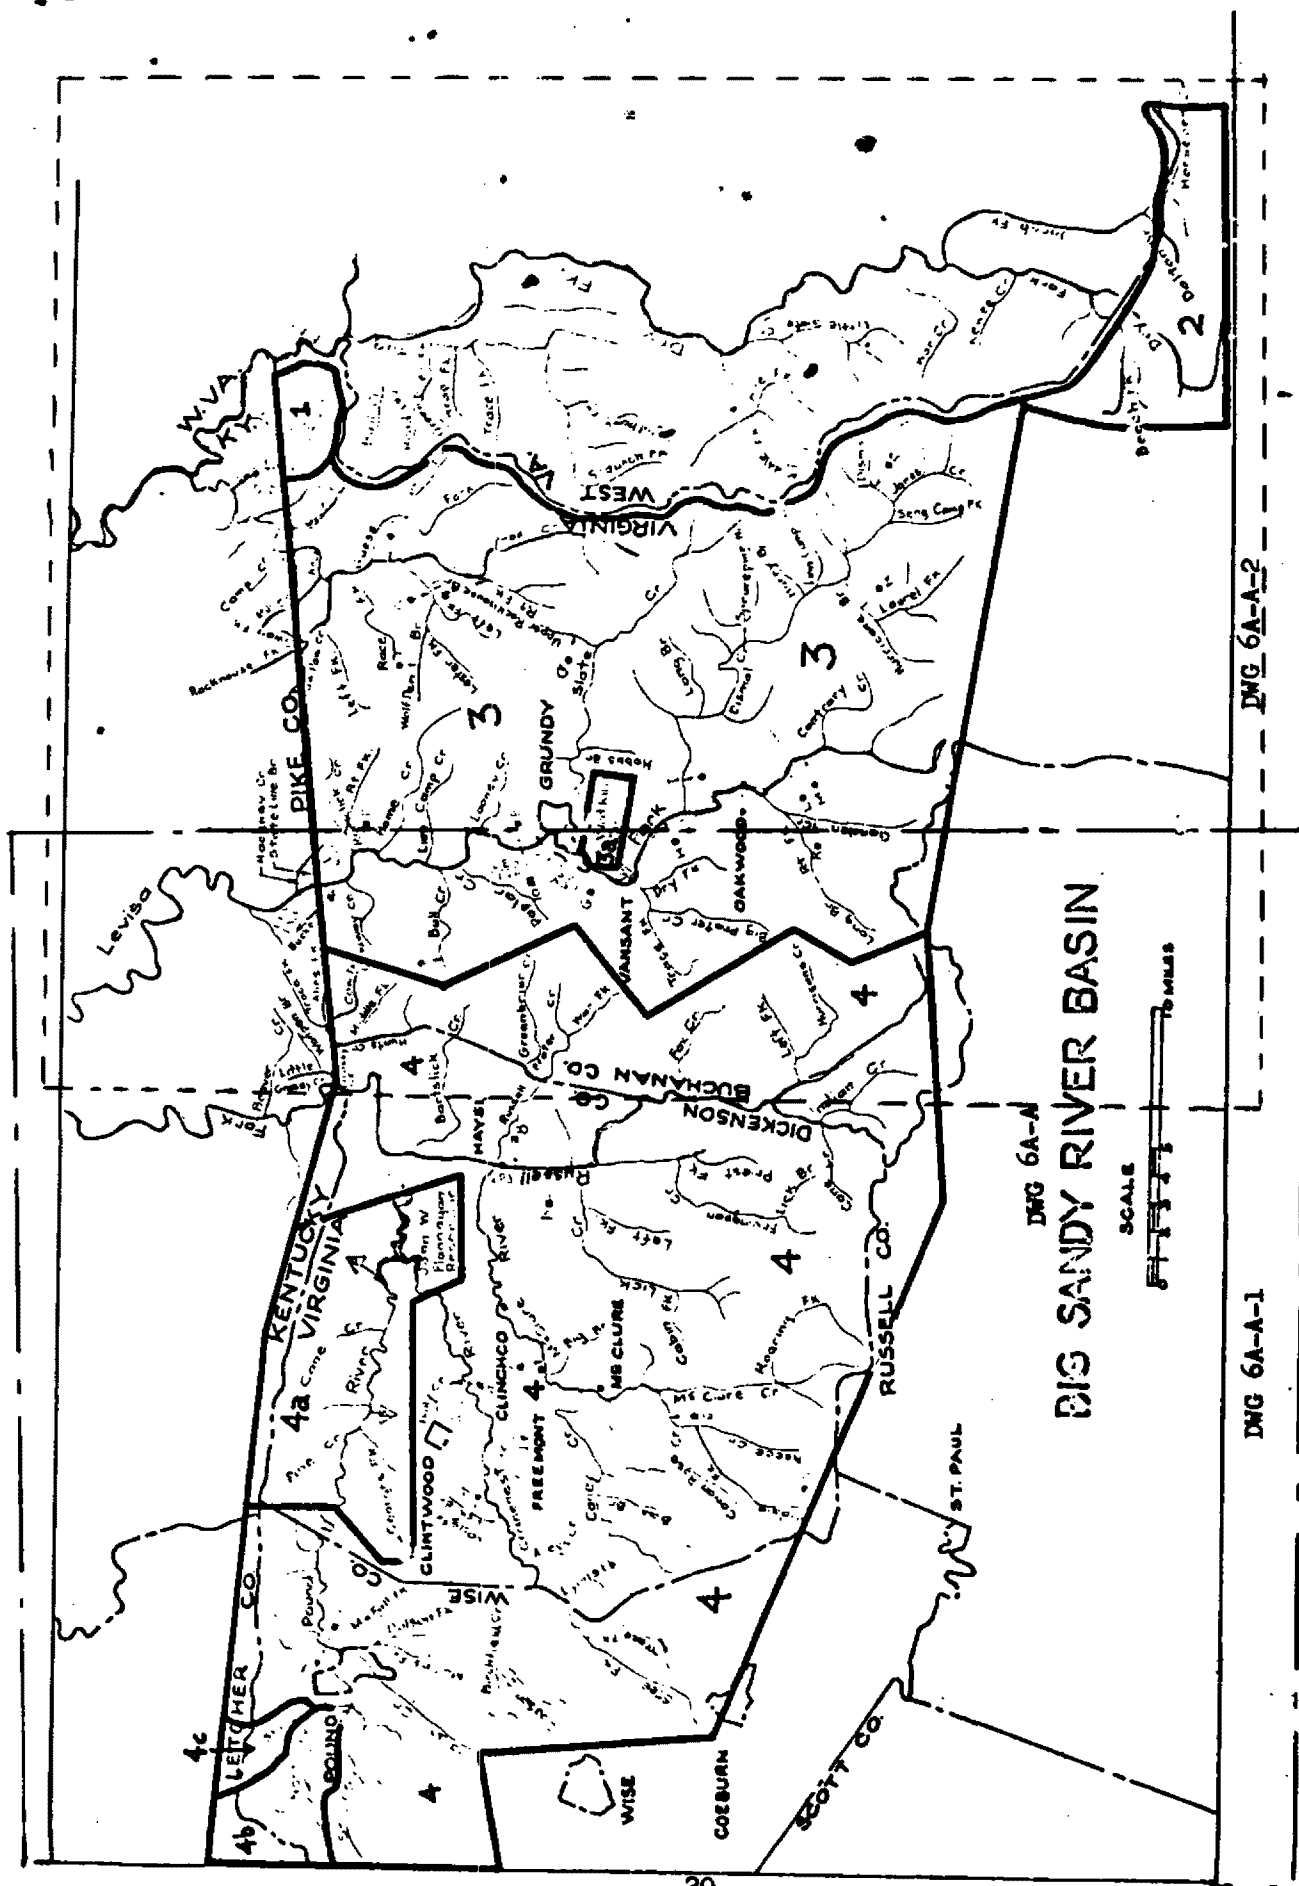


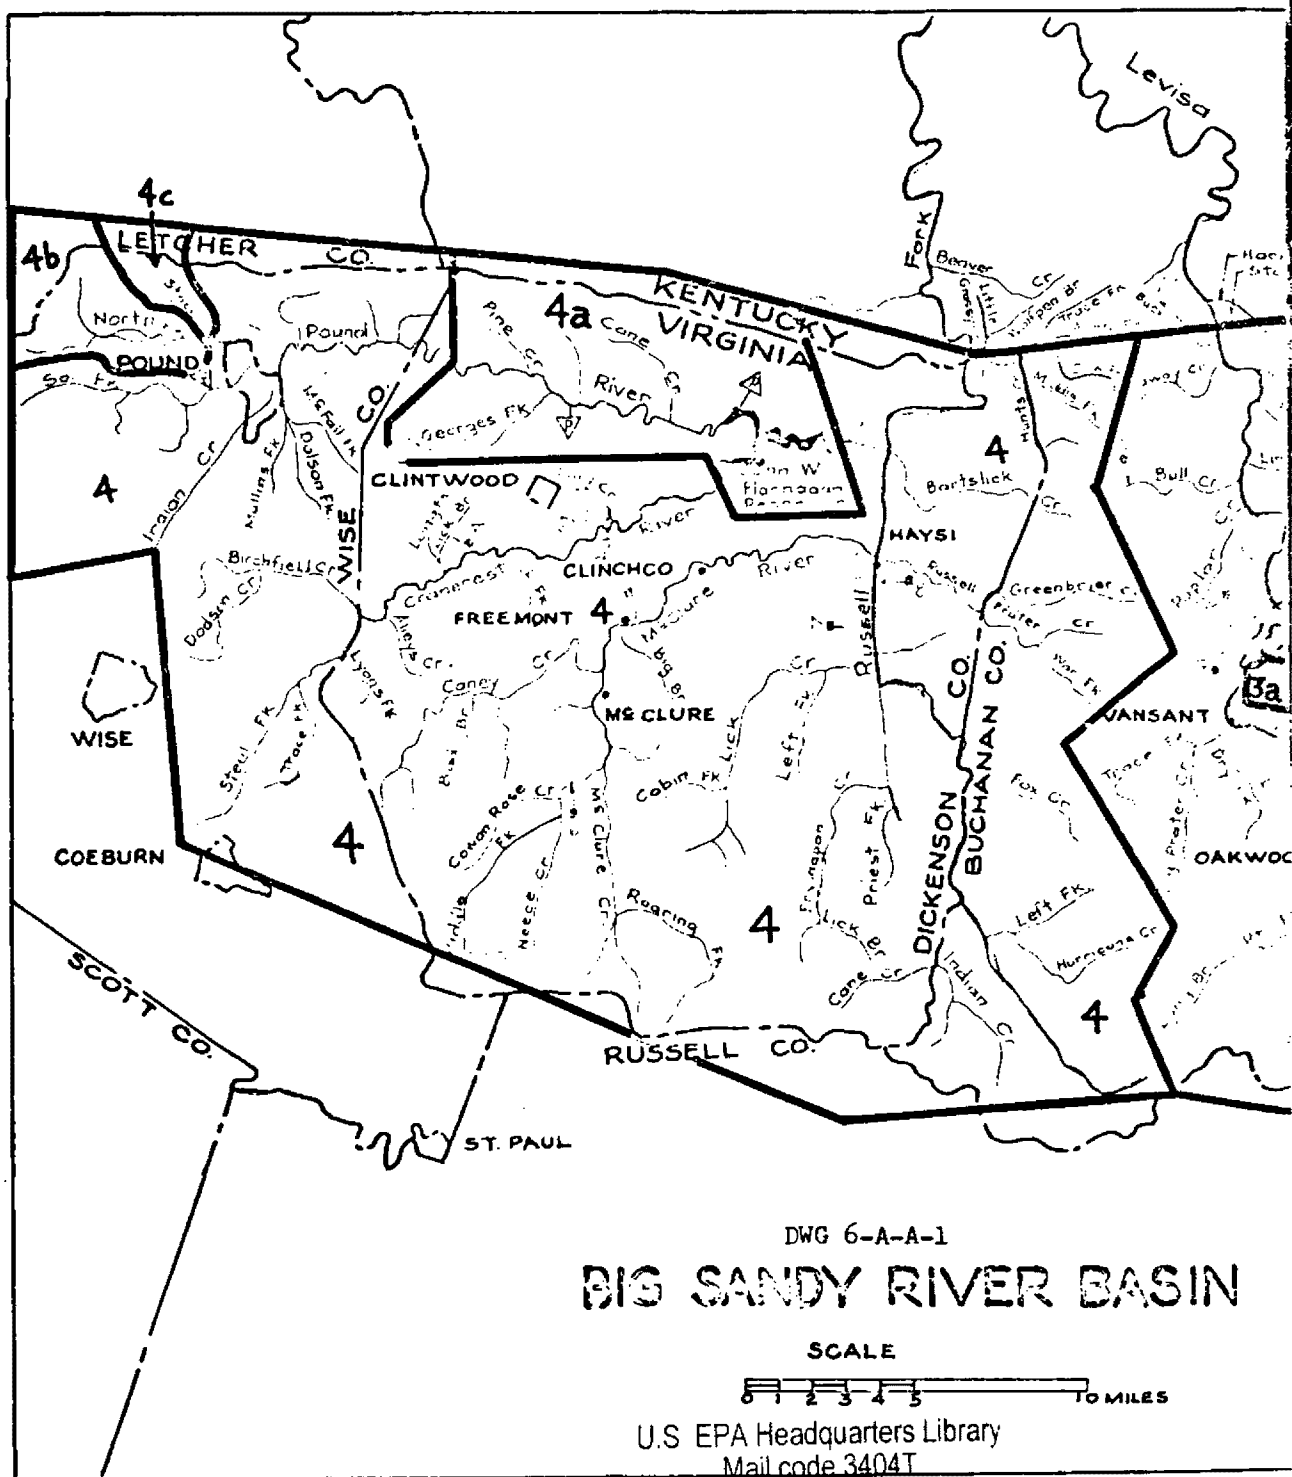

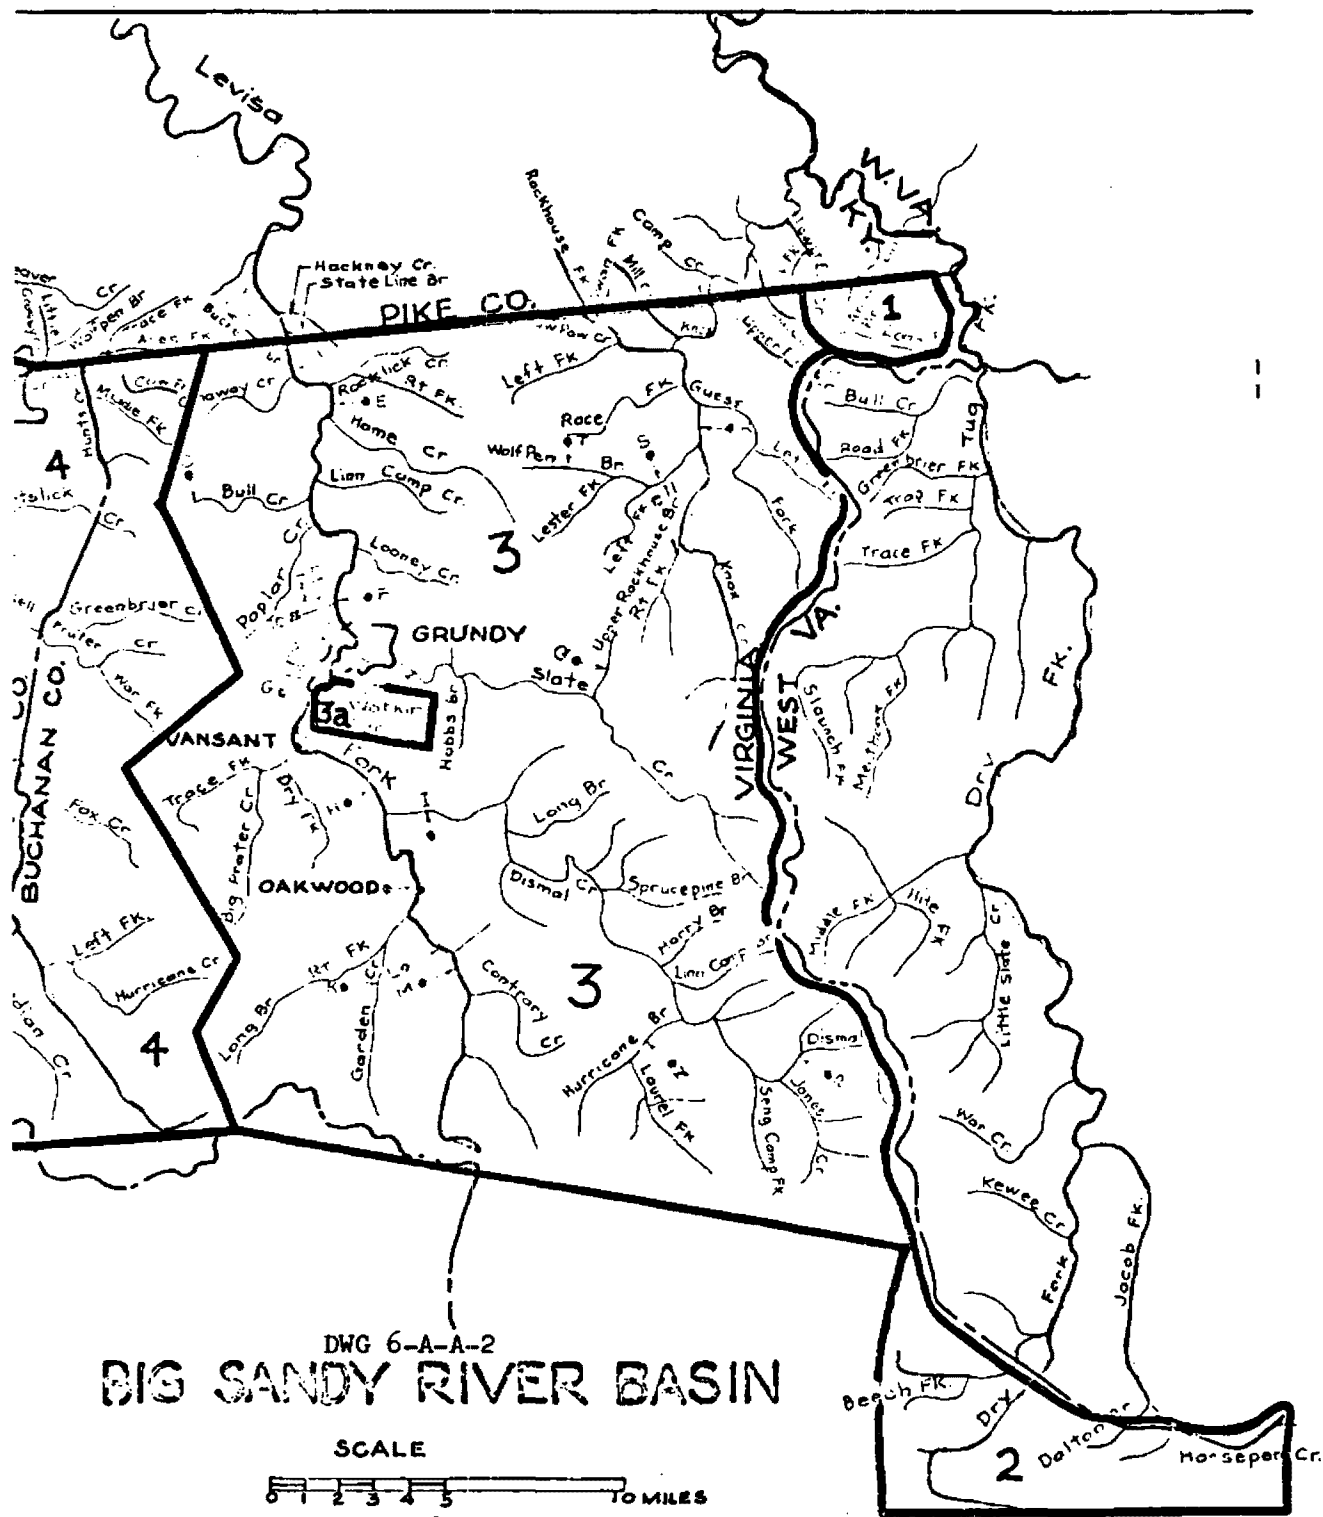


BIG SANDY RIVER BASIN

Section	Section Description	Class	Special Standards
1	All tributaries of Tug Fork in Virginia	IV B	
2	All tributaries of Jacob Fork and Dry Fork in Virginia	IV B	
3	Levisa Fork and its tributaries and Knox Creek and its tributaries, unless otherwise designated, from the Virginia-Kentucky state line upstream to their headwaters	IV A	
	<u>Trout Waters in Section 3:</u> Put and Take: Slate Creek from the northern corporate limits of Grundy to the State post office	V A	
3a	Watkins Branch from Grundy's raw water supply dam upstream to its headwaters	IV A	Public Water Supply
4	Russell Fork and its tributaries, unless otherwise designated, from the Virginia-Kentucky state line upstream to their headwaters	IV A	
	<u>Trout Waters in Section 4:</u> Put and Take: Caney Creek from Long Branch Creek upstream 5.5 miles.	V A	
	Fryingpan Creek from its confluence with Russell Fork upstream to junction of stream and routes 604 and 600.		
	North Fork Pound River from town limits of Pound upstream to water supply dam.		
	Natural: Russell Fork from the Virginia-Kentucky state line to the confluence with the Pound River	VI A	
	Pound River to John W. Flannagan Dam		
4a	The Pound River and its tributaries from the John W. Flannagan Dam, including the John W. Flannagan Reservoir, to 5 miles above Clintwood's raw water intake.	IV B	b Public Water Supply
4b	Pound River from North Fork Pound River Dam upstream to its headwaters and Stacy Branch upstream to Pound's raw water intake.	IV A	Public Water Supply
4c	Stacy Branch from Pound's raw water intake upstream to its headwaters.	IV A	Public Water Supply




BIG SANDY RIVER BASIN

Section	Section Description	Class	Special Standards
1	All tributaries of Tug Fork in Virginia	IV B	
2	All tributaries of Jacob Fork and Dry Fork in Virginia	IV B	
3	Levisa Fork and its tributaries and Knox Creek and its tributaries, unless otherwise designated, from the Virginia-Kentucky state line upstream to their headwaters	IV A	
	<u>Trout Waters in Section 3:</u>		
	Put and Take:	V A	
	Slate Creek from the northern corporate limits of Grundy to the State post office		
3a	Watkins Branch from Grundy's raw water supply dam upstream to its headwaters	IV A	Public Water Supply
4	Russell Fork and its tributaries, unless otherwise designated, from the Virginia-Kentucky state line upstream to their headwaters	IV A	
	<u>Trout Waters in Section 4:</u>		
	Put and Take:	V A	
	Caney Creek from Long Branch Creek upstream 5.5 miles.		
	Fryingpan Creek from its confluence with Russell Fork upstream to junction of stream and routes 604 and 600.		
	North Fork Pound River from town limits of Pound upstream to water supply dam.		
	Natural:	VI A	
	Russell Fork from the Virginia-Kentucky state line to the confluence with the Pound River		
	Pound River to John W. Flannagan Dam		
4a	The Pound River and its tributaries from the John W. Flannagan Dam, including the John W. Flannagan Reservoir, to 5 miles above Clintwood's raw water intake.	IV B	b Public Water Supply
4b	Pound River from North Fork Pound River Dam upstream to its headwaters and Stacy Branch upstream to Pound's raw water intake.	IV A	Public Water Supply
4c	Stacy Branch from Pound's raw water intake upstream to its headwaters.	IV A	Public Water Supply



Clinch River Basin


DWG 6-B

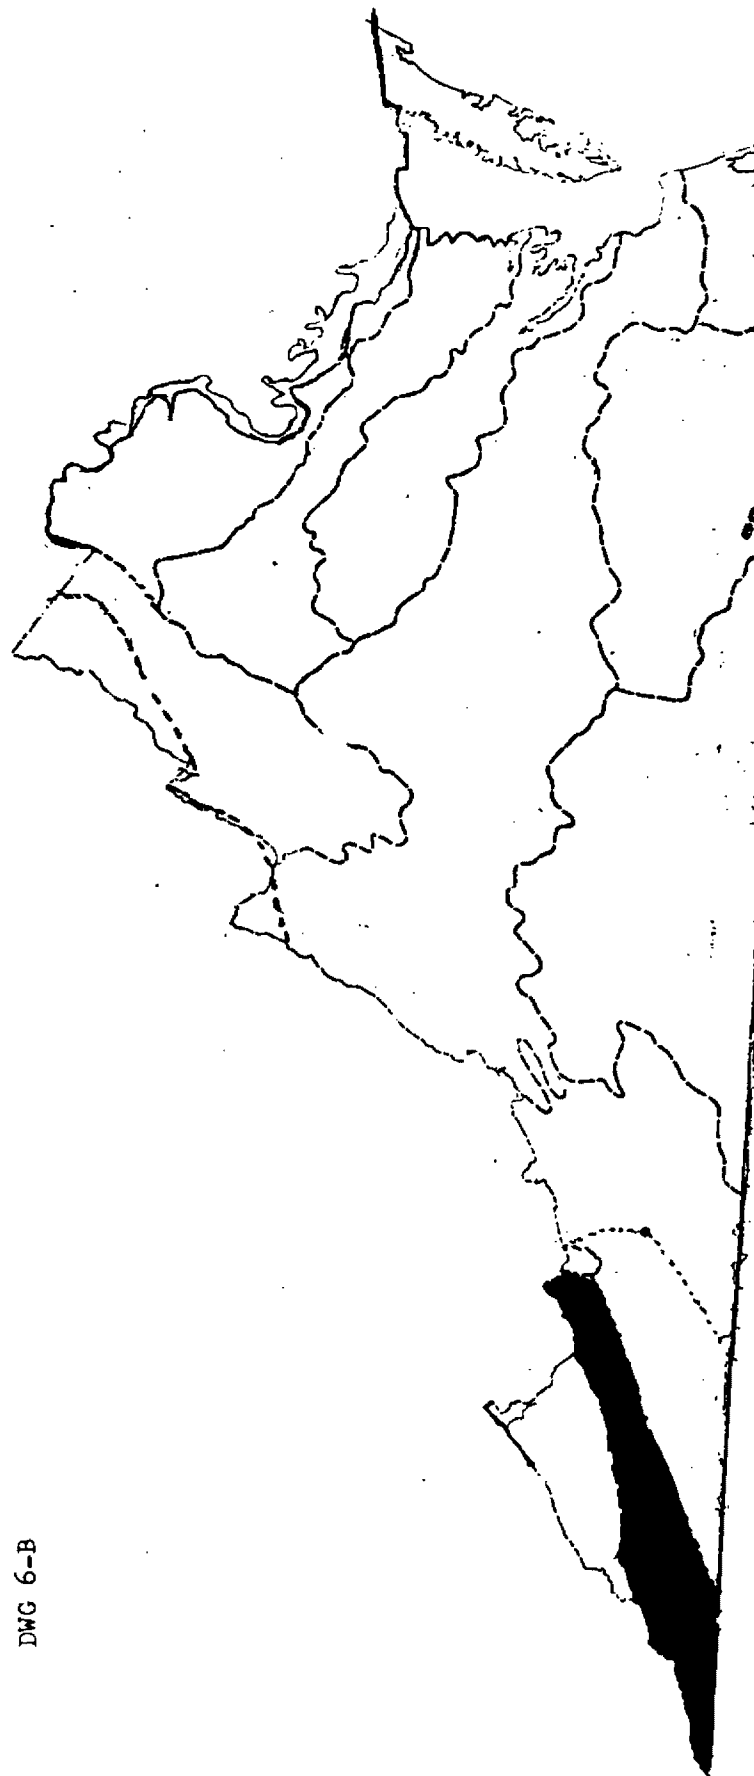


DWG 6B-A-1

DWG 6B-A-2


DWG 6B-A-3

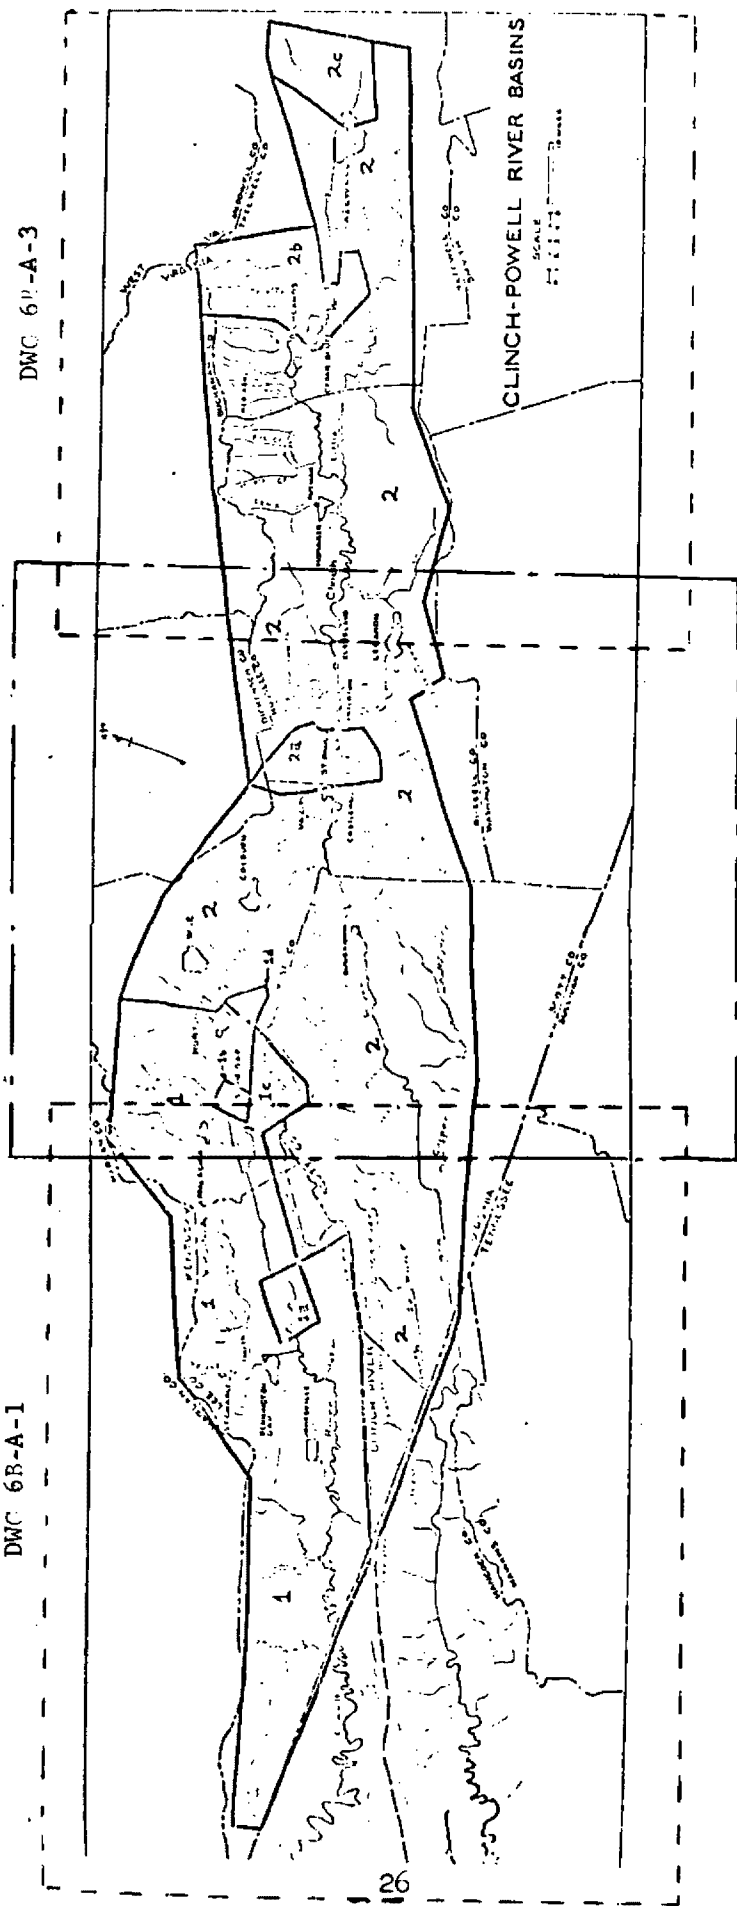

DWG-6B-A

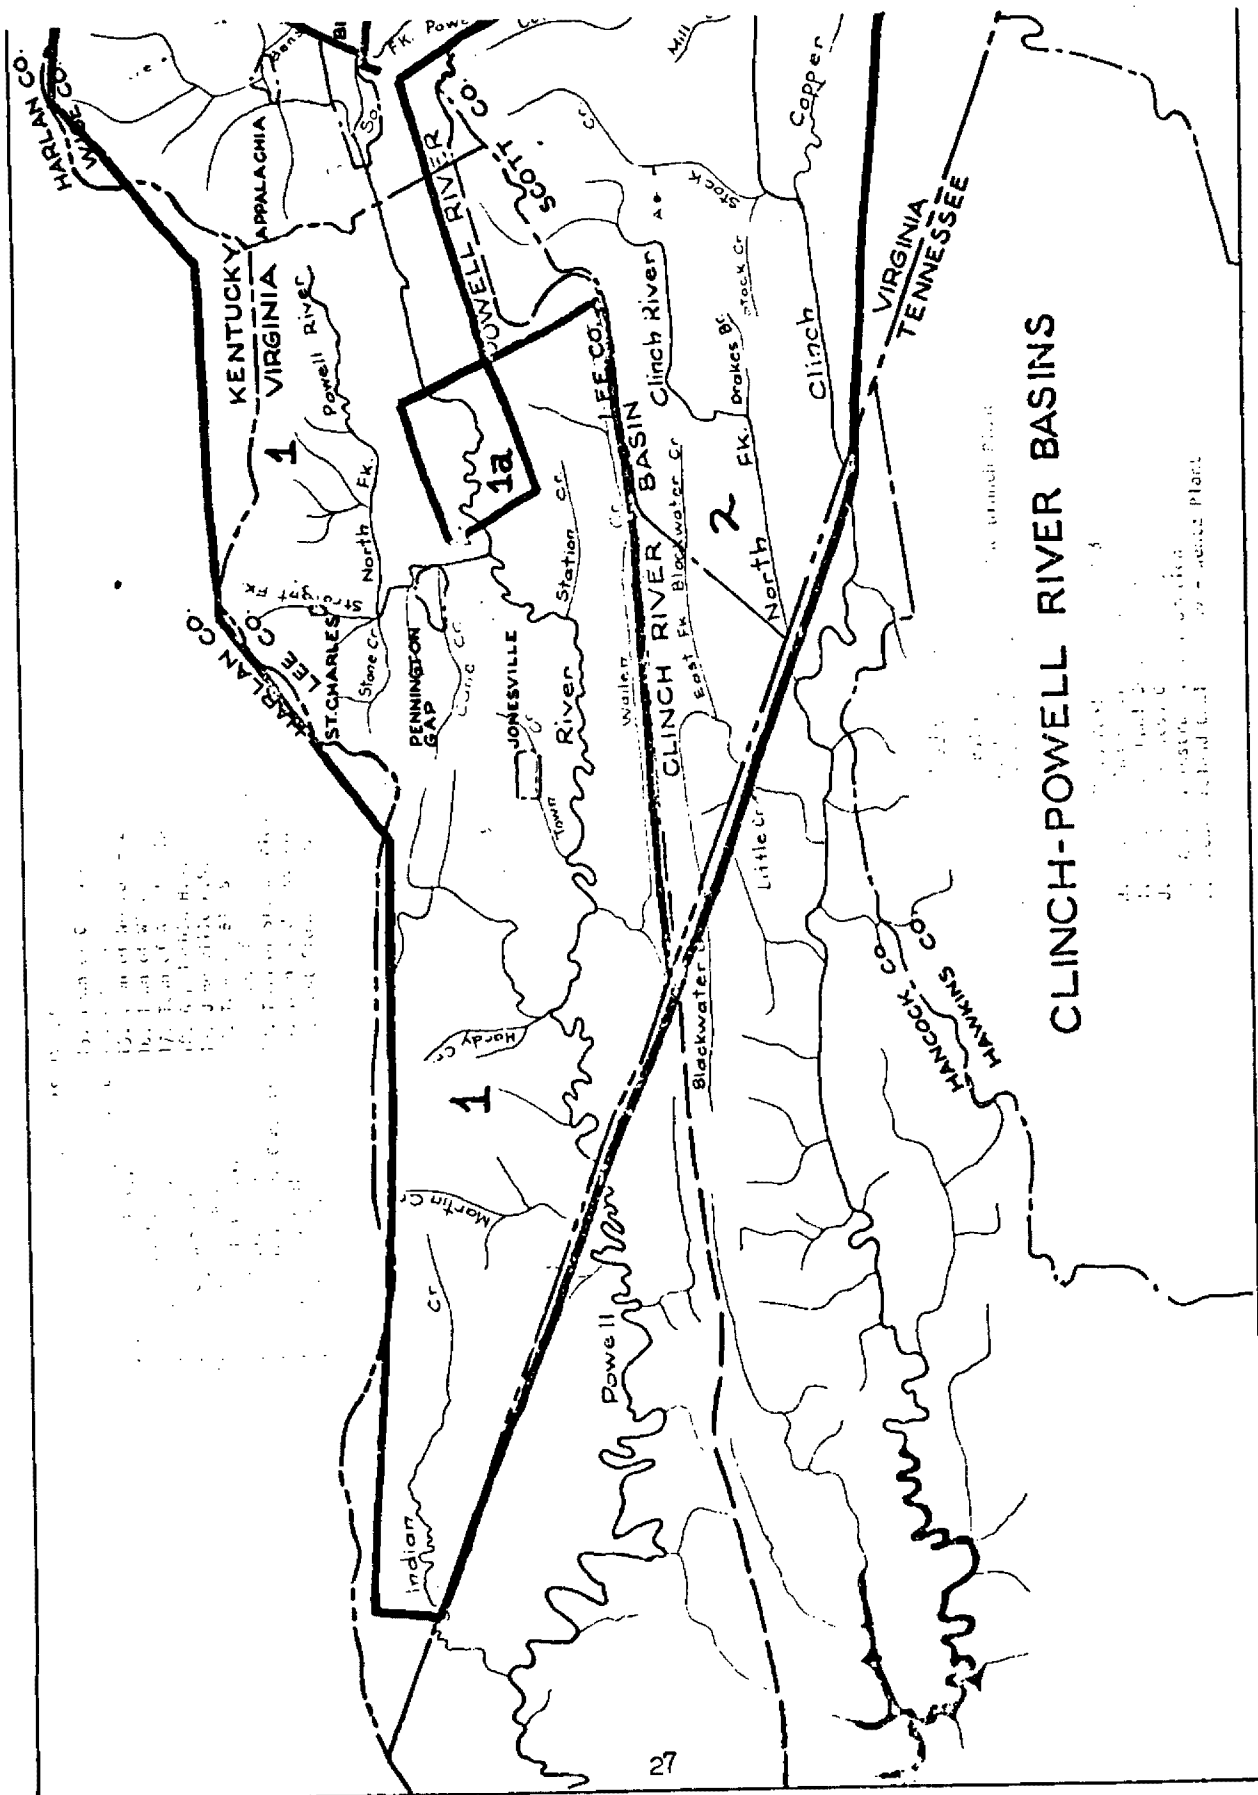

DWG 6B-A-1

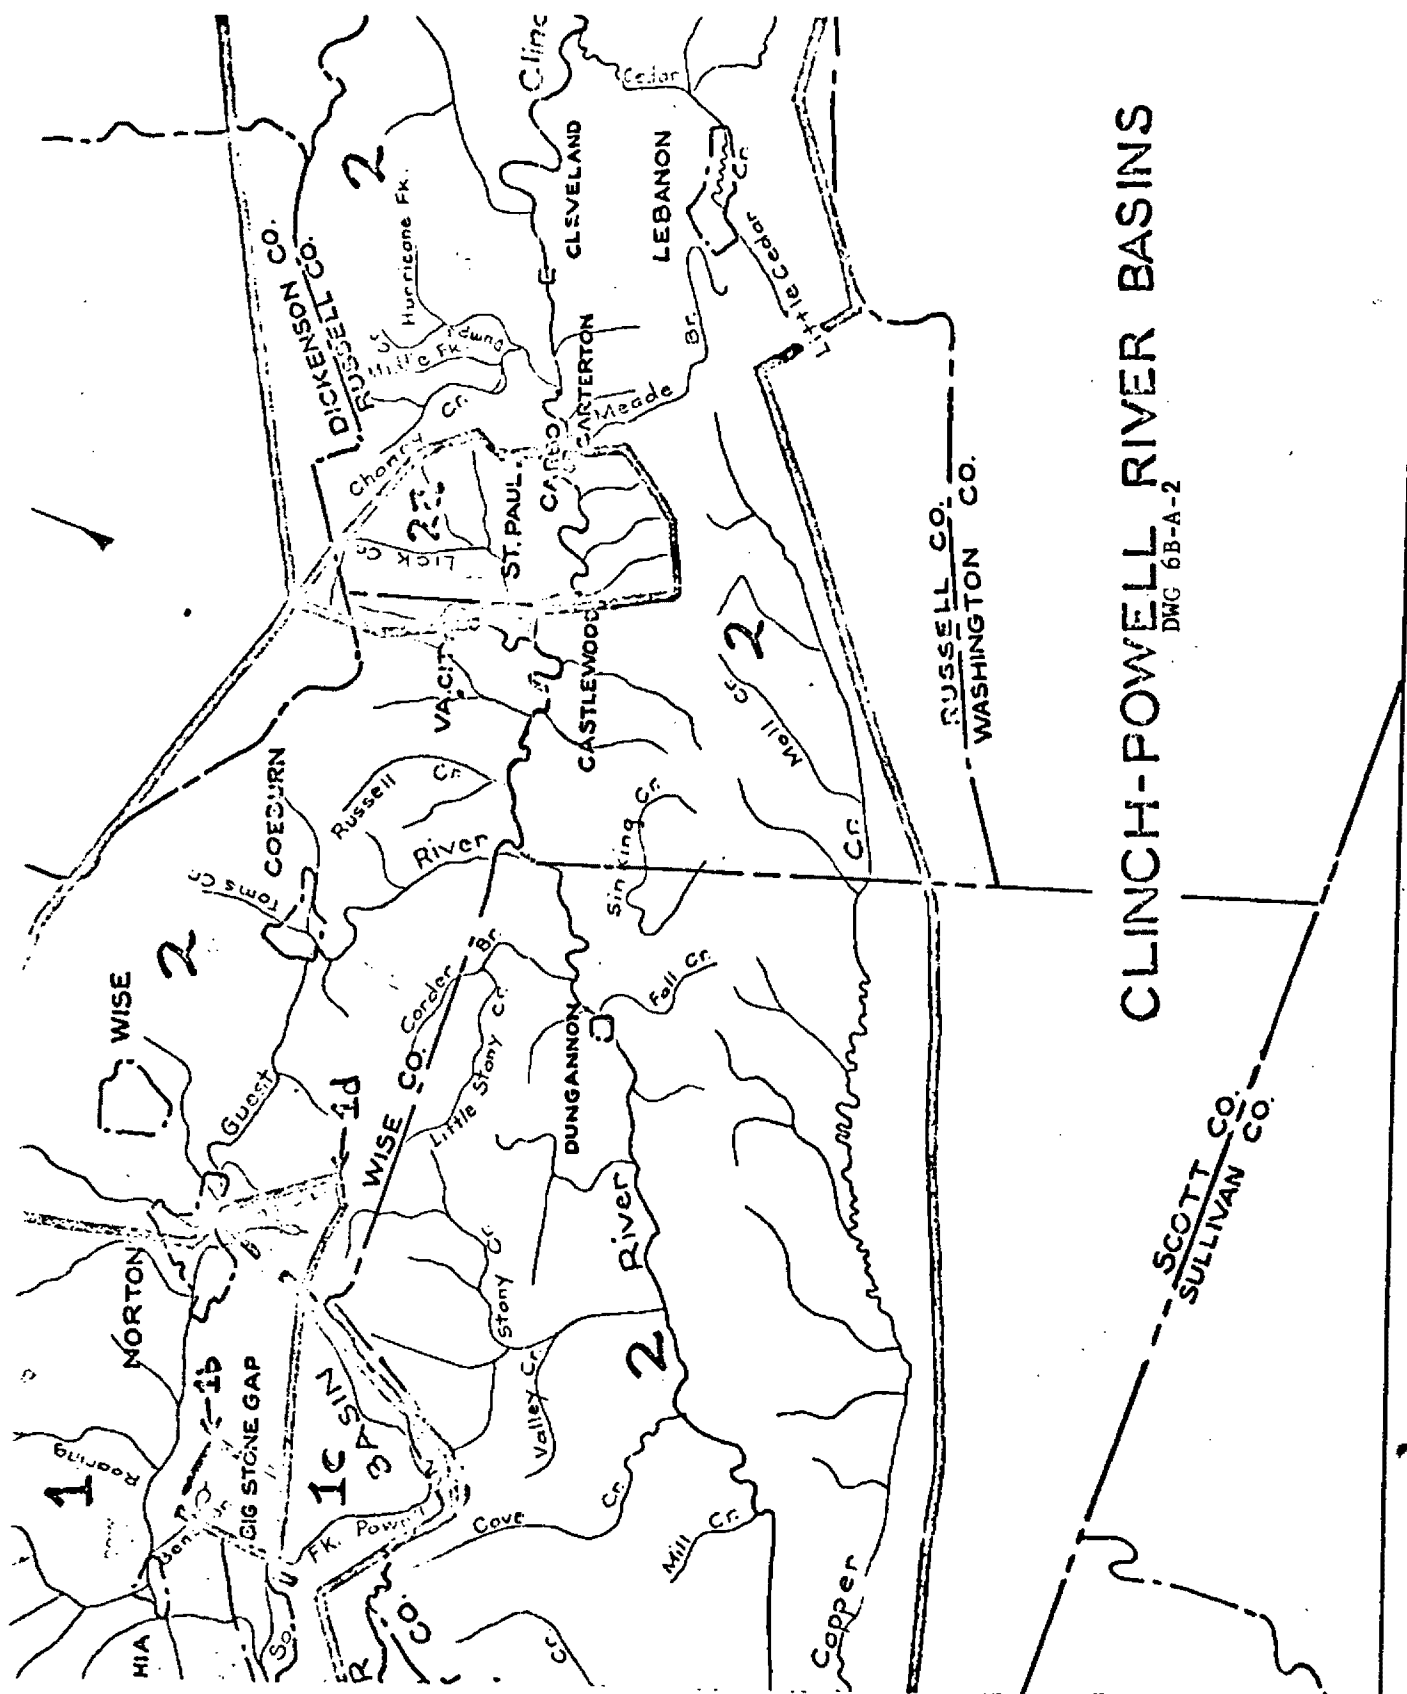

CLINCH-POWELL RIVER BASINS

DWG 6B-A-2


SCOTT CO.
SULLIVAN CO.


RUSSELL CO.
WASHINGTON CO.

Water Quality Standards Summary

Section 6B

Clinch River Basin



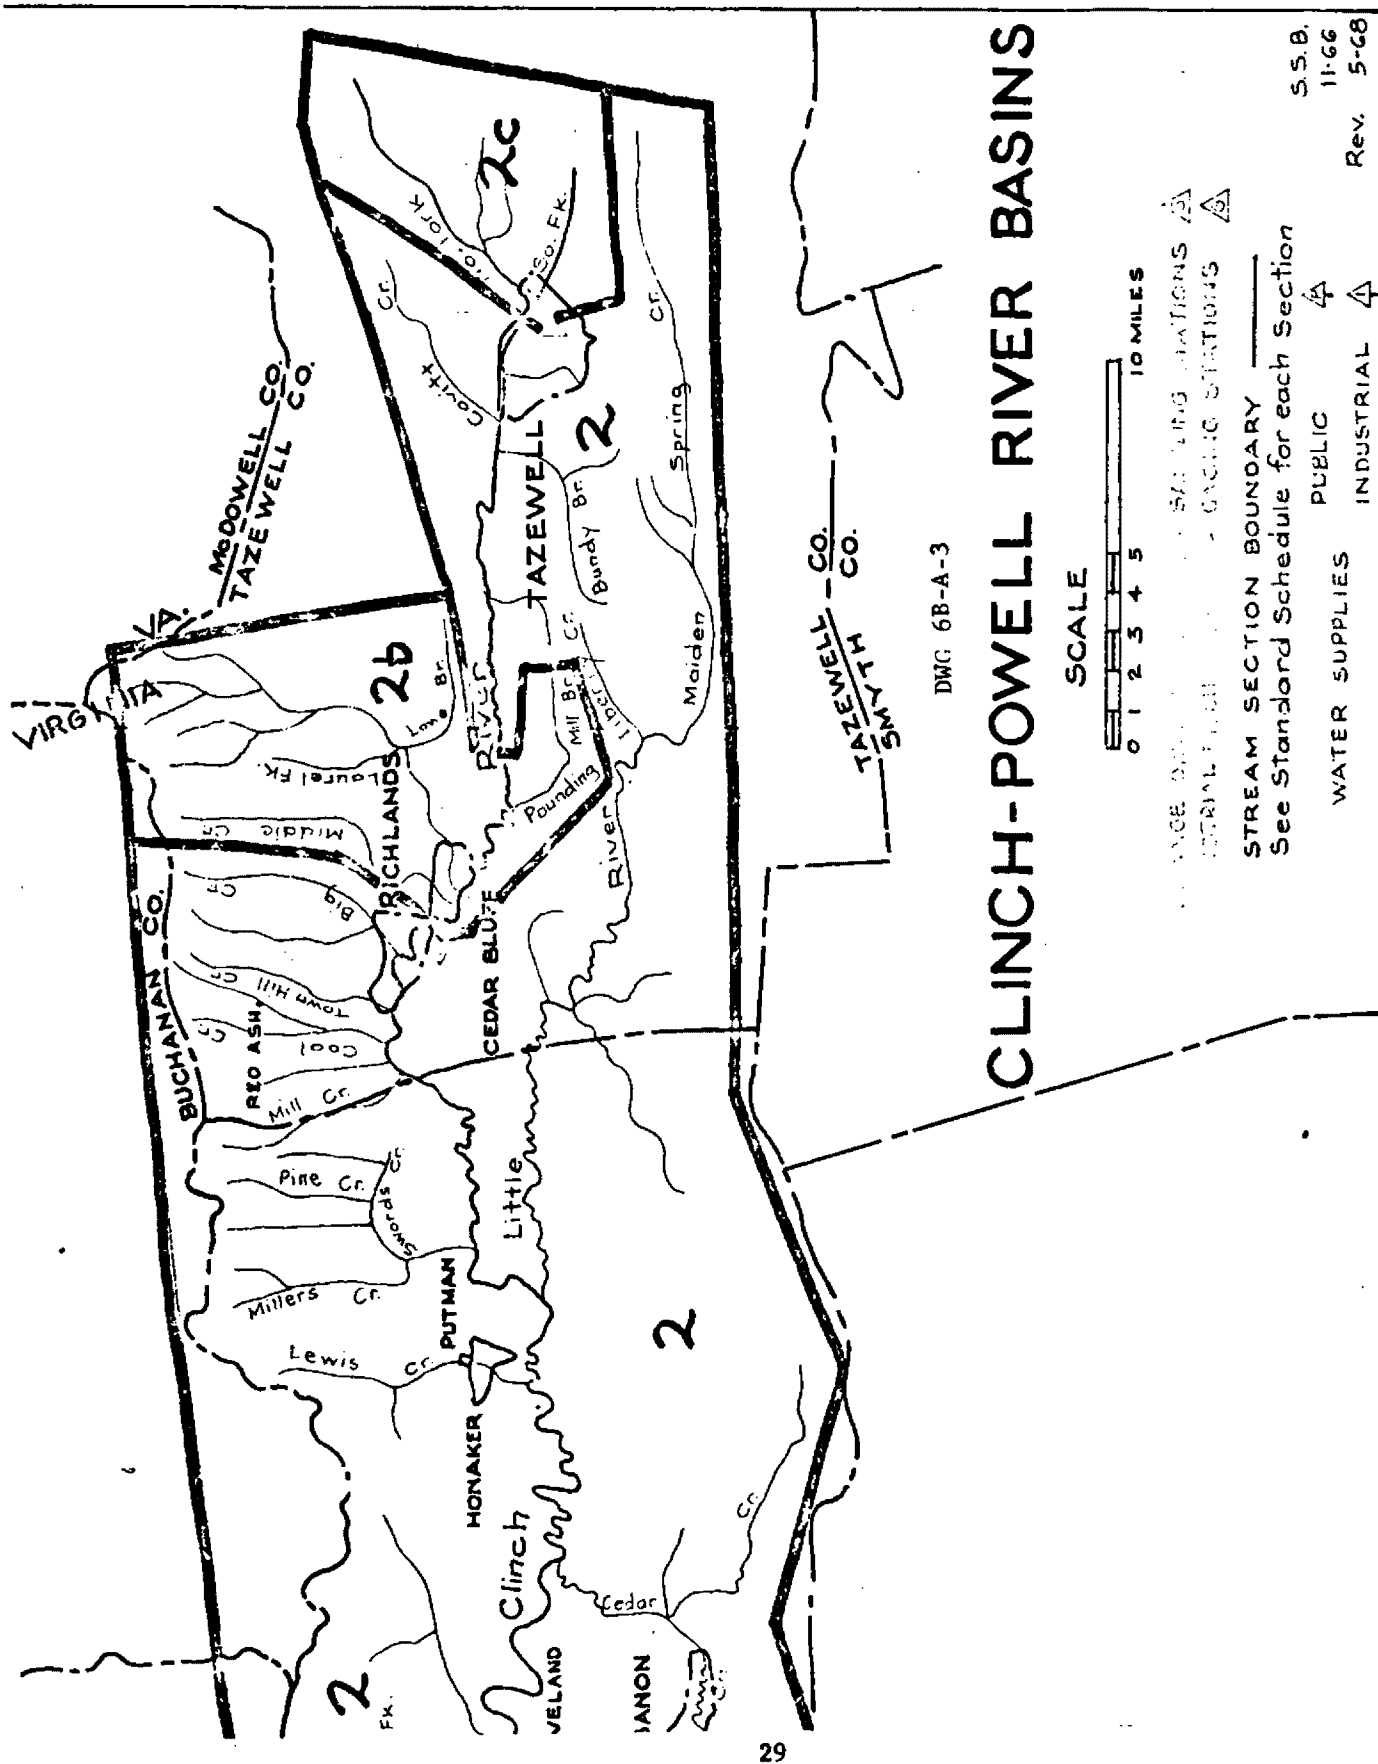


CLINCH RIVER BASIN

Section	Section Description	Class	Special Standards
1	Powell River and its tributaries from the Virginia-Tennessee state line to their headwaters; Indian Creek and Martin Creek in Virginia unless otherwise designated. <u>Trout Waters in Section 1:</u> Put and Take: North Fork Powell River above Pennington Gap to the confluence of Straight Fork. Natural: Hardy Creek and its tributaries. North Fork Powell River from the confluence of Straight Fork to its headwaters. Dry Creek from its confluence with Hardy Creek to its headwaters. Martin's Creek from Virginia-Tennessee state line to its headwaters.	IV A	pH shall be 6.0-9.0
1a	Powell River from Pennington Gap's raw water intake to 5 miles upstream.	V A	pH shall be 6.0-9.0
1b	Bens Branch from Appalachia's raw water intake to its headwaters.	VI A	pH shall be 6.0-9.0
1c	South Fork Powell River from Big Stone Gap's raw water intake to its headwaters.	IV A	Public Water Supply pH shall be 6.0-9.0
1d	Benges Branch from Norton's raw water intake to its headwaters.	IV A	Public Water Supply pH shall be 6.0-9.0
2	Clinch River and its tributaries from the Virginia-Tennessee state line to their headwaters; North Fork Clinch River and its tributaries, Blackwater Creek and its tributaries, and Little Creek in Virginia unless otherwise designated. <u>Trout Waters in Section 2:</u> Put and Take: Corder Branch from its confluence with Little Stony Cove Creek to headwaters. Cove Creek from first bridge on State route 649 west of Kerns to Stanleytown.	IV A	Public Water Supply pH shall be 6.0-9.0 Public Water Supply pH shall be 6.0-9.0 Public Water Supply pH shall be 6.0-9.0 Public Water Supply pH shall be 6.0-9.0
		V A	pH shall be 6.0-9.0

CLINCH RIVER BASIN (cont.)


Section	Section Description	Class	Special Standards
	Little Stony Creek from intersection of stream and route 72 upstream to headwaters. Stock Creek from $\frac{1}{2}$ mile north of Sunbright to $1\frac{1}{2}$ miles north of Mabe. Stony Creek from Fort Blackmore upstream to its headwaters. Natural: Big Cedar Creek from confluence with Little Cedar Creek to its headwaters. Little Cedar Creek from confluence with Big Cedar Creek to its headwaters.	VI A	pH shall be 6.0-9.0
2a	Clinch River from St. Paul's raw water intake to 5 miles upstream, and its tributaries to their headwaters.	IV A	Public Water Supply pH shall be 6.0-9.0
2b	Clinch River from Richlands raw water intake to 5 miles upstream, and its tributaries to their headwaters.	IV A	Public Water Supply pH shall be 6.0-9.0
2c	Clinch River and its tributaries from Tazewell's raw water intake to their headwaters.	IV A	Public Water Supply pH shall be 6.0-9.0



Water Quality Standards Summary

Section 6C

Holston River Basin




Holston River Basin

DWG 6-C




DWG 6C-A

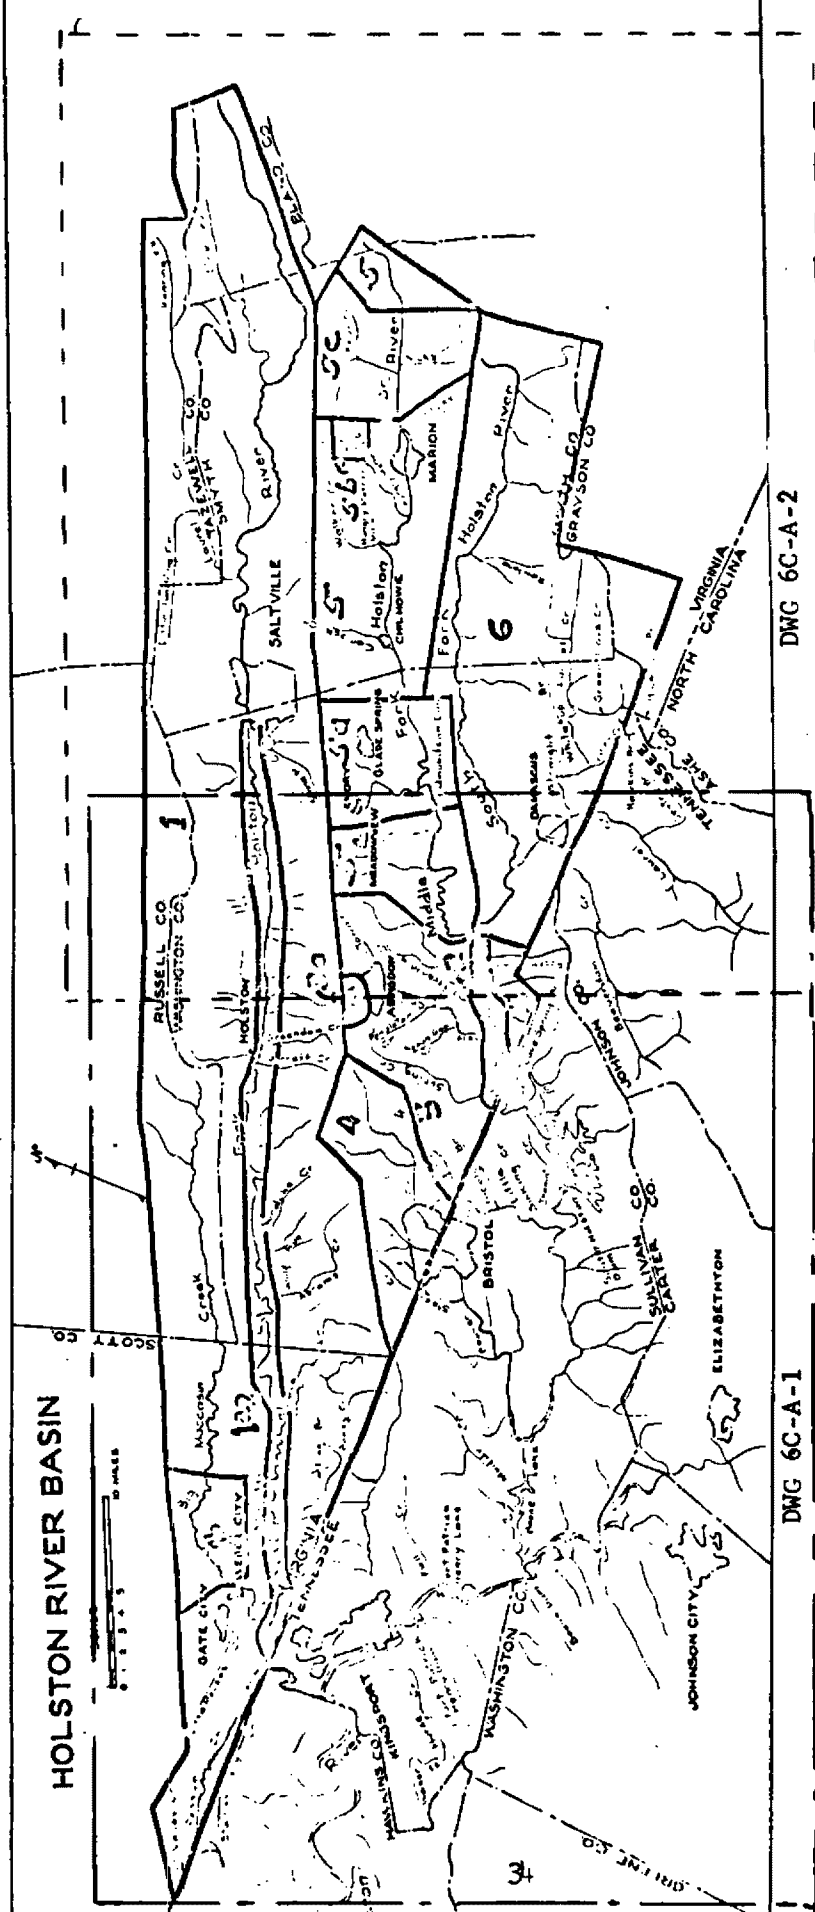

DWG 6C-A-2


DWG 6C-A-1

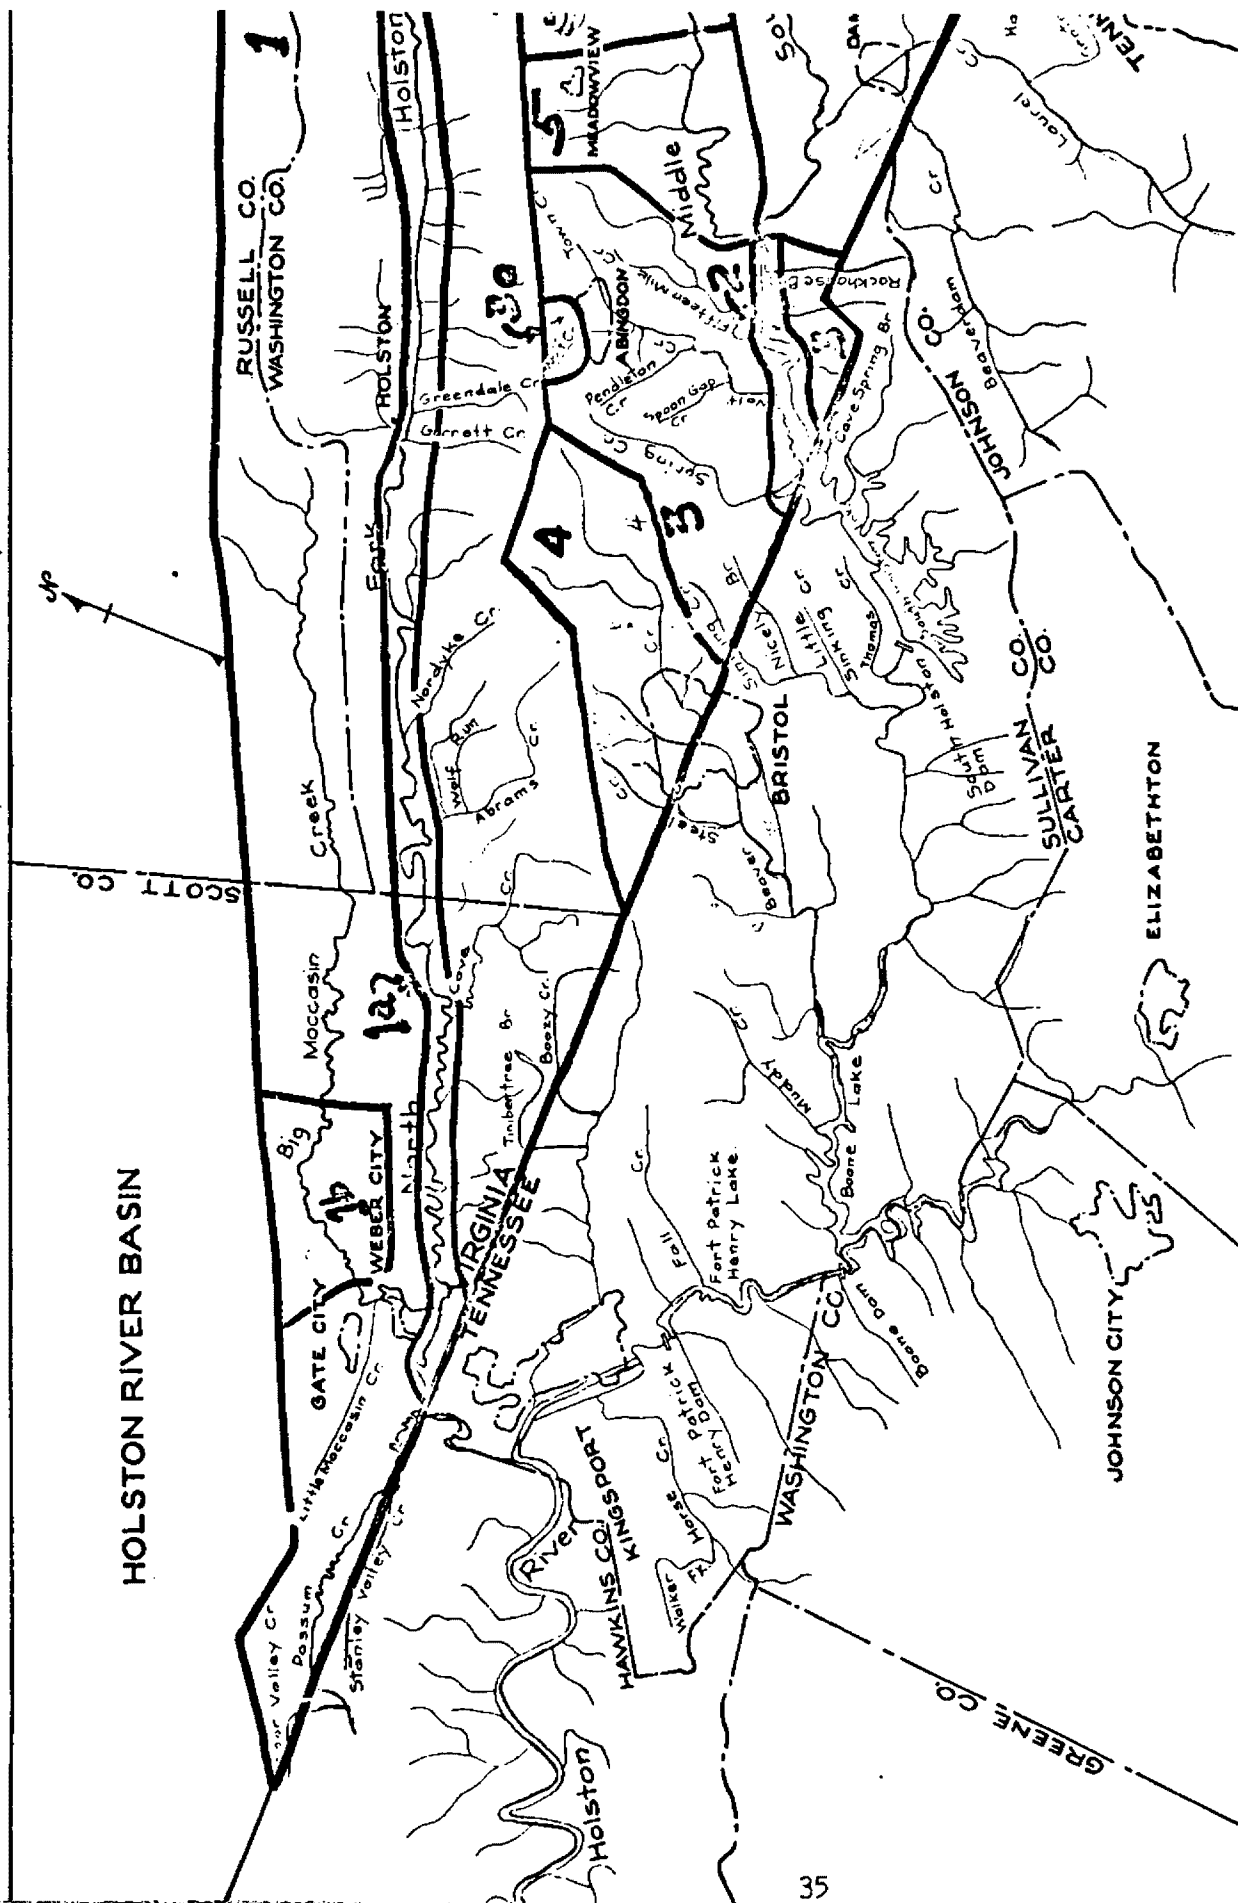

HOLSTON RIVER BASIN

See Standard Schedule for each Section

- 1. Public Water Supply
- 2. Public Water Supply
- 3. Public Water Supply
- 4. Public Water Supply
- 5. Public Water Supply
- 6. Public Water Supply
- 7. Public Water Supply
- 8. Public Water Supply
- 9. Public Water Supply
- 10. Public Water Supply
- 11. Public Water Supply
- 12. Public Water Supply
- 13. Public Water Supply
- 14. Public Water Supply
- 15. Public Water Supply
- 16. Public Water Supply
- 17. Public Water Supply
- 18. Public Water Supply
- 19. Public Water Supply
- 20. Public Water Supply
- 21. Public Water Supply

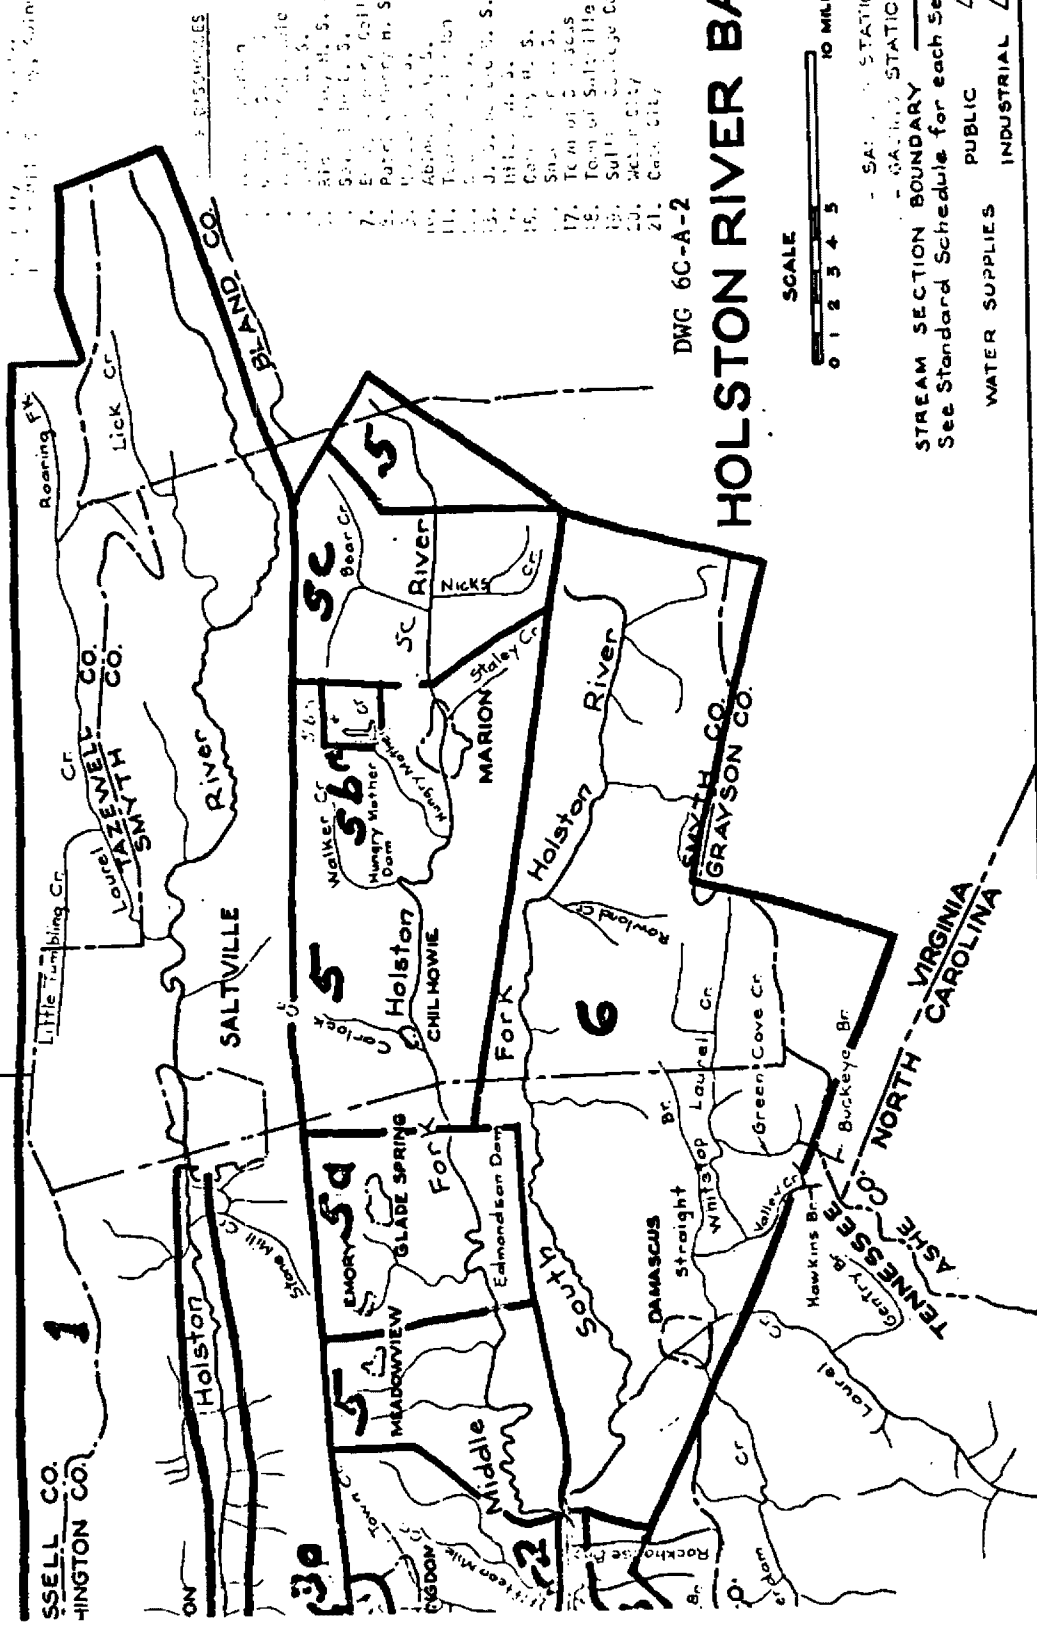

DWG 6C-A-2

HOLSTON RIVER BASIN



- SAL. STATIONS
- GAGE STATIONS

STREAM SECTION BOUNDARY
See Standard Schedule for each Section

WATER SUPPLIES
PUBLIC INDUSTRIAL

558
11-66
REV. 4-68

HOLSTON RIVER BASIN


Section	Section Description	Class	Special Standards
1	North Fork Holston River and its tributaries, unless otherwise designated, from the Virginia-Tennessee state line to their headwaters, and those sections of Timberline Branch and Boozey Creek in Virginia. <u>Trout Waters in Section 1:</u> Put and Take: Laurel Creek within Thomas Jefferson National Forest boundaries. Little Tumbling Creek from Tannersville upstream to where powerline crosses stream. Natural: Brumley Creek from confluence with North Fork Holston River to its headwaters. Laurel Creek from route 16 to confluence with Roaring Fork. Lick Creek from confluence with North Fork Holston River to its headwaters. Little Tumbling Creek from powerline crossing to its headwaters. Roaring Fork Creek from confluence with Laurel Creek to its headwaters. Big Tumbling Creek from confluence with North Fork Holston River to its headwaters. North Fork Holston River from the Olin Corporation to the Virginia-Tennessee state line.	IV A V A VI A	pH shall be 6.0-9.0 pH shall be 6.0-9.0 pH shall be 6.0-9.0
1a	North Fork Holston River from the Olin Corporation to the Virginia-Tennessee state line.	IV A	Total dissolved solids not to exceed 500 mg/l pH shall be 6.0-9.0
1b	Big Moccasin Creek from Weber City's raw water intake to a point 6 miles upstream.	IV A	Public Water Supply pH shall be 6.0-9.0
2	All waters of the South Holston Lake in Virginia.	IV B	Public Water Supply pH shall be 6.0-9.0
3	Tributaries of the South Holston Lake, and Sinking Creek, and Nicely Branch in Virginia unless otherwise designated.	IV A	pH shall be 6.0-9.0

HOLSTON RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
	<u>Trout Waters in Section 3:</u> <u>Natural:</u> Fifteen Mile Creek from confluence with the South Holston Lake to its headwaters. Spring Creek from confluence with South Holston Lake to its headwaters.	VI A	pH shall be 6.0-9.0
3a	Wolf Creek and its tributaries from the northern corporate limits of Abingdon to their headwaters	IV B	pH shall be 6.0-9.0
4	Steel Creek and Beaver Creek and their tributaries in Virginia.	IV B	pH shall be 6.0-9.0
	<u>Trout Waters in Section 4:</u> <u>Natural:</u> Beaver Creek and its tributaries from the flood control dam (near route 11) to their headwaters.	VI B	pH shall be 6.0-9.0
5	Middle Fork Holston River and its tributaries unless otherwise designated.	IV A	pH shall be 6.0-9.0
	<u>Trout Waters in Section 5:</u> <u>Natural:</u> Middle Fork Holston River from eastern town limits of Marion to its headwaters. Staley Creek from its confluence with Middle Fork Holston River to its headwaters.	VI A	pH shall be 6.0-9.0
5a	Middle Fork Holston River and its tributaries from Edmondson Dam upstream to the route 91 bridge.	IV B	pH shall be 6.0-9.0
5b	Hungry Mother Creek from the dam to its headwaters.	IV B	b pH shall be 6.0-9.0
5c	Middle Fork Holston River and its tributaries from Marion's raw water intake to a point 5 miles upstream.	IV A	Public Water Supply pH shall be 6.0-9.0
	<u>Trout Waters in Section 5c:</u> <u>Put and Take:</u> Nicks Creek from the Forest Service boundary to headwaters.	V A	pH shall be 6.0-9.0
	<u>Natural:</u> Bear Creek from confluence with Middle Fork Holston River to its headwaters.	VI A	pH shall be 6.0-9.0

HOLSTON RIVER BASIN (cont.)


Section	Section Description	Class	Special Standards
6	South Fork Holston River and its tributaries in Virginia. <u>Trout Waters in Section 6:</u> <u>Put and Take:</u> Cressy Creek from Forest Service boundary to its headwaters. Dickey Creek from Forest Service boundary to its headwaters. Rowland Creek from Forest Service boundary to its headwaters. Natural: Beaverdam Creek from its confluence with Big Laurel Creek to the Virginia-Tennessee state line. Comers Creek from its confluence with South Fork Holston River to its headwaters. Green Cove Creek from its confluence with Big Laurel Creek to its headwaters. Whitetop Creek from its confluence with Big Laurel Creek to its headwaters. Hurricane Creek from its confluence with Comers Creek to its headwaters. Big Laurel Creek from its confluence with South Fork Holston River to its headwaters. Straight Branch from its confluence with Big Laurel Creek to its headwaters. Valley Creek from its confluence with Big Laurel Creek to headwaters.	IV A V A VI A	pH shall be 6.0-9.0 pH shall be 6.0-9.0 pH shall be 6.0-9.0



Water Quality Standards Summary

Section 6D

New River Basin





New River Basin
DWG 6-D



NEW RIVER BASIN

DWG 6D-A-1

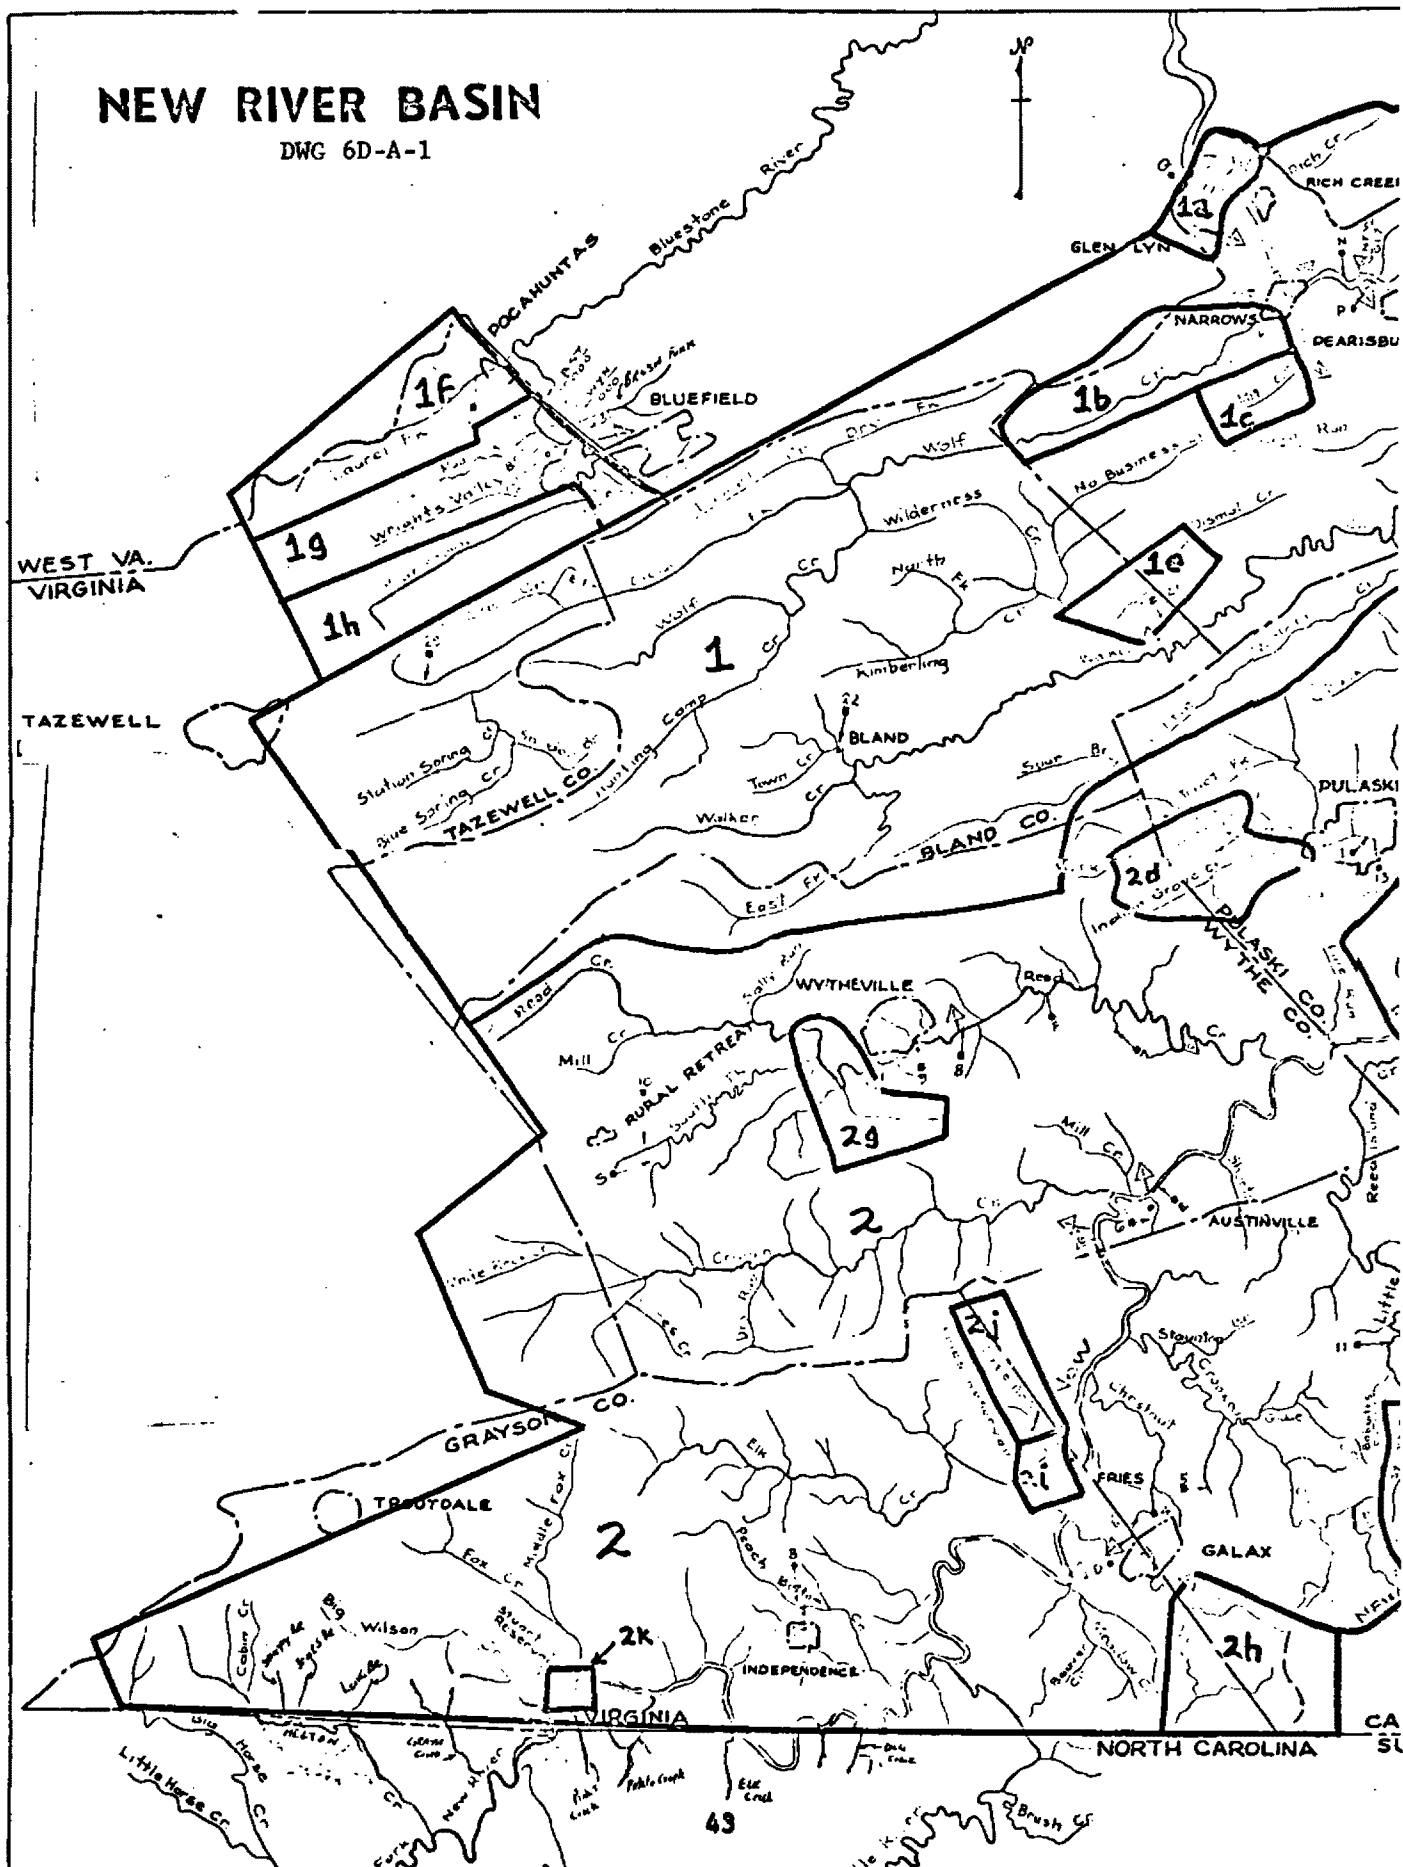


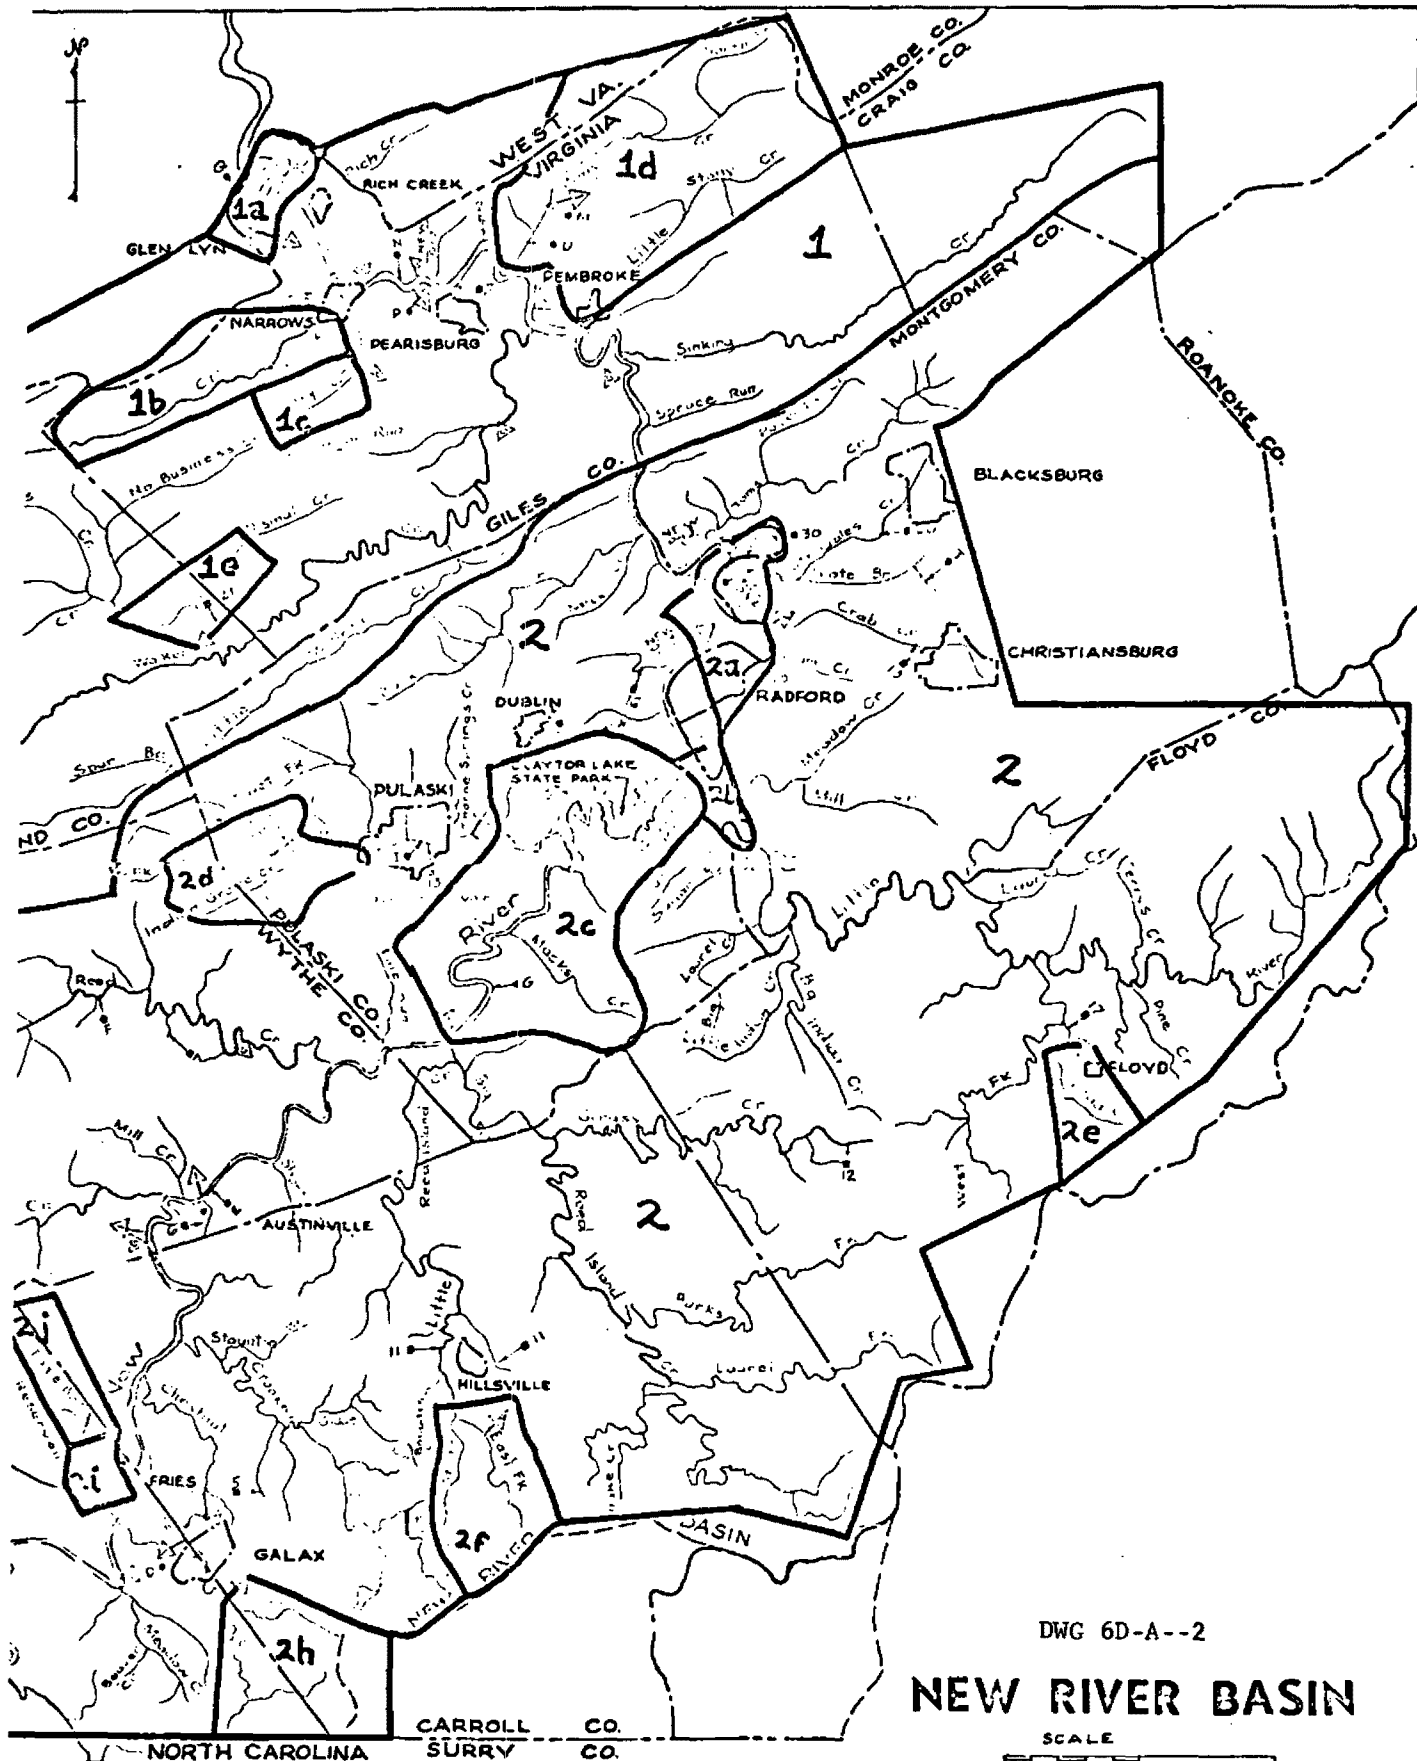

DWG 6D-A--2

NEW RIVER BASIN

SCALE



SEWAGE DISCHARGES — S — SAMPLING STATIONS
 INDUSTRIAL DISCHARGES — I — GAGING STATIONS
 STREAM SECTION BOUNDARY ———
 See Standard Schedule for each Section

NEW RIVER BASIN

Section	Section Description	Class	Special Standards
1	New River and its tributaries, unless otherwise designated, from the Virginia-West Virginia state line to the Montgomery-Giles county line. <u>Trout Waters in Section 1:</u> <u>Put and Take:</u> Wolf Creek from Rocky Gap to its confluence with Wilderness Creek. Laurel Creek from Rocky Gap to route 613 bridge 1 mile west of the junction of routes 613 and 21. <u>Natural:</u> Clear Fork Creek from its confluence with Wolf Creek to its headwaters. East Fork Clear Fork Creek from its confluence with Clear Fork Creek to its headwaters. Cove Creek from its confluence with Clear Fork Creek to its headwaters. Wolf Creek from Grapefield to its headwaters. Huntingcamp Creek from its confluence with Wolf Creek to its headwaters. Walker Creek from Bland corporate limits to its headwaters. Little Walker Creek from Pulaski-Bland county line to its headwaters. Spur Branch from its confluence with Little Walker Creek to its headwaters. Dismal Creek from its confluence with Kimberling Creek to its headwaters. No Business Creek from its confluence with Kimberling Creek to its headwaters. New River and its tributaries from Appalachia Power Company's raw water intake to a point 5 miles upstream.	IV A V A VI A IV A	pH shall be 6.0-9.0_c pH shall be 6.0-9.0 pH shall be 6.0-9.0 pH shall be 6.0-9.0_c Public Water Supply

Section	Section Description	Class	Special Standards
1b	Wolf Creek from its confluence with Mill Creek upstream to the Giles-Bland county line.	IV B	pH shall be 6.0-9.0 c
1c	Mill Creek from Narrows raw water intake upstream to its headwaters.	IV A	pH shall be 6.0-9.0 c
1d	Stony Creek from its confluence with the New River upstream to its headwaters, and Little Stony Creek from its confluence with the New River to its headwaters. <u>Trout Waters in Section 1d:</u> Natural: Stony Creek from its confluence with the New River to its headwaters. North Fork Stony Creek from its confluence with Stony Creek to its headwaters. Little Stony Creek from confluence with the New River to its headwaters.	IV B	Public Water Supply pH shall be 6.0-9.0 c
1e	Kimberling Creek and its tributaries from Bland Correctional Farm's raw water intake to a point 5 miles upstream.	IV A	pH shall be 6.0-9.0 c
1f	Laurel Fork from the Virginia-West Virginia state line to its headwaters.	IV A	Public Water Supply pH shall be 6.0-9.0 c
1g	Bluestone River and its tributaries, unless otherwise designated, from the Virginia-West Virginia state line upstream to their headwaters.	IV B	pH shall be 6.0-9.0 c
1h	Bluestone River from Bluefield's raw water intake upstream to its headwaters.	IV B	pH shall be 6.0-9.0 c
2	New River and its tributaries, unless otherwise designated, from the Montgomery-Giles county line upstream to the Virginia-North Carolina state line.	IV A	Public Water Supply pH shall be 6.0-9.0

Section	Section Description	Class	Special Standards
	<u>Trout Waters in Section 2:</u> <u>Put and Take:</u> Elk Creek from its confluence with Knob Fork Creek to the junction of State routes 611 and 662. Brush Creek from the first bridge on route 617 south of junction of routes 617 and 601 to the Floyd County line West Fork Peak Creek from the Forest Service boundary to its headwaters. Tract Fork from the Forest Service boundary to its headwaters. Poverty Creek from the Forest Service boundary to its headwaters. Tom's Creek to its headwaters. <u>Natural:</u> Main Fork Helton Creek from Virginia-North Carolina state line to its headwaters. Cabin Creek from its confluence with Helton Creek to its headwaters. Big Wilson Creek from its confluence with the New River to its headwaters. Fox Creek from junction of creek and route 734 to its headwaters. Middle Fox Creek from its confluence with Fox Creek to its headwaters. Peach Bottom Creek from its confluence with the New River to its headwaters. Crooked Creek from its confluence with the New River to its headwaters. Glade Creek from its confluence with Crooked Creek to its headwaters. East Fork Crooked Creek from its confluence with Crooked Creek to its headwaters.	V A	pH shall be 6.0-9.0
		VI A	pH shall be 6.0-9.0

NEW RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
2a	Burks Fork from the Floyd-Carroll County line to its headwaters. Mira Fork Creek from its confluence with Greasy Creek to its headwaters. White Rock Creek from its confluence with Cripple Creek to its headwaters. Jones Creek from its confluence with Harris Branch to its headwaters. Dry Run from its confluence with Cripple Creek to its headwaters. Cripple Creek from the junction of stream and U.S. Route 21 in Wythe County to its headwaters. Reed Creek from Western Town limits of Wytheville to its headwaters. Francis Mill Creek from its confluence with Cripple Creek to its headwaters. Little River from the junction of stream and route 706 to its headwaters. West Fork Little River from its confluence with Little River to its headwaters. Meadow Creek from its confluence with Little River to its headwaters. Big Reed Island Creek from Route 221 to its headwaters. Killinger Creek from its confluence with Cripple Creek and White Rock Creek to its headwaters. New River from Radford Army Ammunition Plant's raw water intake (that raw water intake which is farther downstream) to a point 5 miles above Blacksburg-Christiansburg, V.P.I. Water Authority's raw water intake. New River from Radford's raw water intake upstream to Claytor Dam and Little River from its confluence with the New River to the mouth of Burks Run.	IV A	pH shall be 6.0 - 9.0 Public Water Supply
2b		IV A	pH shall be 6.0 - 9.0 Public Water Supply

NEW RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
2c	New River and its tributaries, except Peak Creek, from Claytor Dam to Big Reed Island Creek.	IV B	pH shall be 6.0-9.0
2d	Peak Creek and its tributaries from Pulaski's raw water intake upstream, including Hogan Branch to its headwaters and Gatewood Reservoir.	IV A	pH shall be 6.0-9.0 Public Water Supply
2e	Dodd Creek from Floyd's raw water intake upstream to its headwaters. <u>Trout Water in Section 2e:</u> Natural: Howells Creek from its confluence with West Fork Little River to its headwaters.	IV A	pH shall be 6.0-9.0 Public Water Supply
2f	Little Reed Island Creek and its tributaries from Hillsville's raw water intake to a point 5 miles upstream, including the entire watershed of East Fork Little Reed Island Creek. <u>Trout Waters in Section 2f:</u> Natural:	VI A	pH shall be 6.0-9.0
2g	Little Reed Island Creek from the junction of stream and state routes 782 and 772 to headwaters, including East and West Forks Reed Creek and its tributaries from Wytheville's raw water intake to 5 miles upstream. <u>Trout Waters in Section 2g:</u> Natural: Reed Creek from the western town limits of Wytheville to its headwaters.	IV A	pH shall be 6.0-9.0 Public Water Supply
2h	Chestnut Creek from Galax's raw water intake upstream to its headwaters. <u>Trout Waters in Section 2h:</u> Natural: Coal Creek from its confluence with Chestnut Creek to its headwaters.	VI A	pH shall be 6.0-9.0 Public Water Supply


NEW RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
2i	Fries Reservoir section of the New River.	IV B	pH shall be 6.0-9.0 b
2j	Eagle Bottom Creek from Fries' raw water intake upstream to its headwaters.	IV A	pH shall be 6.0-9.0 Public Water Supply
2k	Stuart Reservoir section of the New River.	IV B	pH shall be 6.0-9.0 b

Water Quality Standards Summary


Section 6E

Roanoke River Basin

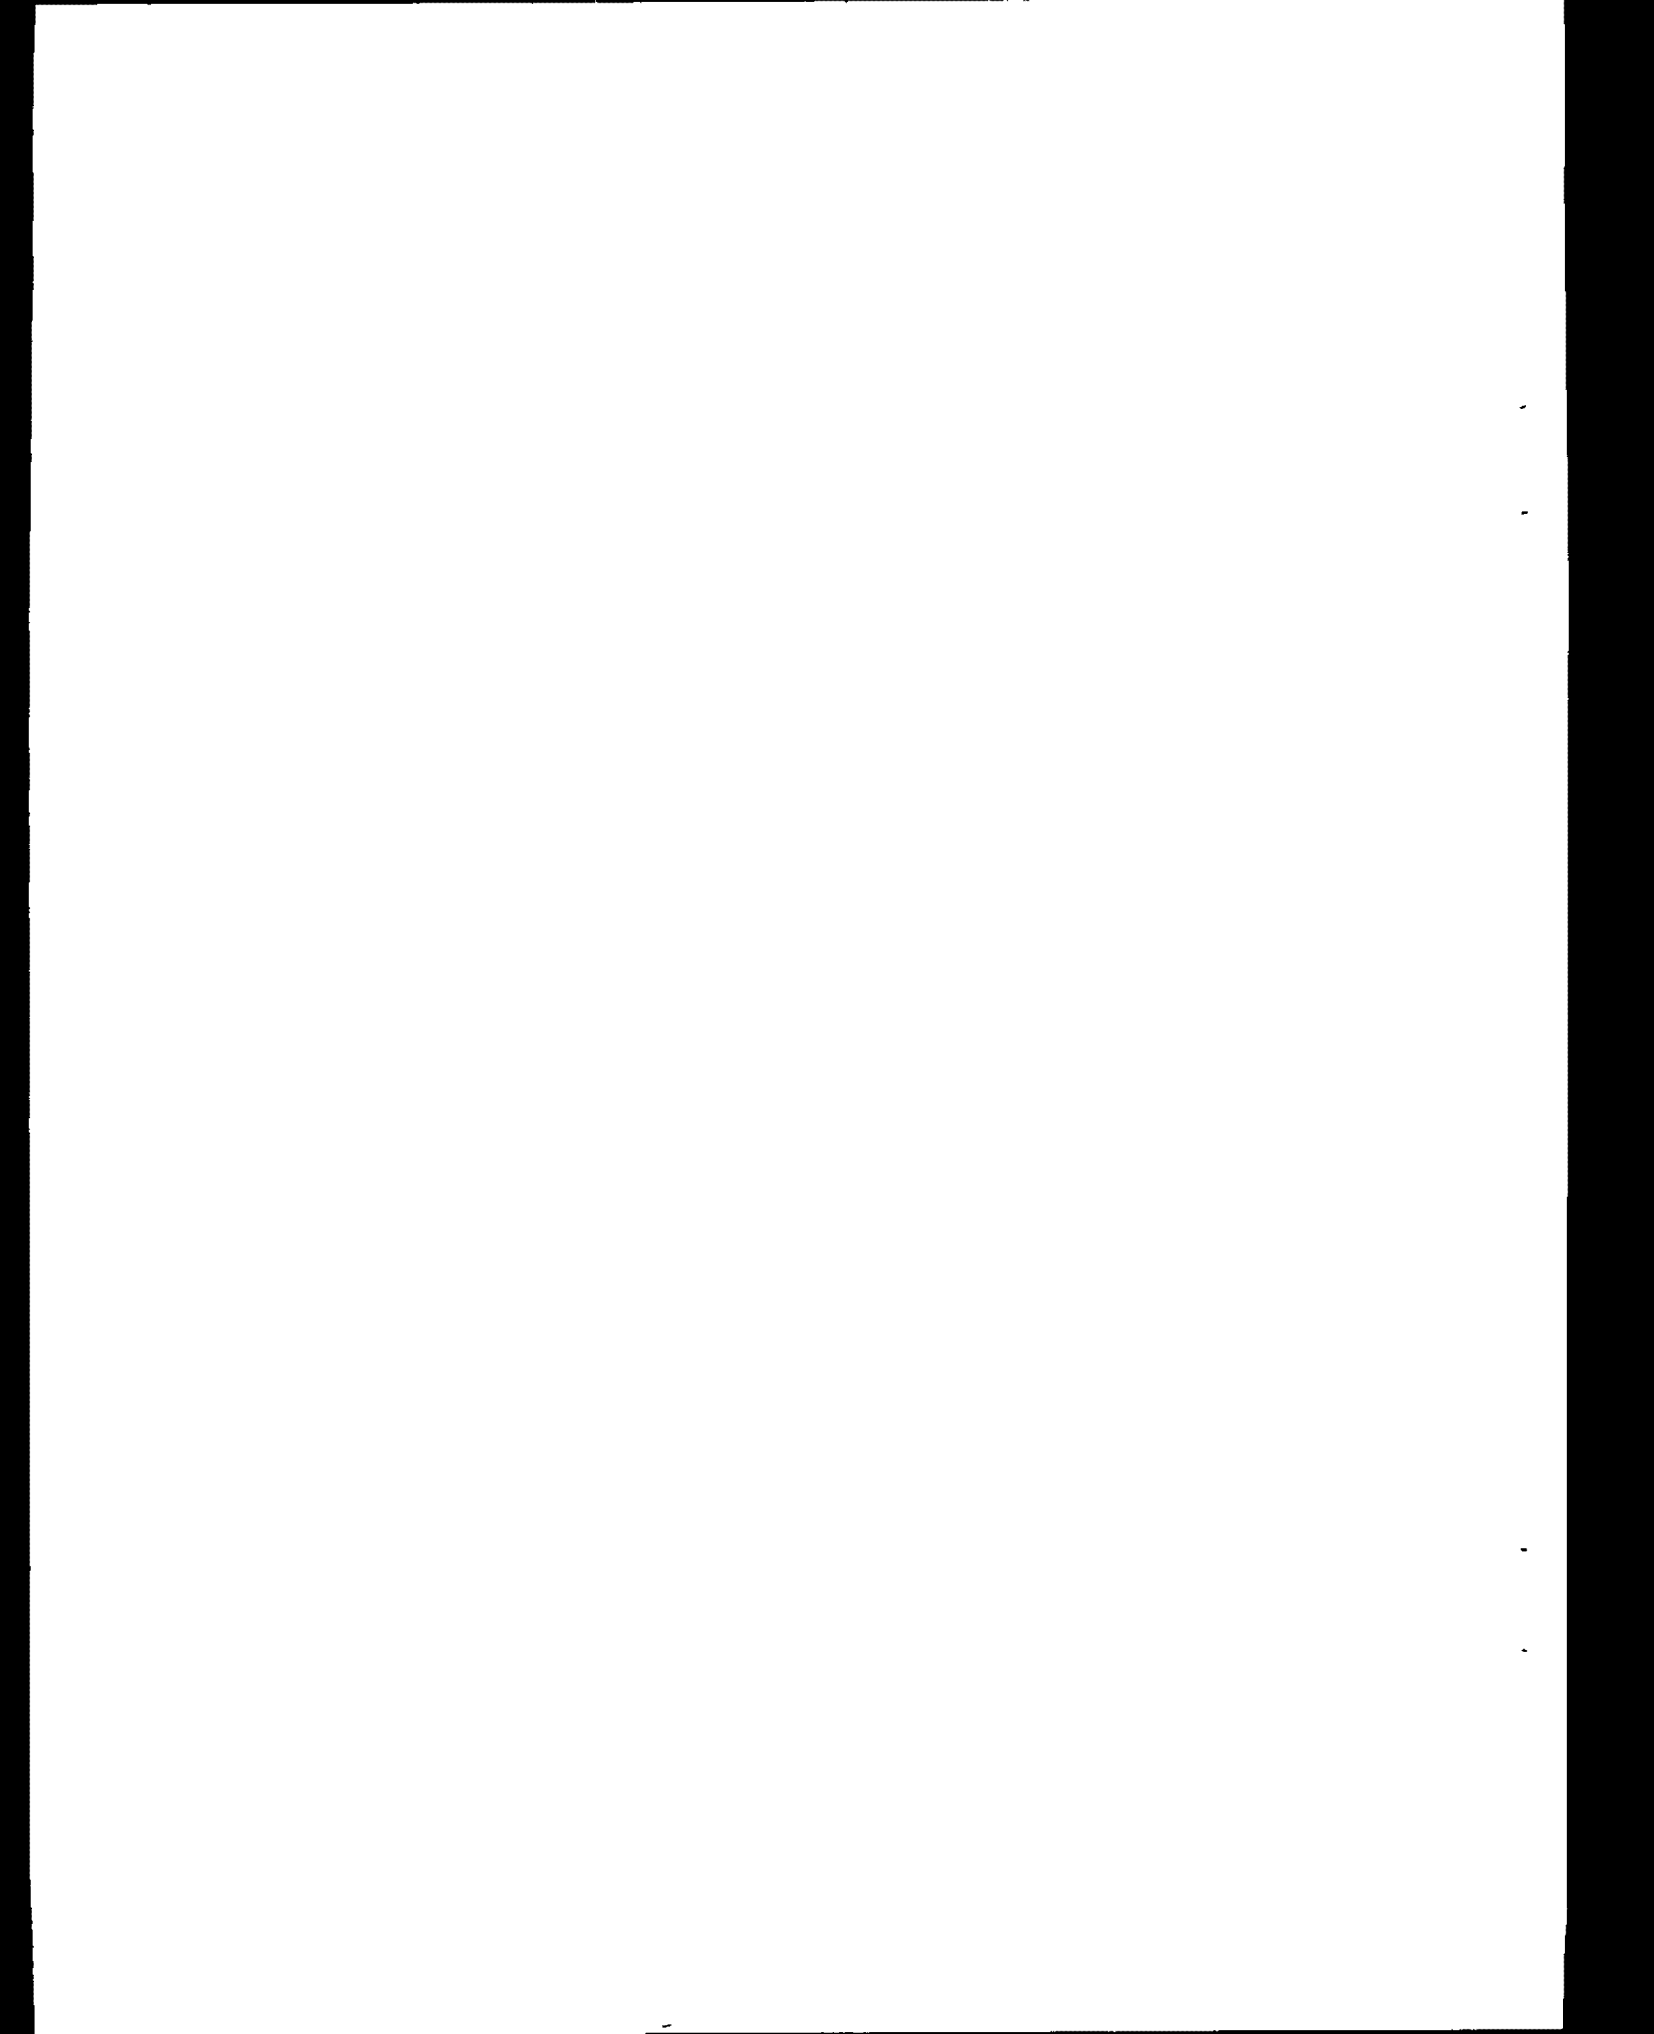

Roanoke River Basin

DWG 6E

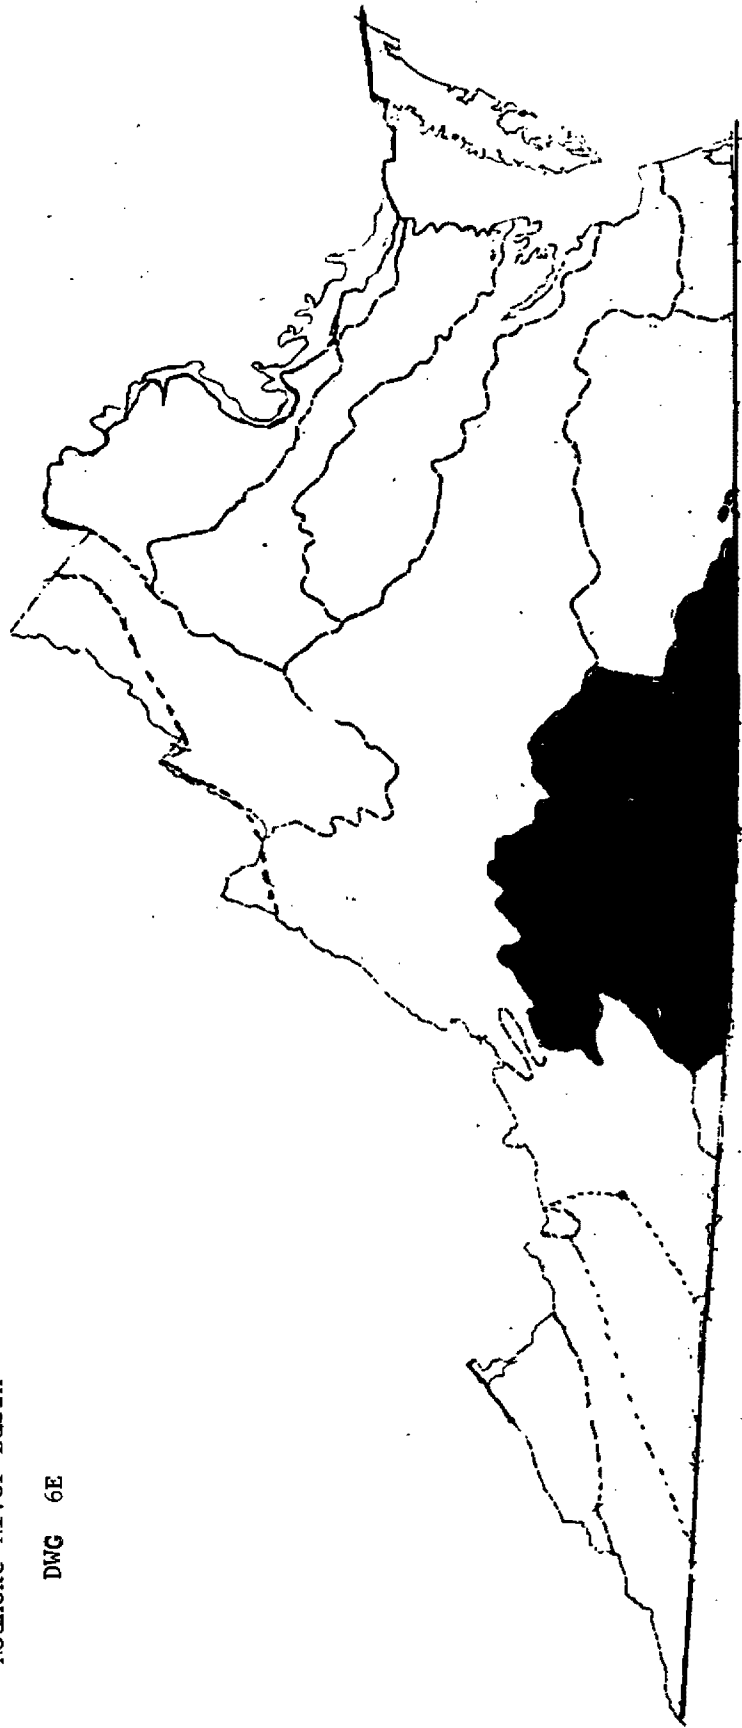

DWG 6E-A-1

DWG 6E-A-3


ROANOKE RIVER BASIN

1. Stream channels - 100' contour
 2. Stream channels - 200' contour
 3. Stream channels - 300' contour
 4. Stream channels - 400' contour
 5. Stream channels - 500' contour
 6. Stream channels - 600' contour
 7. Stream channels - 700' contour
 8. Stream channels - 800' contour
 9. Stream channels - 900' contour
 10. Stream channels - 1000' contour
 11. Stream channels - 1100' contour
 12. Stream channels - 1200' contour
 13. Stream channels - 1300' contour
 14. Stream channels - 1400' contour
 15. Stream channels - 1500' contour
 16. Stream channels - 1600' contour
 17. Stream channels - 1700' contour
 18. Stream channels - 1800' contour
 19. Stream channels - 1900' contour
 20. Stream channels - 2000' contour
 21. Stream channels - 2100' contour
 22. Stream channels - 2200' contour
 23. Stream channels - 2300' contour
 24. Stream channels - 2400' contour
 25. Stream channels - 2500' contour
 26. Stream channels - 2600' contour
 27. Stream channels - 2700' contour
 28. Stream channels - 2800' contour
 29. Stream channels - 2900' contour
 30. Stream channels - 3000' contour
 31. Stream channels - 3100' contour
 32. Stream channels - 3200' contour
 33. Stream channels - 3300' contour
 34. Stream channels - 3400' contour
 35. Stream channels - 3500' contour
 36. Stream channels - 3600' contour
 37. Stream channels - 3700' contour
 38. Stream channels - 3800' contour
 39. Stream channels - 3900' contour
 40. Stream channels - 4000' contour
 41. Stream channels - 4100' contour
 42. Stream channels - 4200' contour
 43. Stream channels - 4300' contour
 44. Stream channels - 4400' contour
 45. Stream channels - 4500' contour
 46. Stream channels - 4600' contour
 47. Stream channels - 4700' contour
 48. Stream channels - 4800' contour
 49. Stream channels - 4900' contour
 50. Stream channels - 5000' contour
 51. Stream channels - 5100' contour
 52. Stream channels - 5200' contour
 53. Stream channels - 5300' contour
 54. Stream channels - 5400' contour
 55. Stream channels - 5500' contour
 56. Stream channels - 5600' contour
 57. Stream channels - 5700' contour
 58. Stream channels - 5800' contour
 59. Stream channels - 5900' contour
 60. Stream channels - 6000' contour
 61. Stream channels - 6100' contour
 62. Stream channels - 6200' contour
 63. Stream channels - 6300' contour
 64. Stream channels - 6400' contour
 65. Stream channels - 6500' contour
 66. Stream channels - 6600' contour
 67. Stream channels - 6700' contour
 68. Stream channels - 6800' contour
 69. Stream channels - 6900' contour
 70. Stream channels - 7000' contour
 71. Stream channels - 7100' contour
 72. Stream channels - 7200' contour
 73. Stream channels - 7300' contour
 74. Stream channels - 7400' contour
 75. Stream channels - 7500' contour
 76. Stream channels - 7600' contour
 77. Stream channels - 7700' contour
 78. Stream channels - 7800' contour
 79. Stream channels - 7900' contour
 80. Stream channels - 8000' contour
 81. Stream channels - 8100' contour
 82. Stream channels - 8200' contour
 83. Stream channels - 8300' contour
 84. Stream channels - 8400' contour
 85. Stream channels - 8500' contour
 86. Stream channels - 8600' contour
 87. Stream channels - 8700' contour
 88. Stream channels - 8800' contour
 89. Stream channels - 8900' contour
 90. Stream channels - 9000' contour
 91. Stream channels - 9100' contour
 92. Stream channels - 9200' contour
 93. Stream channels - 9300' contour
 94. Stream channels - 9400' contour
 95. Stream channels - 9500' contour
 96. Stream channels - 9600' contour
 97. Stream channels - 9700' contour
 98. Stream channels - 9800' contour
 99. Stream channels - 9900' contour
 100. Stream channels - 10000' contour


DWG 6E-A-2

DWG 6E-A


ROANOKE RIVER BASIN

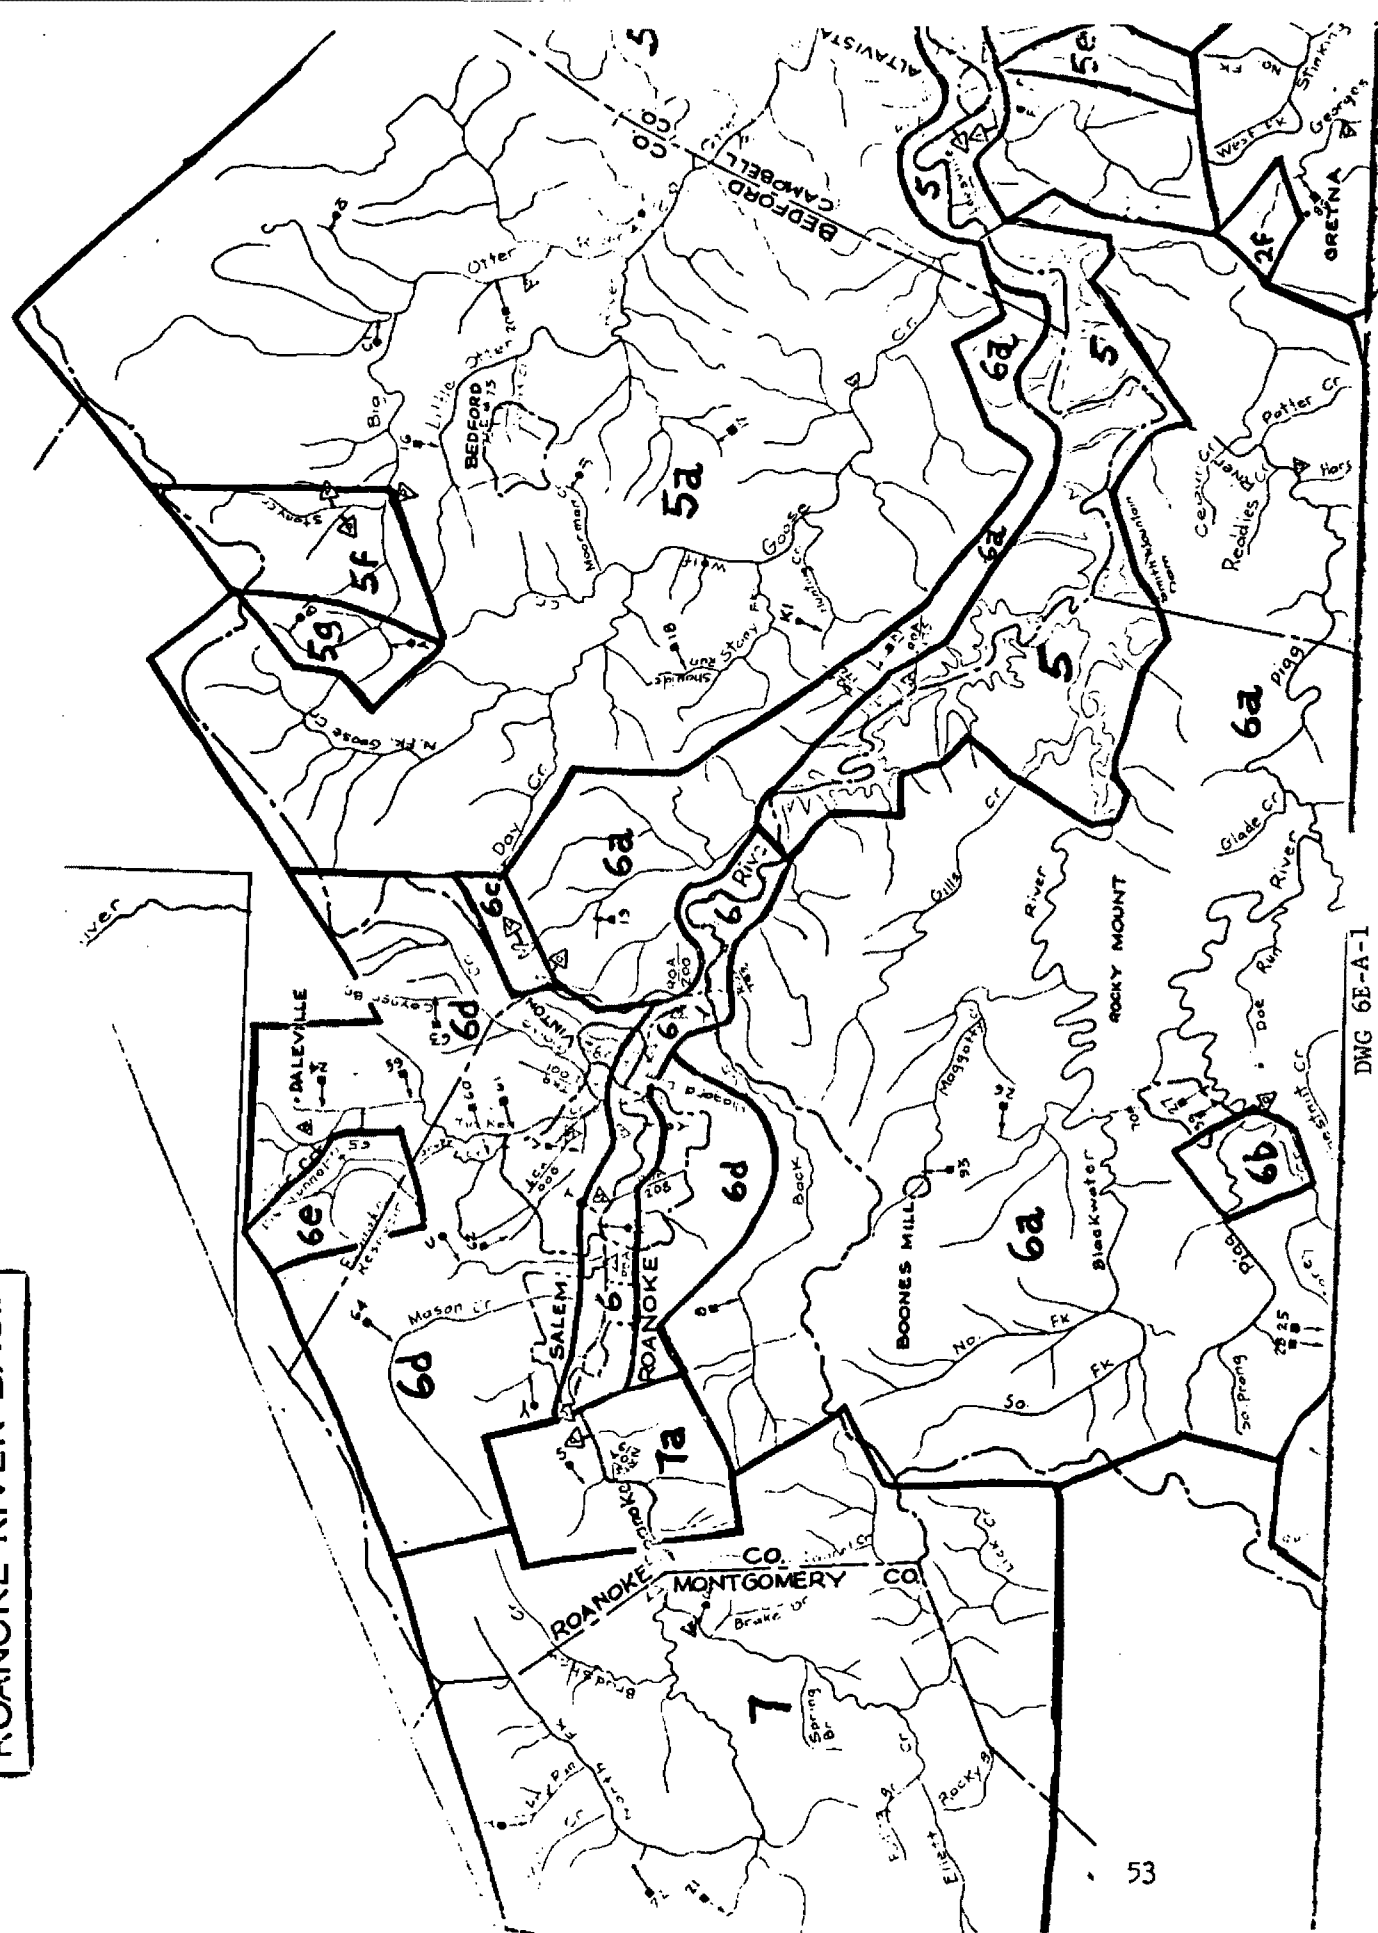

DWG 6E-A-1

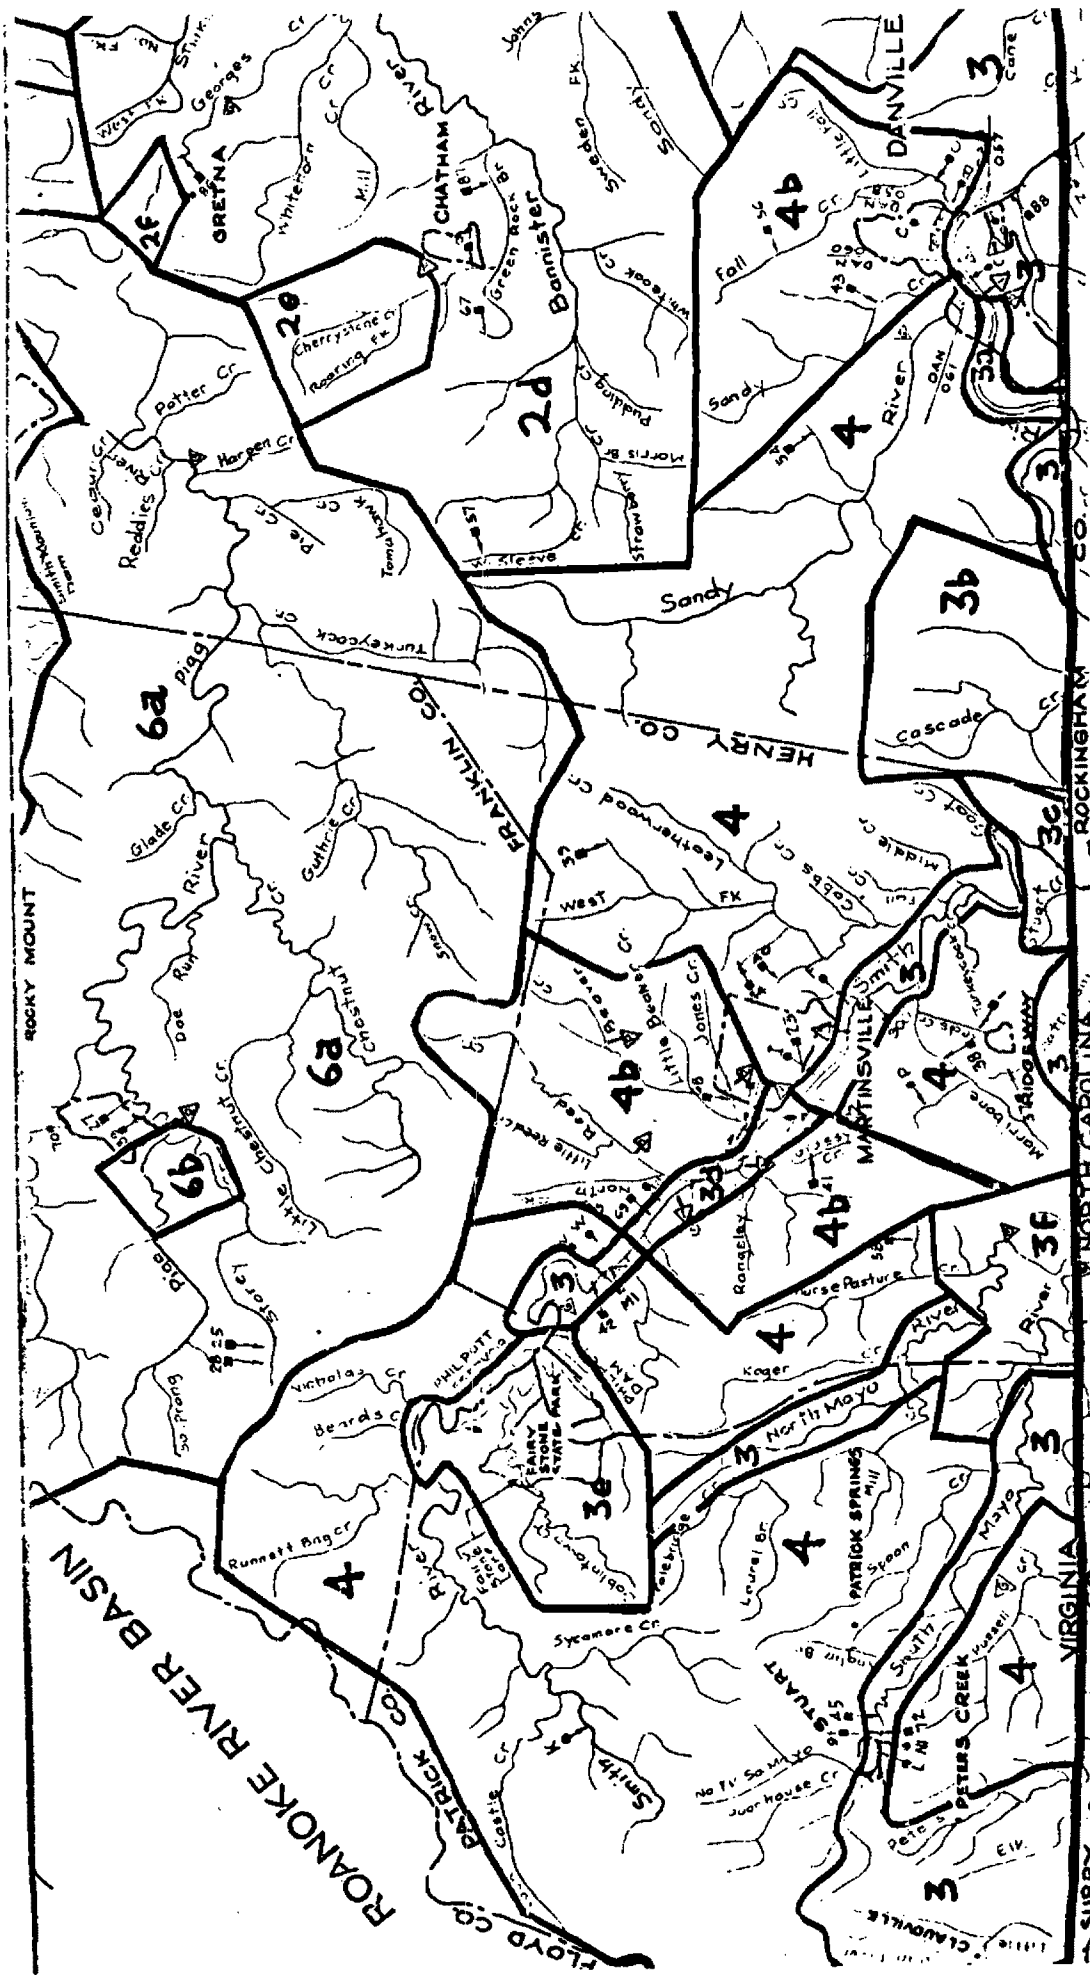

DWG 6E-A-2

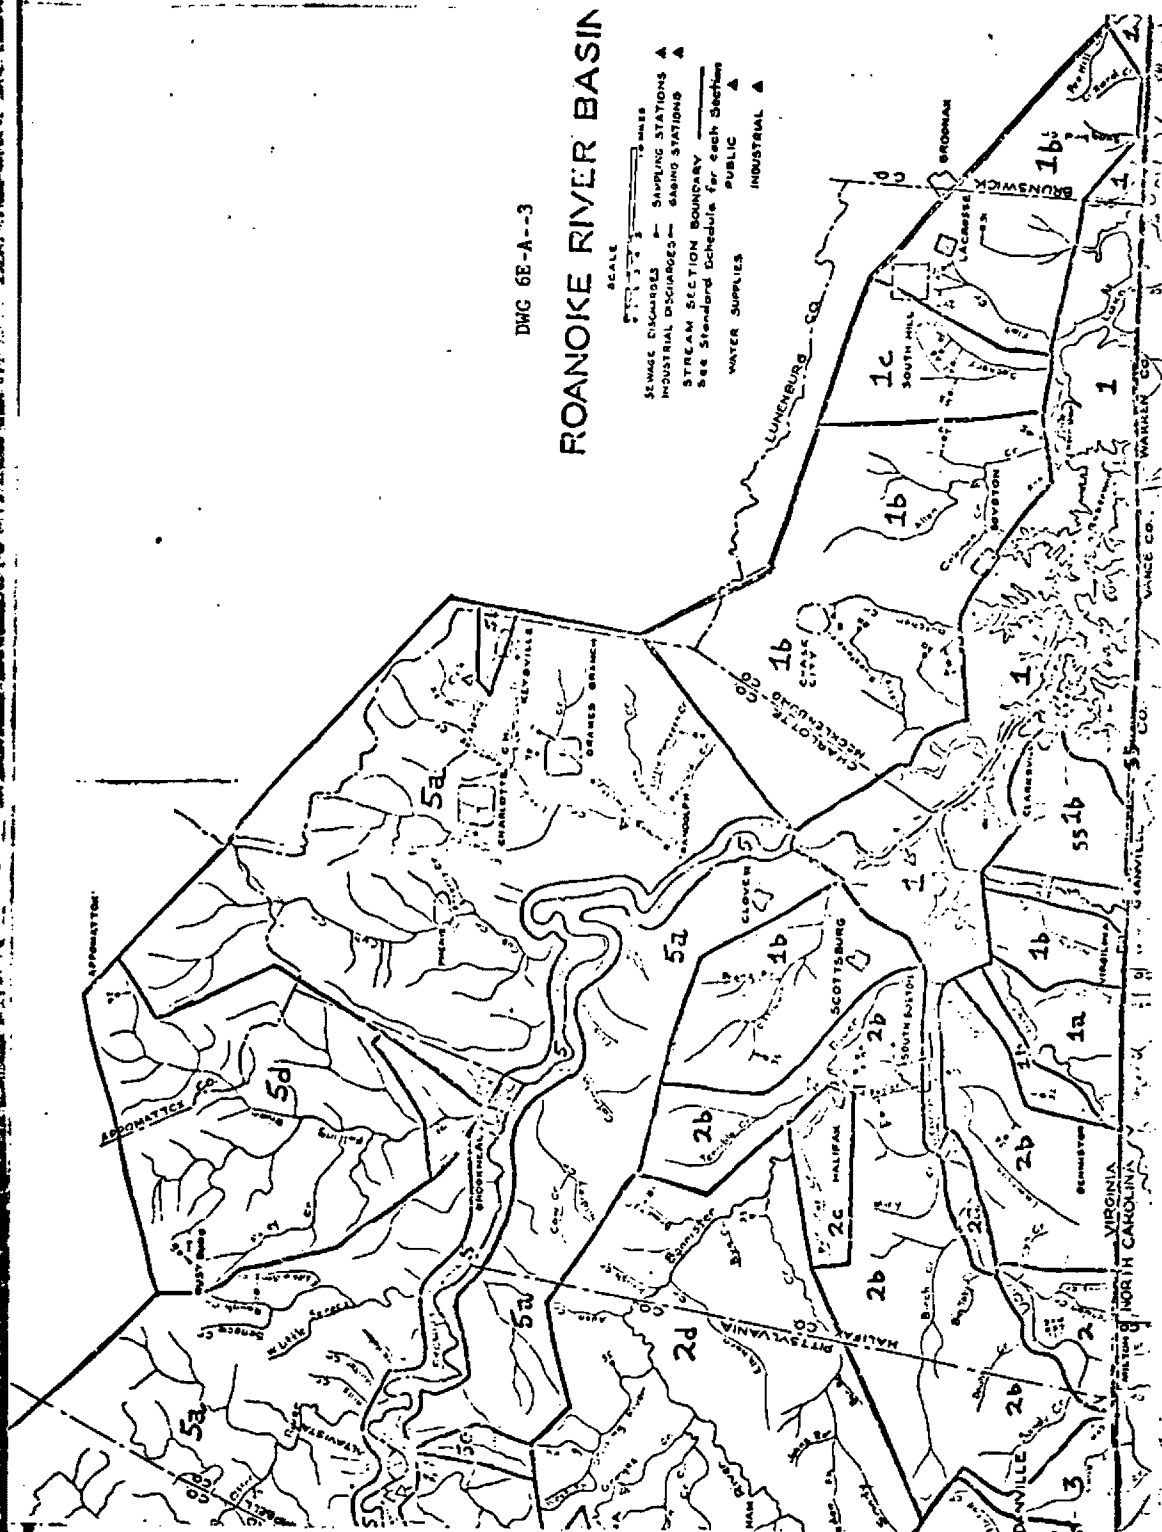

ROANOKE RIVER BASIN

Section	Section Description	Class	Special Standards
1	Lake Gaston and the John Kerr Reservoir in Virginia	IV B	b Public Water Supply
1a	Interstate tributaries of Lake Gaston and John Kerr Reservoir, including, but not limited to, Hawtree Creek, Smith Creek, Aarons Run, Wolfpit Run, Big Bluewing Creek, Mayo Creek, Crutchfield Branch, and the Hycro River (not to include the Roanoke or Dan Rivers.)	IV B	
1b	Intrastate tributaries to Lake Gaston and John Kerr Reservoir, unless otherwise designated.	III B	
1c	Dockery Creek and its tributaries to their headwaters.	III B	e
2	Dan River and its interstate tributaries, from John Kerr Reservoir to the Virginia-North Carolina state line just east of the Pittsylvania-Halifax county line, including, but not limited to, Winns Creek, Brandon Creek and Country Line Creek, unless otherwise designated.	IV B	
2a	Dan River from South Boston's raw water intake upstream to Paces, Virginia (below route 658 bridge.)	IV B	Public Water Supply
2b	Intrastate tributaries to the Dan River from John Kerr Reservoir upstream to the Virginia-North Carolina state line just east of the Pittsylvania-Halifax County line, unless otherwise designated.	III B	
2c	Bannister River and its tributaries from Halifax's raw water impoundment dam to a point 5 miles upstream.	III A	Public Water Supply
2d	Bannister River and its tributaries from 5 miles above Halifax's raw water impoundment dam upstream to their headwaters, unless otherwise designated.	III A	
2e	Cherry Stone Creek from Chatham's raw water intake upstream to its headwaters.	III A	Public Water Supply
2f	Georges Creek from Gretna's raw water intake upstream to its headwaters.	III A	Public Water Supply
3	Dan River and its interstate tributaries from the Virginia-North Carolina state line just east of the Pittsylvania-Halifax County line to their headwaters, including, but not	IV A	

ROANOKE RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
	limited to, Cane Creek, Coy Creek, Pumpkin Creek, Matrimony Creek, North Mayo River, South Mayo River, Crooked Creek, Elk Creek, Peters Creek, and Little Dan River, unless otherwise designated. <u>Trout Waters in Section 3:</u> <u>Put and Take:</u> Little Dan River from its confluence with Hookers Creek to its headwaters. South Mayo River from its confluence with the North Fork South Mayo River to route 640. Smith River from Philpott dam 5 miles downstream to Koehler (at about route 667). Dan River from Coleman's Mill Pond upstream to route 750 (about 4 miles). Dan River from route 773 upstream to the Pinnacles of Dan (approximately 6 miles). <u>Natural:</u> Dan River from route 758 to its headwaters. Smith River from route 613 to its headwaters. South Mayo River from route 640 to its headwaters. Dan River from the Schoolfield Dam upstream to the Virginia-North Carolina state line. Cascade Creek and its tributaries. Smith River from the Virginia-North Carolina state line to, but not including, Goat Creek. Smith River from DuPont's raw water intake to 5 miles upstream from Fieldale's raw water intake. Philpot Reservoir, Fairystone Lake and their tributaries. North Mayo River and South Mayo River and their tributaries from the Virginia-North Carolina state line to a point 5 miles upstream.	V A VI A IV A IV A IV A IV A IV B IV A	Public Water Supply Public Water Supply Public Water Supply Public Water Supply Public Water Supply^b Public Water Supply
3a			
3b			
3c			
3d			
3e			
3f			

ROANOKE RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
4	Intrastate tributaries to the Dan River from the Virginia-North Carolina state line just east of the Pittsylvania-Halifax county line to their headwaters, unless otherwise designated. <u>Trout Waters in Section 4:</u> <u>Put and Take:</u> Runnett Bag Creek from route 792 downstream to route 40 at Endicott. Round Meadow Creek from its confluence with the Dan River upstream to Route 634 (approximately 3 miles). Rock Castle Creek from its confluence with the Smith River upstream to route 40. Ivy Creek from Coleman's Mill Pond upstream to route 58 (approximately 2.5 miles). Poorhouse Creek from its confluence with North Fork South Mayo River upstream to route 817. North Fork South Mayo River from its confluence with the South Mayo River upstream to route 640 (approximately 3.25 miles). <u>Natural:</u> Rock Castle Creek from route 40 to its headwaters. Poorhouse Creek from route 817 to its headwaters. North Fork South Mayo River from route 640 to its headwaters. Mayberry Creek from its confluence with Round Meadow Creek upstream to its headwaters. Maple Swamp Branch from its confluence with Round Meadow Creek upstream to its headwaters. Round Meadow Creek from route 634 upstream to its headwaters.	III A V A VI A	

ROANOKE RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
4a	Tuggle Creek from its confluence with the Dan River upstream to its headwaters.	III B	
4b	Cherry Creek from its confluence with Ivy Creek upstream to its headwaters.	III A	
5	Fall Creek from its confluence with the Dan River upstream to its headwaters. Intrastate tributaries of the Dan River from Brantley Stream station to just below Schoolfield Dam.	IV B	Public Water Supply
5a	Intrastate tributaries to the Dan River from DuPont's raw water intake to a point 5 miles upstream from Fieldale's raw water intake.	III B	Public Water Supply pH shall be 6.5-9.0
5b	Roanoke River from the headwaters of the John Kerr Reservoir to Leesville Dam and including Leesville Reservoir and Smith Mountain Lake.	III A	Public Water Supply pH shall be 6.5-9.0
5c	Tributaries to the Roanoke River from the headwaters of the John Kerr Reservoir to Leesville Dam, unless otherwise designated.	III A	Public Water Supply pH shall be 6.5-9.0
5d	Spring Creek from Keysville's raw water intake upstream to its headwaters.	III A	Public Water Supply pH shall be 6.5-9.0
5e	Falling River and its tributaries from Brookneal's raw water intake to a point 5 miles upstream and Phelps Creek to its headwaters.	III A	Public Water Supply pH shall be 6.5-9.0
5f	Falling River from 5 miles above Brookneal's raw water intake to its headwaters.	III A	Public Water Supply pH shall be 6.5-9.0
5g	Reed Creek from Altavista's raw water intake upstream to its headwaters.	III A	Public Water Supply pH shall be 6.5-9.0
	Big Otter River and its tributaries from Bedford's raw water intake to a point 5 miles upstream, and Stony Creek and Little Stony Creek upstream to their headwaters.	III A	Public Water Supply pH shall be 6.5-9.0
	Big Otter River and its tributaries from 5 miles upstream from Bedford's raw water intake upstream to their headwaters.	III A	Public Water Supply pH shall be 6.5-9.0

ROANOKE RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
6	Roanoke River from the headwaters of Smith Mountain Lake upstream to Salem's #1 raw water intake. <u>Trout Waters in Section 6:</u> Put and Take: Roanoke River from its junction with routes 11 and 419 to Salem's #1 raw water intake.	IV B	pH shall be 6.5-9.0
6a	Tributaries of the Roanoke River from Leesville Dam to Niagara Reservoir, unless otherwise designated. <u>Trout Waters in Section 6a:</u> Put and Take: Maggodee Creek from Boone's Mill upstream to Route 862 (approximately 3.8 miles). Green Creek from its confluence with the Blackwater River upstream to its headwaters. Pigg River from Rocky Mount's raw water intake to a point 5 miles upstream. Falling Creek Reservoir and Beaver Dam Reservoir.	V B III A V A	pH shall be 6.5-9.0 pH shall be 6.5-9.0 pH shall be 6.5-9.0
6b	Tributaries of the Roanoke River from Niagara Reservoir to Salem's #1 raw water intake	III A	Public Water Supply pH shall be 6.5-9.0
6c	<u>Trout Waters in Section 6d:</u> Put and Take: Glade Creek from its junction with route 633 to the Bedford county line.	III A	Public Water Supply pH shall be 6.5-9.0
6d	Tinker Creek from its confluence with Route 115 north to routes 11 and 220 (1.5 miles).	IV B	pH shall be 6.5-9.0
6e	Carvin Cove Reservoir and its tributaries to a point 5 miles upstream.	V B	pH shall be 6.5-9.0
7	Roanoke River and its tributaries, unless otherwise designated, from Salem's #1 raw water intake to their headwaters.	IV A	Public Water Supply pH shall be 6.5-9.0
7a	Roanoke River and its tributaries from Salem's #1 raw water intake to a point 5 miles upstream from Salem's #2 raw water intake.	IV A	pH shall be 6.5-9.0 Public Water Supply pH shall be 6.5-9.0

ROANOKE RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
	<u>Trout Waters in Section 7a:</u> <u>Put and Take:</u> Roanoke River from Salem's #1 raw water intake to the Montgomery county line. <u>Natural:</u> South Fork Roanoke River from its confluence with North Fork Roanoke River to its headwaters. Bottom Creek from its confluence with South Fork Roanoke River to its headwaters.	V A VI A	Public Water Supply pH shall be 6.5-9.0 Public Water Supply pH shall be 6.5-9.0

Water Quality Standards Summary


Section 6F


Chowan River Basin



Chowan River Basin

DWG 6F

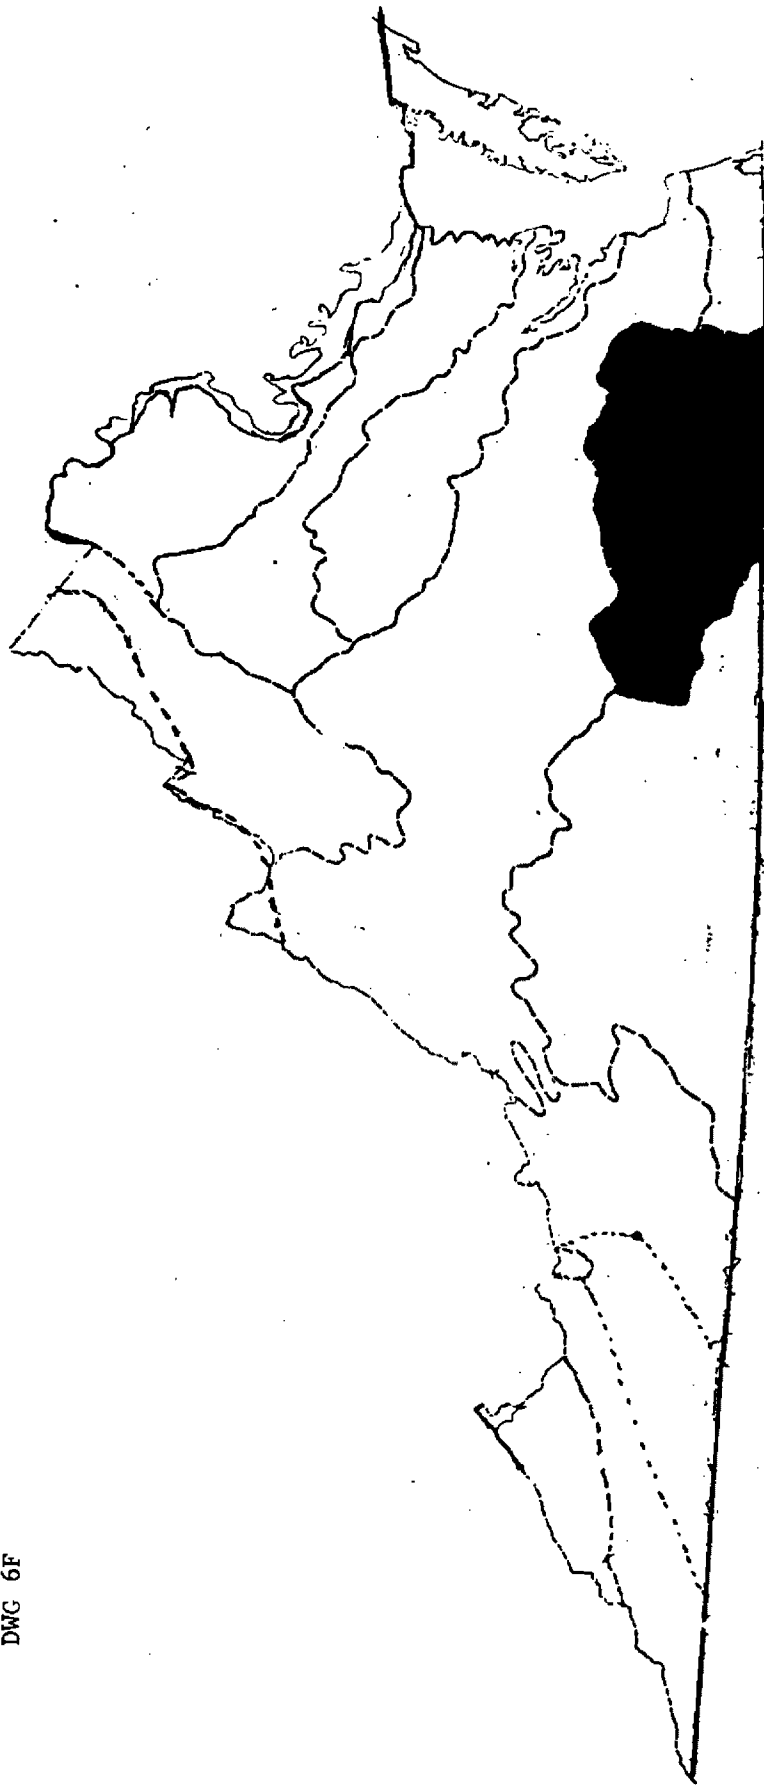


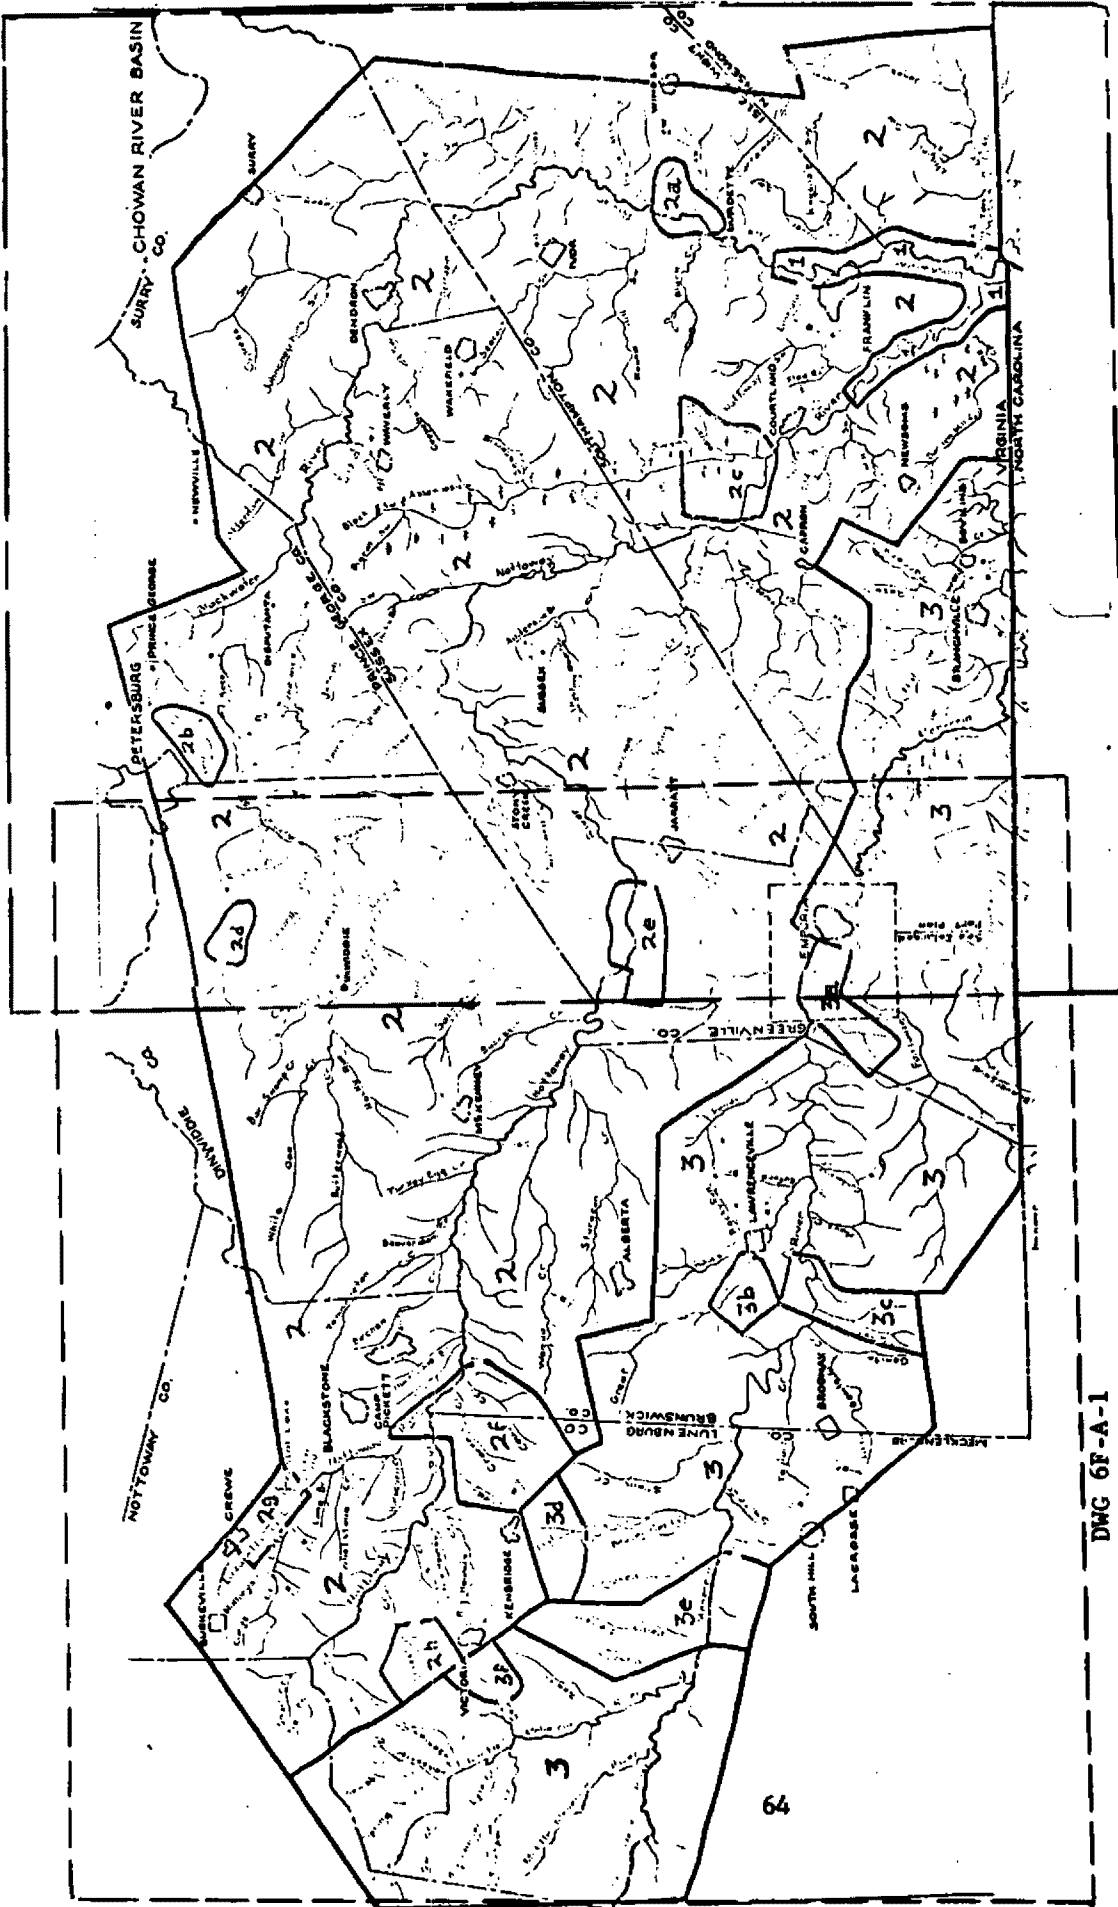

DWG 6F-A-1

DWG 6F-A

DWG 6F-A-2

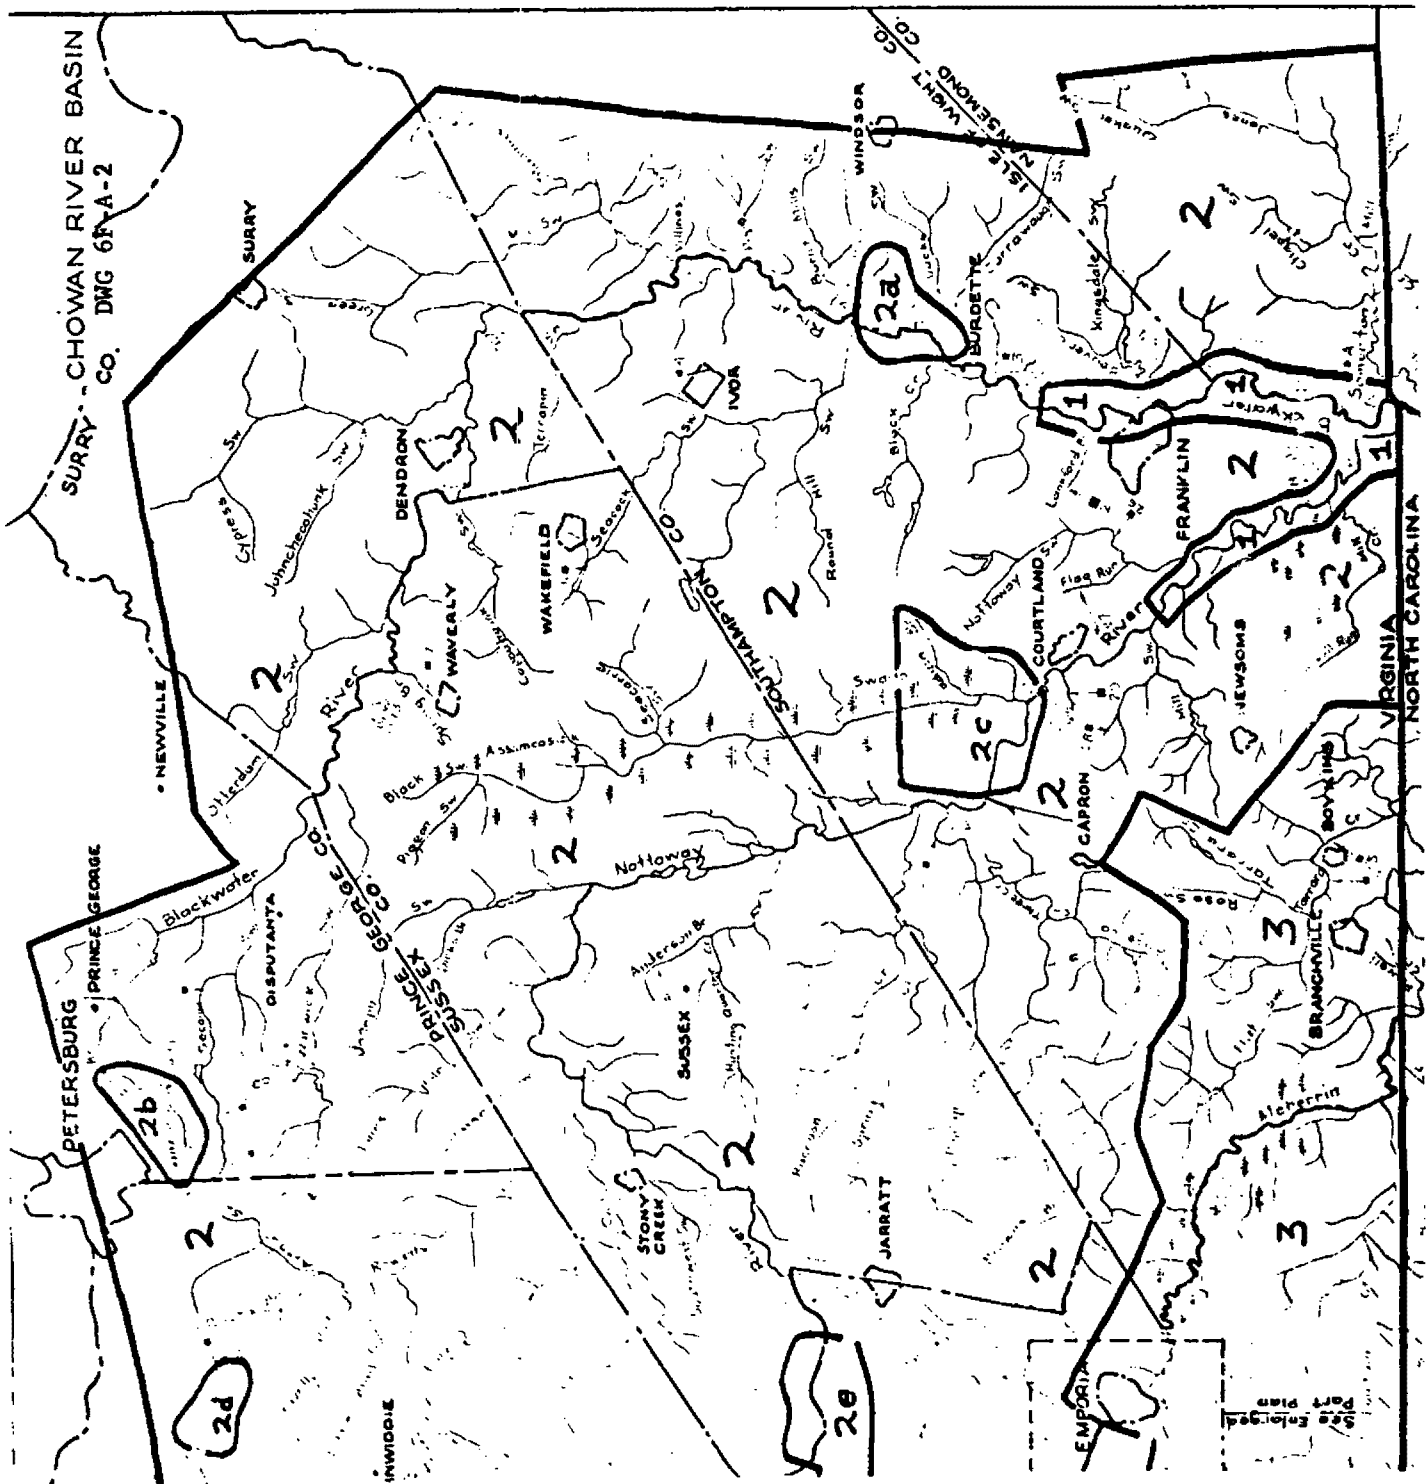

CHOWAN RIVER BASIN

Section	Section Description	Class	Special Standards
1	The Blackwater River and its tidal tributaries from the Virginia-North Carolina state line to the end of tidal waters at approximately state route 611 at river mile BLW - 20.97; Nottoway River and its tidal tributaries from the Virginia-North Carolina state line to the end of tidal waters at approximately state route 674.	II A	
2	The Blackwater and Nottoway Rivers from the end of tidal waters to their headwaters and their free-flowing tributaries in Virginia, unless otherwise designated.	III A	
2a	Blackwater River and its tributaries from Norfolk's auxiliary raw water intake near Burdette, Virginia, to a point 5 miles above the raw water intake, to include Corrowaugh Swamp to a point 5 miles above the raw water intake.	III A	Public Water Supply
2b	Hanzlins Pond Branch from a point one mile below route 460 to its headwaters.	III B	
2c	Nottoway River and its tributaries from Norfolk's auxiliary raw water intake near Courtland, Virginia, to a point 5 miles upstream.	III A	Public Water Supply
2d	Hatcher Run from the impoundment dam on Lake Jordan to state route 631.	III B	
2e	Nottoway River from Johns Manville's raw water intake near Jarratt, Virginia, to a point 5 miles above the intake.	III A	Public Water Supply
2f	Nottoway River and its tributaries from Camp Pickett's raw water intake to a point 5 miles above the raw water intake.	III A	Public Water Supply
2g	Lazaretto Creek and its tributaries from Crewe's raw water intake to a point 5 miles upstream.	III A	Public Water Supply
2h	Modest Creek and its tributaries from Victoria's raw water intake to their headwaters.	III A	Public Water Supply
3	The Meherrin River and its tributaries in Virginia from the Virginia-North Carolina state line to its headwaters.	III A	
3a	Meherrin River and its tributaries from Emporia's water supply dam to a point 5 miles upstream.	III A	Public Water Supply


CHOWAN RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
3b	Great Creek from Lawrenceville's raw water intake to a point 5 miles upstream.	III A	Public Water Supply
3c	Meherrin River from Lawrenceville's raw water intake to a point 5 miles upstream.	III A	Public Water Supply
3d	Flat Rock Creek from Kenbridge's raw water intake upstream to its headwaters.	III A	Public Water Supply
3e	Meherrin River and its tributaries from South Hill's raw water intake to a point 5 miles upstream.	III A	Public Water Supply
3f	Couches Creek from a point 1.6 miles downstream from the Industrial Development Authority discharge to its headwaters.	III A	f

Water Quality Standards Summary


Section 6G


Shenandoah River Basin



Shenandoah River Basin
DWG 6G



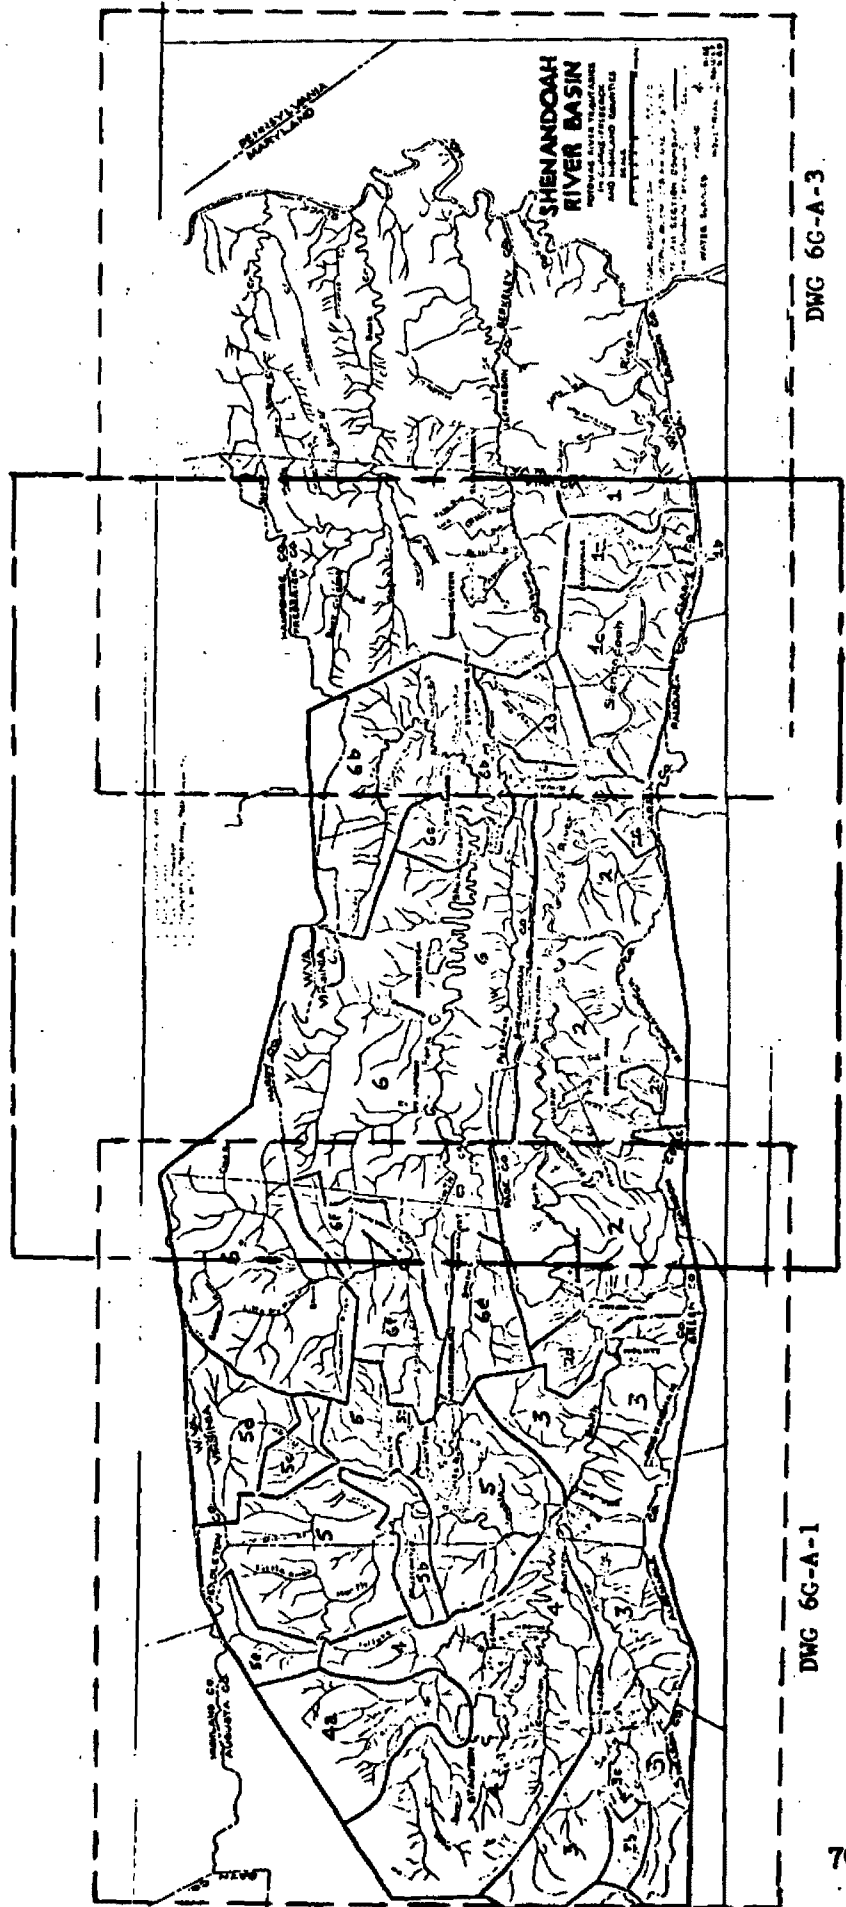

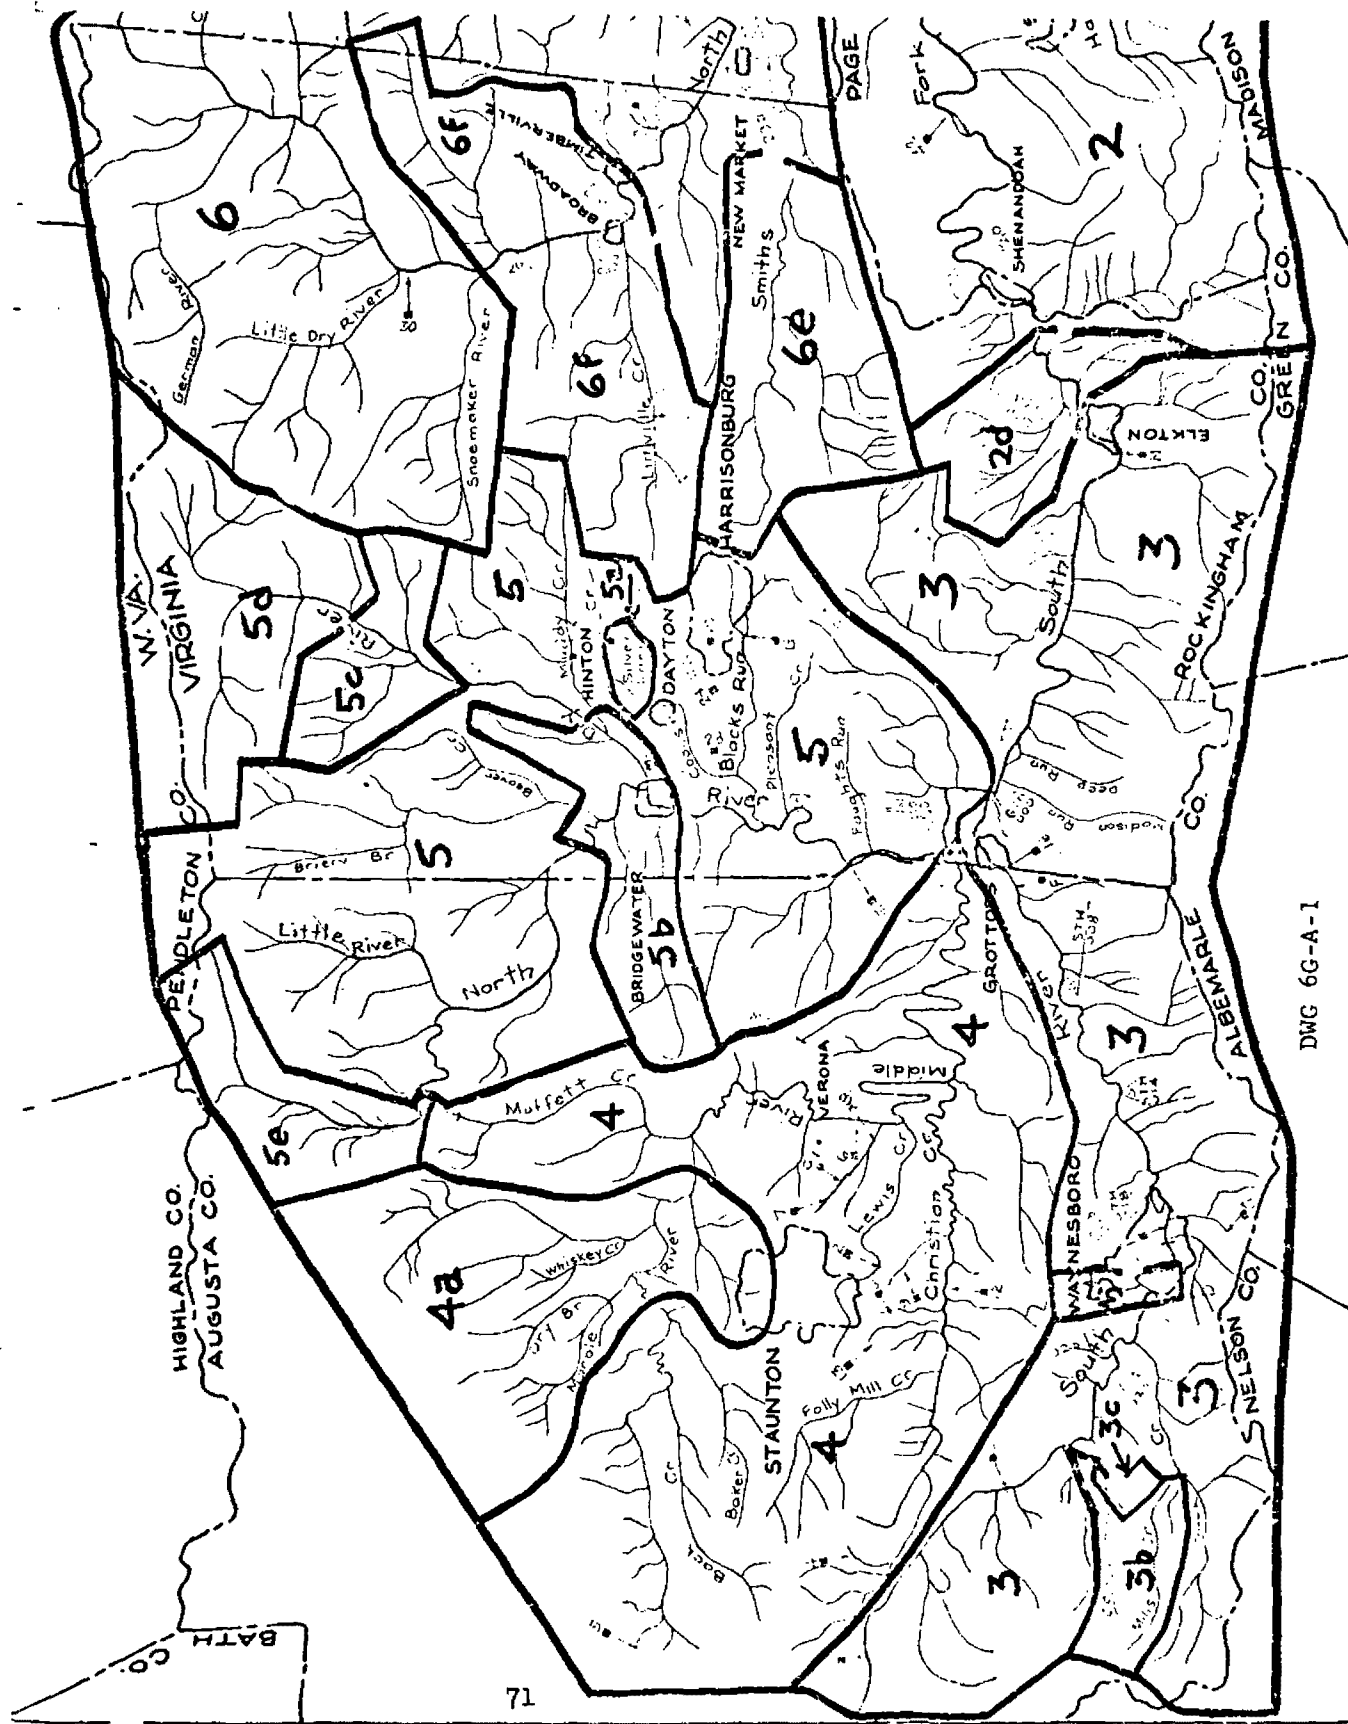


SHENANDOAH RIVER BASIN


DWG 6G-A-1

SHENANDOAH RIVER BASIN

DWG 6G-A-2

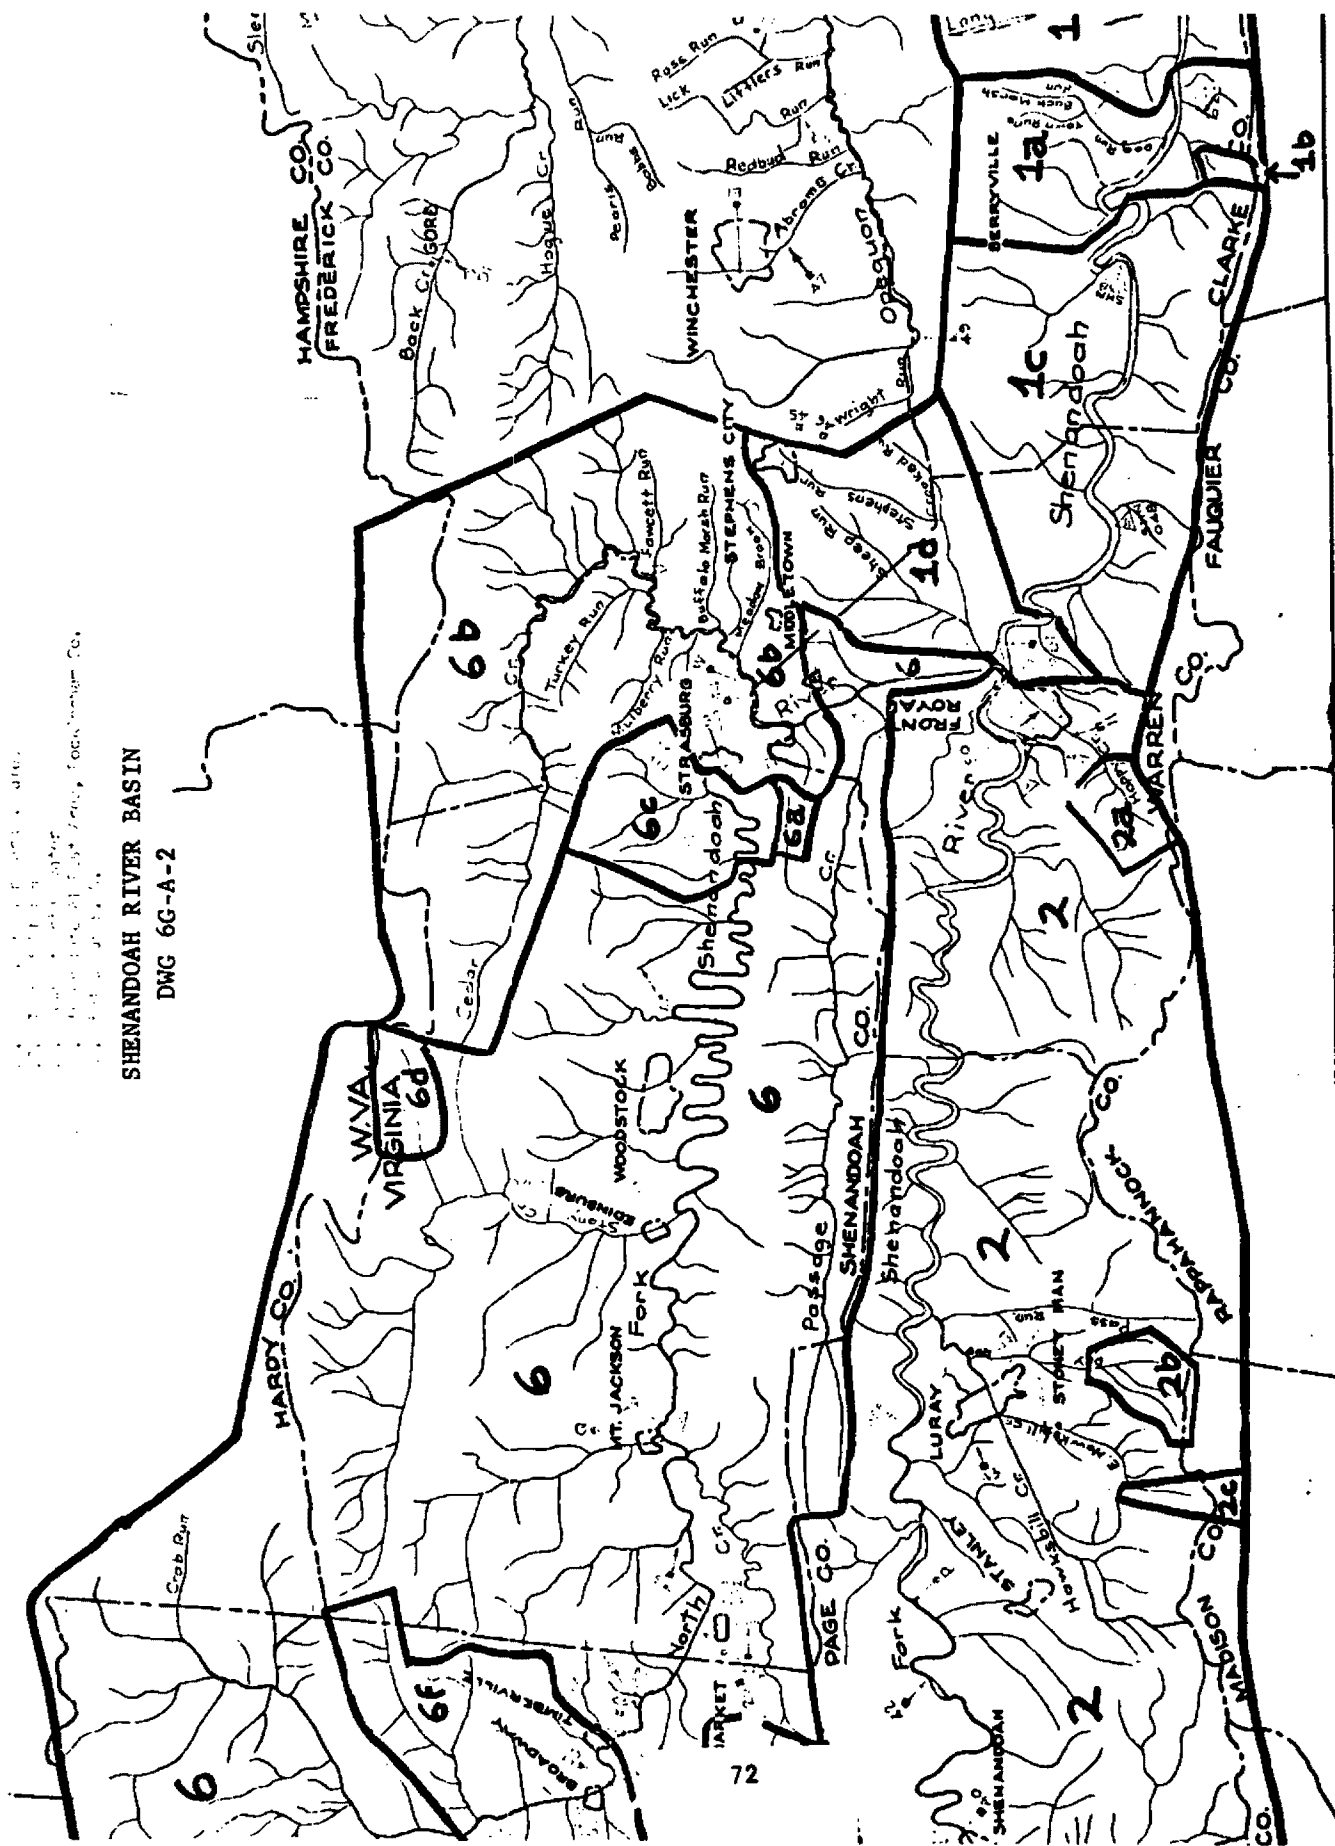

DWG-6G-A-2

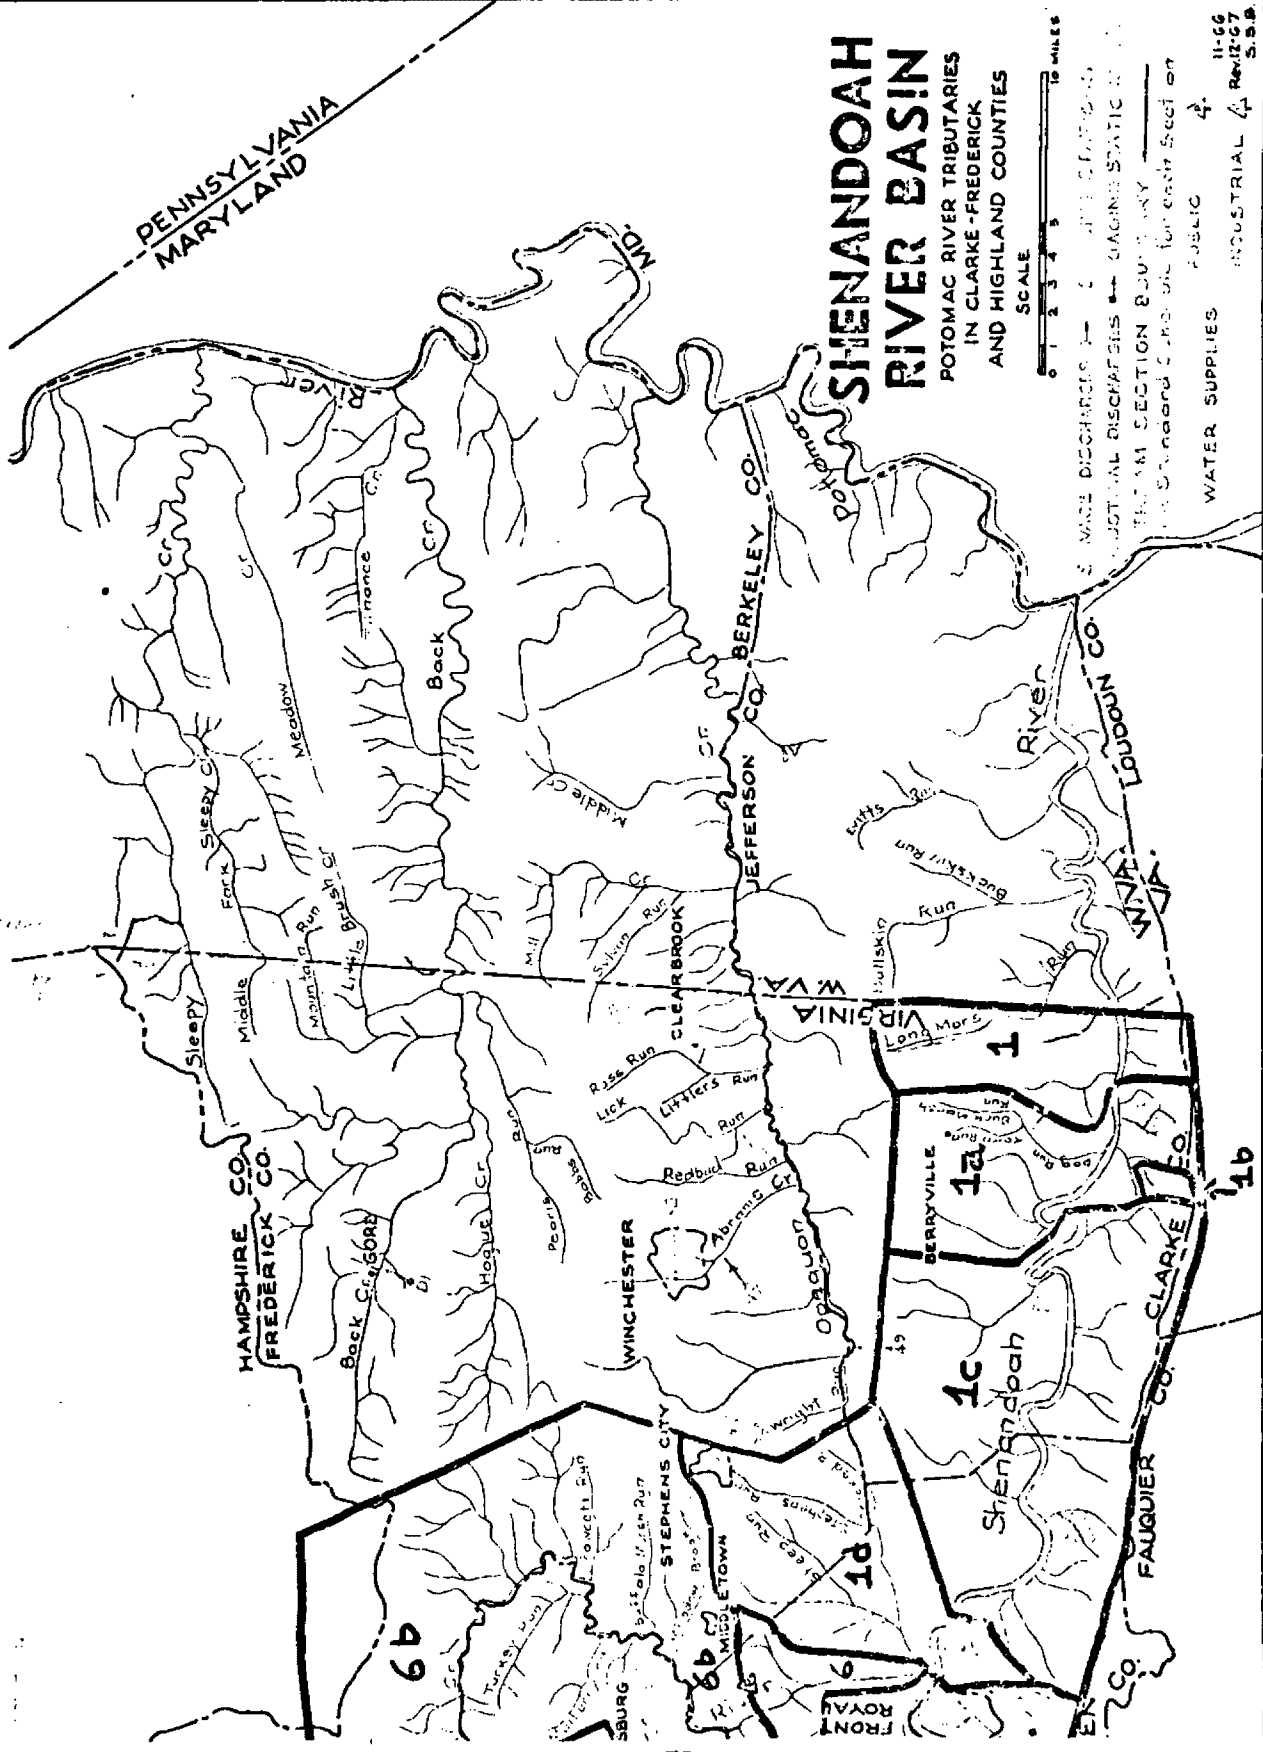

Section	Section Description	Class	Special Standards
1	Shenandoah River and its tributaries in Clarke County, Virginia, from the Virginia-West Virginia state line to route 7 bridge.	IV B	pH shall be 6.5-9.5
1a	Shenandoah River and its tributaries from route 7 bridge to a point 7 miles upstream--U. S. Army Corps of Engineers.	IV A	Public Water Supply pH shall be 6.5-9.5
1b	Unnamed tributary to the Shenandoah River (east side) which serves as Berryville's water supply, from the raw water intake upstream to its headwaters.	IV A	Public Water Supply pH shall be 6.5-9.5
1c	Shenandoah River and its tributaries from 7 miles above route 7 bridge to Northern Virginia Power Company Dam.	IV A	pH shall be 6.5-9.5
1d	Shenandoah River and its tributaries from the Northern Virginia Power Company Dam to the confluence of the North and South Forks of the Shenandoah.	IV B	m, b, Public Water Supply pH shall be 6.5-9.5
2	South Fork Shenandoah River and its tributaries from its confluence with the North Fork Shenandoah River, upstream to a point 5 miles above the Town of Shenandoah's raw water intake, unless otherwise designated.	IV B	pH shall be 6.5-9.5
	<u>Trout Waters in Section 2:</u> Put and Take: Gooney Run from mouth to route 632 above Browntown. Little Hawksbill Creek from route 628 to route 626. Hawksbill Creek from route 675 in Luray to 1 mile above route 631. Cub Run from Pitt Spring upstream 6.5 miles. Brown Run from its confluence with Big Run upstream 1 mile.	V B	pH shall be 6.5-9.5
	Natural: Jeremiah's Run from National Park boundary to its headwaters. Little Hawksbill Creek from route 626 to its headwaters. Cub Run from mouth to Pitt Spring Run. Pitt Spring Run from Cub Run to Pitt Spring. East Branch Naked Creek from route 759 to its headwaters.	VI B	pH shall be 6.5-9.5

SHENANDOAH RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
2a	Fultz Run from the Park boundary to its headwaters. Pass Run from route 611 to its headwaters.	IV A	Public Water Supply pH shall be 6.5-9.5
2b	Happy Creek from Front Royal's raw water intake to its headwaters.	IV A	Public Water Supply pH shall be 6.5-9.5
2c	Dry Run and its tributaries from Luray's raw water intake to its headwaters.	IV A	Public Water Supply pH shall be 6.5-9.5
2d	East Hawksbill Creek and its tributaries from Ida's raw water intake to its headwaters.	IV B	Public Water Supply pH shall be 6.5-9.5
3	South Fork Shenandoah River from the Town of Shenandoah's raw water intake to a point 5 miles upstream. South Fork Shenandoah River and its tributaries from 5 miles above the Town of Shenandoah's raw water intake to its confluence with the North and South Rivers, and the South River and its tributaries from its confluence with the South Fork Shenandoah River to their headwaters, unless otherwise designated.	IV A	Public Water Supply pH shall be 6.5-9.5
	<u>Trout Waters in Section 3:</u> Natural: Johns Run from its confluence with the South River to its headwaters.	VI A	pH shall be 6.5-9.5
3a	South River from the dam above Waynesboro (all waters of the impoundment.)	IV B	b pH shall be 6.5-9.5
3b	Coles Run and Mills Creek from South River Sanitary District's raw water intake to their headwaters.	IV A	Public Water Supply pH shall be 6.5-9.5
	<u>Trout Waters in Section 3b:</u> Natural: Kennedy Run from its confluence with Coles Run to its headwaters.	VI A	pH shall be 6.5-9.5 Public Water Supply
3c	Stuarts Draft Water Company's (R. A. Blacka) raw water intake on a tributary of Coles Run, approximately $\frac{1}{2}$ mile south of Stuarts Draft and just off route 610, to its headwaters.	IV A	Public Water Supply pH shall be 6.5-9.5
4	Middle River and its tributaries from the confluence with the North River upstream to its headwaters, unless otherwise designated.	IV A	pH shall be 6.5-9.5

SHENANDOAH RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
4a	Middle River and its tributaries from Staunton's raw water intake at Gardner Spring to a point 5 miles upstream	IV A	Public Water Supply pH shall be 6.5 - 9.5
5	North River from its confluence with the South River upstream to its headwaters, unless otherwise designated.	IV A	Public Water Supply pH shall be 6.5 - 9.5
	<u>Trout Waters in Section 5:</u>		
	<u>Put and Take:</u>		
	Briery Branch from Routes 257 and 613 to headwaters--6 miles.	V A	pH shall be 6.5 - 9.5
	Dry River from its junction with Routes 42 and 259 to Rawley Springs.		
	<u>Natural:</u>		
	Little River from confluence with Route 718 to its headwaters.	VI A	pH shall be 6.5-9.5
	Skidmore Fork from Route 718 to its headwaters.		
	Black Run from its confluence with Dry River to its headwaters.		
	Hone Quarry from its confluence with Briery Branch to its headwaters.		
5a	Silver Lake	IV A	b, Public Water Supply pH shall be 6.5 - 9.5
5b	North River and its tributaries from Harrisonburg's raw water intake at Bridgewater to a point 5 miles above Bridgewater's raw water intake to include Dry River and Muddy Creek to a point 5 miles above Bridgewater's raw water intake.	IV A	Public Water Supply pH shall be 6.5 - 9.5
5c	Dry River from Harrisonburg's raw water intake to a point 5 miles upstream and Rocky Run to its headwaters.	IV A	Public Water Supply pH shall be 6.5 - 9.5
	<u>Trout Waters in Section 5c:</u>		
	<u>Natural:</u>		
	Dry River from Harrisonburg's raw water intake to a point 5 miles upstream.	VI A	pH shall be 6.5 - 9.5
5d	Dry River from 5 miles above Harrisonburg's raw water intake to its headwaters.	IV A	pH shall be 6.5- 9.5
	<u>Trout Waters in Section 5d:</u>		
	<u>Natural:</u>		
	Dry River from 5 miles above Harrisonburg's raw water intake to its headwaters.	VI A	pH shall be 6.5 - 9.5

SHENANDOAH RIVER BASIN (cont.)


Section	Section Description	Class	Special Standard
5e	Big Laurel Run from its confluence with Dry River to its headwaters. Skidmore Fork from its confluence with Dry River to its headwaters. North River from Staunton Dam to its headwaters. <u>Trout Waters in Section 5e:</u> <u>Natural:</u> North River above City of Staunton's water drain North Fork Shenandoah River from its confluence with the Shenandoah River to its headwaters, unless otherwise designated. <u>Trout Waters in Section 6:</u> <u>Natural:</u> German River from its junction with route 820 to its headwaters - 9.5 miles. Shoemaker River from route 612 to its junction with route 818 - 7.9 miles. Little Passage Creek - mouth to Strasburg Reservoir Dam. Peters Mill Run from mouth to its headwaters. Laurel Run from mouth at Big Stony Creek to its headwaters. Little Stony Creek mouth to Woodstock's raw water intake. Slate Lick Run from its confluence with the Shoemaker River to its headwaters. Long Run from its confluence with the Shoemaker River to its headwaters. <u>Put and Take:</u> Passage Creek from U. S. Forest Service line 4 miles upstream to Pitt Spring. Mountain Run from mouth at Passage Creek to its headwaters.	IV A VI A IV A VI A V A	Public Water Supply pH shall be 6.5-9.5 pH shall be 6.5-9.5 pH shall be 6.5-9.5 pH shall be 6.5-9.5 pH shall be 6.5-9.5

SHENANDOAH RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
6a	Big Stony Creek from route 685 above Edinburg upstream to Bayse. Mill Creek from Mount Jackson to Route 720 - 3.5 miles. Little Passage Creek from the Strasburg Reservoir dam upstream to its headwaters. <u>Trout Waters in Section 6a:</u> <u>Put and Take:</u> Little Passage Creek from Strasburg Reservoir Dam to headwaters. North Fork Shenandoah River and its tributaries from the Winchester raw water intake to a point 5 miles upstream (to include Cedar Creek and its tributaries to their headwaters.) <u>Trout Waters in Section 6b:</u> <u>Put and Take:</u> Cedar Creek from route 55 to U. S. Forest Service Boundary - 7.0 miles. Natural: Paddy Run from mouth to headwaters. Cedar Creek from Forest Service Boundary to headwaters. North Fork Shenandoah River and its tributaries from Strasburg's raw water intake to its confluence with Deep Hollow Run. Little Stony Creek and its tributaries from Woodstock's raw water intake to its headwaters. <u>Trout Waters in Section 6d:</u> <u>Natural:</u> Little Stony Creek from Woodstock's raw water intake to headwaters. Smith Creek from New Market's raw water intake to its headwaters.	IV A V A IV A V A VI A IV A IV A VI A IV A	Public Water Supply pH shall be 6.5-9.5 Public Water Supply pH shall be 6.5-9.5 Public Water Supply pH shall be 6.5-9.5 Public Water Supply pH shall be 6.5-9.5 Public Water Supply pH shall be 6.5-9.5 Public Water Supply pH shall be 6.5-9.5 Public Water Supply pH shall be 6.5-9.5 Public Water Supply pH shall be 6.5-9.5 Public Water Supply pH shall be 6.5-9.5

SHENANDOAH RIVER BASIN (cont.)


Section	Section Description	Class	Special Standards
6f	North Fork Shenandoah River and its tributaries from the Timberville Food Process Dam to the confluence with the Shoemaker River.	IV A	Public Water Supply pH shall be 6.5-9.5




Water Quality Standards Summary


Section 6H

Rappahannock River Basin




Rappahannock River Basin
DWG 6H

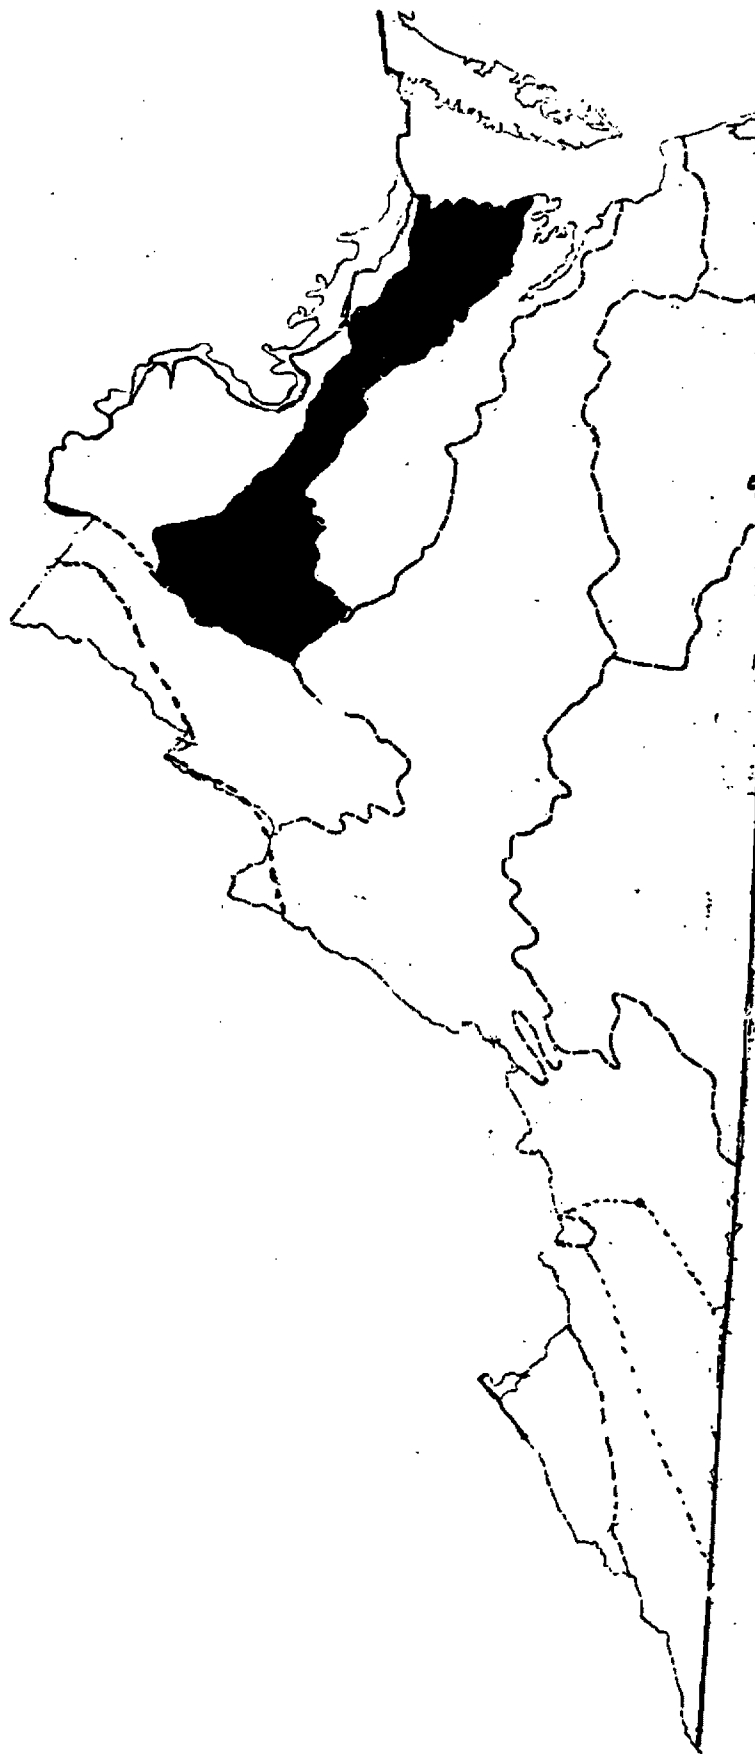


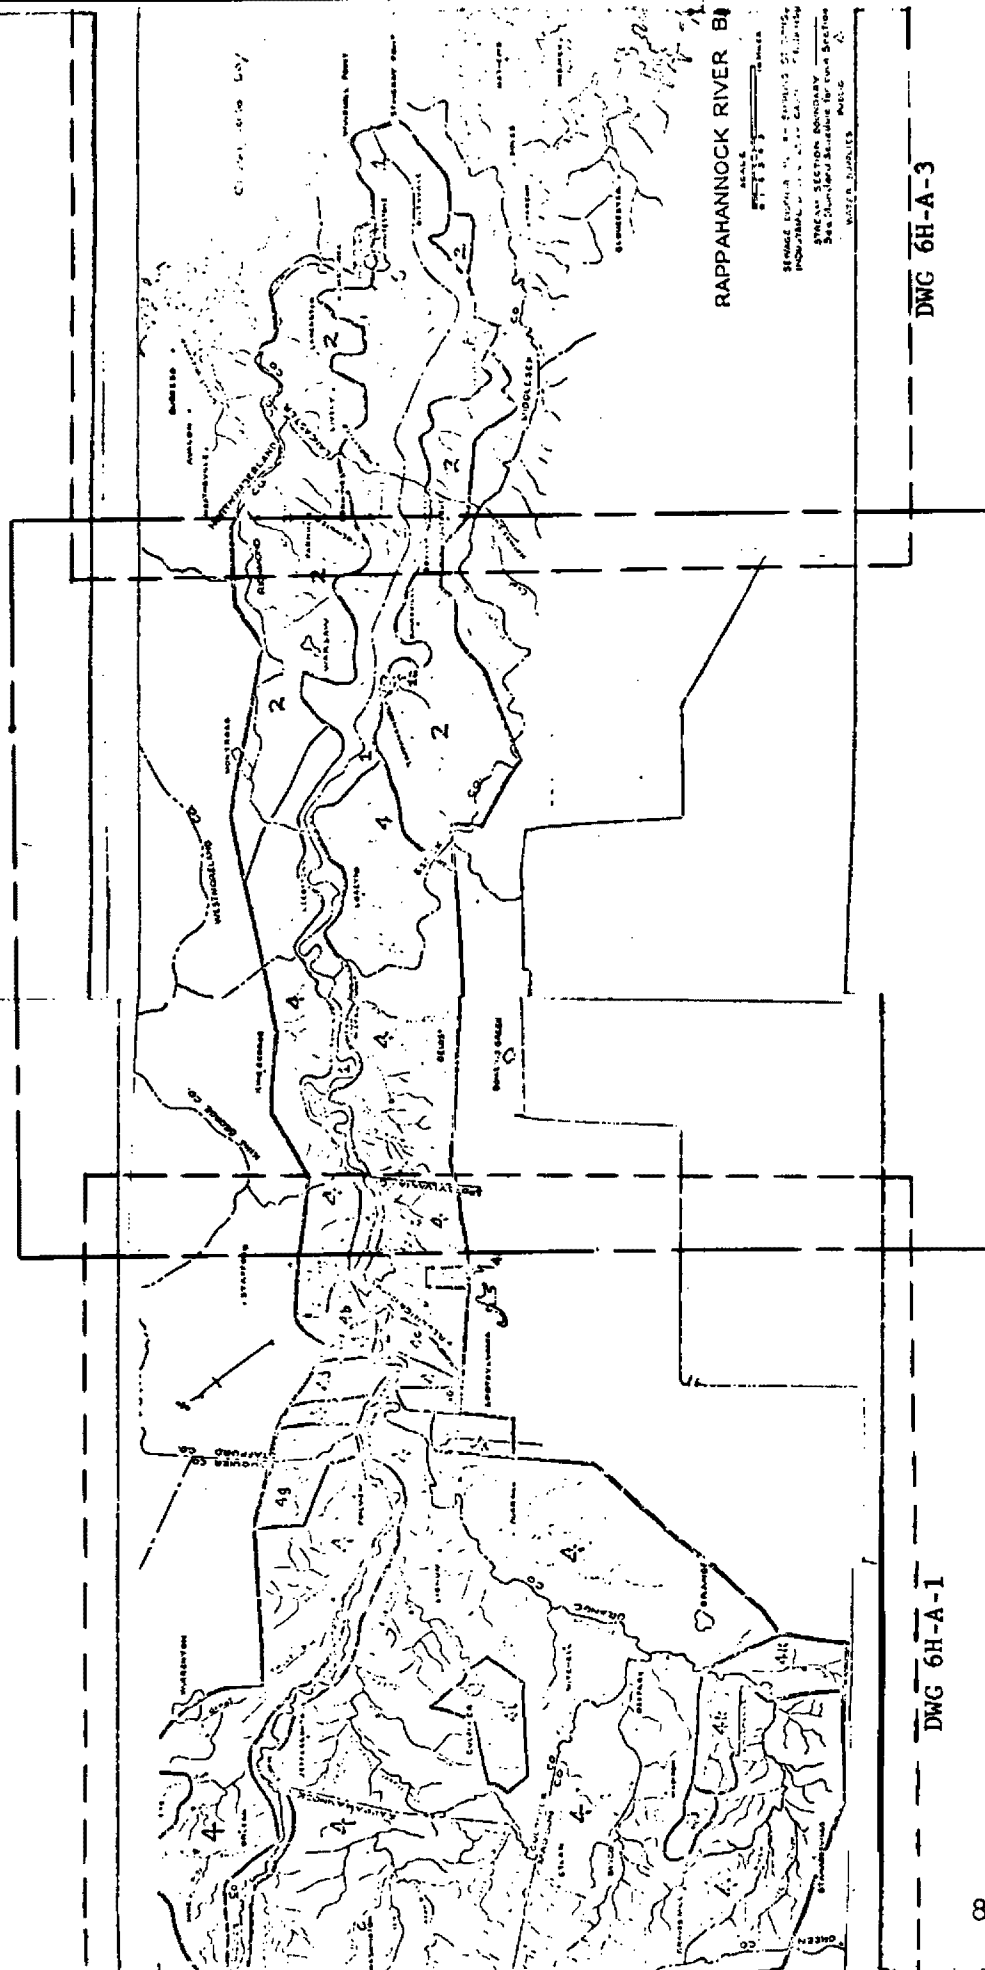

DWG 6H-A

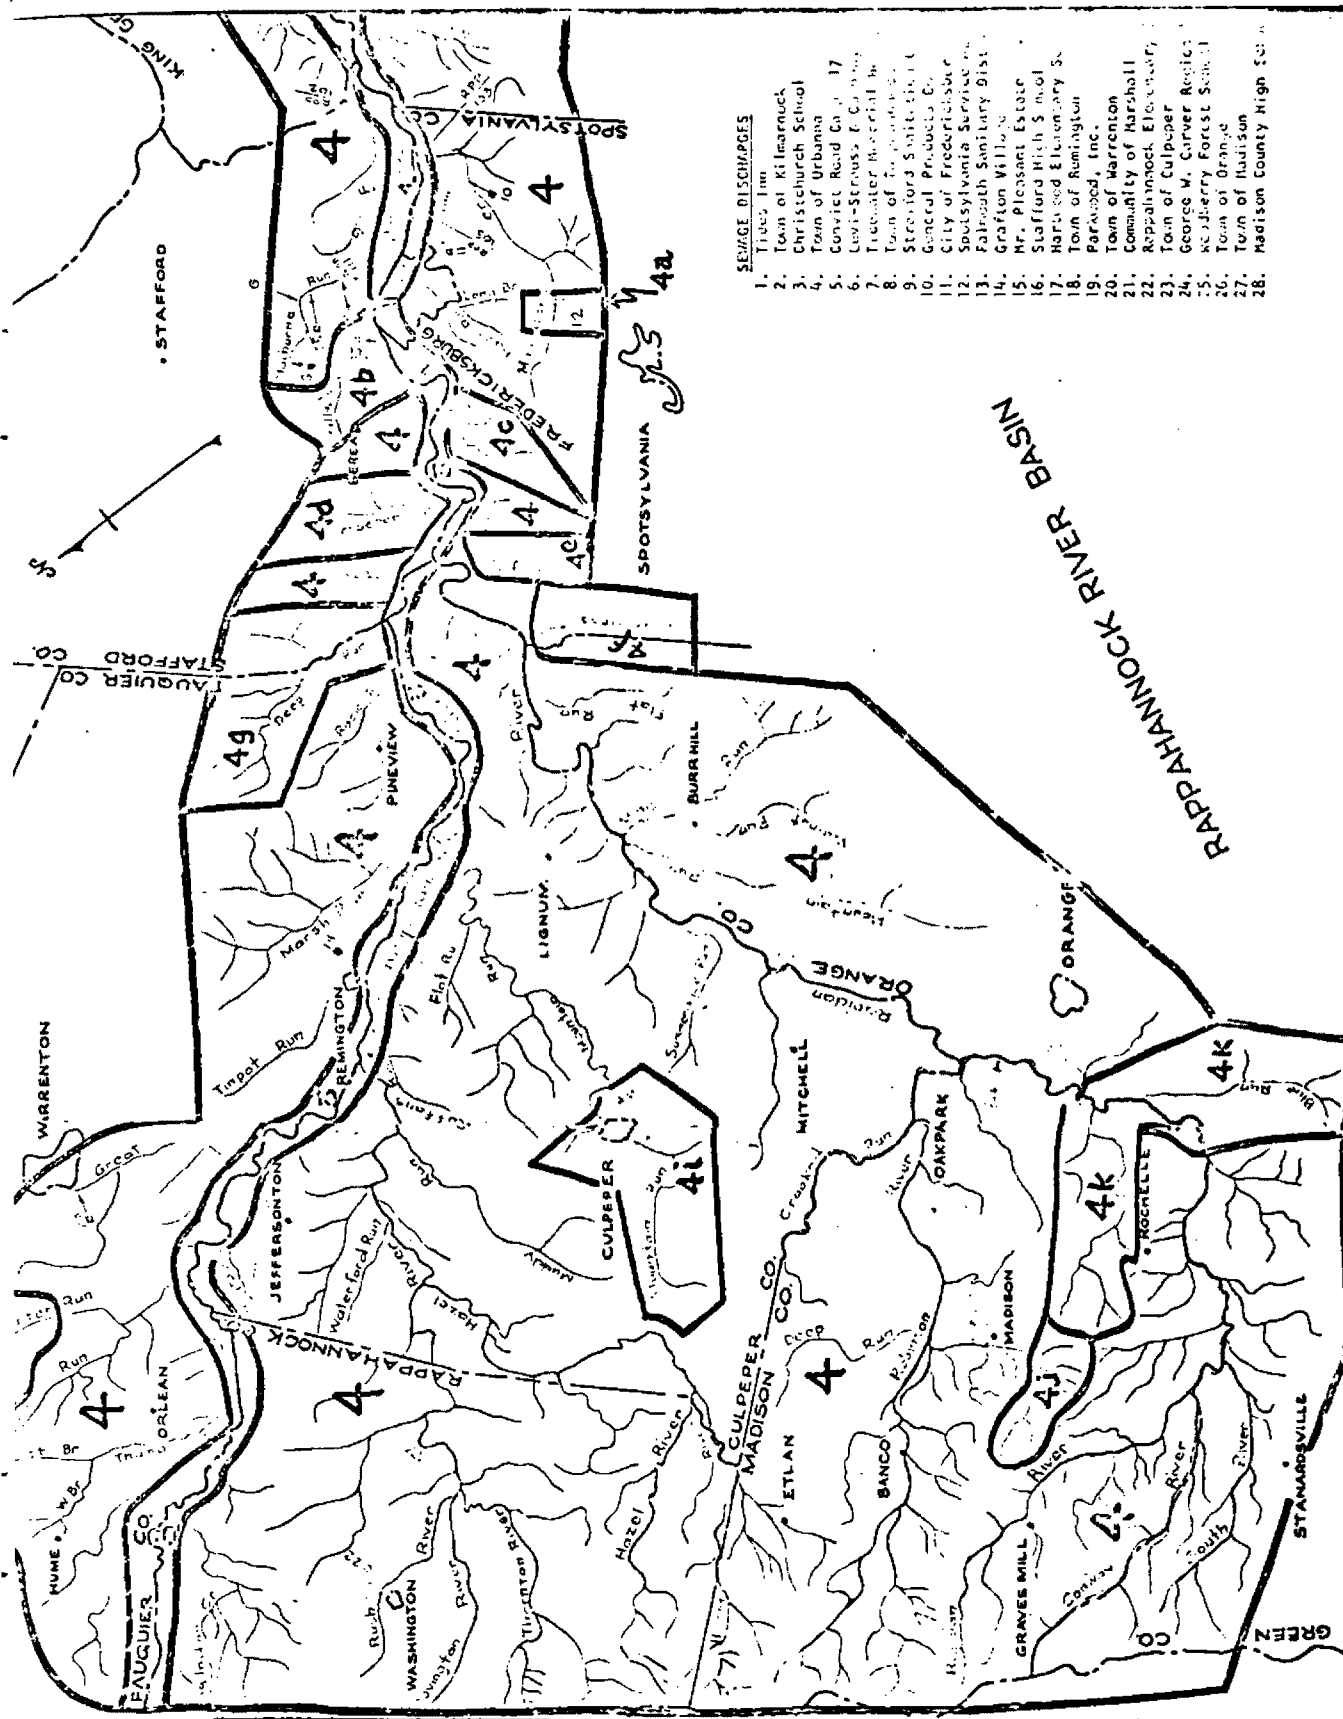


DWG-6H-A-1

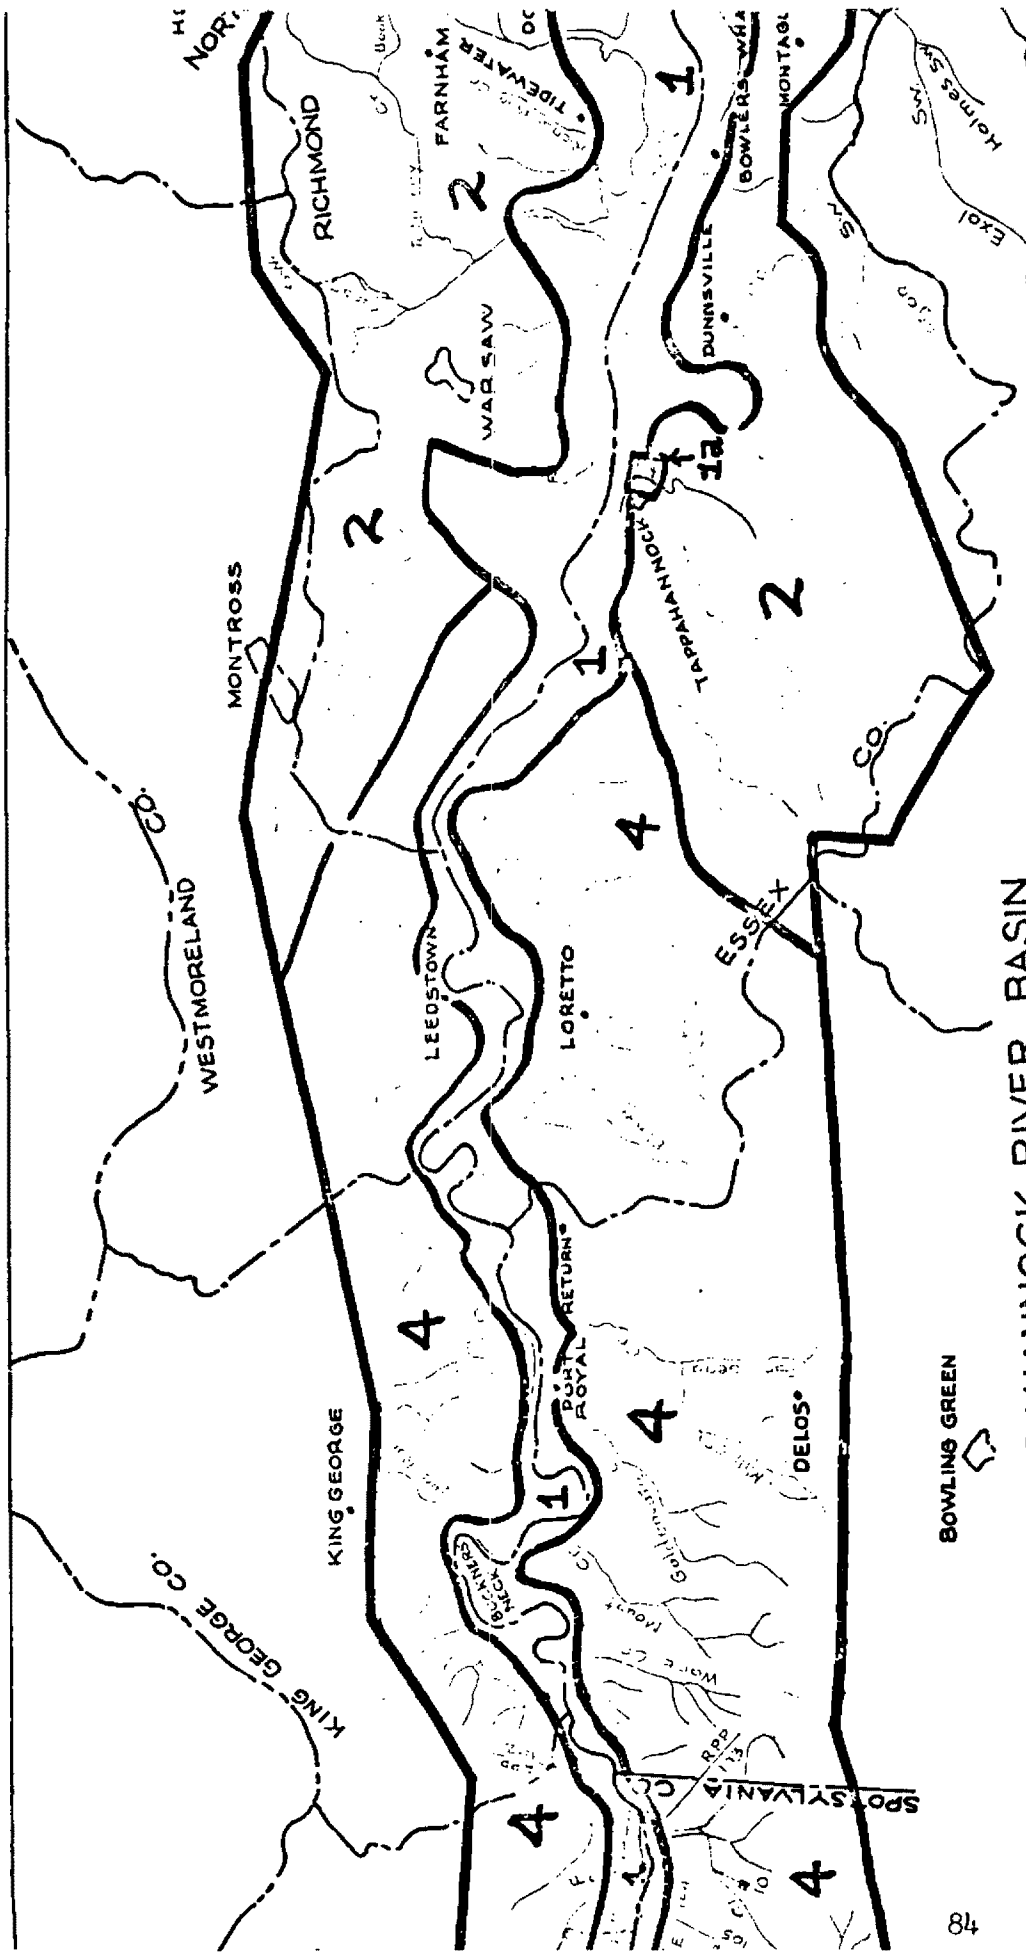


RAPPANNOCK RIVER BASIN

DWG 6H-A-2

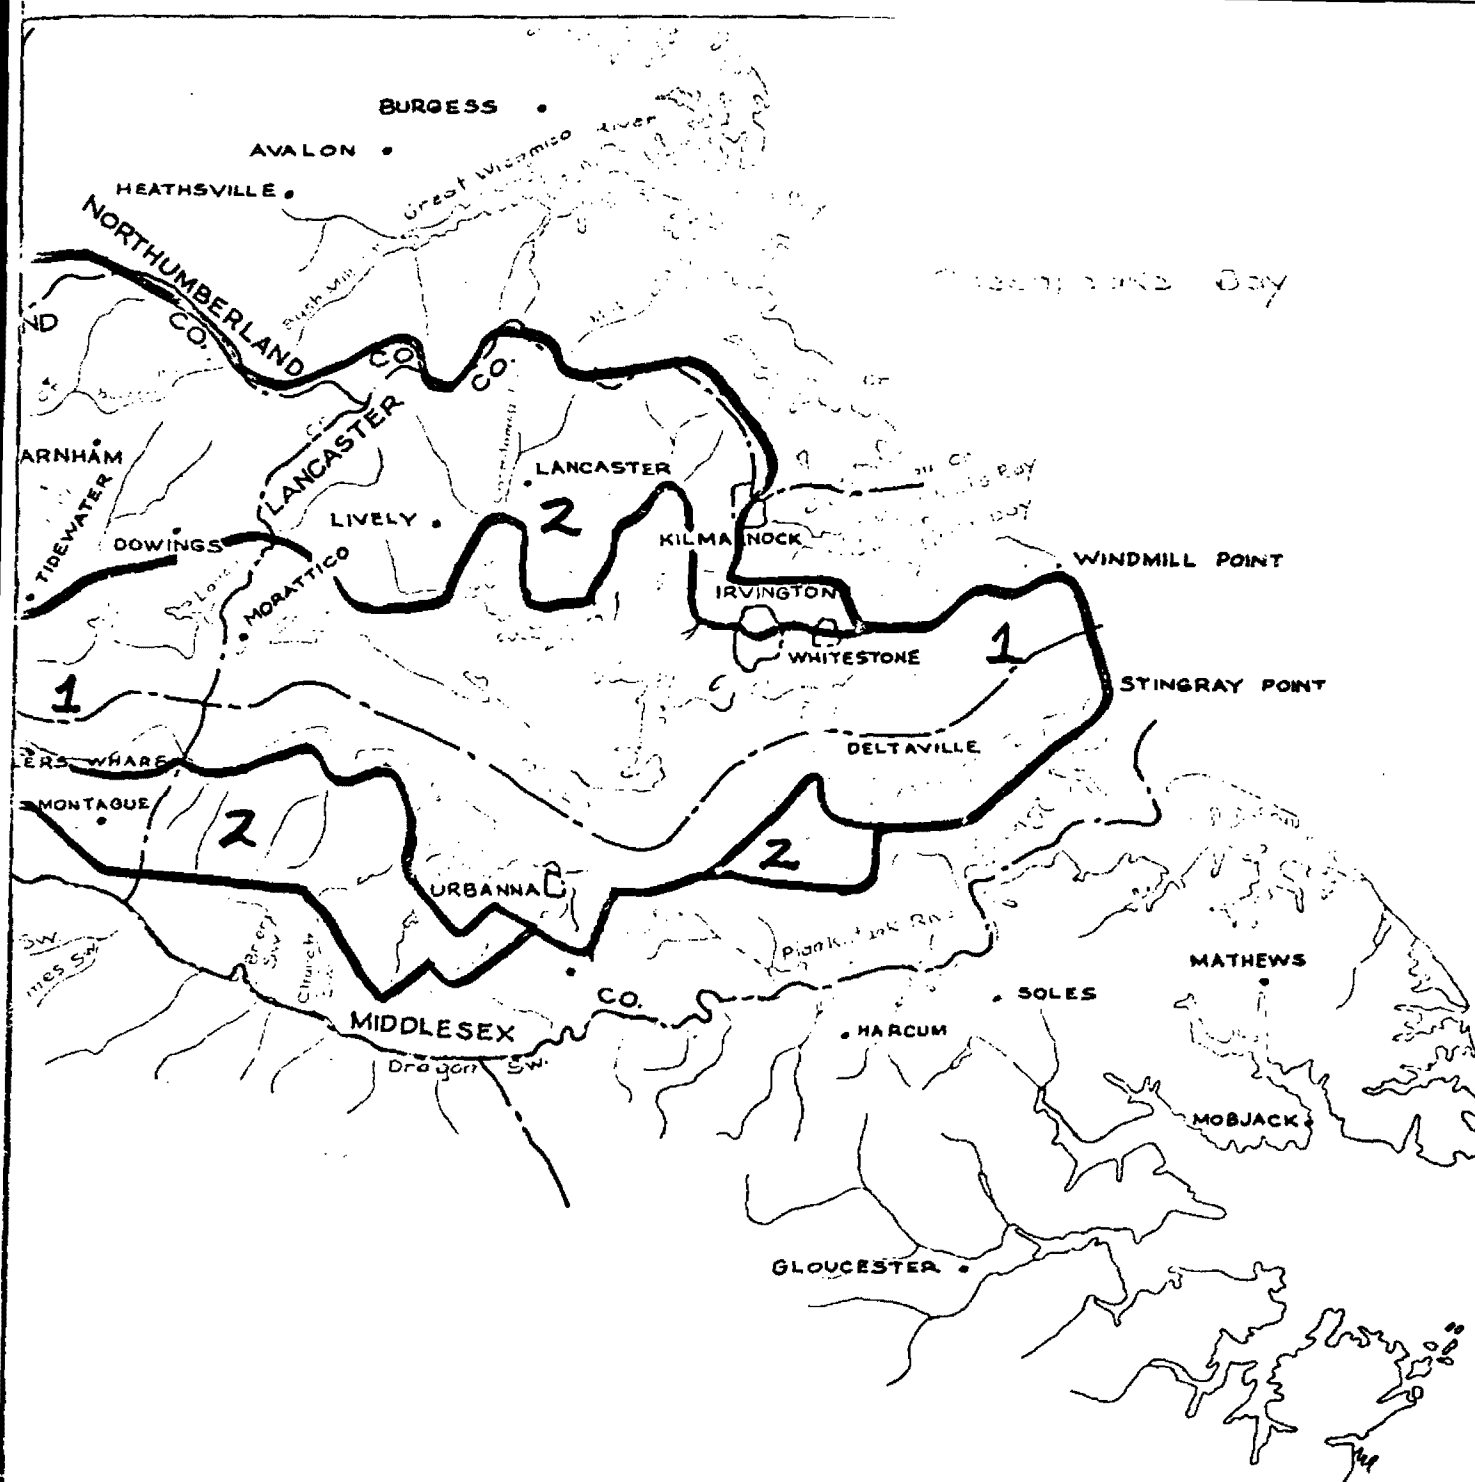

RAPPAHANNOCK RIVER BASIN



DWG 6H-A-3

SEWAGE DISCHARGES — SAMPLING STATIONS
INDUSTRIAL DISCHARGES — GAGING STATIONS

85

STREAM SECTION BOUNDARY —
See Standard Schedule for each Section

PUBLIC

5.1

RAPPAHANNOCK RIVER BASIN

Section	Section Description	Class	Special Standards
1	Rappahannock River and the tidal portions of its tributaries from Stingray and Windmill Points to Route 1 Alternate Bridge at Fredericksburg.	II B	a
1a	Hoskins Creek from the confluence with the Rappahannock River to its tidal headwaters.	II A	
2	Free flowing tributaries of the Rappahannock from Stingray and Windmill Points upstream to Blandfield Point, unless otherwise designated.	III B	
3	The Rappahannock River from the Route 1 Alternate Bridge at Fredericksburg upstream to its headwaters, unless otherwise designated.	III B	
4	Free flowing tributaries of the Rappahannock from Blandfield Point to the headwaters, unless otherwise designated.	III A	
	<u>Trout Waters in Section 4:</u> Put and Take: Robinson River from route 649 to its confluence with the Rose River.	V A	
	Natural: South River from its confluence with the Rapidan River to its headwaters. Devils Ditch from its confluence with the Conway River to its headwaters. Conway River from the Town of Fletcher to its headwaters. Pocosin Creek from its confluence with the Conway River to its headwaters. Rapidan River from Graves Mill (route 615) to its headwaters. Wilson Run from its confluence with the Staunton River to its headwaters. Brokenback Run from its confluence with the Hughes River to its headwaters.	VI A	

Section	Section Description	Class	Special Standards
	Rose River from its confluence with the Robinson River to its headwaters. Cedar Run from its confluence with the Robinson River to its headwaters. White Oak Canyon Run from its confluence with the Robinson River to its headwaters. Hughes River from route 231 to its headwaters. Hogcamp Branch from its confluence with the Rose River to its headwaters. North Fork Thornton River from its confluence with Thornton River to its headwaters. Piney Branch from its confluence with Thornton River to its headwaters. Staunton River from its confluence with Rapidan River to its headwaters. Rush River from route 628 to its headwaters. Robinson River from its confluence with the Rose River to its headwaters. Garth Run from its confluence with the Rapidan River to its headwaters.		
4a	Massaponax Creek from the impoundment dam to be constructed by Mrs. E. Smith to the headwaters of the impoundment.	III B	
4b	The Rappahannock River and its tributaries, to include the VEPCO Canal, from Fredericksburg's raw water intake to a point 5 miles upstream.	III B	Public Water Supply
4c	Motts Run and its tributaries.	III B	
4d	Horsepen Run and its tributaries.	III B	
4e	Hunting Run and its tributaries.	III B	
4f	Wilderness Run and its tributaries.	III B	
4g	Deep Run and its tributaries.	III B	
4h	Carters Run from State Route 738 to its headwaters.	III B	Public Water Supply
4i	Mountain Run from Culpeper's raw water intake to its headwaters.	III A	Public Water Supply


RAPPAHANNOCK RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
4j	White Oak Run from the Town of Madison's raw water intake to a point 5 miles upstream.	III A	Public Water Supply
4k	Rapidan River from Orange's raw water intake upstream 5 miles.	III A	Public Water Supply


Water Quality Standards Summary


Section 6I

York River Basin




York River Basin
DWG 6I

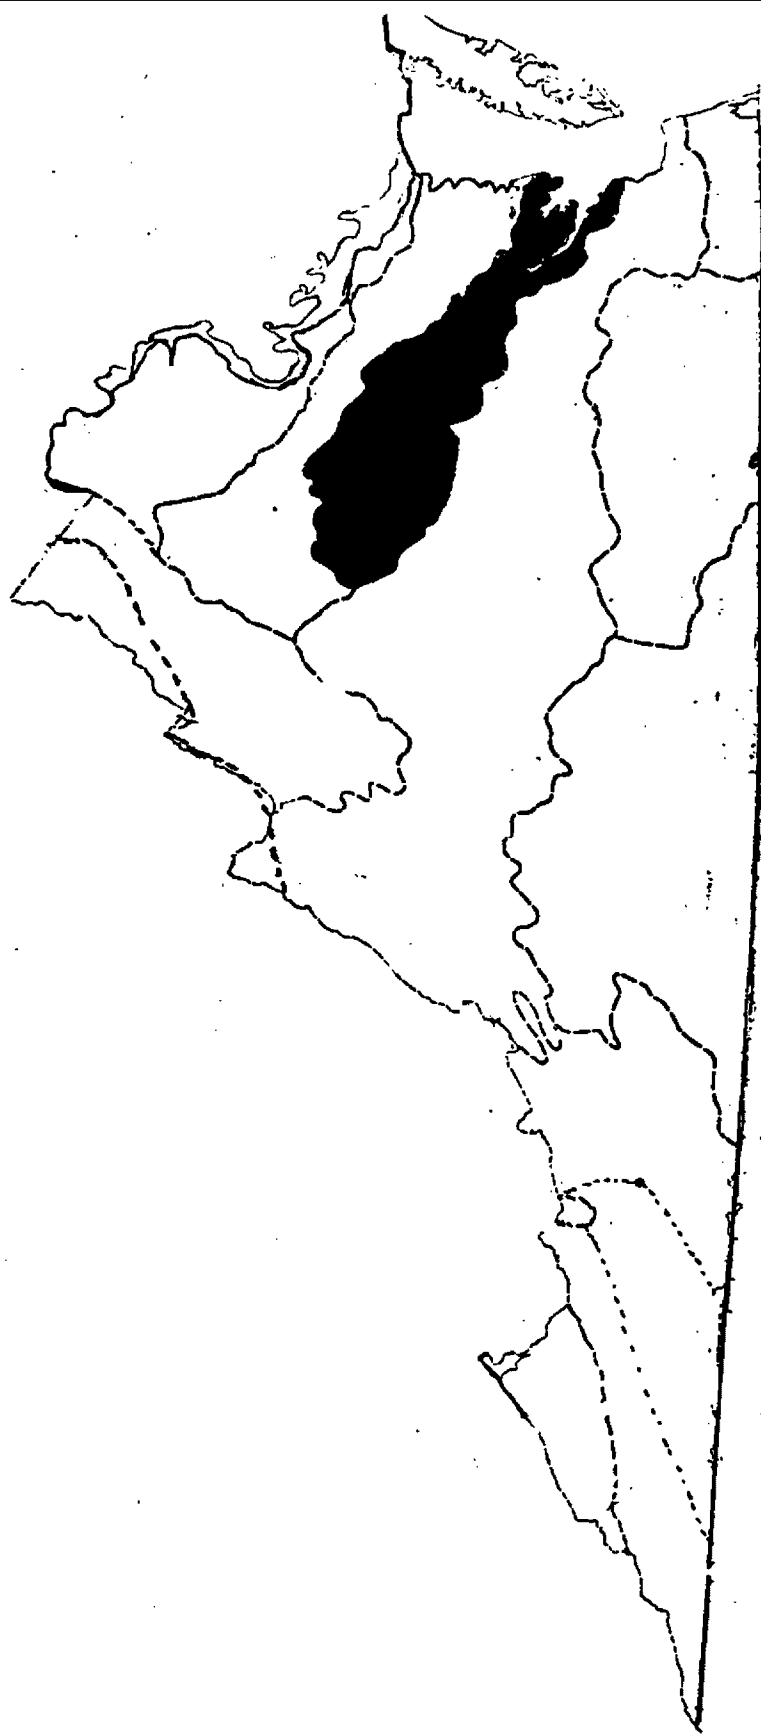

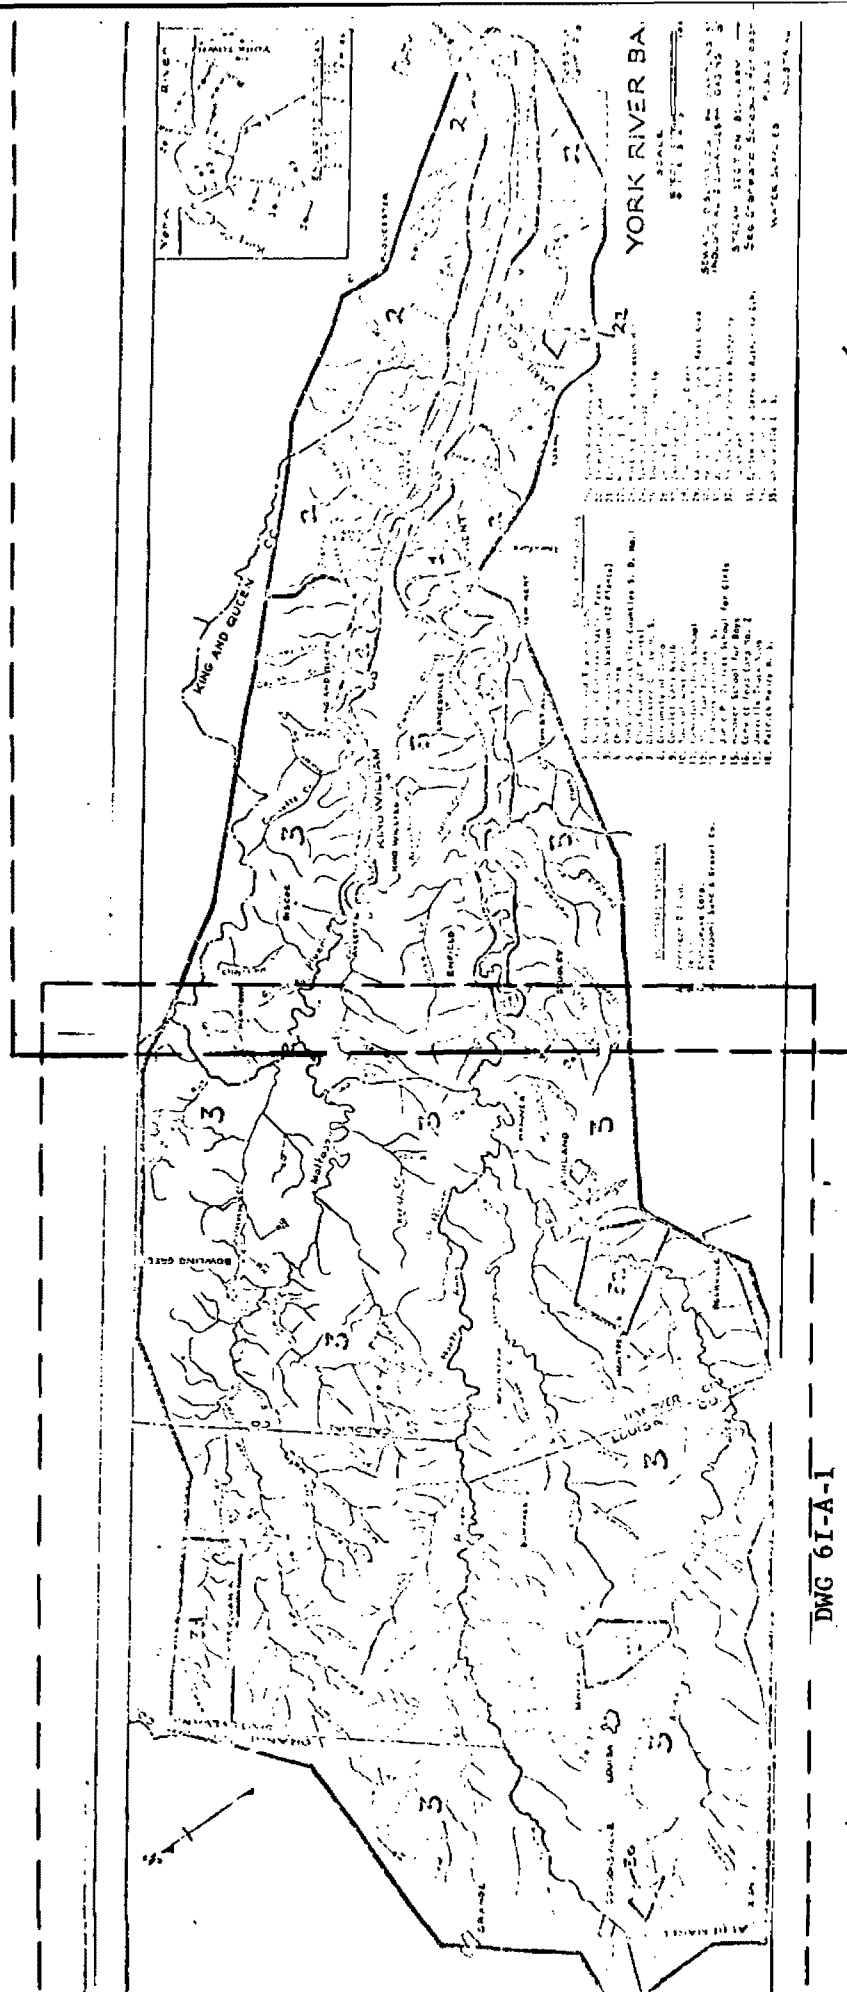


DWG 6I-A

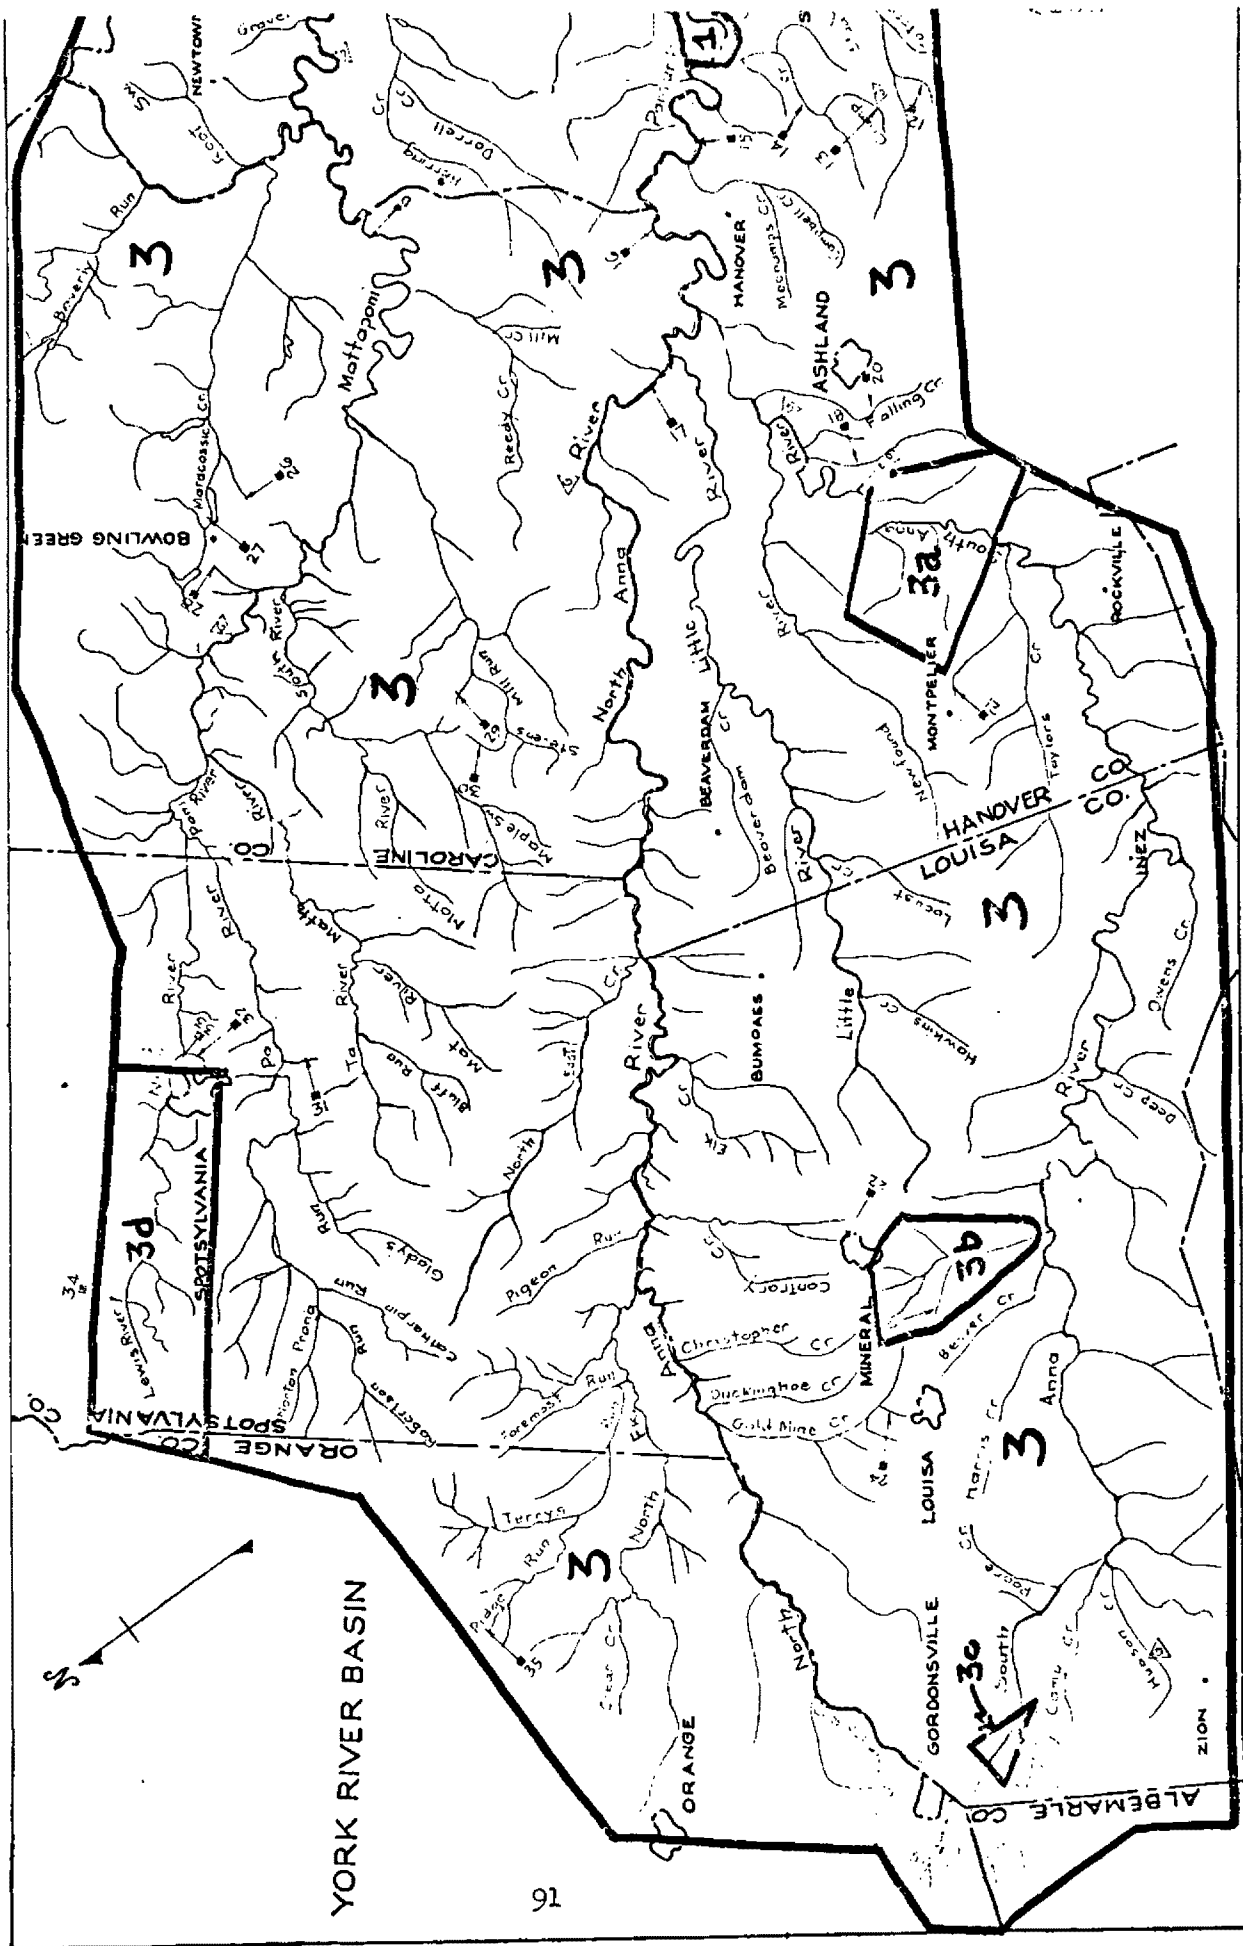

DWG 61 A-1

YORK RIVER BASIN


Section	Section Description	Class	Special Standards
1	York River and the tidal portions of its tributaries from Goodwin Neck and Sandy Point upstream to Thorofare Creek and Little Salem Creek near West Point; Mattaponi River and the tidal portions of its tributaries from Little Salem Creek to the end of tidal waters; Pamunkey River and the tidal portions of its tributaries from Thorofare Creek near West Point to the end of tidal waters.	II B	a
2	Free flowing tributaries of the York River, free flowing tributaries of the Mattaponi River to Clifton and the Pamunkey River to Romancoke, unless otherwise designated.	III B	
2a	Queen Creek and Wallers Mill Pond to the headwaters of the pond.	III B	Public Water Supply
3	Free flowing portions of the Mattaponi and Pamunkey Rivers, free flowing tributaries of the Mattaponi above Clifton, and free flowing tributaries of the Pamunkey above Romancoke unless otherwise designated.	III A	
3a	South Anna River from Ashland's raw water intake to a point 5 miles upstream.	III A	Public Water Supply
3b	Northeast Creek from the proposed site of the impoundment dam to its headwaters.	III A	Public Water Supply
3c	South Anna River from route 15 upstream to a point 1.5 miles below the present effluent from the Gordonsville Sewage Treatment Plant.	III B	
3d	Ni River and its tributaries from Spotsylvania's raw water intake near route 208 to their headwaters.	III A	Public Water Supply



Water Quality Standards Summary


Section 6J


James River Basin (Lower)




Lower James River Basin


DWG 6J

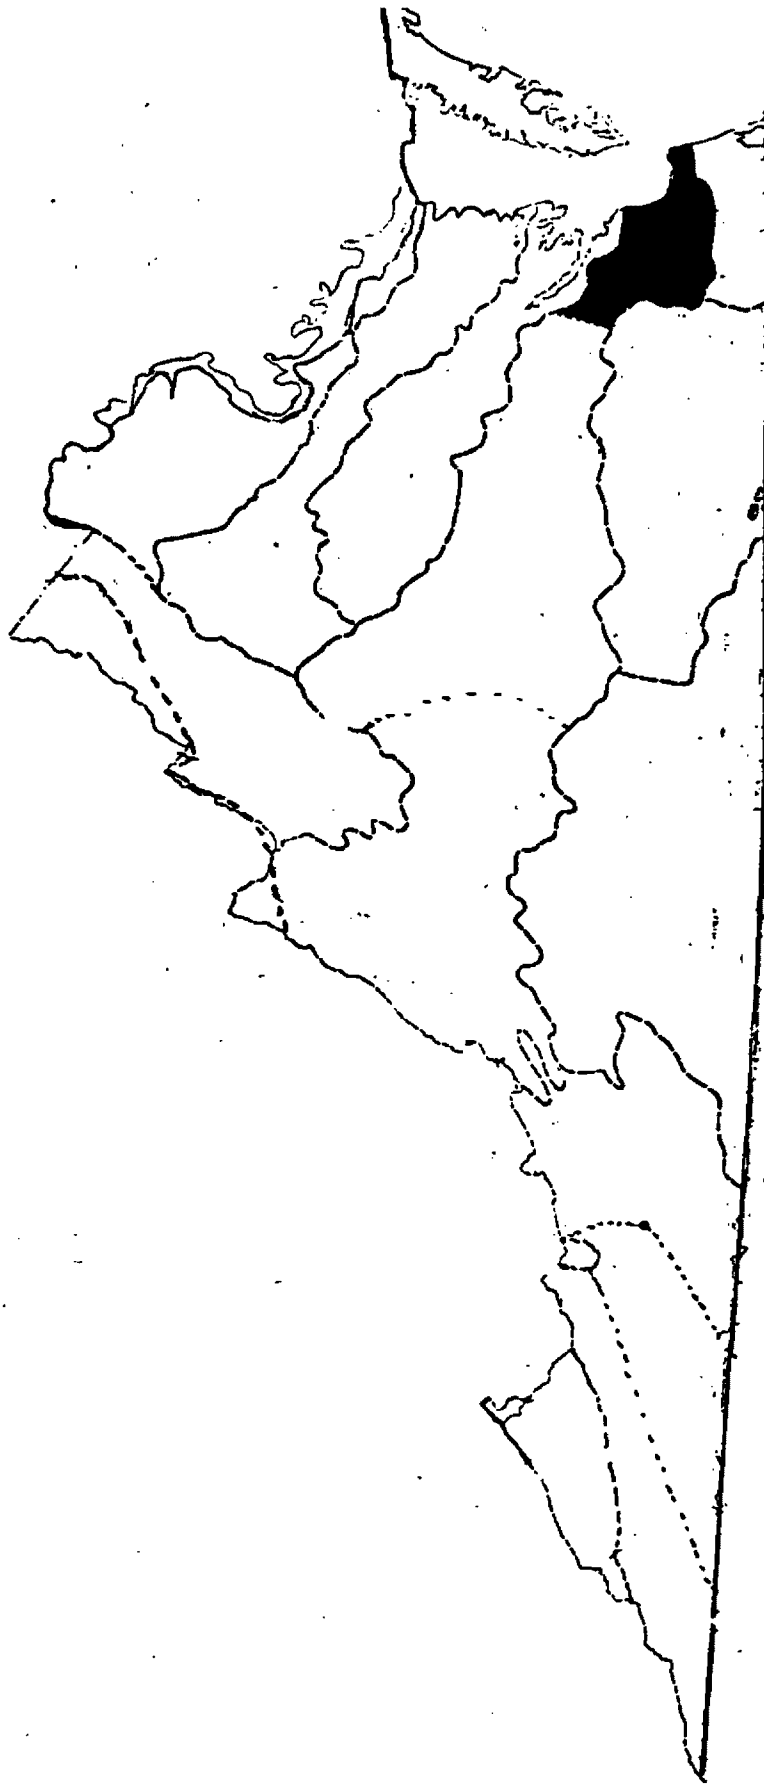

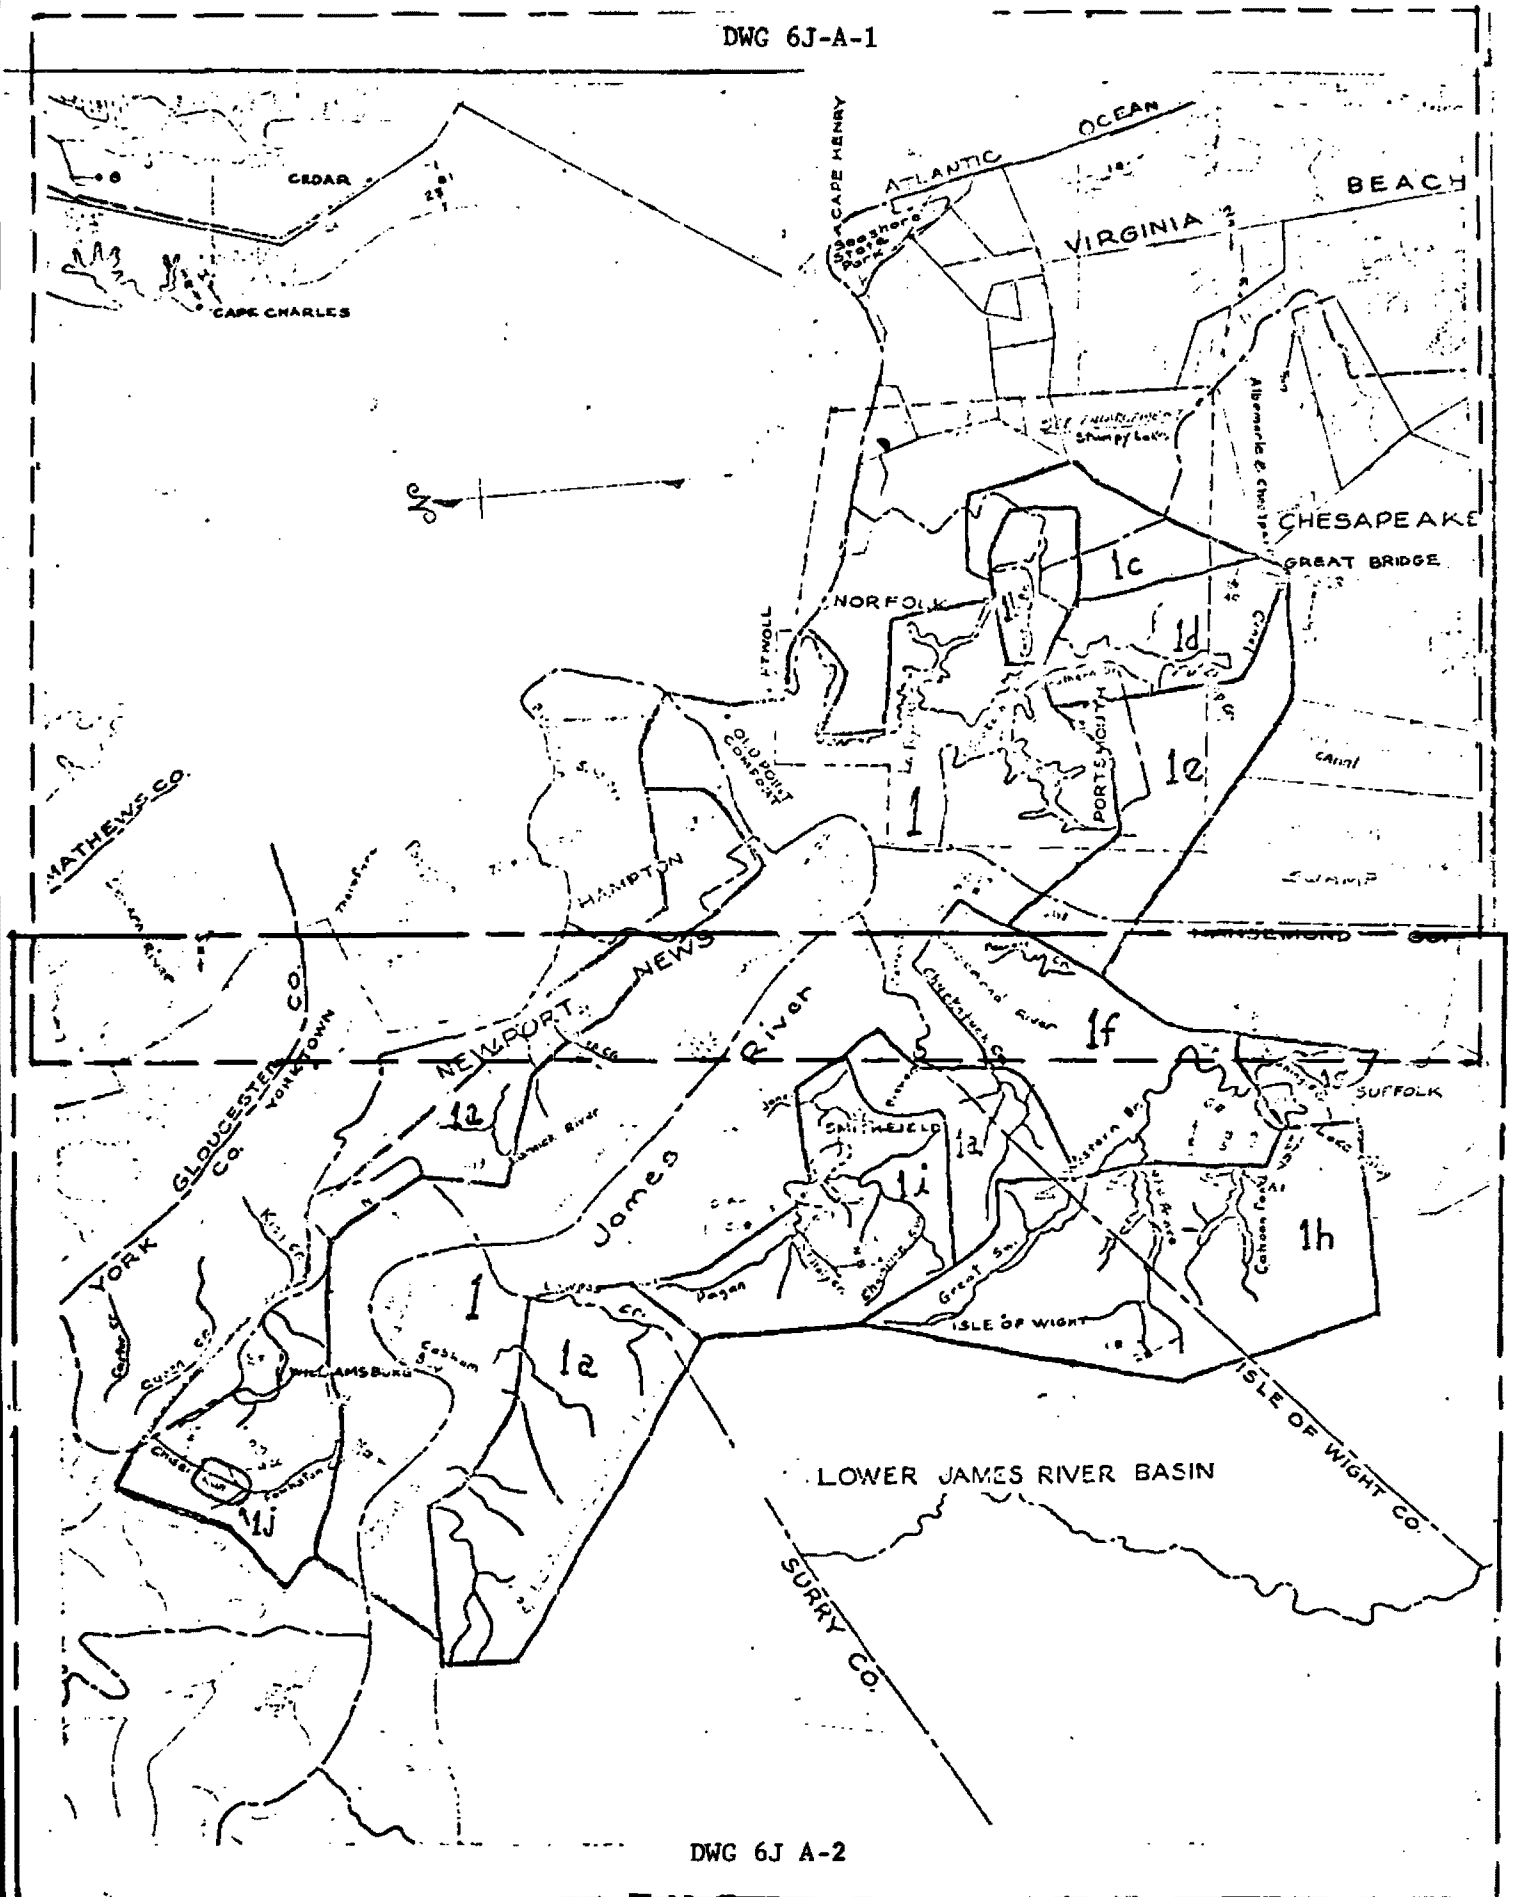

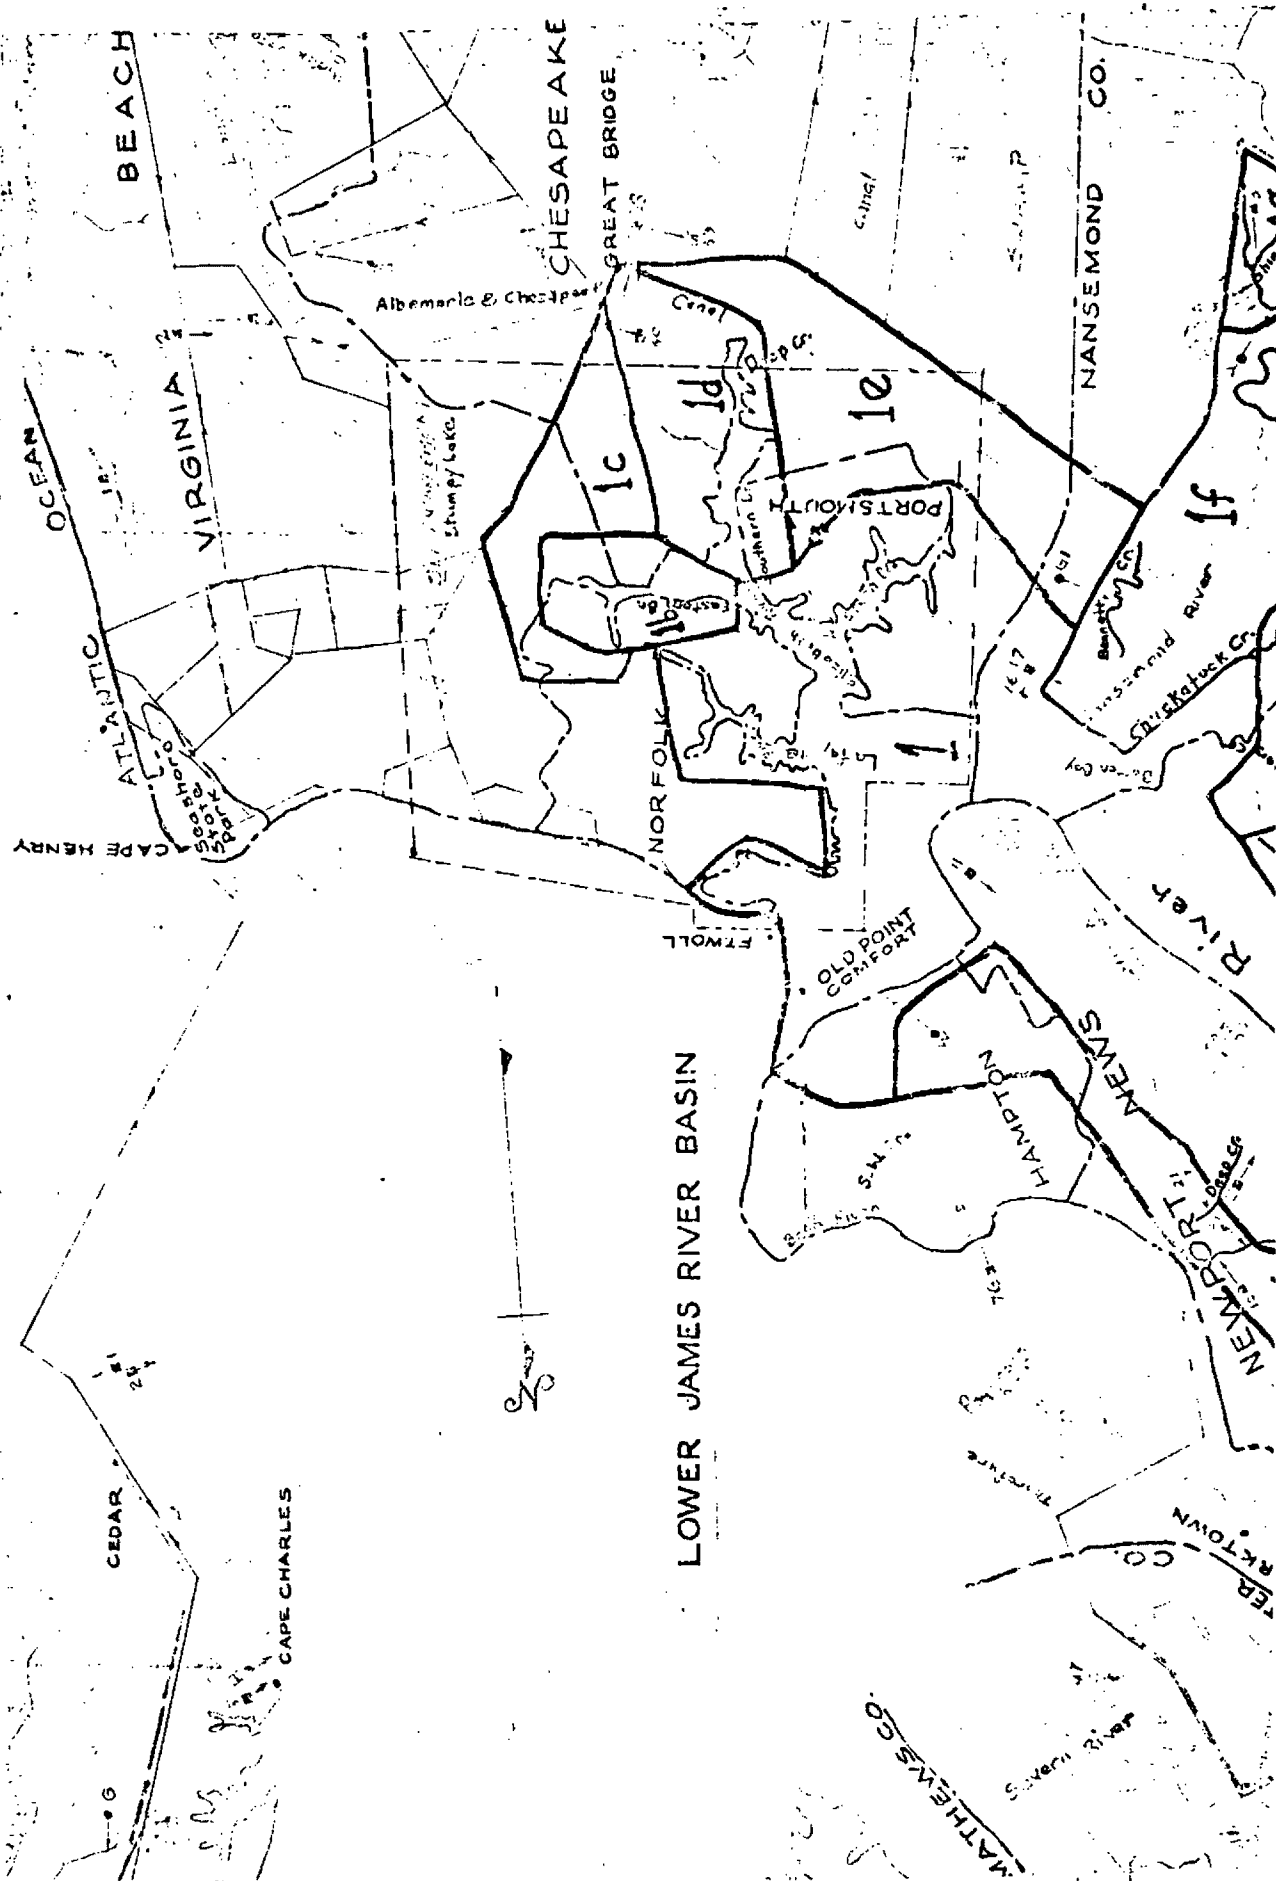


DWG 6J-A-1

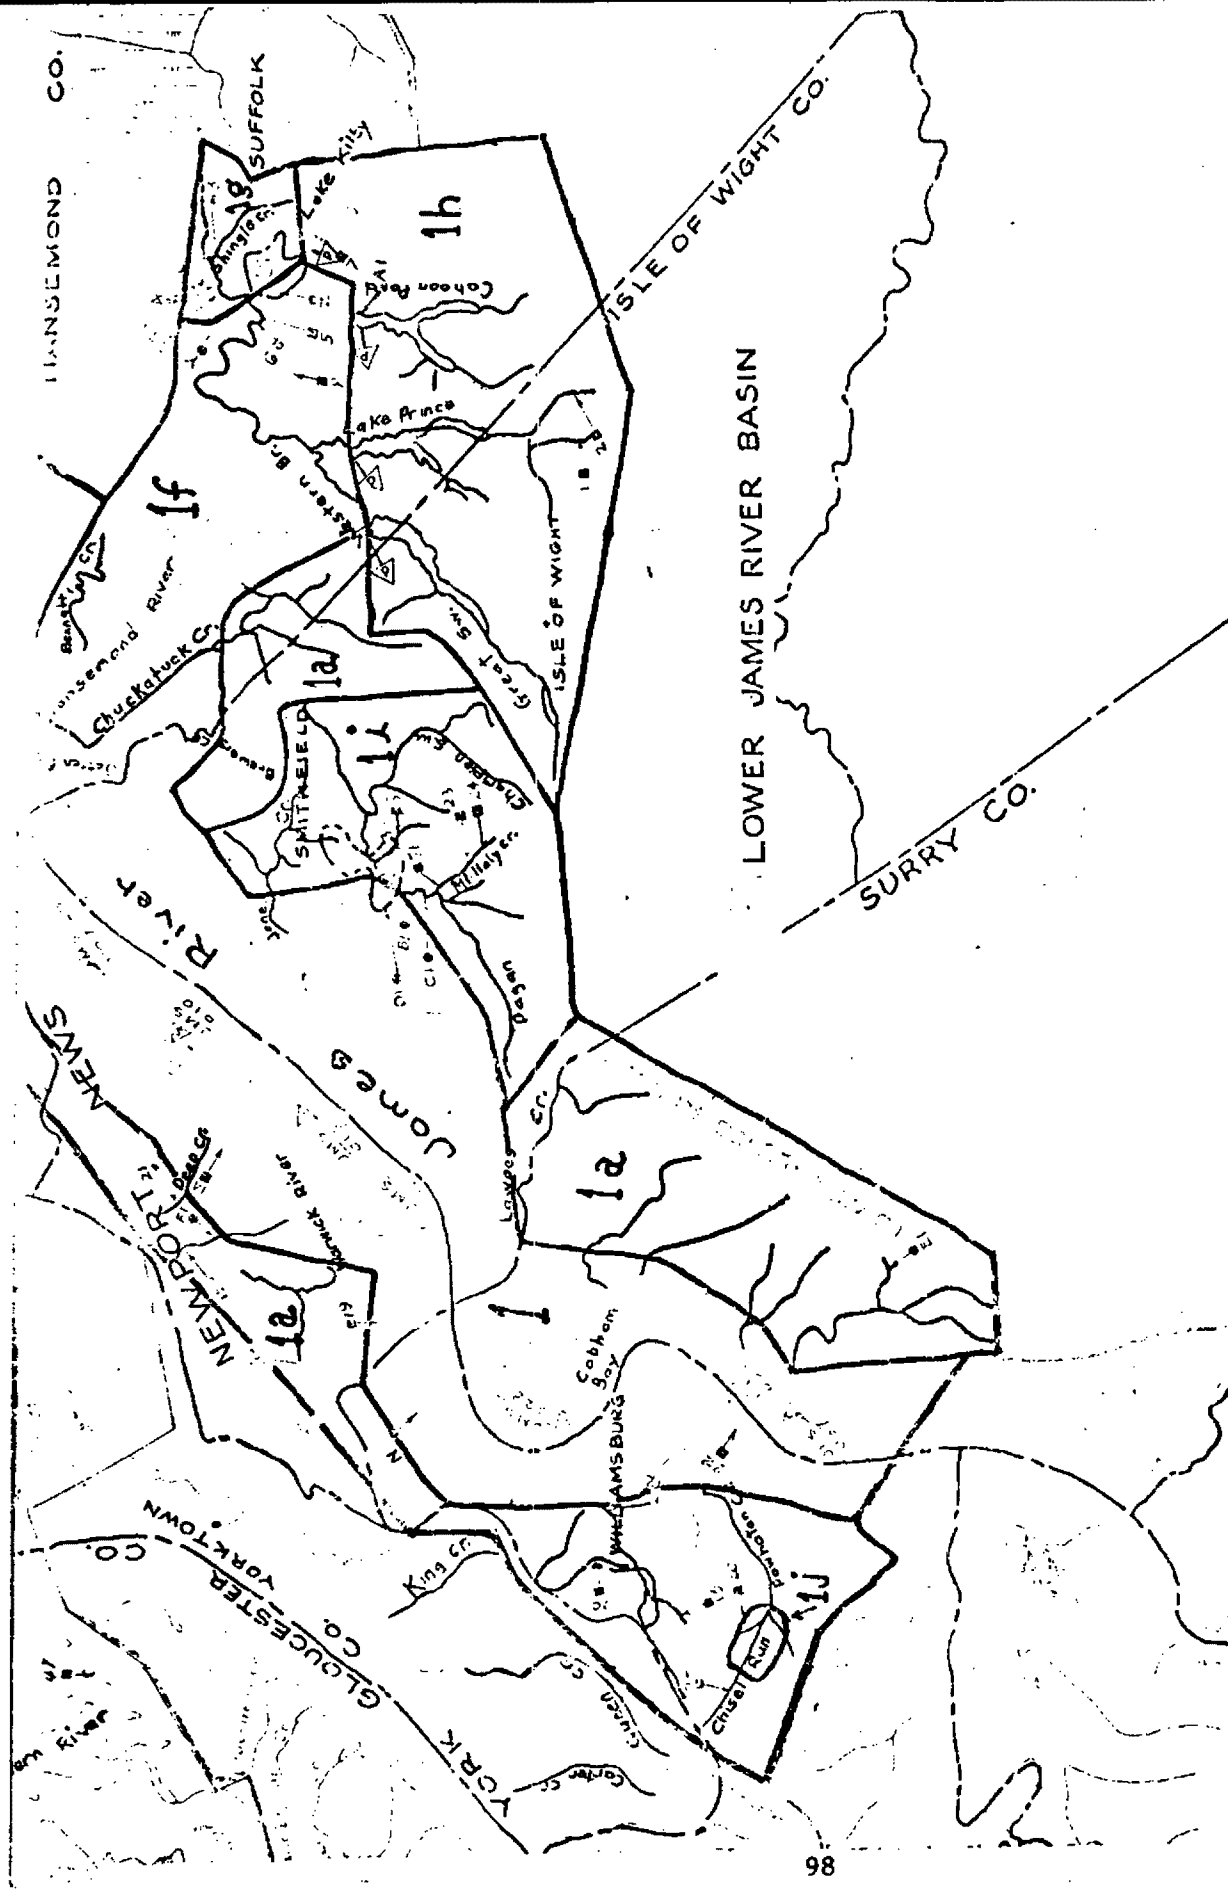

DWG 6J-A--2

JAMES RIVER BASIN (LOWER)


Section	Section Description	Class	Special Standards
1	James River and its tidal tributaries from Old Point Comfort--Fort Wool to Barrett Point (Buoy 64), except prohibited or or spoil areas, unless otherwise designated.	II B	a
1a	The free flowing or non-tidal portions of streams in section 1 unless otherwise designated.	III B	s
1b	Eastern Branch of the Elizabeth River from its confluence with the Elizabeth River to end of navigable waters.	II B	a, h, i
1c	Free flowing portions of the Eastern Branch of the Elizabeth River.	III B	h, i
1d	Southern Branch of the Elizabeth River from its confluence with the Elizabeth River to the lock at Great Bridge.	II B	a
1e	Free flowing portions of the Western Branch of the Elizabeth River and of the Southern Branch of the Elizabeth River from its confluence with the Elizabeth River to the lock at Great Bridge.	III B	
1f	The Nansemond River and its tributaries from its confluence with the James River to Suffolk (dam at Lake Meade), unless otherwise designated.	II B	a, l
1g	Shingle Creek from its confluence with the Nansemond River to its headwaters in the Dismal Swamp.	II B	l
1h	Lake Prince, Lake Burnt Mill and Western Branch impoundments for Norfolk raw water supplies and Lake Kilby--Cahoon Pond and Lake Meade impoundment for Portsmouth raw water supply.	III B	b
1i	Free flowing portions of Pagan River and its free flowing tributaries.	III B	Public Water Supply
1j	Chisel Run and its tributaries, except that tributary into which Eastern State Hospital discharges, to their headwaters.	III B	s




Water Quality Standards Summary


Section 6K

James River Basin (Middle)



Middle James River Basin
DWG 6K

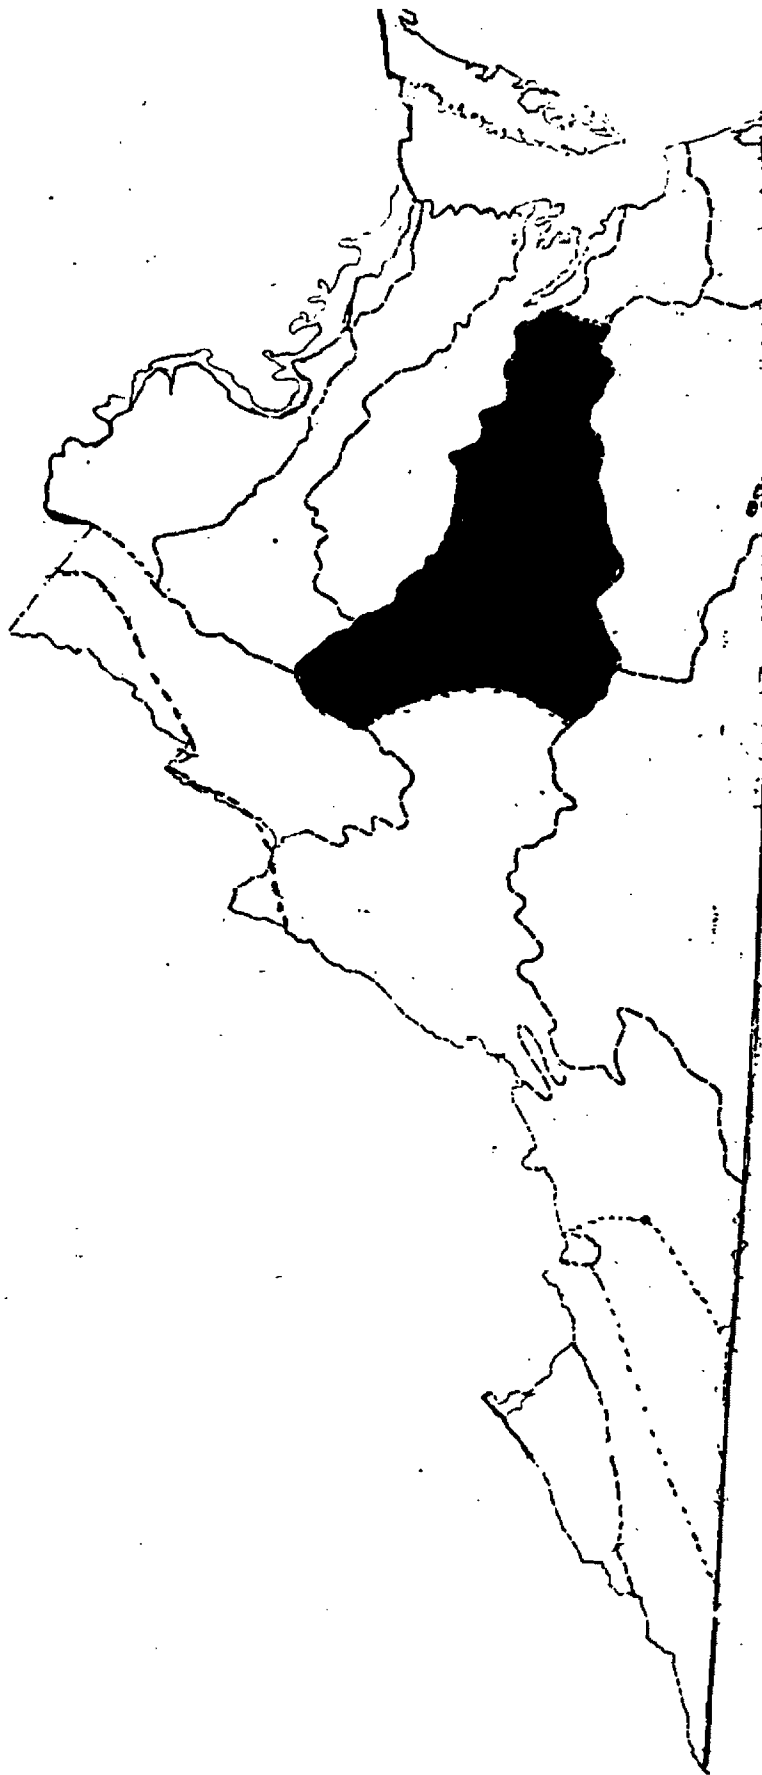

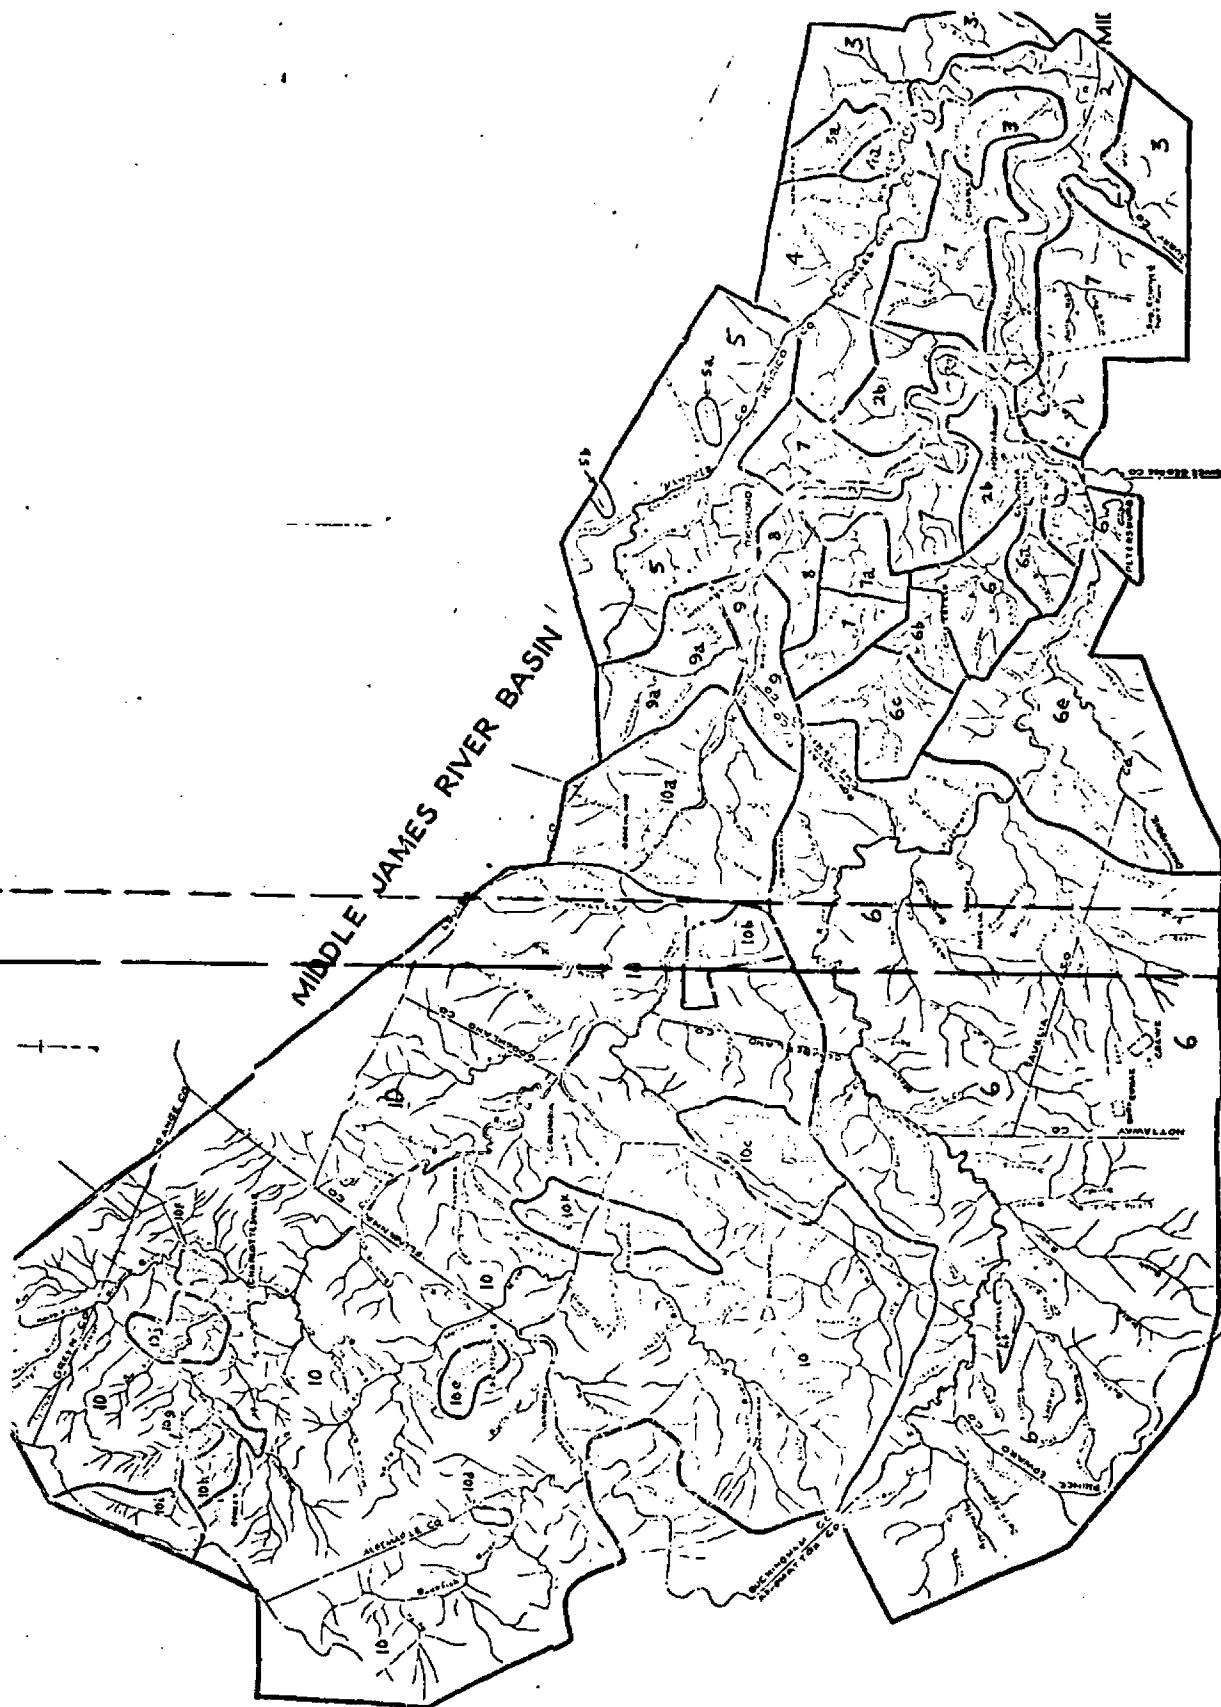



DWG 6K-A-1

DWG 6K-A

DWG 6K-A--2

MIDDLE JAMES RIVER BASIN

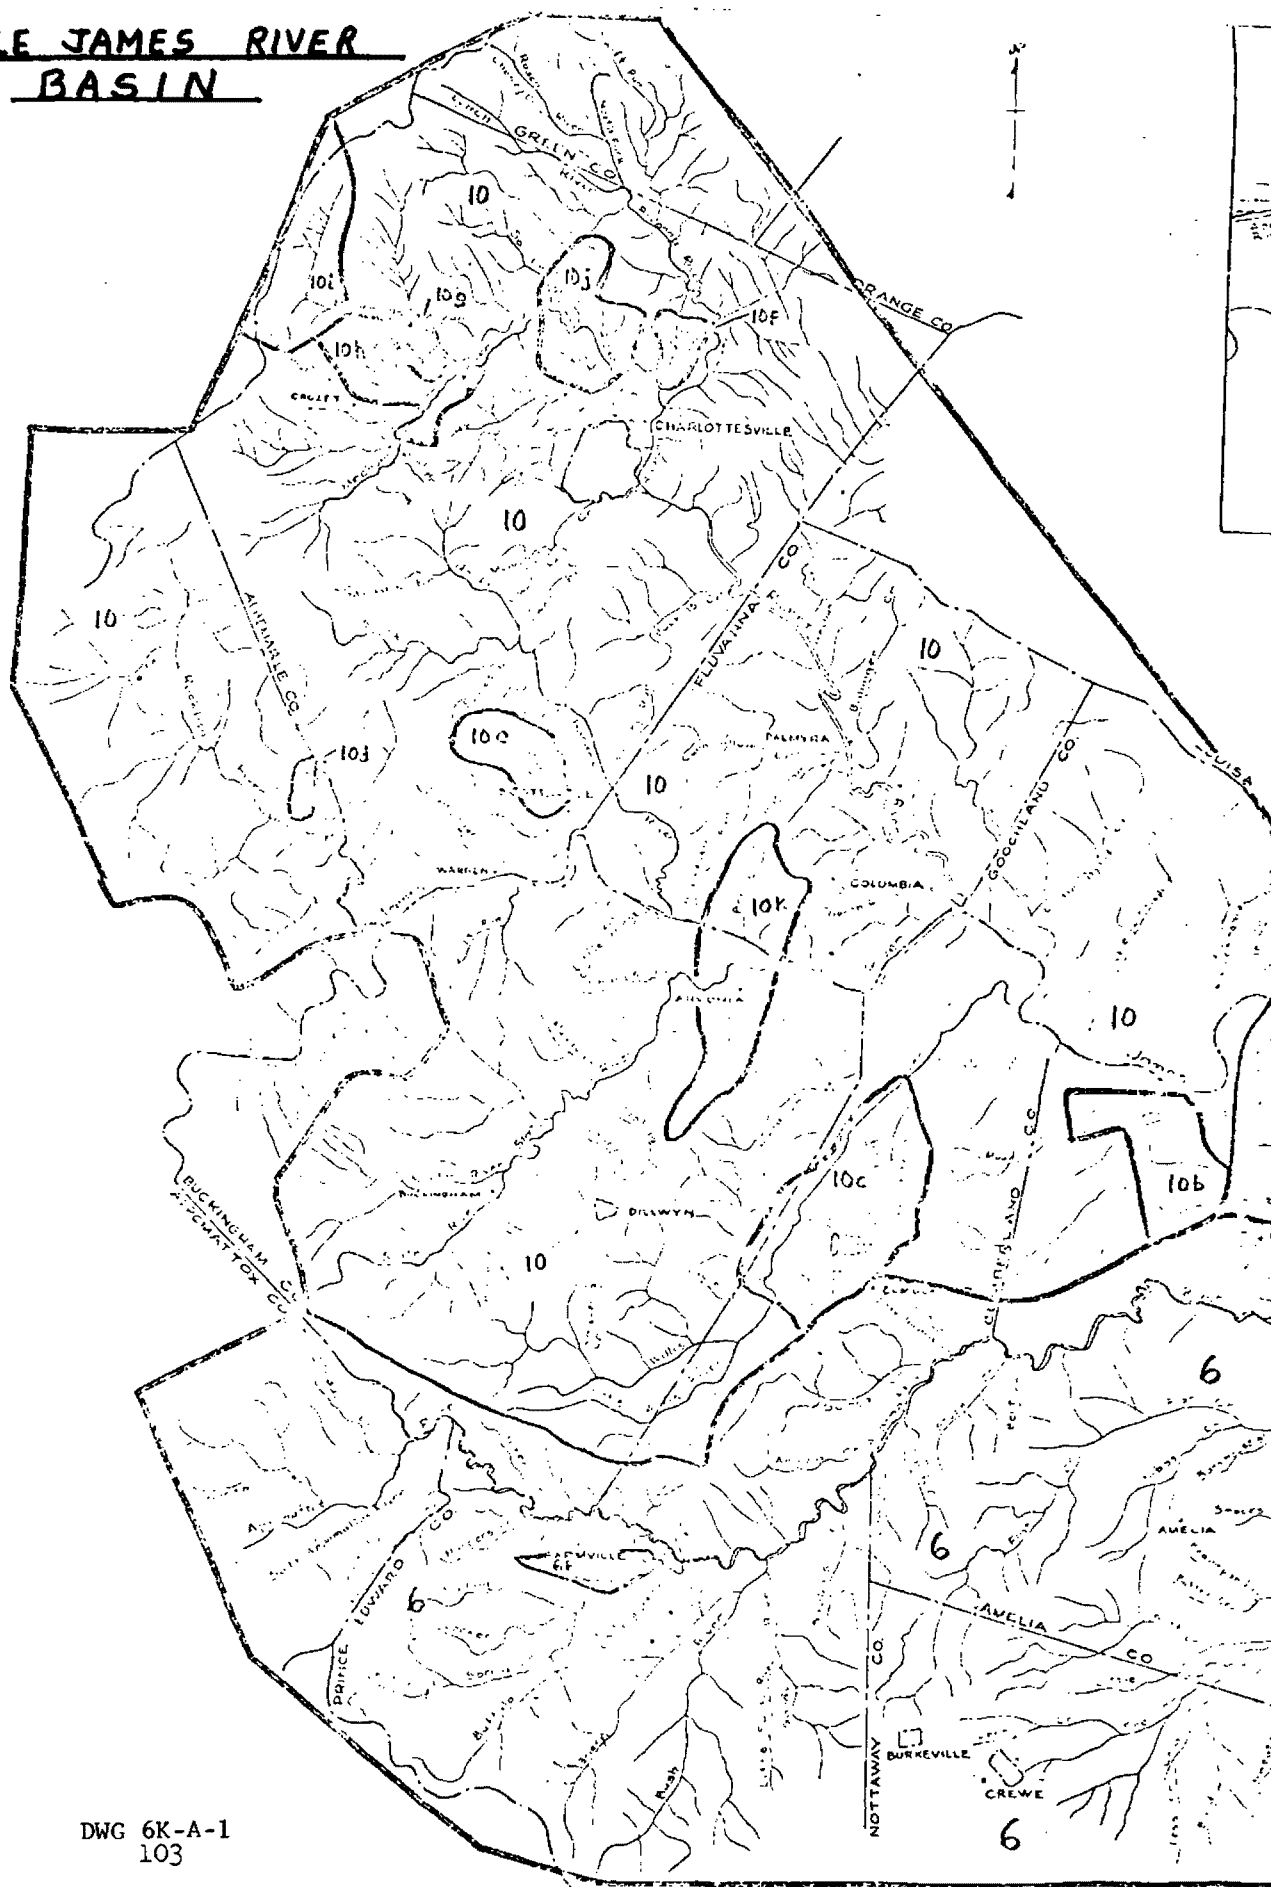

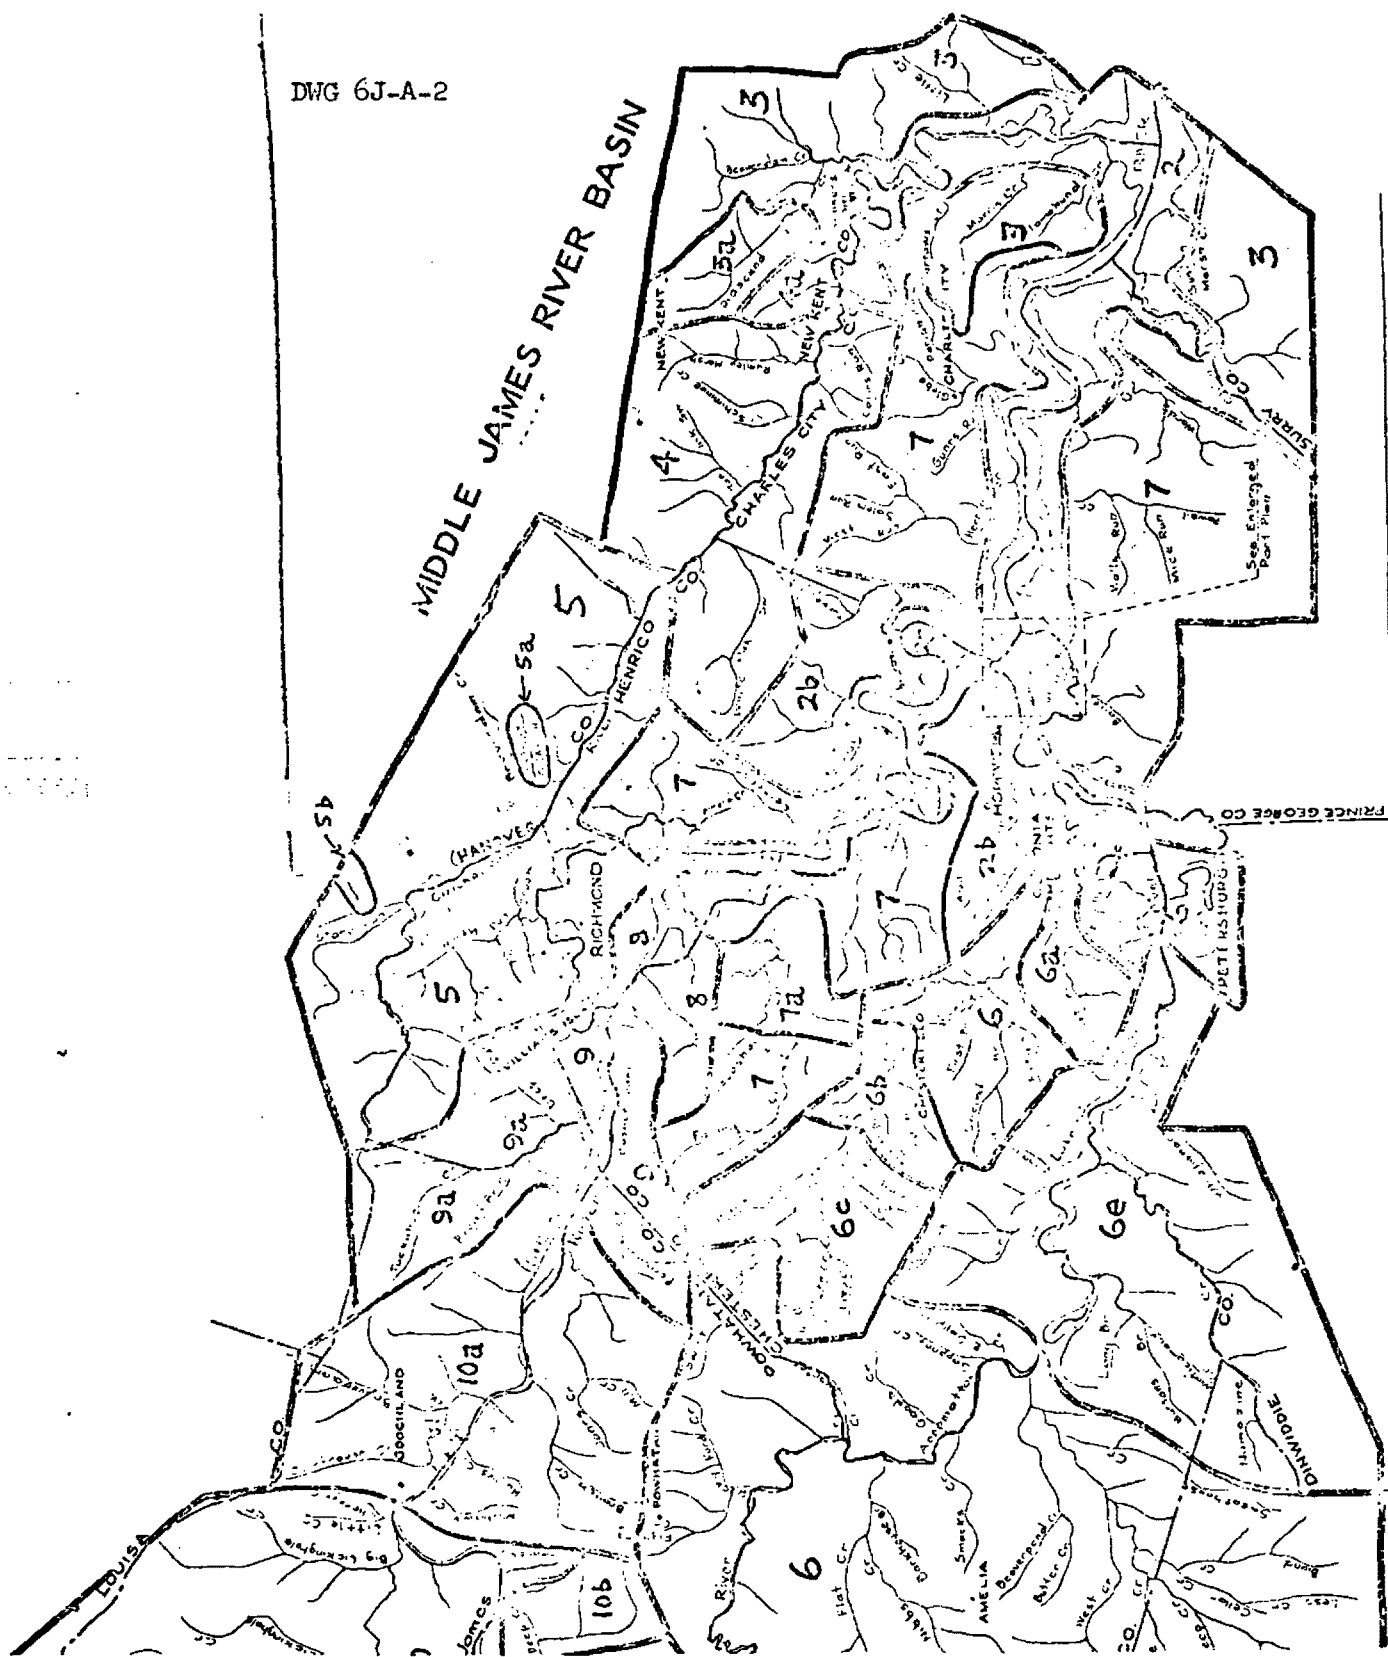

JAMES RIVER BASIN (MIDDLE)

Section	Section Description	Class	Special Standards
2	The James River and its tidal tributaries from Buoy 64 near Barrett's Point upstream to the fall line at Richmond, to include the Chickahominy River and its tidal tributaries from the mouth upstream to Walker's Dam and the Appomattox River and its tidal tributaries from the mouth upstream to the head of tidal waters (approximately at the route 1 - 301 Bridge across the Appomattox), unless otherwise designated.	II B	
2a	James River from City Point to a point 5 miles above American Tobacco Company's raw water intake and the Appomattox River from Hopewell's raw water intake to a point 5 miles upstream from flowing tributaries to Section 2a.	II B	Public Water Supply
2b	Free flowing tributaries of the James River from Buoy 64 to	III B	Public Water Supply
3	Free flowing tributaries of the James River from Buoy 64 to Brandon and free flowing tributaries of the Chickahominy River to Walker's Dam, unless otherwise designated.	III B	
3a	Diascund Creek from Newport News' raw water intake dam to its headwaters.	III B	Public Water Supply
4	The Chickahominy River and its tributaries from Walker's Dam to Bottoms Bridge (route 60 Bridge).	III A	t
4a	Chickahominy River from Walker's Dam to a point 5 miles upstream.	III A	Public Water Supply
5	Chickahominy River and its tributaries, unless otherwise designated, from Bottom's Bridge (route 60 Bridge) to its headwaters.	III A	t
5a	Brandy Branch (a tributary to Beaverdam Creek).	III B	t
5b	Unnamed tributary to Lickinghole Creek which has its confluence 1.38 miles above the mouth of Lickinghole Creek.	III B	t
6	Appomattox River from the head of tidal waters, and free flowing tributaries to the Appomattox River, to their headwaters, unless otherwise designated.	III A	
6a	Swift Creek and its tributaries from Colonial Heights' raw water intake to a point 5 miles upstream.	III B	Public Water Supply
6b	Swift Creek and its tributaries from the dam at Pocahontas State Park upstream to Chesterfield County's raw water impoundment dam.	III B	

JAMES RIVER BASIN (MIDDLE) (cont.)

Section	Section Description	Class	Special Standards
6c	Swift Creek and its tributaries from Chesterfield County's raw water impoundment dam to a point 5 miles upstream.	III A	Public Water Supply
6d	That portion of Old Town Creek within the corporate limits of Colonial Heights.	III B	
6e	Appomattox River and its tributaries from Petersburg's raw water intake to the headwaters of the Appomattox Water Authority impoundment lake.	III B	Public Water Supply
6f	Buffalo Creek from Farmville's raw water intake to a point 5 miles upstream.	III A	Public Water Supply
7	Free flowing tributaries to the James River from Brandon to the fall line at Richmond, unless otherwise designated.	III A	
7a	Falling Creek and its tributaries from Bellwood Defense General Depot's raw water intake to a point 5 miles above Chesterfield County's raw water intake.	III A	Public Water Supply
8	James River and its tributaries from the low water dam above 14th Street Bridge to Richmond's raw water intake at Williams Island Dam.	III B	
9	James River and its tributaries, unless otherwise designated, from Richmond's raw water intake at Williams' Island Dam to a point 5 miles above Richmond's raw water intake at Boshers' Dam.	III B	Public Water Supply
9a	Tuckahoe Creek from its confluence with the James River to its headwaters.	III B	
10	James River and its tributaries from a point 5 miles above Richmond's raw water intake at Boshers' Dam to and including the Rockfish River, unless otherwise designated.	III A	Public Water Supply
	<u>Trout Waters in Section 10:</u> Put and Take: Ivy Branch 1.5 miles upstream from the church above the junction of routes 628 and 614. Swift Run from route 604 upstream 2.5 miles to route 810. South Fork Moormans River from its confluence with Moormans River to its headwaters.	V A	

JAMES RIVER BASIN (MIDDLE) (cont.)

Section	Section Description	Class	Special Standards
	North Fork Moormans River from its confluence with Moormans River to its headwaters. South Fork Rockfish River from its confluence with the Rockfish River to its headwaters. Stony Creek from its confluence with the South Fork Rockfish River to its headwaters. Rockfish Creek from its confluence with the South Fork Rockfish River to its headwaters. Natural: Ivy Branch from route 810 to headwaters. Swift Run from Albemarle County line to headwaters. James River and its tributaries from and including Little River to 5 miles above State Farm's raw water intake including Beaverdam and Courthouse Creeks to their headwaters. Deep Creek from St. Emma's Military Academy's raw water intake to a point 5 miles upstream. Willis River and its tributaries within Cumberland State Forest. Johnson Creek above Alberene Stone Corporation's raw water intake to its headwaters. Totter Creek and its tributaries from Scottsville's raw water intake to their headwaters. Powell Creek from its confluence with the Rivanna River upstream to its headwaters. Beaver Creek above Albemarle County Service Authority's raw water intake upstream to its headwaters. Mechum River and its tributaries from Charlottesville's raw water intake to a point 5 miles upstream. Moormans River from Charlottesville's raw water intake to its headwaters. South Fork Rivanna River and its tributaries, except Ivy Creek, from Charlottesville's South Fork Rivanna River Dam to the confluence of the South Fork Rivanna River and Moormans River, and Ivy Creek to a point 5 miles above the dam.	VI A III A III A III B III A III A III B III A III A III A III A	Public Water Supply Public Water Supply Public Water Supply Public Water Supply Public Water Supply Public Water Supply Public Water Supply Public Water Supply Public Water Supply Public Water Supply
10a			
10b			
10c			
10d			
10e			
10f			
10g			
10h			
10i			
10j			


JAMES RIVER BASIN (MIDDLE) (cont.)

Section	Section Description	Class	Special Standards
10k	James River and its tributaries from Fork Union Sanitary District's raw water intake (just below the route 15 bridge) to a point 5 miles upstream, including the Slate River to a point 5 miles above the intake.	III A	Public Water Supply

Water Quality Standards Summary

Section 6L

James River Basin (Upper)



Upper James River Basin
DWG 6L




DWG 6L-A-2

UPPER JAMES RIVER BASIN


DWG 6L-A-1


DWG 6L-A

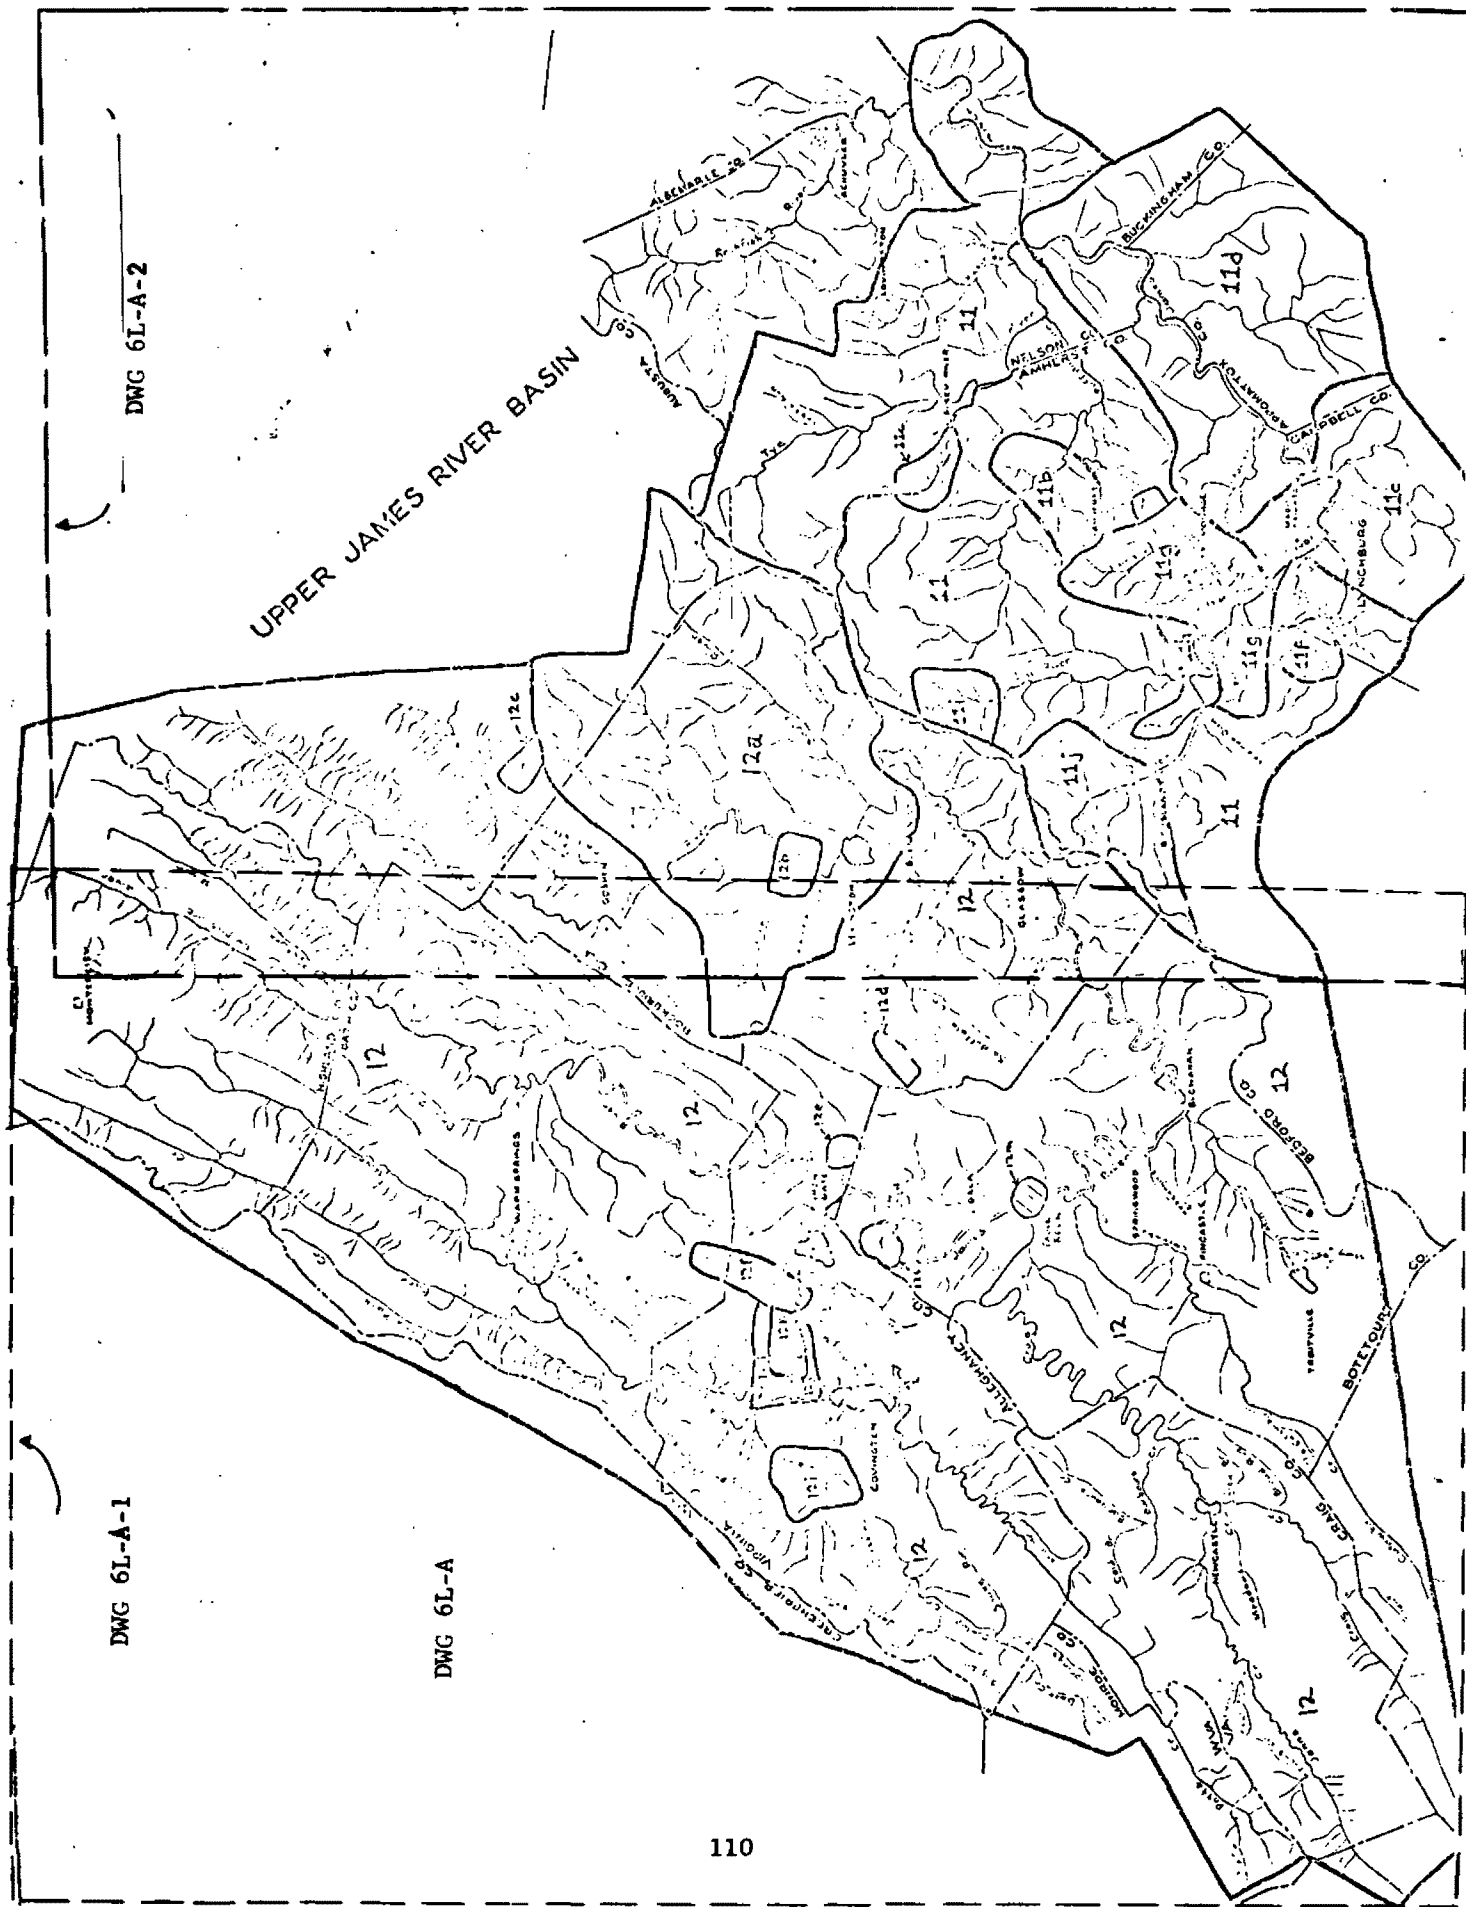

UPPER JAMES RIVER BASIN

DWG 6L-A-1

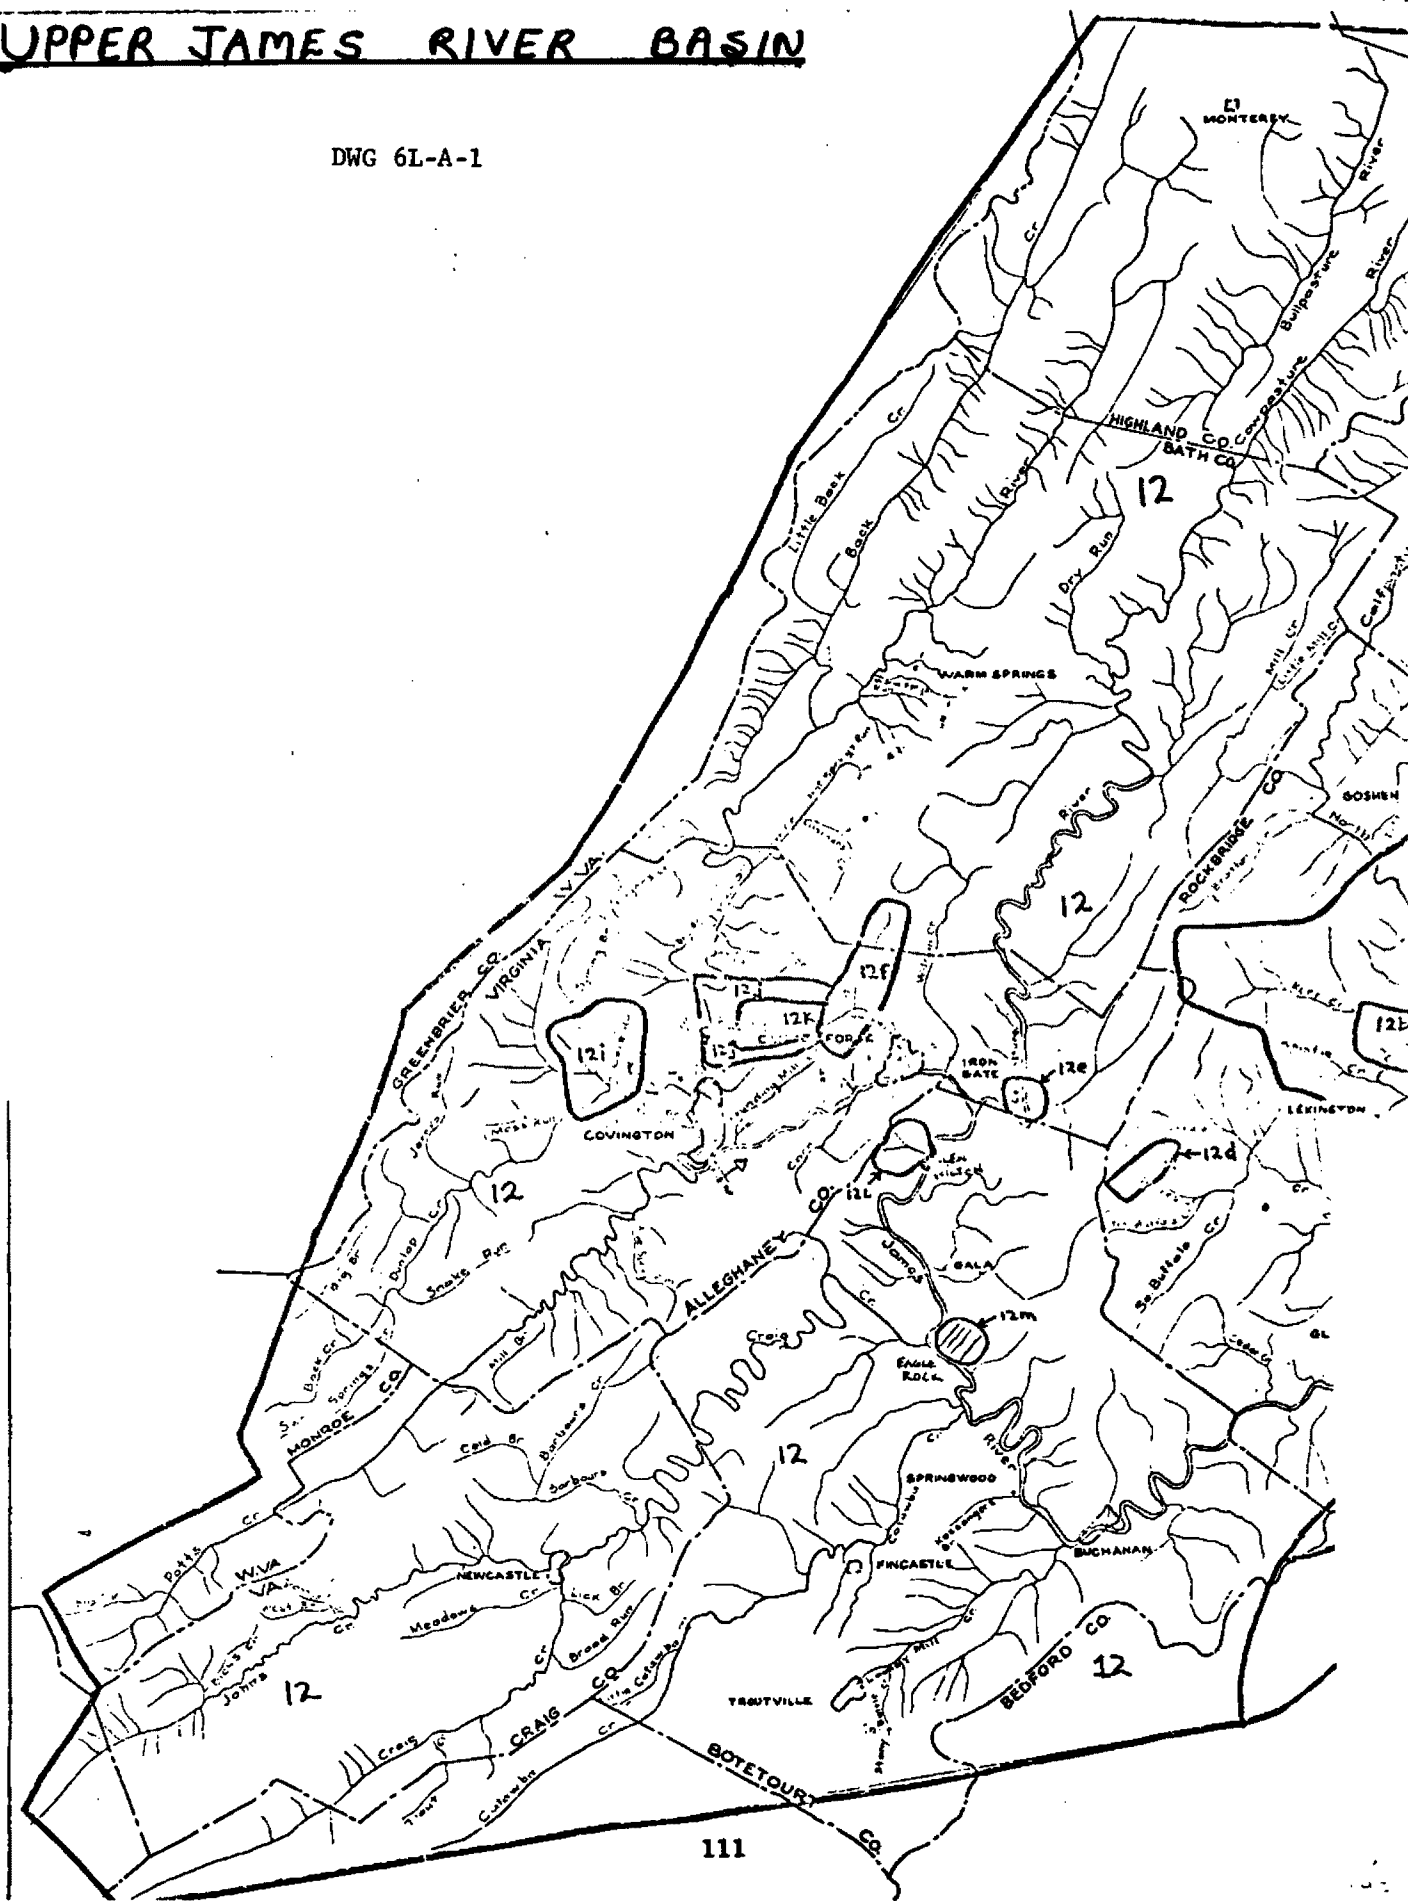

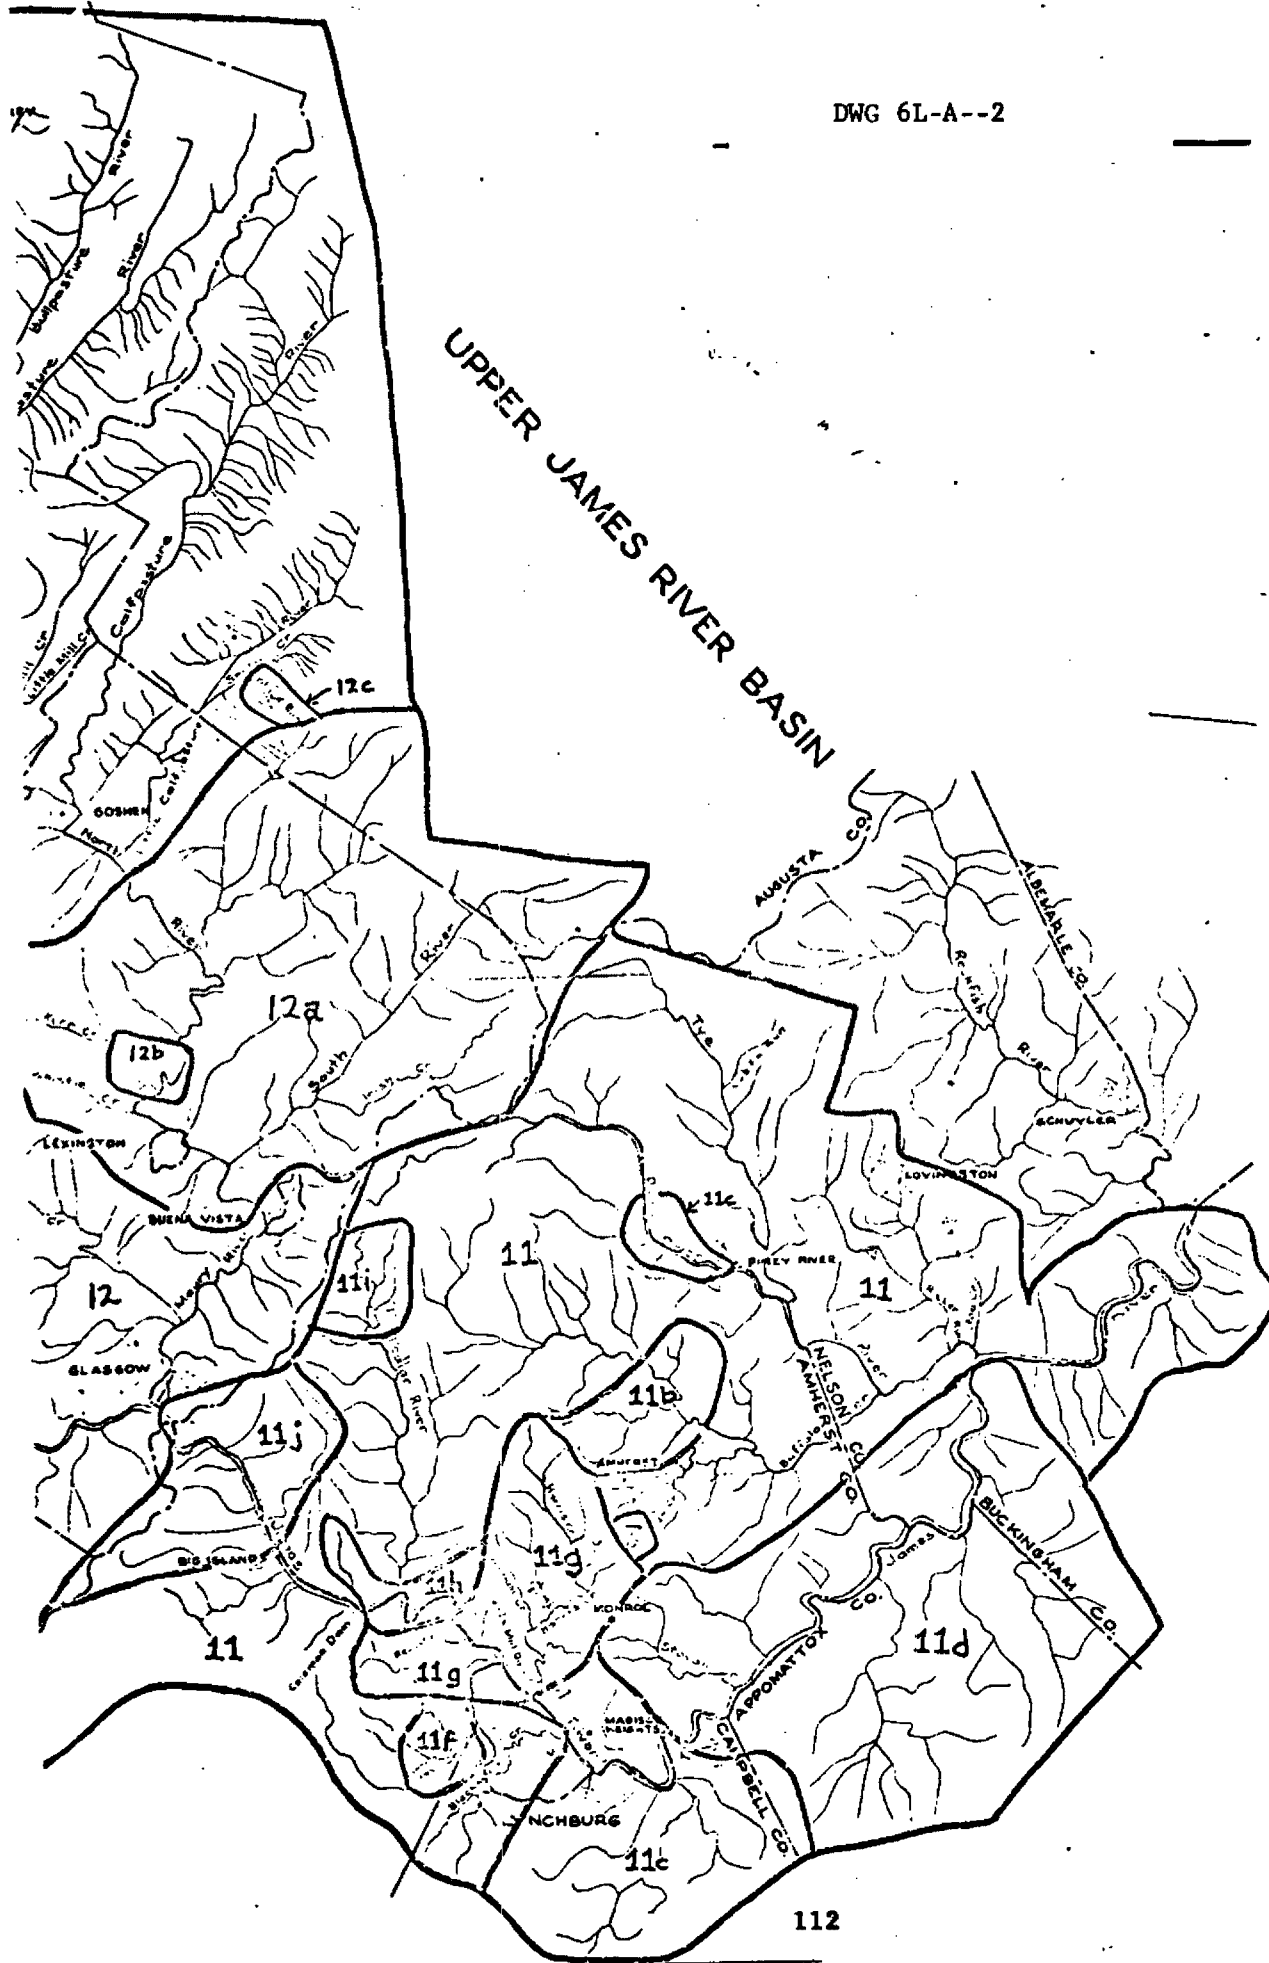

JAMES RIVER BASIN (UPPER)

Section	Section Description	Class	Special Standards
11	James River and its tributaries from, but not including, the Rockfish River to, but not including, the Maury River. <u>Trout Waters in Section 11:</u> <u>Natural:</u> Enchanted Creek from its confluence with the Pedlar River upstream to its headwaters. Irish Creek from its confluence with the Pedlar River upstream to its headwaters. Pedlar River from 5 miles above Lynchburg's raw water intake upstream to its headwaters. Mill Creek from its confluence with the Pedlar River upstream to its headwaters. Statom Creek from its confluence with the Pedlar River upstream to its headwaters. Piney River from a point 5 miles above American Cyanamid's raw water intake upstream to its headwaters. North Fork Buffalo River from its confluence with the Buffalo River upstream to its headwaters. Tye River from Tyro upstream to its headwaters. North Fork Tye River from its confluence with the Tye River upstream to its headwaters. Rutledge Creek from Sweet Briar College's raw water intake to its headwaters. Buffalo River and its tributaries from Amherst's raw water intake to a point 5 miles upstream. Piney River and its tributaries from American Cyanamid Company's auxiliary raw water intake to a point 5 miles upstream. <u>Trout Waters in Section 11c:</u> <u>Natural:</u> Piney River from American Cyanamid's raw water intake to a point 5 miles upstream.	III A VI A	Public Water Supply Public Water Supply Public Water Supply
11a		III A	Public Water Supply
11b		III A	Public Water Supply
11c		III A	Public Water Supply
		VI A	

JAMES RIVER BASIN (UPPER) (cont.)

Section	Section Description	Class	Special Standards
11d	James River and its tributaries from a point $\frac{1}{2}$ mile above the confluence of the Buffalo River to Six Mile Bridge.	III A	g
11e	James River and its tributaries excluding Blackwater Creek from Six Mile Bridge to Scotts Mill Dam.	III B	
11f	Ivy Creek from Blue Ridge Farm's (Campbell County) raw water intake to a point 5 miles upstream.	III A	Public Water Supply
11g	James River and its tributaries from Scotts Mill Dam to Reusens Dam to include Madison Heights' raw water intake on Harris and Graham Creeks.	III B	Public Water Supply
11h	James River and its tributaries, excluding the Pedlar River, from Reusens Dam to Coleman's Dam.	III B	d Public Water Supply Public Water Supply
11i	Pedlar River and its tributaries from Lynchburg's raw water intake to a point 5 miles upstream.	III A	
	<u>Trout Waters in Section 11i:</u>		
	Natural:	VI A	
	Pedlar River from Lynchburg's raw water intake to a point 5 miles upstream.		
	Brown's Mill Creek from its confluence with the Pedlar River upstream to its headwaters.		
11j	James River and its tributaries from the Owens-Illinois raw water intake near Big Island to, but not including, the Maury River.	III B	
	<u>Trout Waters in Section 11j:</u>		
	Put and Take:	V B	
	Hunting Creek from its headwaters to a point 2 miles downstream.		
	Battery Creek from its headwaters to a point 2 miles downstream.		
	Natural:	VI B	
	Rocky Row Run from the telegraph line above Snowden to its headwaters.		

JAMES RIVER BASIN (UPPER) (cont.)

Section	Section Description	Class	Special Standards
12	James River and its tributaries from and including the Maury River to its headwaters unless otherwise designated. <u>Trout Waters in Section 12:</u> Put and Take: Potts Creek from the junction of routes 18 and 615 to the Craig County line. East Dry Branch from its confluence with Calfpasture to headwaters. Roaring Run from route 615 to headwaters. Mill Creek from the junction of routes 622 and 612 to headwaters. Jennings Creek from the junction of routes 11 and 614 to headwaters. Bullpasture River from the junction of Cowpasture and route 678 to headwaters. Jackson River from its junction with route 603 to headwaters. Potts Creek from the junction of routes 311 and 18 to its headwaters. Johns Creek from the junction of routes 632 and 658 to its headwaters. Buffalo Creek from the junction with route 11 north 4.5 miles. Natural: Simpson Creek from the junction of routes 776 and U. S. route 60 to its headwaters. Pounding Mill Creek from its junction with route 771, 2 miles north of Covington, to headwaters. Jerrys Run from its junction with route 60 and 782 to its headwaters. Dunlap Creek from the town of Crows to its headwaters.	IV A V A VI A	

JAMES RIVER BASIN (UPPER) (cont.)

Section	Section Description	Class	Special Standards
	Blue Springs Run from its confluence with Potts Creek to its headwaters. Calfpasture River from its junction with routes 250 and 715 to headwaters. Clayton Mill Creek from its junction with route 600 to its headwaters. Jerkentight from its confluence with the Calfpasture River to its headwaters. Ramsey's Draft from its confluence with the Calfpasture River to its headwaters. Fridleys Branch from its confluence with the Calfpasture River to its headwaters. St. Marys River from route 606 to its headwaters. Little Mill Creek from its confluence with the Maury River to route 39. Little Back Creek from route 600 to its headwaters. Wilson Creek from Douthat State Park to its headwaters. Muddy Run from route 220 to its headwaters. Smith Creek from its confluence with Wilson Creek to its headwaters. Mares Run from its junction with route 39 at Bath Alum to its headwaters. Cedar Creek from its confluence with the Jackson River to its headwaters. Pads Creek from its junction with routes 42 and 630 to its headwaters. North Creek from its confluence with Jennings Creek to its headwaters. Middle Creek from its confluence with Jennings Creek to its headwaters. Cornelius Creek from its confluence with Jennings Creek to its headwaters. Hypes Creek from route 696 to its headwaters.		

JAMES RIVER BASIN (UPPER) (cont.)

Section	Section Description	Class	Special Standards
12a	Sinking Creek from route 697 to its headwaters. Madison Creek from route 682 to its headwaters. Crab Run from its confluence with Bullpasture River to its headwaters. Davis Run from route 678 to its headwaters. Barbours Creek from the junction of routes 611 and 617 to its headwaters. Cove Creek from its confluence with Craig Creek to its headwaters. Lick Branch from its confluence with Craig Creek to its headwaters. Broad Run from its junction with routes 311 and 618 to its headwaters. Elk Creek from route 799 to its headwaters (1.5 miles) Brattons Run from its confluence with the Maury River to its headwaters. Guys Run from its confluence with the Maury River to its headwaters (3.6 miles). Maury River and its tributaries, unless otherwise designated, from U. S. Route 60 Bridge to its confluence with the Little Calfpasture River. <u>Trout Waters in Section 12a:</u> <u>Put and Take:</u> Hays Creek from its confluence with the Maury River to Brownsburg (9.5 miles). Irish Creek from its confluence with the South River to its headwaters (along route 603 - 9 miles). Natural: Big Mary's Creek from its confluence with the South River to its headwaters. Laurel Run from its confluence with the Maury River to its headwaters (2 miles). Mill Creek from its confluence with the Maury River to its headwaters.	IV B V B VI B	

JAMES RIVER BASIN (UPPER) (cont.)

Section	Section Description	Class	Special Standards
12b	Maury River and its tributaries from Lexington's raw water intake to a point 5 miles upstream.	IV A	Public Water Supply
12c	Black Run from Craigsville's raw water intake to its headwaters.	IV A	Public Water Supply
12d	Moores Creek located on Brushy Mountain.	IV A	Public Water Supply
12e	Cowpasture River from the Allegheny-Botetourt County line upstream to U. S. Route 60 bridge.	IV B	Public Water Supply
12f	Smith Creek and Clifton Forge Reservoir from Clifton Forge's raw water intake to their headwaters.	IV A	Public Water Supply
	<u>Trout Waters in Section 12f:</u>		
	Natural;		
	Smith Creek from 4 miles north of Clifton Forge Route 606 to its headwaters.	VI A	Public Water Supply
12g	Mill Branch located on Horse Mountain.	IV A	Public Water Supply
12h	Potts Creek and its tributaries from Hercules Incorporated's raw water intake to a point 5 miles upstream.	IV A	Public Water Supply
12i	Dunlop Creek and its tributaries from the Covington Boys' Home's raw water intake to a point 5 miles upstream.	IV A	Public Water Supply
12j	Jackson River and its tributaries from Covington's raw water intake to a point 5 miles upstream.	IV A	Public Water Supply
12k	Roaring Run above Clearwater Park's raw water intake to its headwaters.	IV A	Public Water Supply
12l	Unnamed tributary to the James River from Glen Wilton's raw water intake to its headwaters.	IV A	Public Water Supply
12m	Unnamed tributary to the James River from Eagle Rock's raw water intake to its headwaters.	IV A	Public Water Supply

Water Quality Standards Summary

Section 6M


Chesapeake Bay and Atlantic Ocean

Chesapeake Bay

and


Atlantic Ocean

DWG 6M

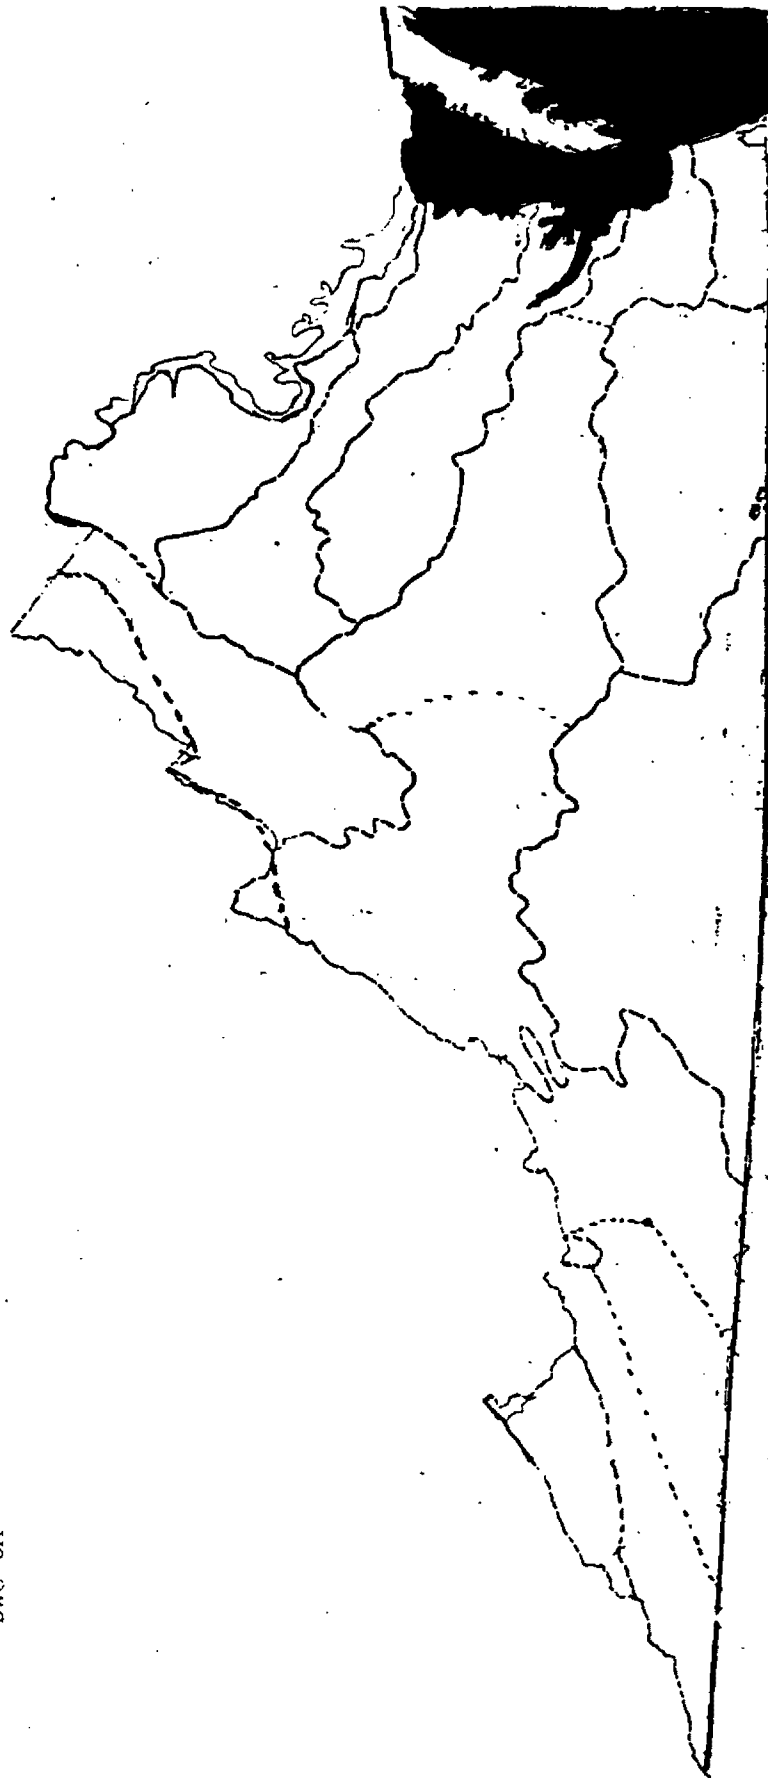


CHESAPEAKE BAY - ATLANTIC OCEAN
BASIN DWG-6M-A


DWG-6M-A

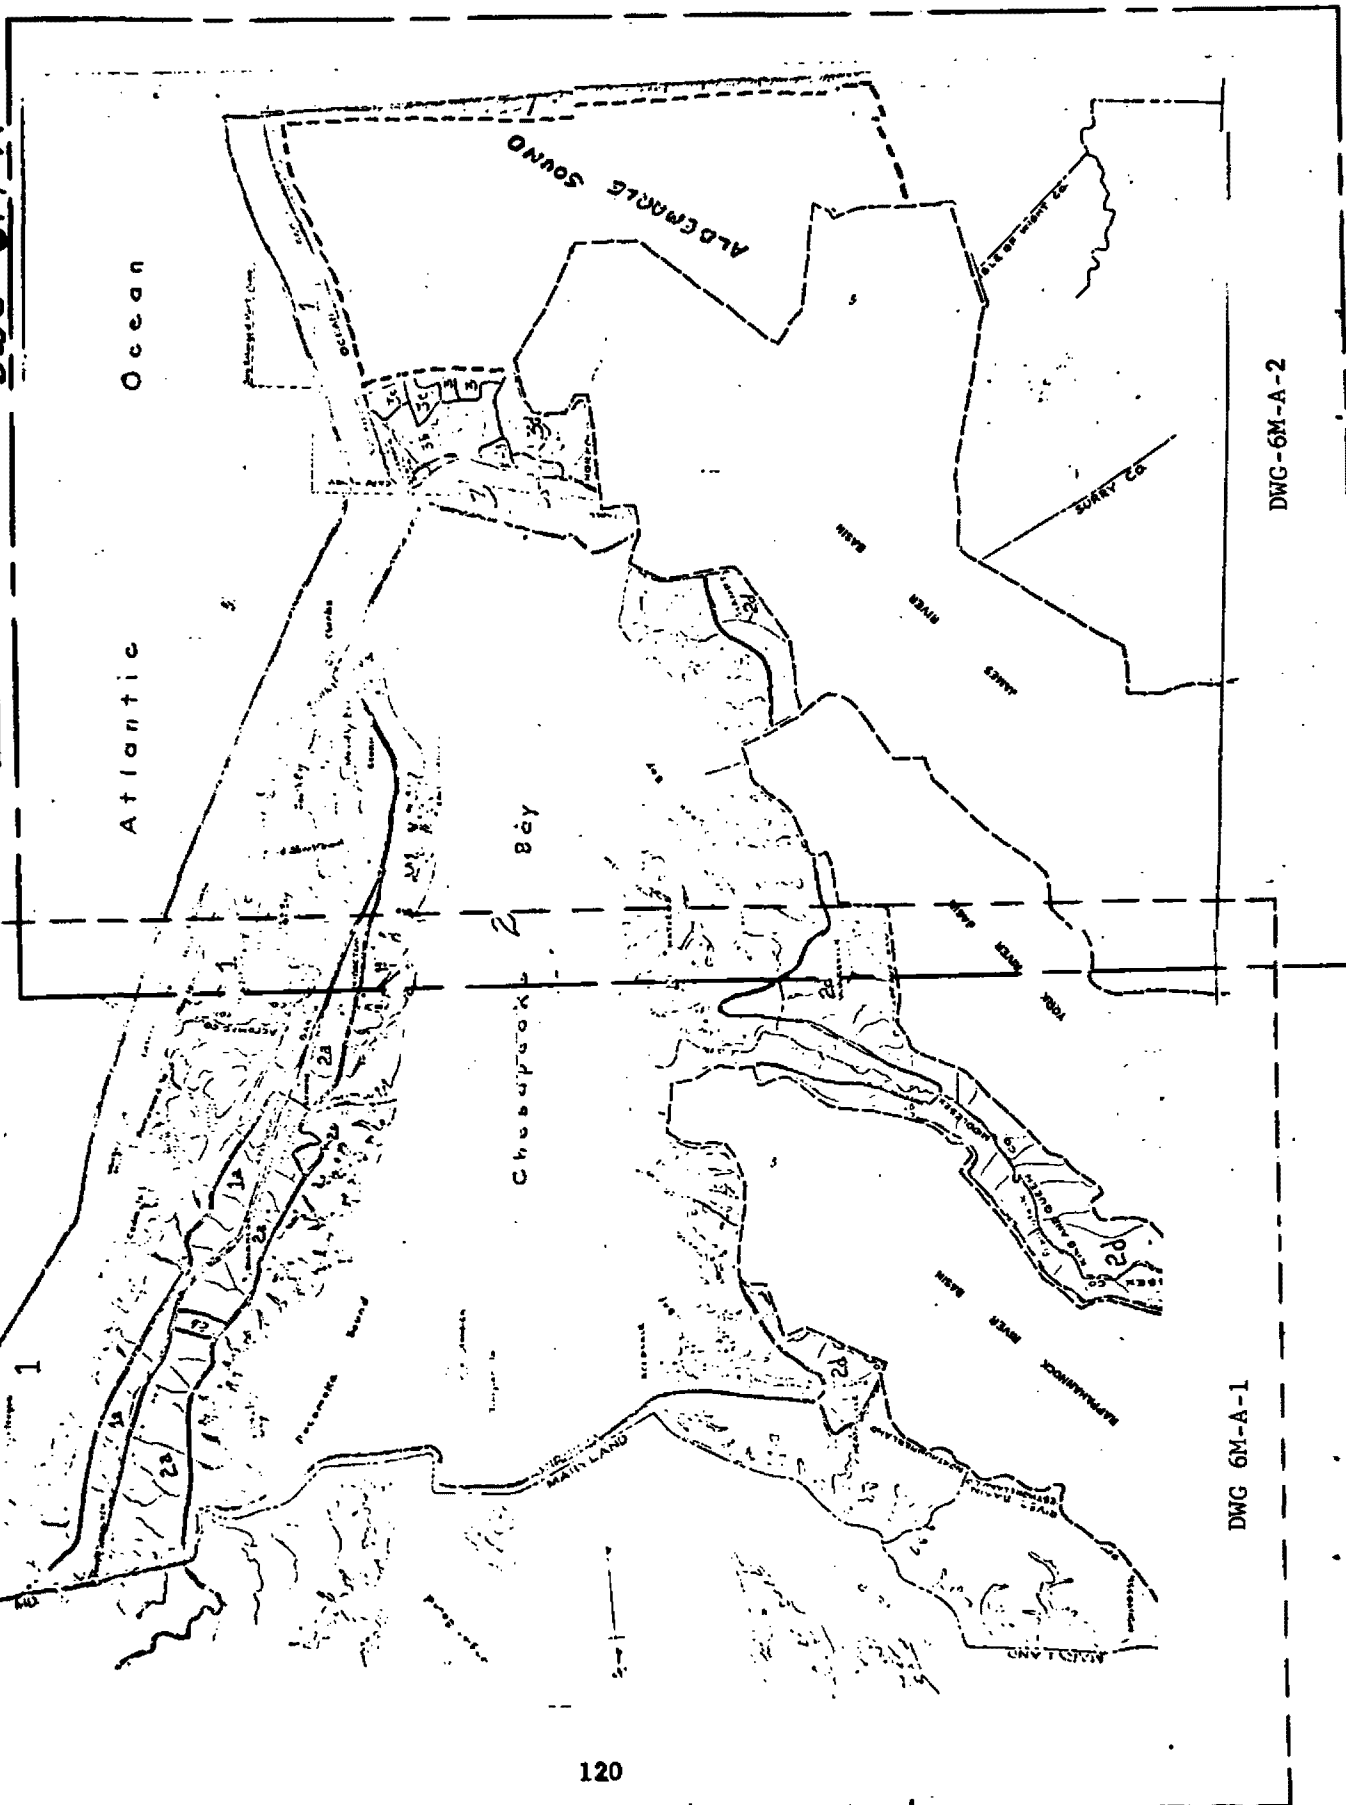

Atlantic

Ocean

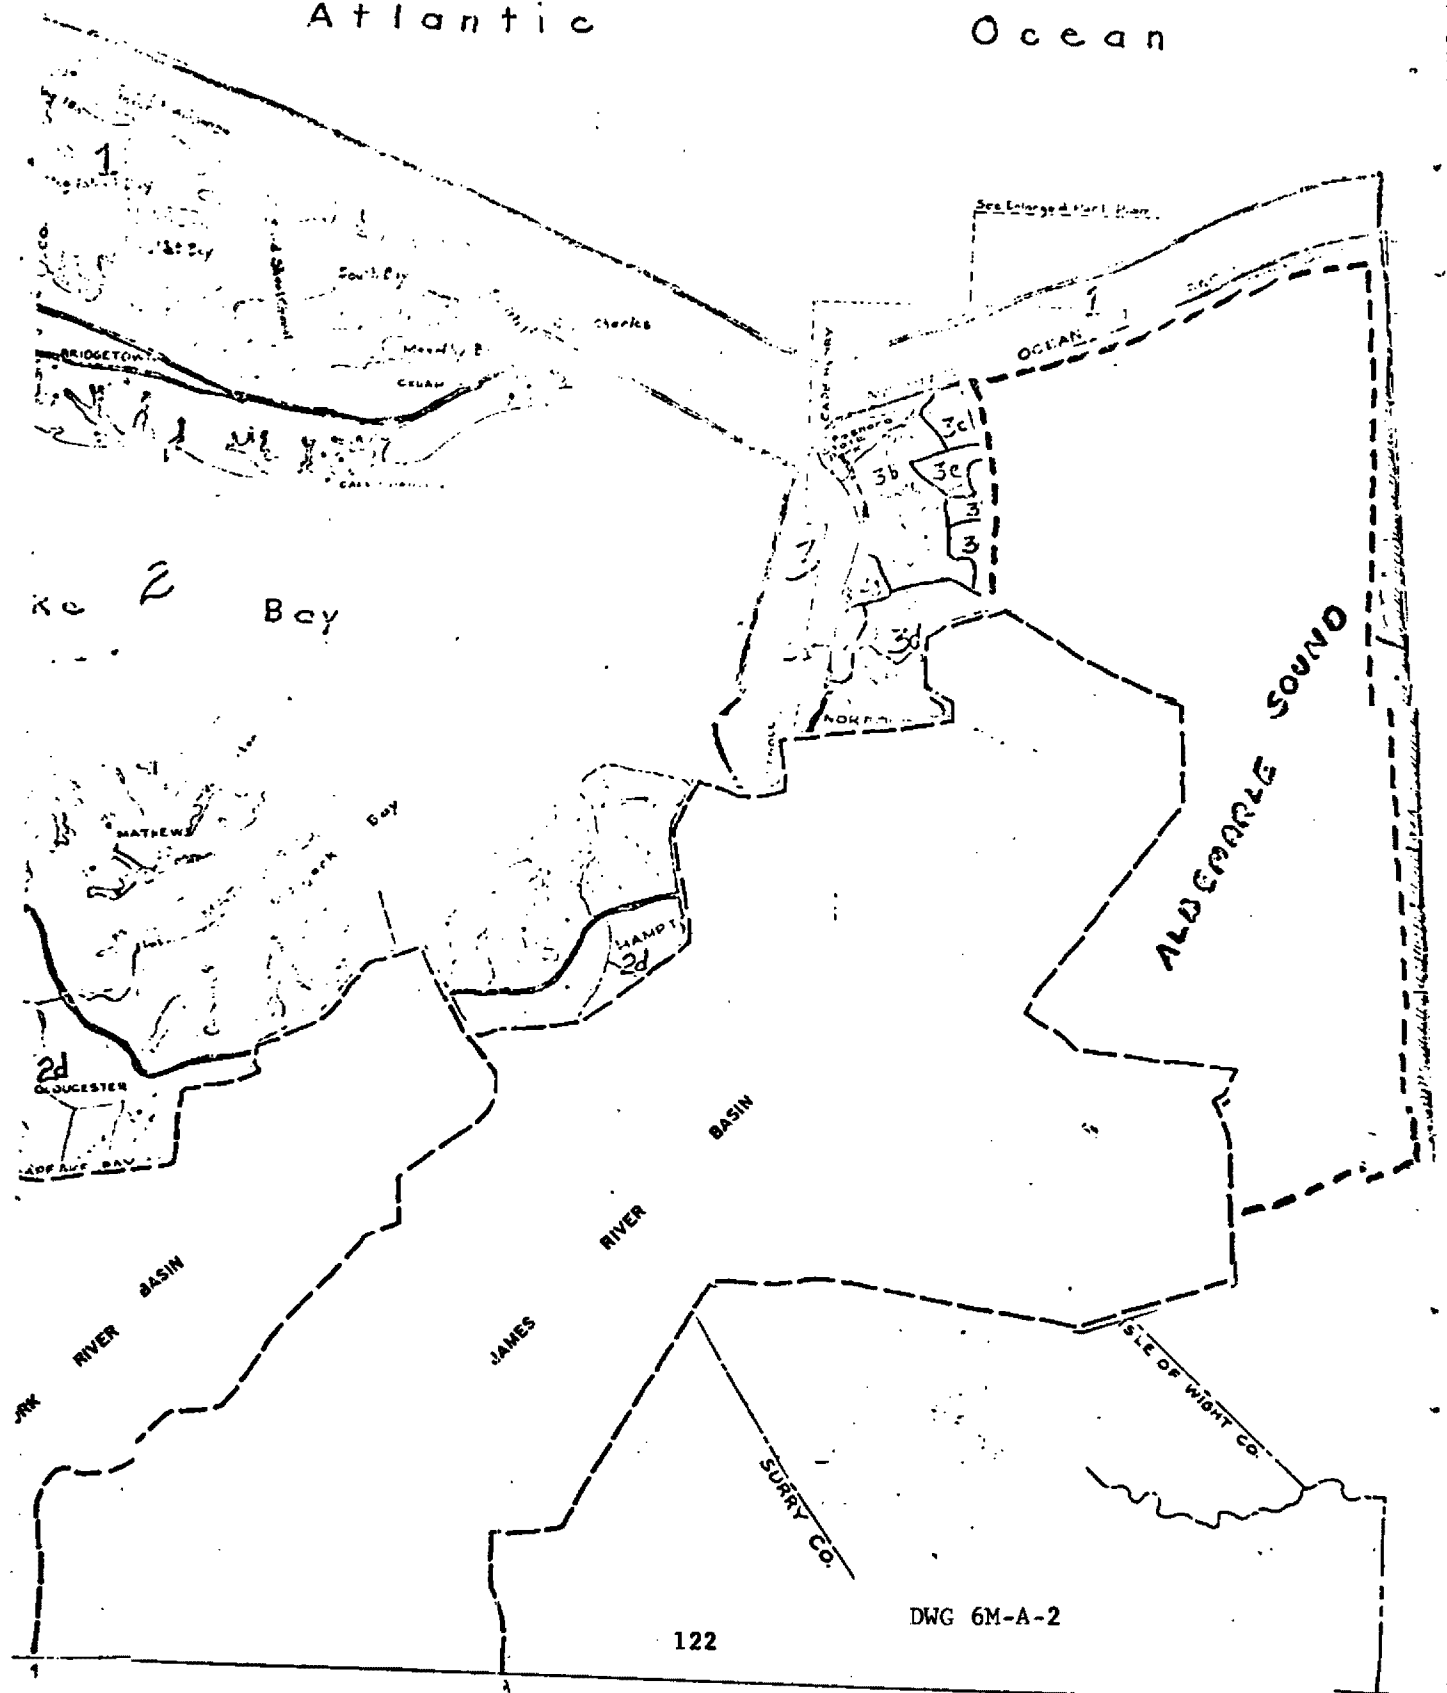

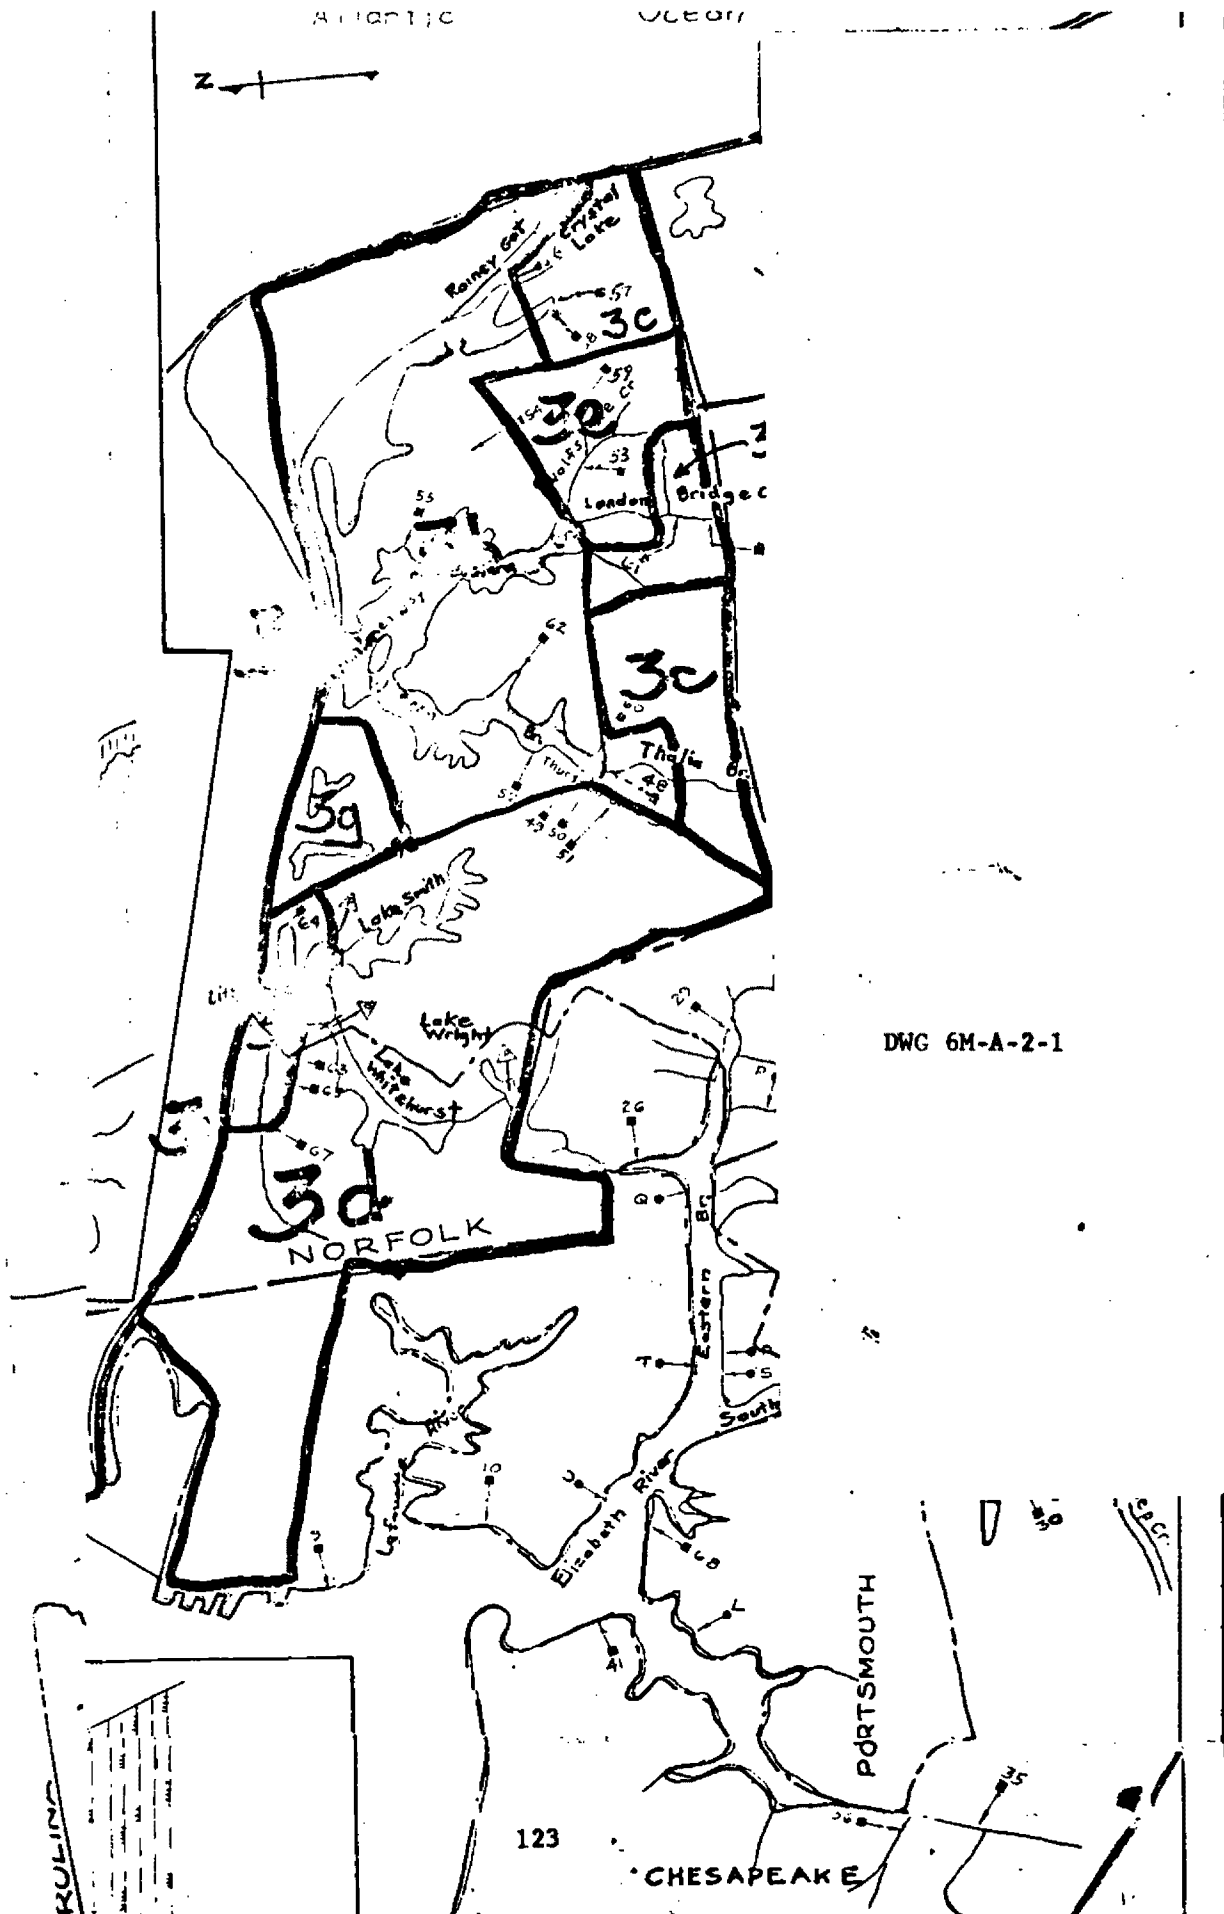


CHESAPEAKE BAY AND ATLANTIC OCEAN

Section	Section Description	Class	Special Standards
1	The Atlantic Ocean and its tidal tributaries from Cape Henry Light (Latitude 36° 55.6' North; Longitude 76° 00.4' West) east to the three-mile limit and south to the North Carolina state line. The Atlantic Ocean and its tidal tributaries from Cape Henry Light to Thimble Shoal Channel (Latitude 36° 57.30' North; Longitude 76° 02.30' West) from Thimble Shoal Channel to Cape Charles (Latitude 37° 07.4' North; Longitude 75° 54.4' West) east of the eastwest divide boundary on the Eastern Shore of Virginia to the three-mile limit and north to the Virginia-Maryland state line.	I B	a
1a	All free flowing portions of the stream, creeks and coves in Section 1.	III B	
2	Chesapeake Bay and its tidal tributaries from Thimble Shoal Channel (Longitude 76° 10' West to Cape Charles; Latitude 37° 07.4' North), and north to Virginia-Maryland state line west of the eastwest divide boundary on the Eastern Shore of Virginia and from Thimble Shoal Channel west to longitude 76° 10' West and North to Virginia-Maryland state line.	II B	a
2a	Free flowing portions of streams lying on the Eastern Shore of Virginia west of the eastwest divide boundary, unless otherwise designated.	III B	
2b	Drummond's Mill Pond including Coard's Branch.	III B	b
2c	The Virginia Department of Agriculture experimental station pond and its tributaries.	III B	b
2d	The free flowing streams tributary to the western portion of Chesapeake Bay lying between the Virginia-Maryland state line and Old Point Comfort.	III B	
3	Chesapeake Bay from Old Point Comfort Tower (Latitude 37° 00' North; Longitude 76° 18.8' West) to Thimble Shoal Light (Latitude 37° 00.9' North; Longitude 76° 14.4' West) along the south side of Thimble Shoal Channel to Cape Henry Light (Latitude 36° 55.6' North; Longitude 76° 00.4' West).	II B	a

CHESAPEAKE BAY AND ATLANTIC OCEAN (cont.)

Section	Section Description	Class	Special Standards
3a	Little Creek from its confluence with Chesapeake Bay (Lynnhaven Roads) to end of navigable waters.	II B	a
3b	Tidal portions of Lynnhaven watershed from its confluence with the Chesapeake Bay (Lynnhaven Roads) to and including Lynnhaven Bay; Western Branch Lynnhaven River; Eastern Branch Lynnhaven River; Long Creek, Broad Bay and Linkhorn Bay. Thaila Creek and its tributaries to the end of tidal waters. Great Neck Creek and Little Neck Creek from their confluence with Linkhorn Bay and their tidal tributaries. Rainey Cut and Crystal Lake from their confluence with Linkhorn Bay.	II B	a, h, i
3c	Free flowing portions of streams in Section 3b, unless otherwise designated.	III B	h, i
3d	Impoundments on Little Creek watershed.	III B	b, Public Water Supply
3e	London Bridge Creek from its confluence with the Eastern Branch of Lynnhaven River to the end of tidal waters.	II B	h, i
	Wolfsnare Creek from its confluence with the Eastern Branch Lynnhaven River to its headwaters.		
3f	Free flowing portions of London Bridge Creek.	III B	h, i
3g	Lake Joyce and Lake Bradford.	III B	b, h


U.S. EPA Headquarters Library
 Mail code 3404T
 1200 Pennsylvania Avenue NW
 Washington, DC 20460
 202-566-0556




Water Quality Standards Summary

Section 6N

Yadkin River Basin



Yadkin River Basin
DWG 6N

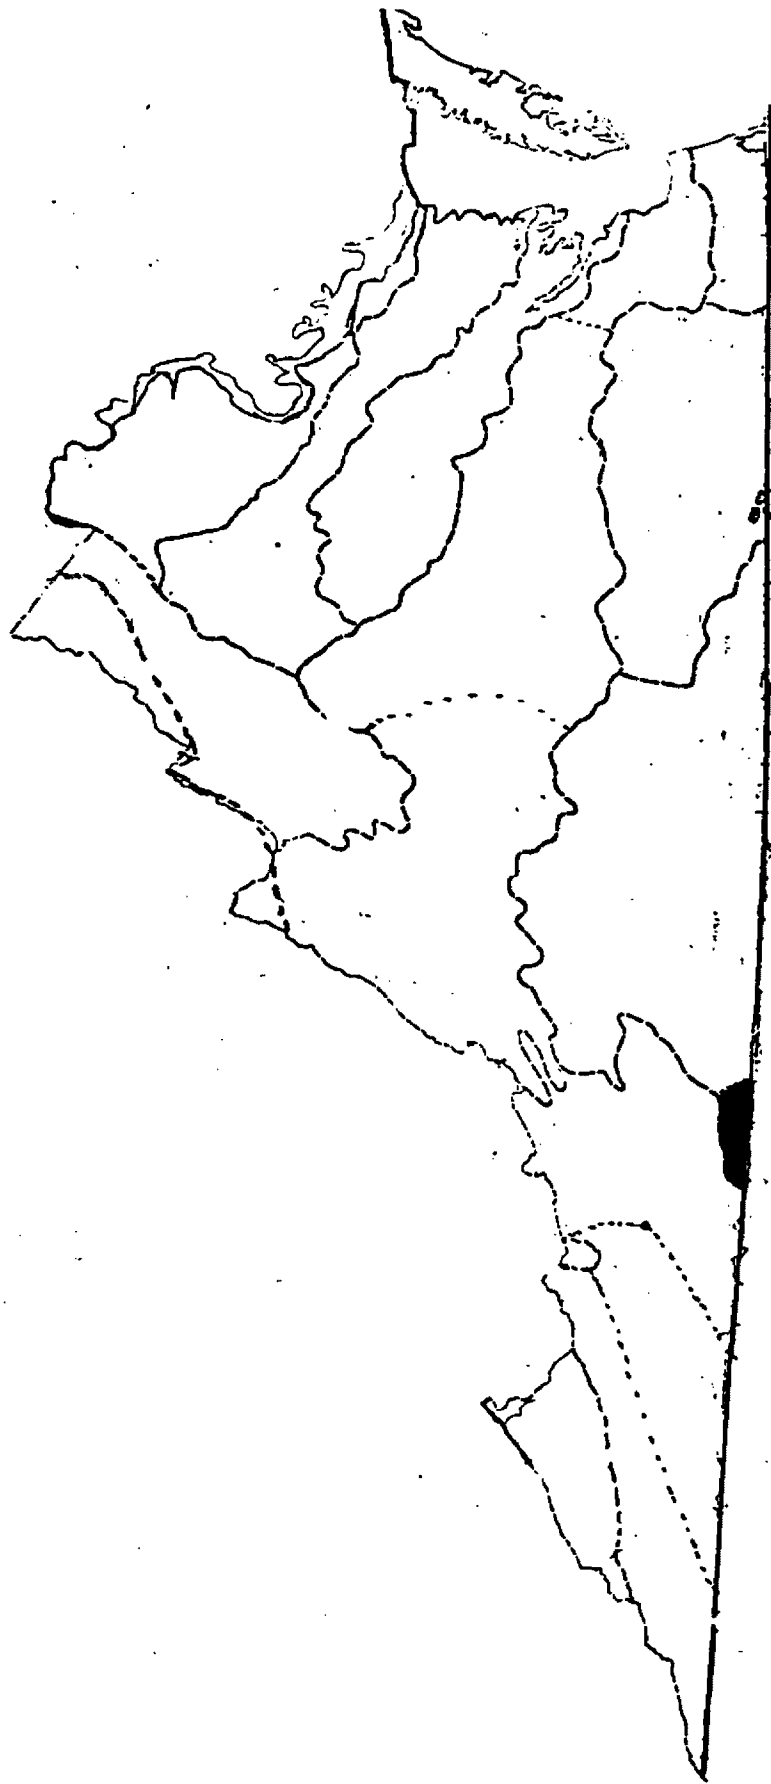

YADKIN RIVERS
MAY 28 1970
THE WATERS


For continuation of
see insert above

Yadkin River Basin

DWG 6N-A




Yadkin River
Basin

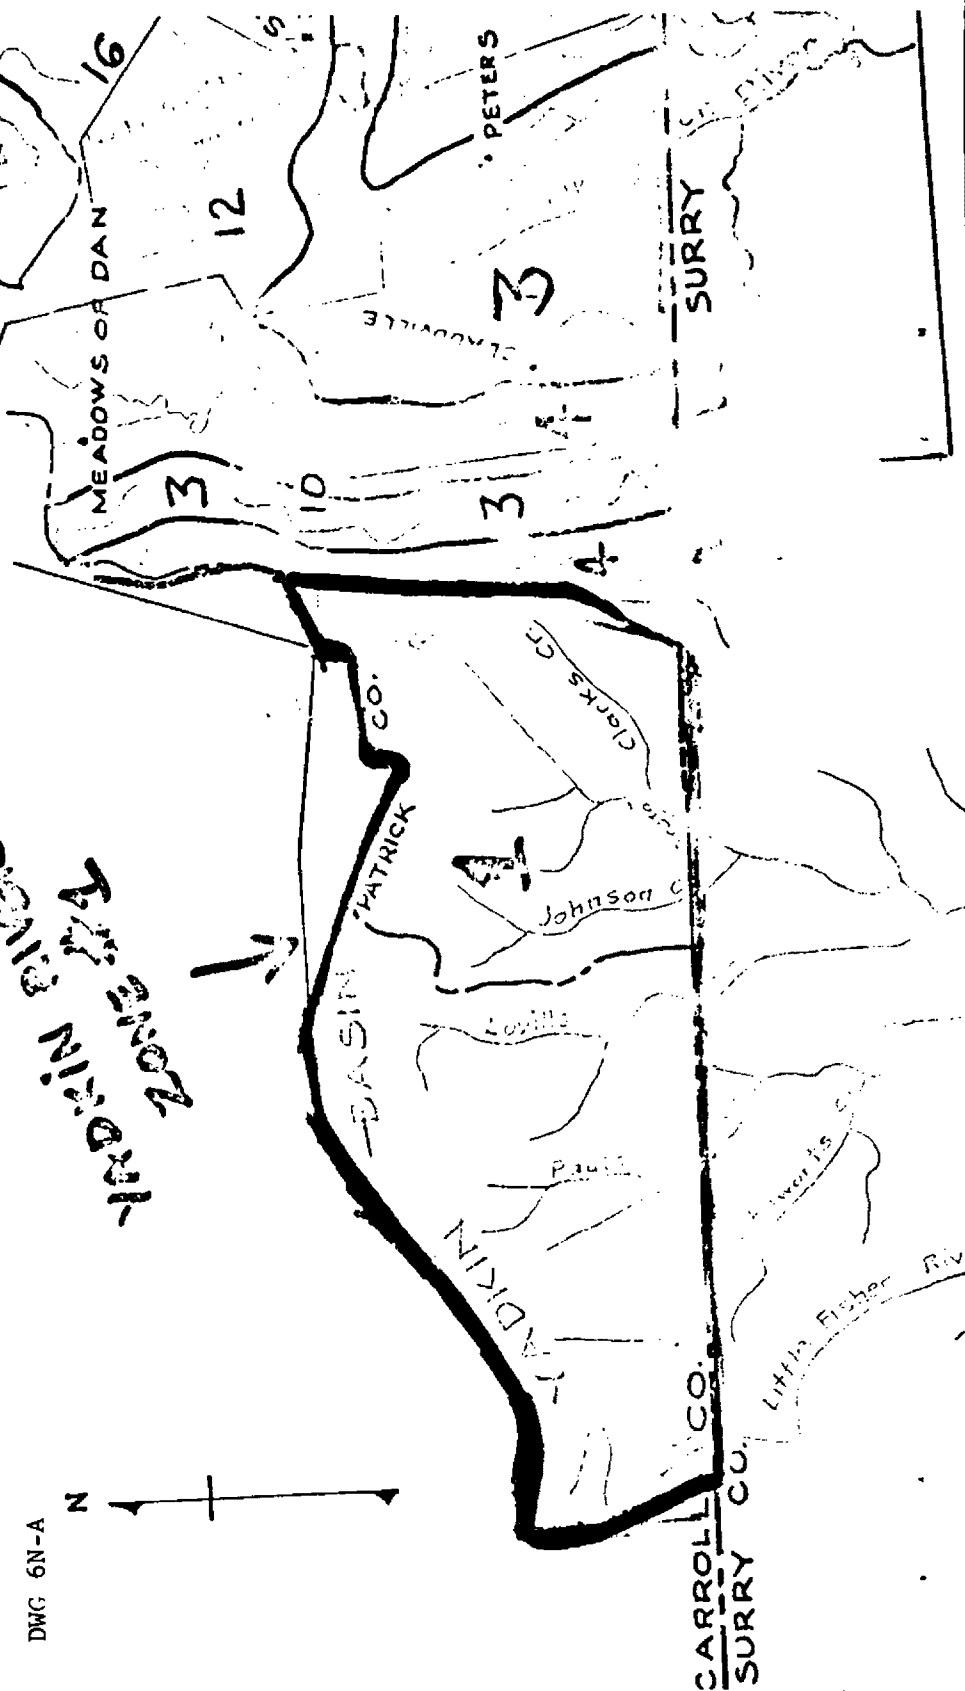

YADKIN RIVER


Section	Section Description	Class	Special Standards
1	Yadkin River Basin in Virginia including Ararat River, Johnson Creek, Little Fisher River, Lovills Creek, Paul's Creek and Stewarts Creek - the entire reach of these streams from the Virginia-North Carolina state line to their headwaters. <u>Trout Waters in Section 1:</u> Put and Take: Ararat River from route 823 upstream to route 671. Natural: Ararat River from route 671 upstream to its headwaters.	IV A V A VI A	Public Water Supply Public Water Supply Public Water Supply



Water Quality Standards Summary


Section 60

Albemarle Sound




Albemarle Sound

DWG 6-0

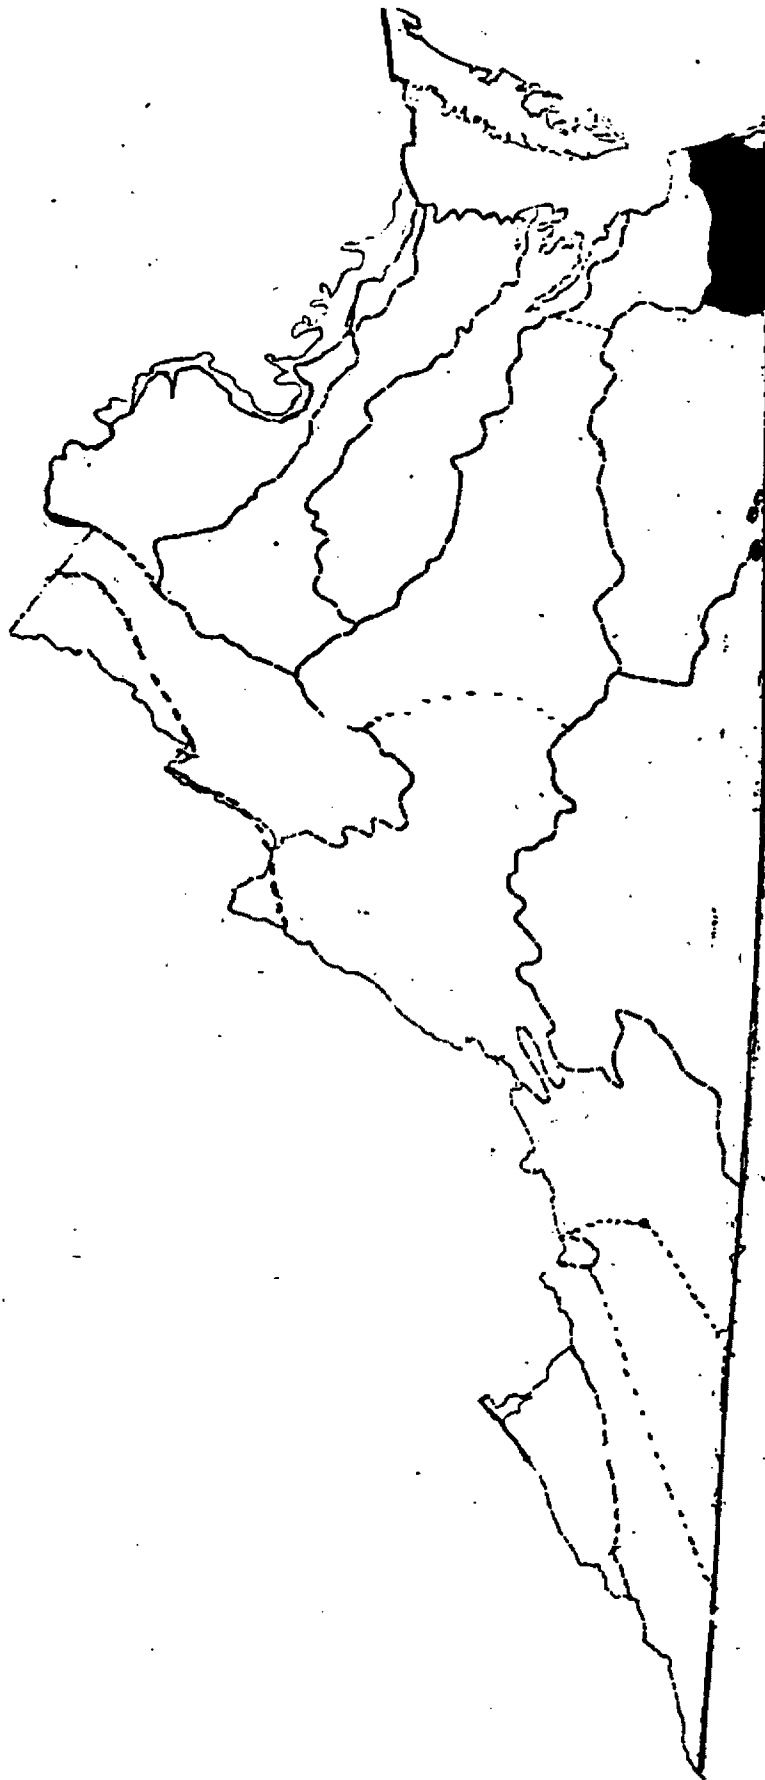


See Enlarged Part Plan.

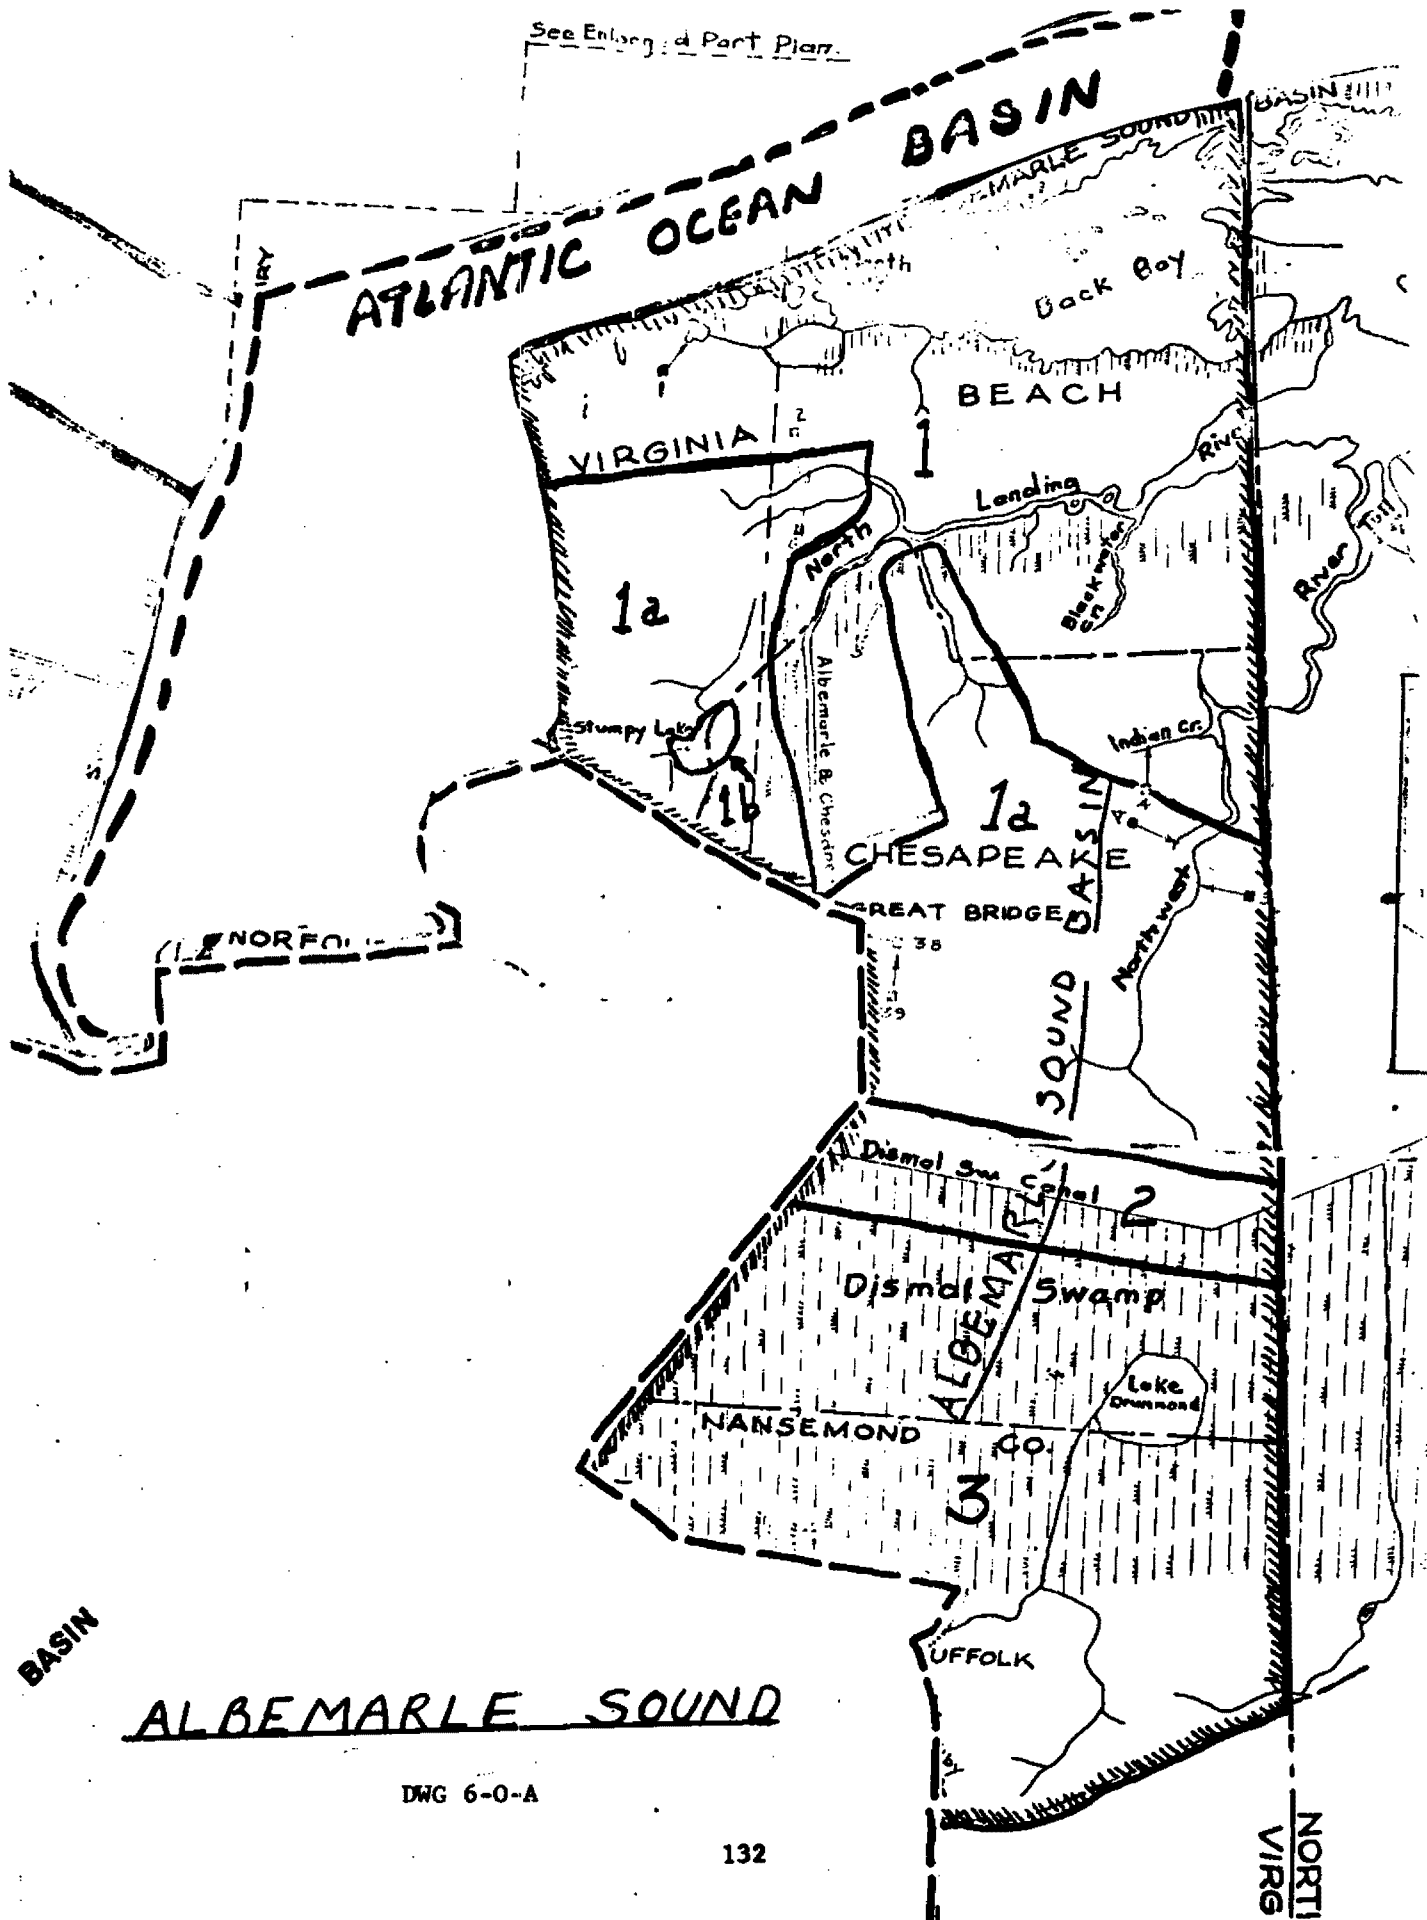

DWG 6-0-A

ALBEMARLE SOUND

Section	Section Description	Class	Special Standards
1	Back Bay and its tributaries in the City of Virginia Beach to the Virginia-North Carolina state line and the Northwest River and its tidal tributaries from the Virginia-North Carolina state line to the free flowing portion, and North Landing River and its tidal tributaries from the Virginia-North Carolina state line to the Great Bridge Lock.	II B	
1a	The free flowing portions of streams in Section 1 and tributaries of Stumpy Lake.	III A	
1b	Stumpy Lake.	III A	b
2	Intercoastal Waterway.	III B	
3	Lake Drummond including feeder ditches and all interstate tributaries of the Dismal Swamp between Virginia and North Carolina.	III B	



Water Quality Standards Summary

Section 6P

Potomac River Basin



DWG 6P-A-1


DWG 6P-A-2


DWG 6P-A

DWG 6P-A-3

Potomac River Basin


DWG 6P

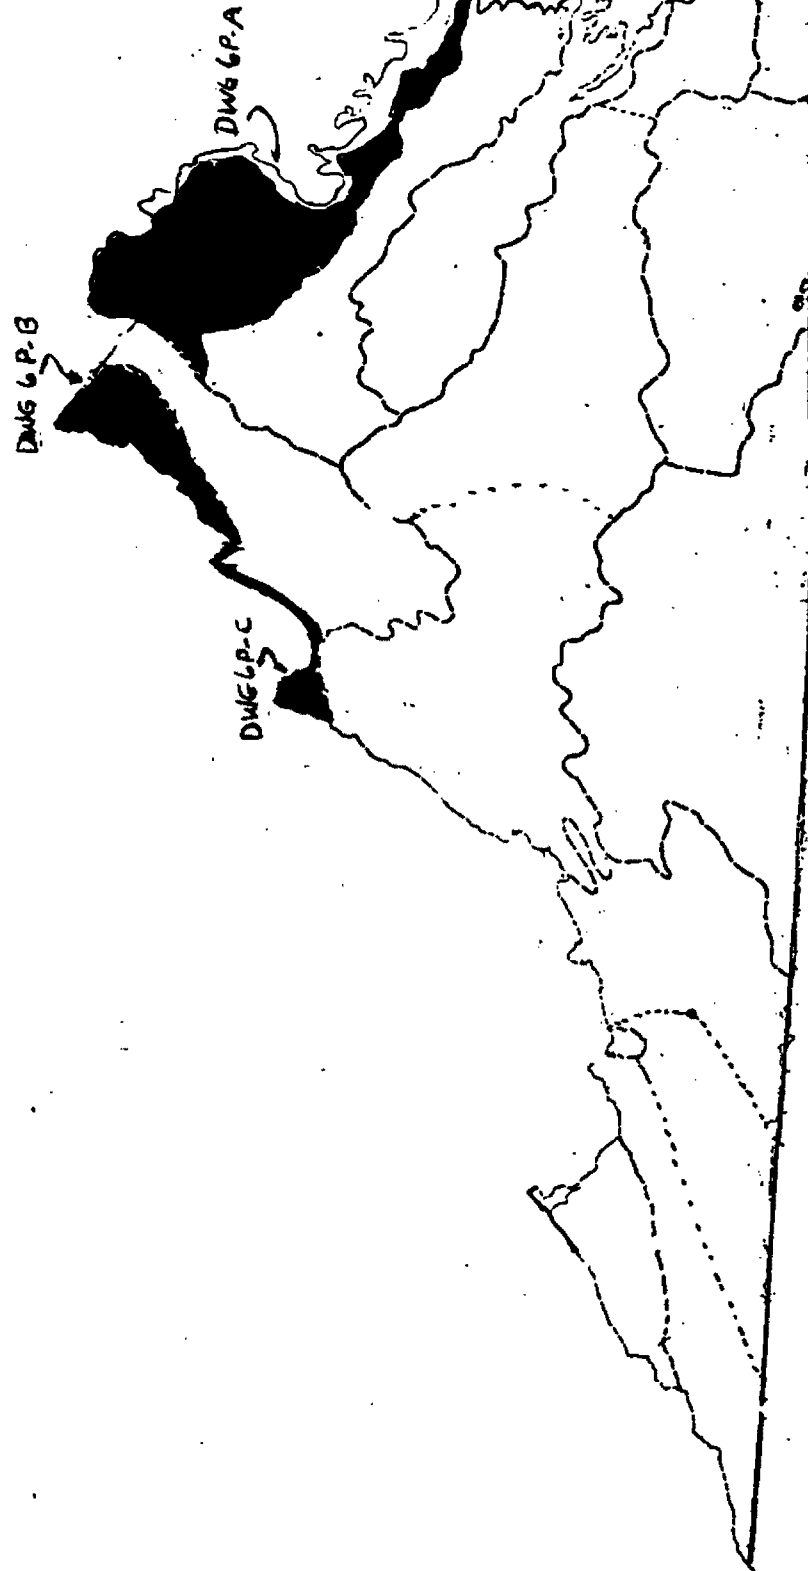

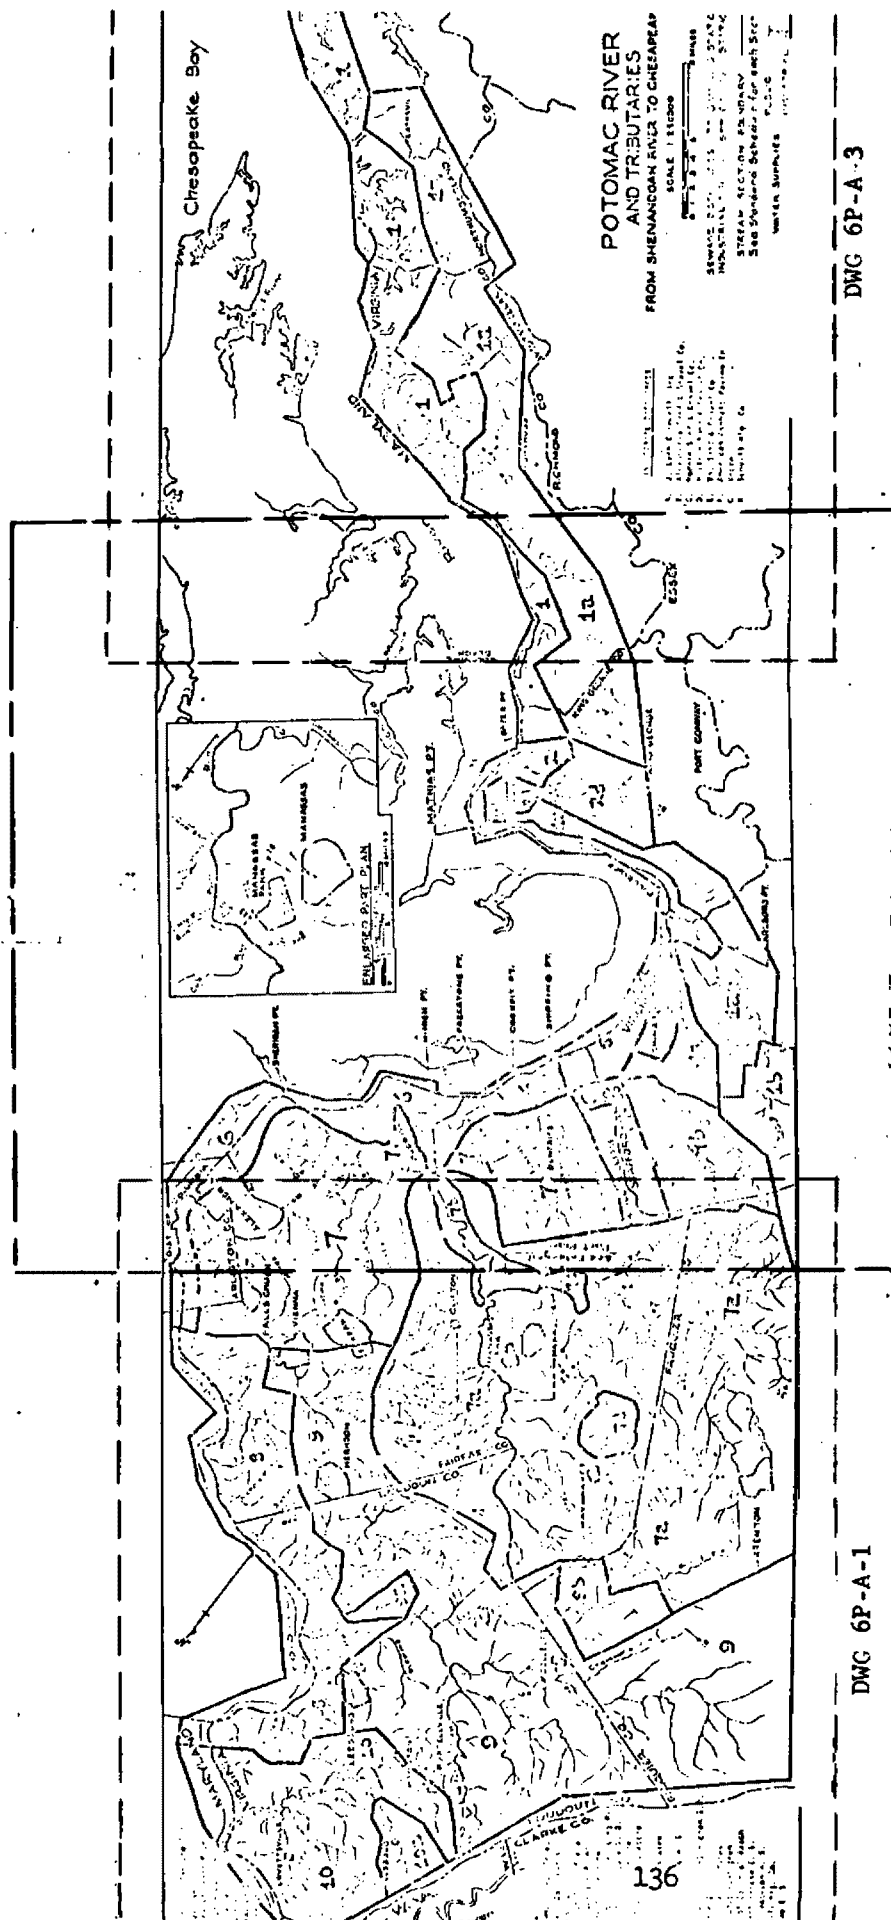


DWG 6P-A

POTOMAC RIVER BASIN

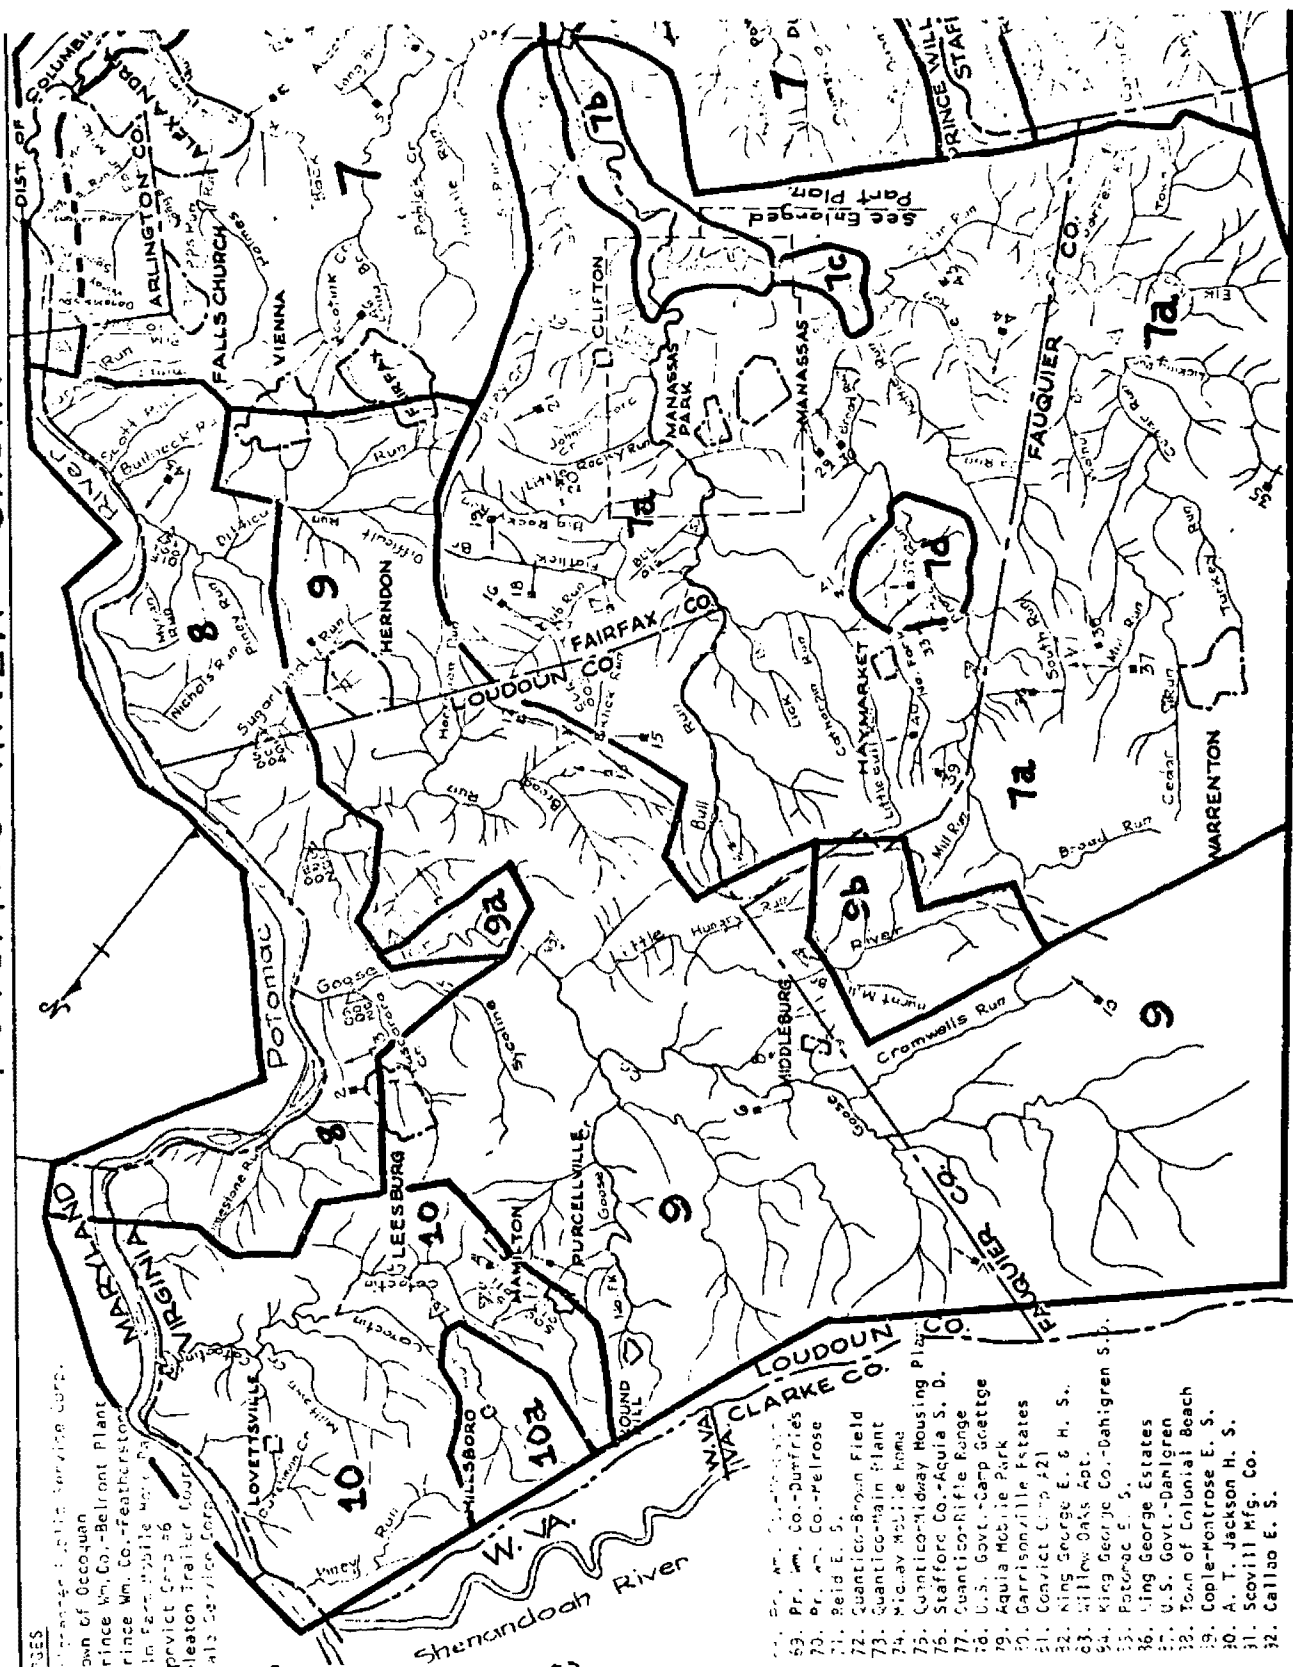


DWG 6P-A-1


POTOMAC RIVER BASIN

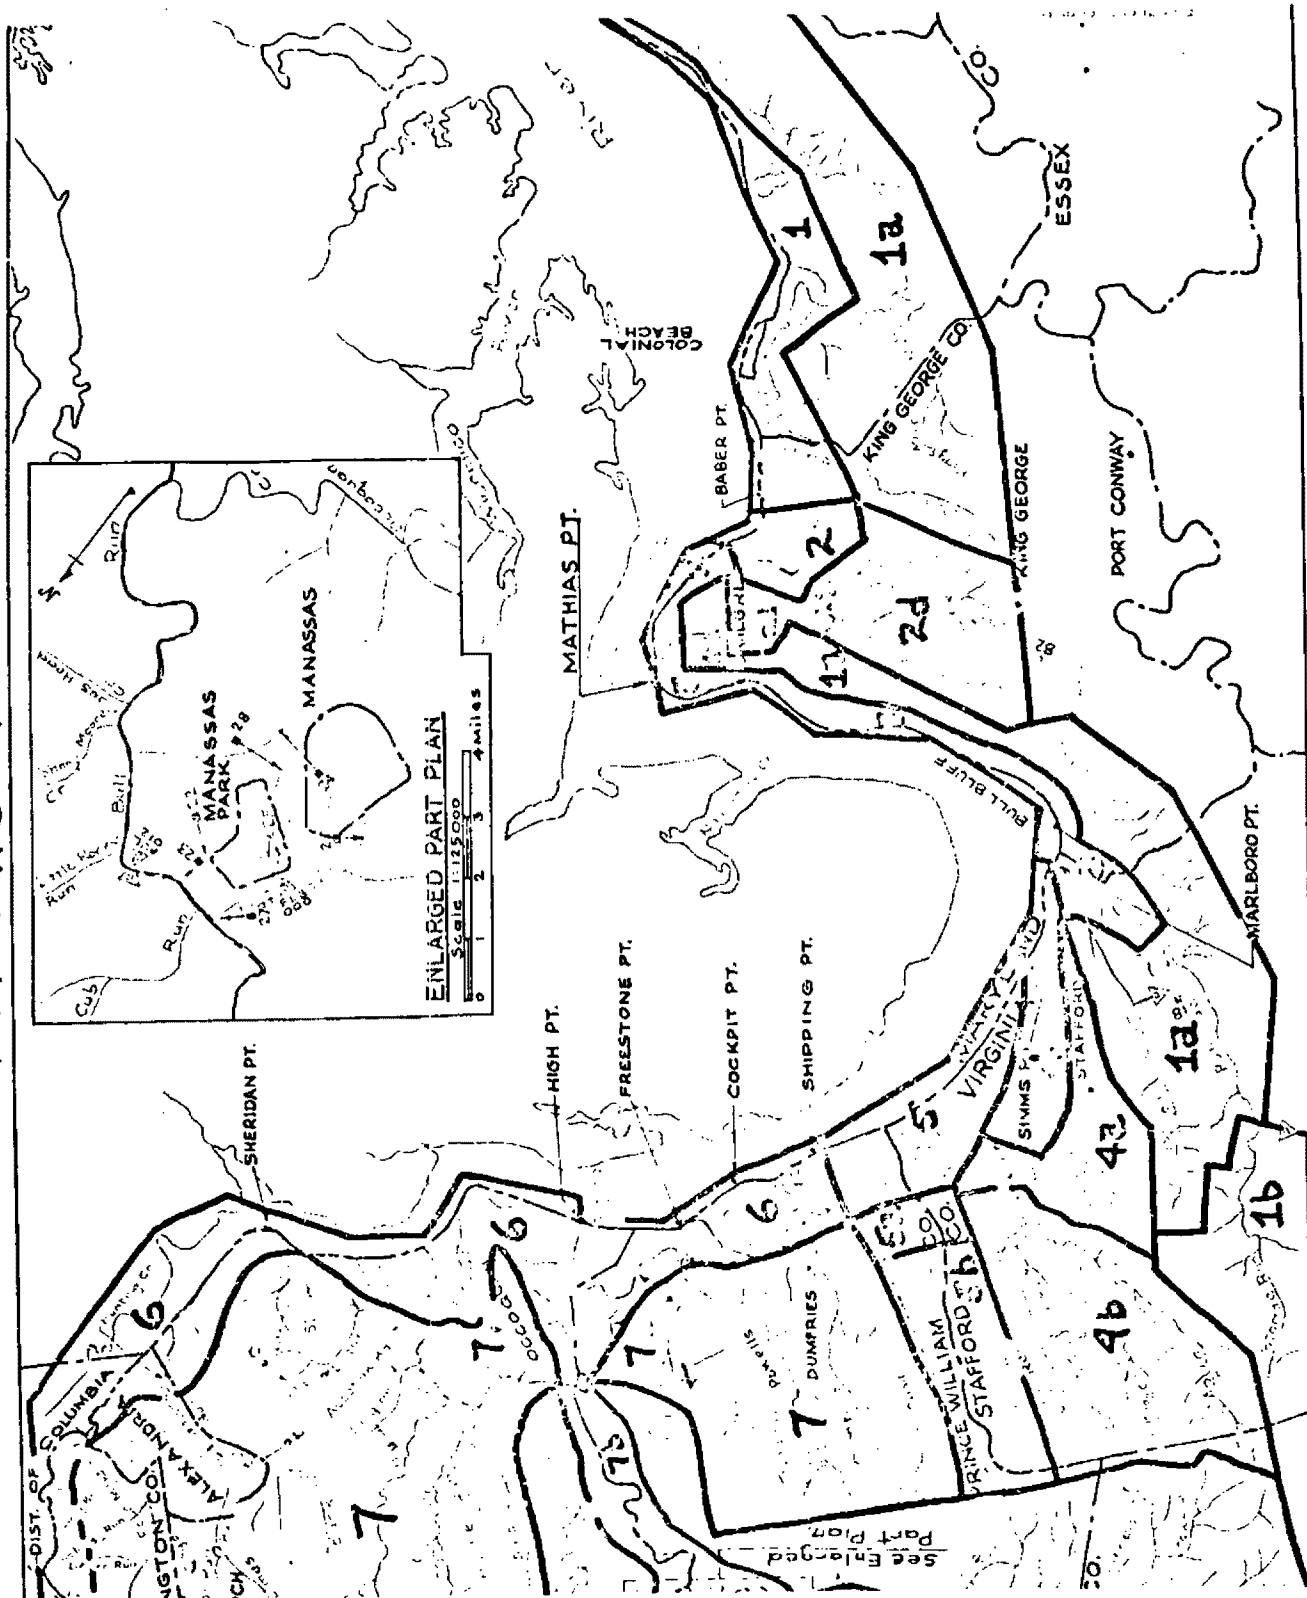

DWG 6P-A-2

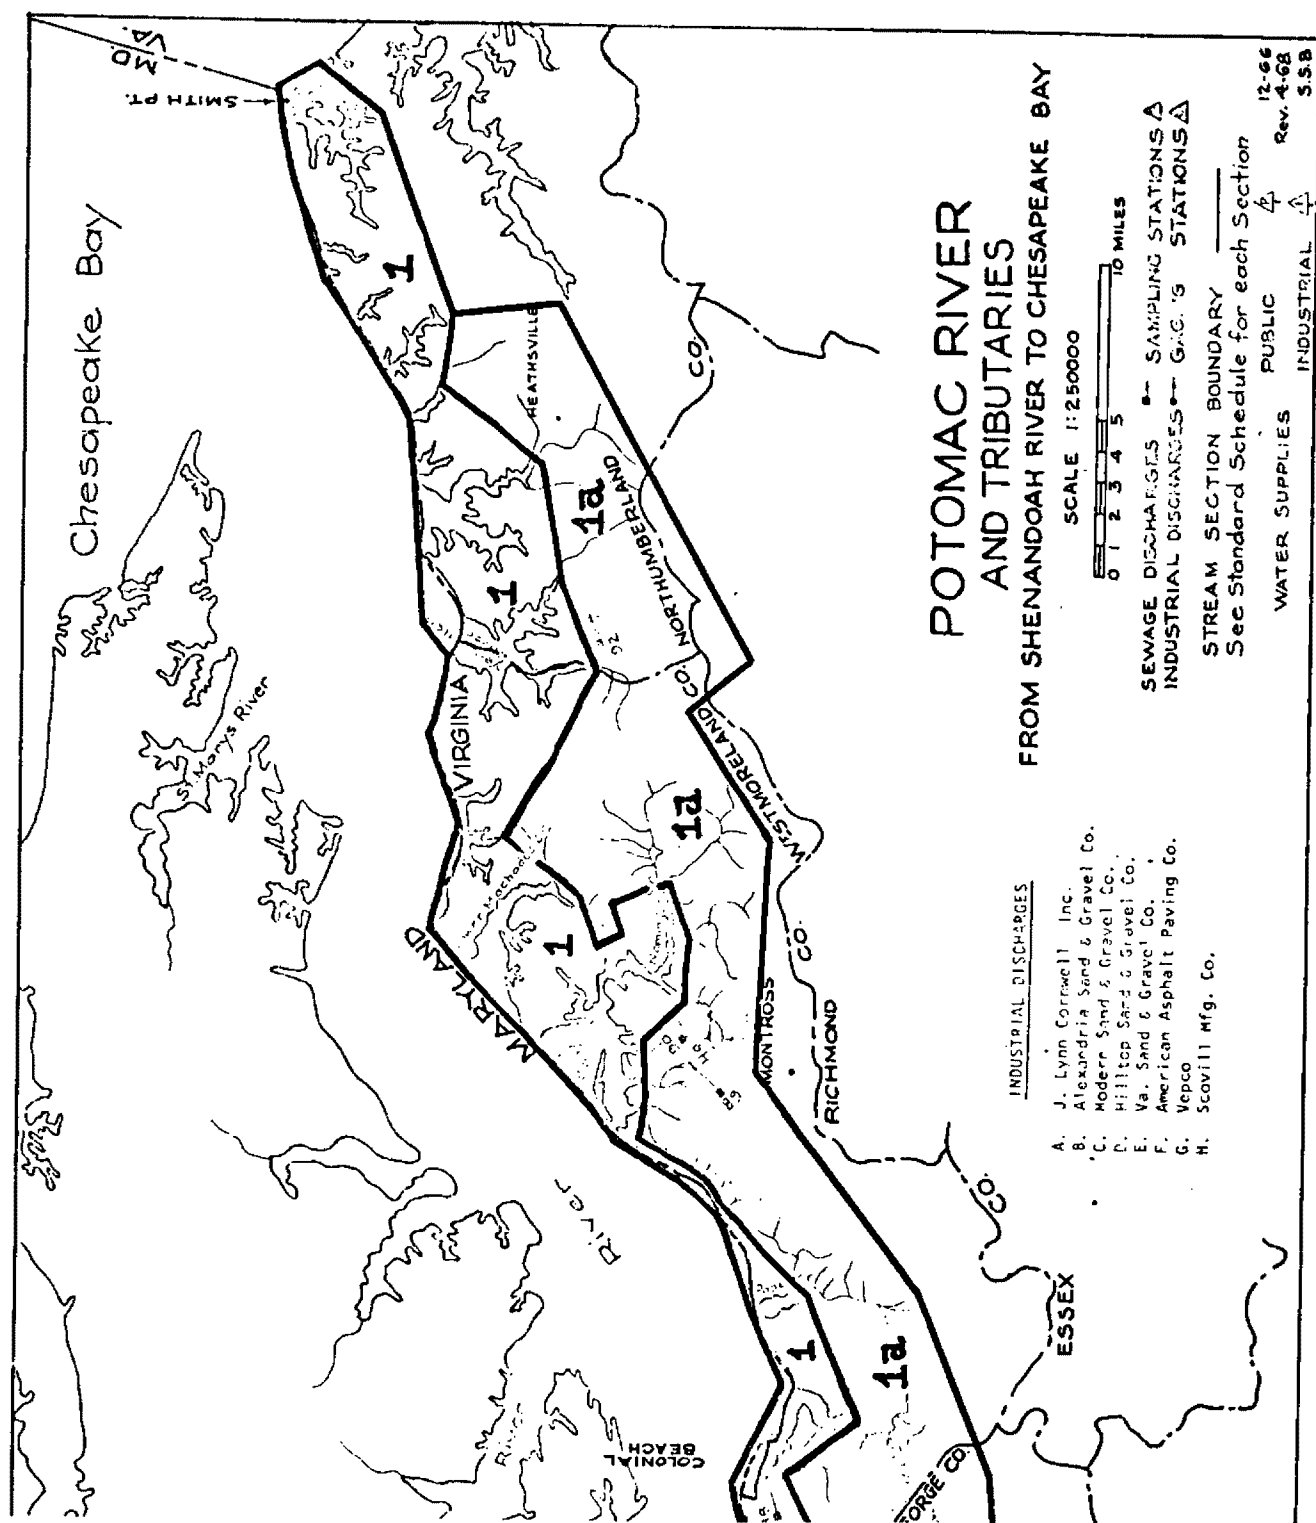


DWG 6P-B
Potomac River Tributaries

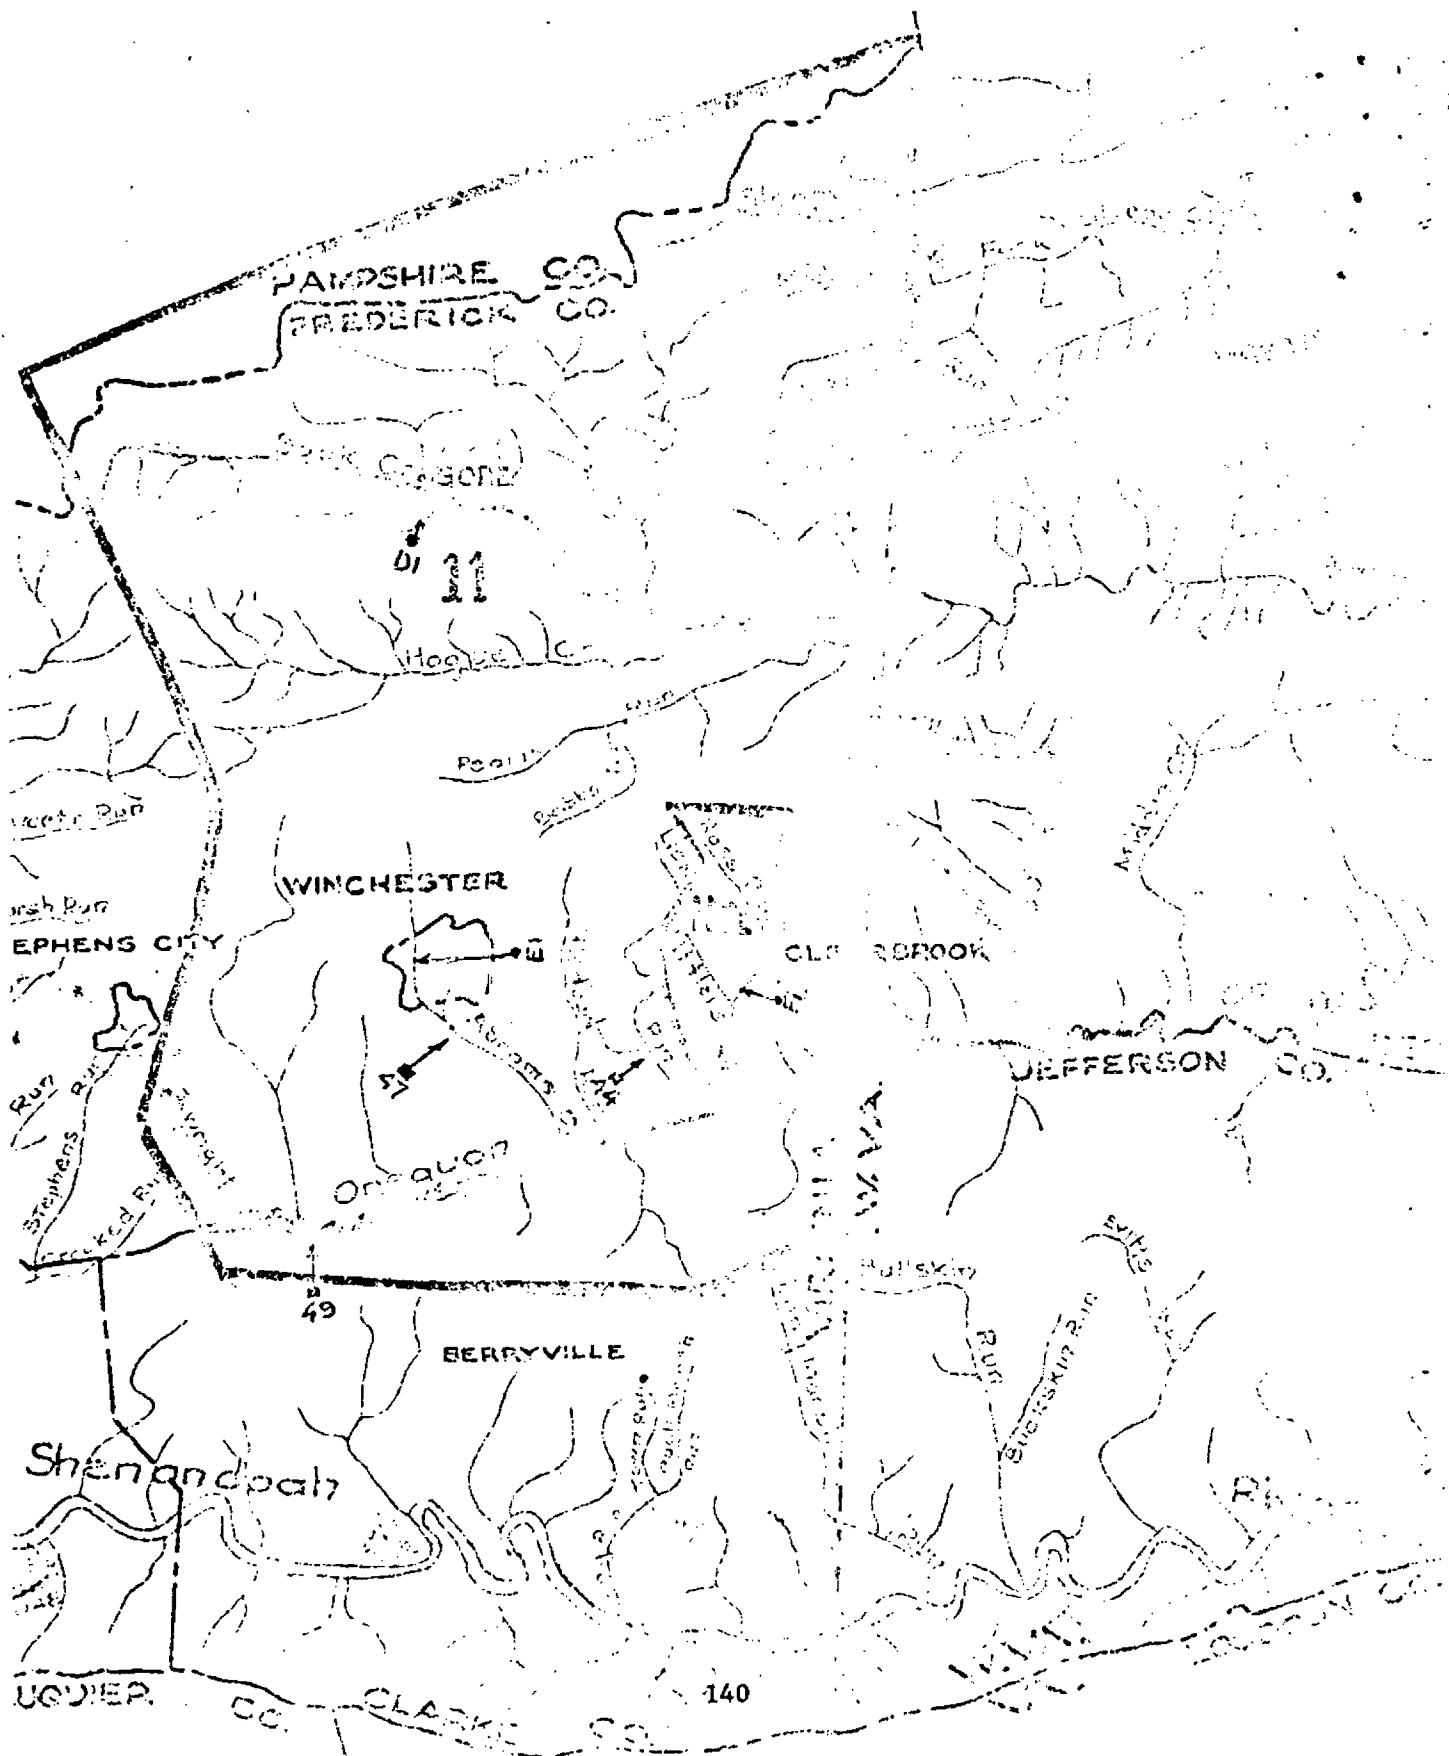

DWG 6P-C

South Branch Potomac River
and
North River

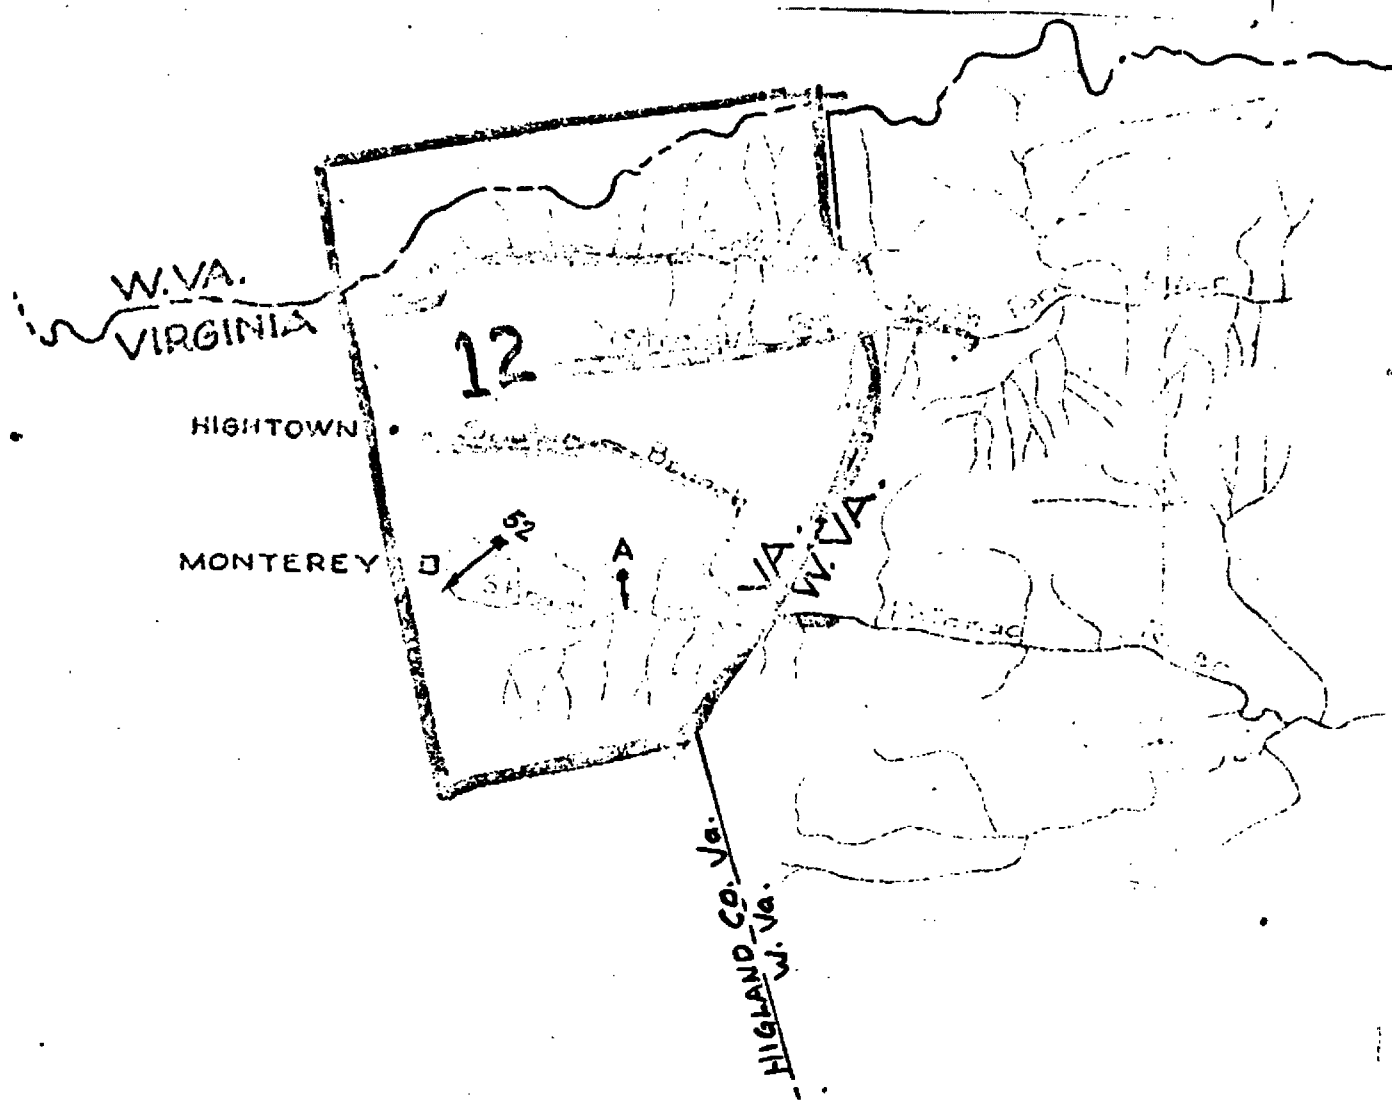

POTOMAC RIVER BASIN

Section	Section Description	Class	Special Standards
1	Tidal tributaries of the Potomac River from Smith Point to Upper Machodoc Creek.	II B	a
1a	All free flowing portions of tributaries to the Potomac River from Smith Point to, and including, Potomac Creek, unless otherwise designated.	III B	
1b	Potomac Creek and its tributaries from the proposed Stafford County water supply dam to its headwaters.	III B	Public Water Supply
2	Upper Machodoc Creek and the tidal portions of its tributaries.	II B	a, p
2a	Free flowing portions of those streams in Section 2.	III B	p
3	Tidal portions of the tributaries to the Potomac River from Upper Machodoc Creek to Marlboro Point.	II B	
4	Tidal portions of the Potomac River to include Aquia Creek and its tidal tributaries from Marlboro Point to Brent Point.	II B	q
4a	Free flowing portions of tributaries to the Potomac River in Section 4 up to the Aquia Sanitary District Water Impoundment.	III A	q
4b	Aquia Creek from the Aquia Sanitary District Water Impoundment and its tributaries to their headwaters.	III A	q
5	Tidal portion of tributaries to the Potomac River from Brent Point to Shipping Point, including tidal portions of Chopawamsic Creek and its tidal tributaries.	II A	Public Water Supply
5a	Free flowing portions of Chopawamsic Creek and its tributaries to Quantico Marine Base Water Supply Dam.	III B	
5b	Chopawamsic Creek and its tributaries above the Quantico Marine Base Water Supply Dam to their headwaters.	III B	b
6	Tidal portion of tributaries to the Potomac River from Shipping Point to Chain Bridge.	II B	Public Water Supply
7	Free flowing portions of tributaries to the Potomac River from Shipping Point to Chain Bridge, unless otherwise designated.	III B	


POTOMAC RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
7a	Occoquan Creek and its tributaries above Alexandria Water Company's water supply impoundment, unless otherwise designated.	III B	r
7b	The impounded waters of Occoquan Creek above the water supply dam of the Fairfax County Water Authority to backwater of the impoundment on Bull Run and Occoquan Creek (Lake Jackson).	III B	b, r Public Water Supply
7c	Broad Run above the proposed impoundment for the Town of Manassas upstream to a point five miles above the dam.	III B	b, r Public Water Supply
7d	The impounded waters of Lake Jackson in Broad Run and Cedar Run.	III B	b, r Public Water Supply
8	Tributaries to the Potomac River in Virginia between Chain Bridge and the Monacacy River from their confluence with the Potomac upstream 5 miles, to include Goose Creek to the City of Fairfax's raw water intake, unless otherwise designated.	III B	Public Water Supply
9	Broad Run, Sugarland Run, Difficult Run, Tuscarora Creek, Sycoline Creek and other streams in Section 8 from a point 5 miles above their confluence with the Potomac River to their headwaters, unless otherwise designated.	III B	Public Water Supply
9a	Little River from Middleburg's raw water intake to its headwaters.	III B	b Public Water Supply
9b	All the impounded water of Goose Creek and its tributaries from the City of Fairfax's raw water intake upstream to backwater.	III B	b Public Water Supply
10	Tributaries of the Potomac River from the Monacacy River to the West Virginia-Virginia state line in Loudoun County, from their confluence with the Potomac River upstream 5 miles, except that on the North Fork of Catoctin Creek the section will extend to the Town of Purcellville's raw water intake.	III A	Public Water Supply
10a	North Fork Catoctin Creek from Purcellville's raw water intake to its headwaters.	III A	
10b	South Fork Catoctin Creek from its confluence with the North Fork Catoctin Creek to its headwaters.	III A	

POTOMAC RIVER BASIN (cont.)

Section	Section Description	Class	Special Standards
11	Tributaries of the Potomac River in Frederick and Clarke Counties, Virginia, unless otherwise designated. <u>Trout Waters in Section 11:</u> Put and Take: Back Creek (upper) from Rock Enon 4 miles upstream. Back Creek (lower) from route 600 to mouth of Hogue Creek - 2.0 miles. Hogue Creek from route 679 upstream 6.0 miles to the Forks below route 612.	IV A	pH shall be 6.5-9.5
11a	Hot Run and its tributaries from its confluence with Opequon Creek to its headwaters.	V A	pH shall be 6.5-9.5
12	South Branch of the Potomac River and its tributaries, such as Strait Creek, and the North Fork River and its tributaries from the Virginia-West Virginia state line to their headwaters.	IV A	d pH shall be 6.5-9.5
		IV A	pH shall be 6.5-9.5

IMPLEMENTATION PLAN
FOR
INTERSTATE WATERS
OF THE
COMMONWEALTH OF VIRGINIA



IMPLEMENTATION PLAN

The "action" plan of the standards is the plan of implementation and enforcement. This plan sets forth requirements for treatment and/or control of all conventional municipal and industrial waste discharges in the Commonwealth which affect interstate waters, specifies the time within which this is to be accomplished, and contains programs for dealing with other water pollution control programs. Section 62.1-44.15(14) of the State Water Control Law is "To establish requirements for the treatment of sewage, industrial wastes and other wastes that are consistent with the purposes of this chapter; provided, however, that no treatment will be less than secondary or its equivalent, unless the owners can demonstrate that a lesser degree of treatment is consistent with the purposes of this chapter." With the exception of those owners granted variance in their time schedules because of unusual technical or economical problems, it is the intention of the Commonwealth of Virginia State Water Control Board to take such action as will result in compliance with standards by July 1, 1972. Information on the requirements for any particular discharger may be obtained from the Commonwealth of Virginia State Water Control Board, P. O. Box 1143, Richmond, Virginia, 23230.

Agricultural Waste Waters and Land Erosion

There is no known significant problem with agricultural waste waters throughout the State of Virginia. Land erosion is generally insignificant except in localized areas such as in Northern Virginia where large subdivision developments are in progress. These problems are generally controlled by local government.

There are high MPN counts in the Shenandoah River believed to result from surface runoff of animal waste products.

Waste From Marinas and Vessels

Waste discharges from marinas and vessels are considered to be minimal in the State except in the Lower James River and Hampton Roads area. Localized problems exist from activity generated at some large marinas, but not as a result of direct discharges from the marinas. The main boat pollution problem is associated with the waste discharges from large commercial and governmental vessels in the Hampton Roads area.

The Water Control Board has authority from the General Assembly to adopt and promulgate regulations for the purpose of controlling the discharge of sewage and other wastes from boats and vessels operation upon

the waters of this State. The problem is under study and conferences have been held with other agencies of the State in regard to developing appropriate boat pollution regulations in the near future.

Combined Sewer Overflows

There are several cities in Virginia with combined sewer overflows, the more important ones being: Richmond, Hopewell, Roanoke, Alexandria, and cities in the Hampton Roads area. Studies to determine the extent of and solution to these problems in the Richmond, Roanoke, and Alexandria areas are underway.

Nutrient Problem Areas

For some time the Board has been aware that nutrient enrichment is a problem in the Occoquan Creek Watershed; and in order to protect the public water supply located on the Creek, the Board has ruled that any proposals received after September 1, 1963, will be considered only after the Board is satisfied that the water quality in the watershed will not be rendered unsatisfactory for present or future uses. As a result of this ruling, the Board granted the Prince William County, Greater Manassas Sanitary District Authority to construct sewage treatment facilities which incorporated phosphate removal facilities. This facility has operated with varying degrees of success but in general has not achieved the desired results. In addition, the Department of the Interior made a direct grant to the District and supplied staff members to conduct nutrient removal pilot plant studies. While the conclusions of these studies have not yet been made available, it appears that the pilot plant studies have achieved a high degree of success.


In addition to the above actions on the Occoquan Watershed, in 1968 a \$300,000 study funded equally by the Virginia General Assembly and four political subdivisions in the watershed was begun, under the guidance of Dr. Clair N. Sawyer. The study has now been completed and a report detailing water quality problems and their cause and solution to the problems in the watershed expected from the State Water Control Board by September of 1970.

Mine Drainage

There are no significant mine drainage problems in the State.

Water Quality Standards Summary

Appendix

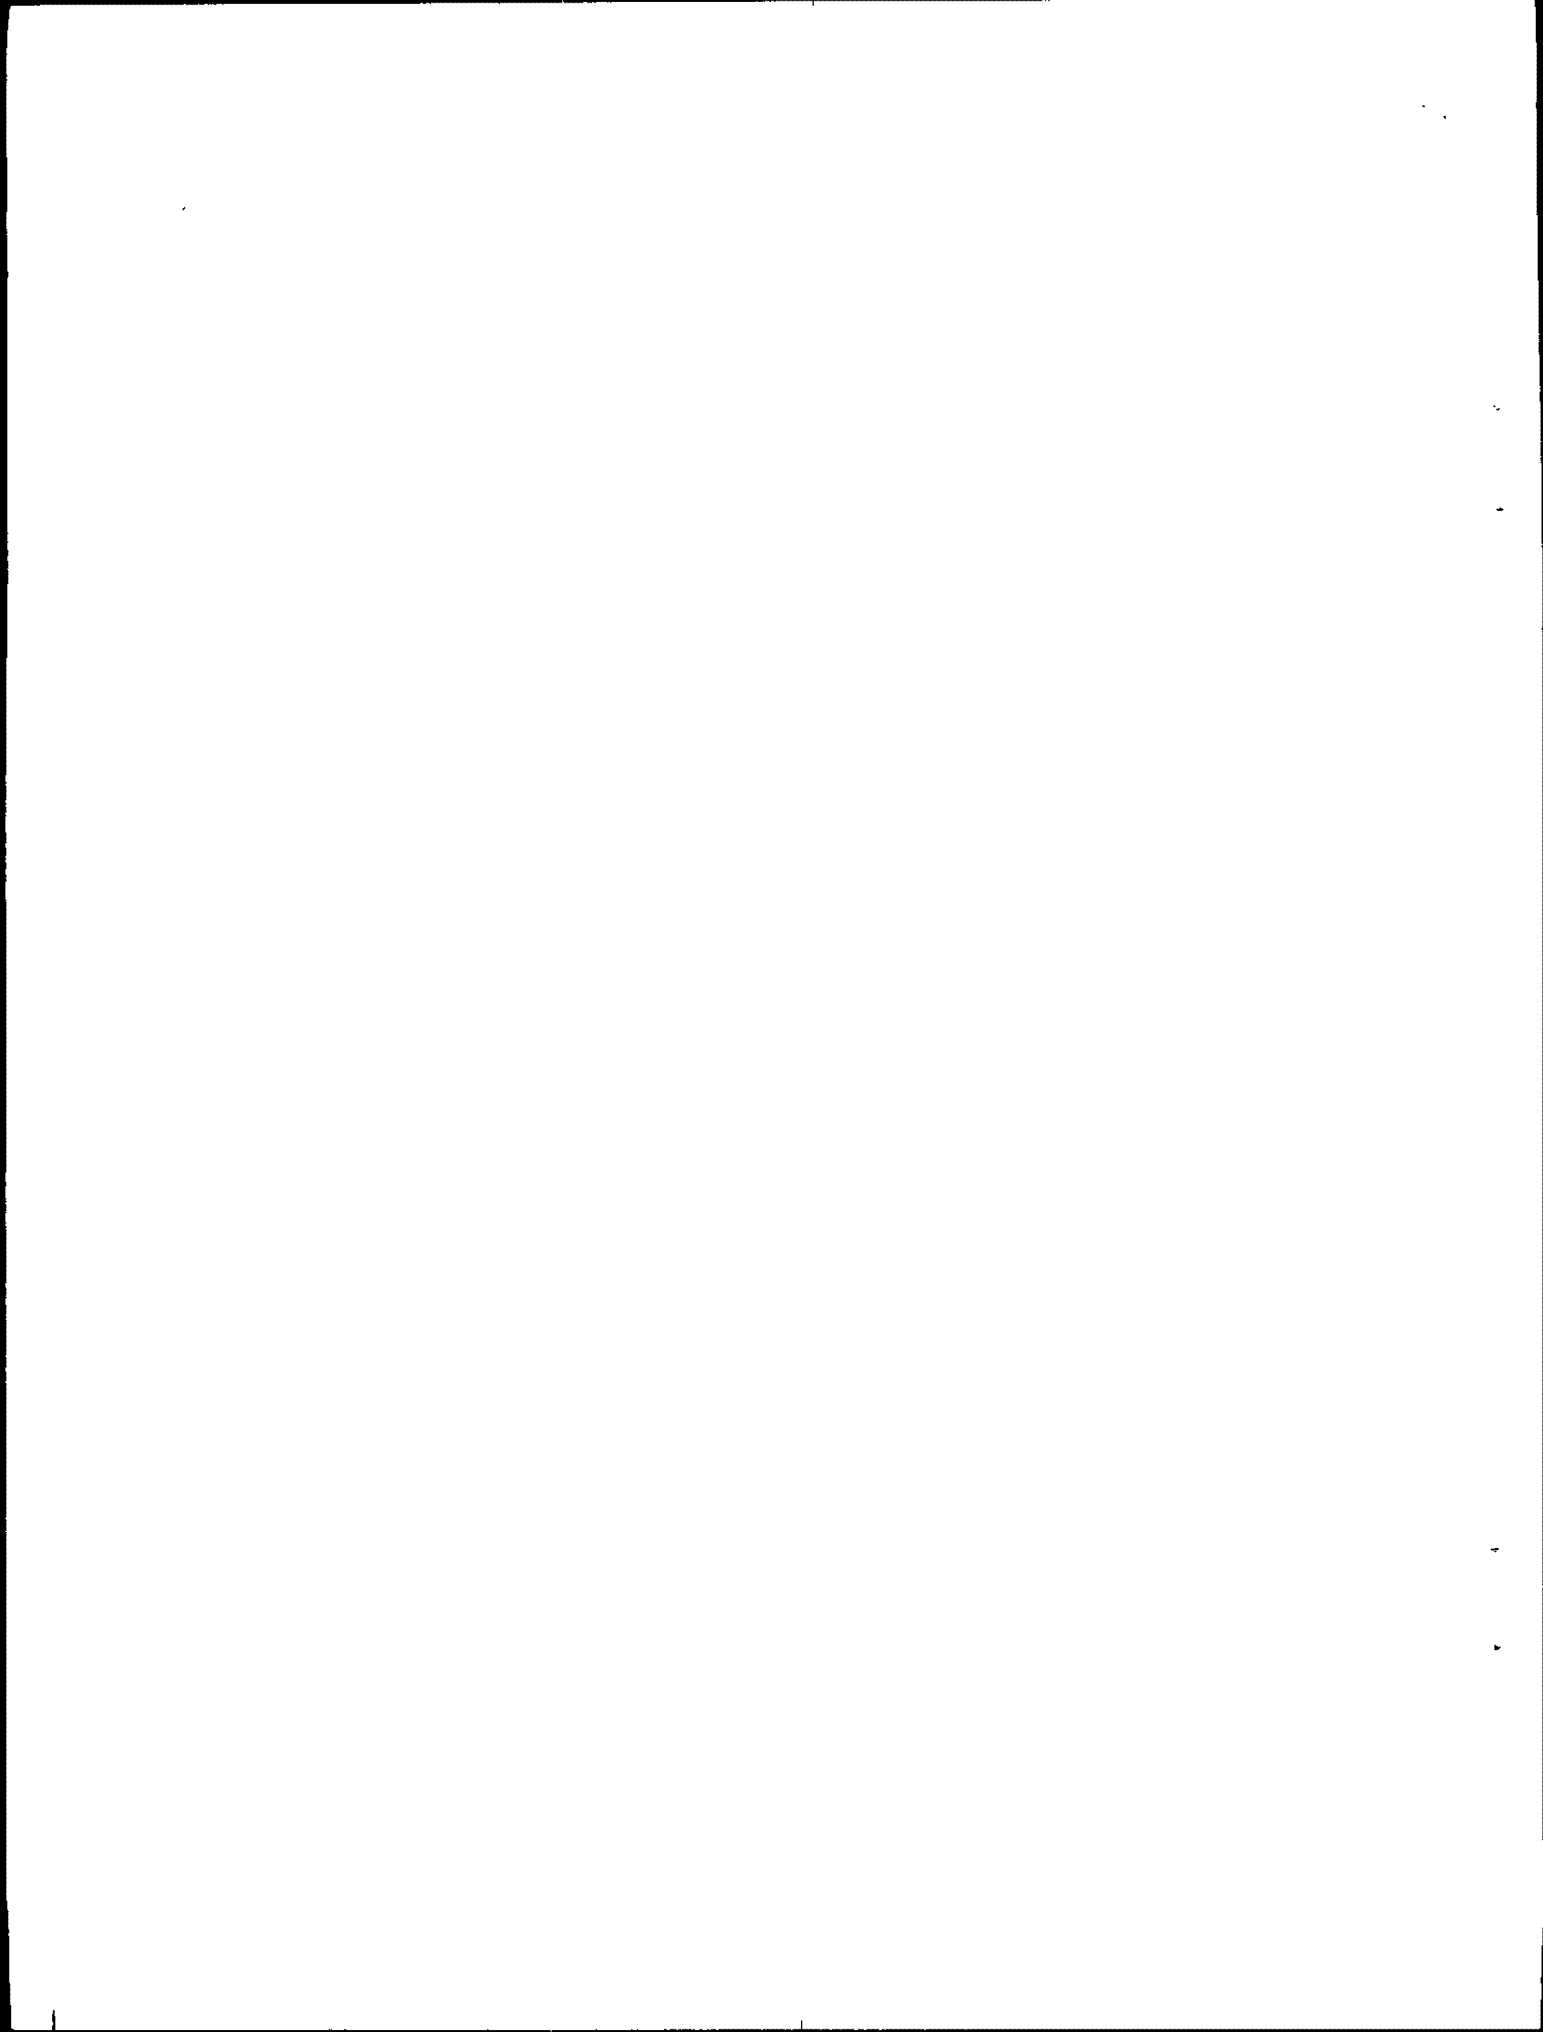

GLOSSARY OF TERMS

Advanced Waste Treatment - Refers to methods and processes that will remove more contaminants from wastewater than are usually removed in present day conventional treatment plants. The processes may be physical, chemical, or biological. Examples of advanced waste treatment are carbon columns, electrolytic coagulation, reverse osmosis, electrodialysis, and ion exchange.

Bacteria - A group of test organisms which are used as indicators of the sanitary quality of the water. The Commonwealth of Virginia uses total coliform bacteria as their specific test organism. Bacterial concentrations originate primarily from municipal waste treatment plants, sanitary and combined sewers, storm drains, vessels and agricultural wastes.

Biochemical Oxygen Demand (BOD) - The quantity of oxygen utilized in the biochemical oxidation of organic matter in a specified time and at a specified temperature. Waste discharges containing high levels of BOD will deplete oxygen supplies in receiving waters.

Disinfection - The killing of the larger portion (but not necessarily all) of the harmful and objectionable micro-organisms in, or on, a medium by means of chemicals, heat, ultraviolet light, etc. Chlorination is the method commonly employed in sewage treatment processes.

Dissolved Oxygen (DO) - The oxygen dissolved as a gas in sewage, water, or other liquid usually expressed in milligrams per liter (mg/l), parts per million (ppm), or percent saturation. Adequate dissolved oxygen levels are necessary in waters to protect fish and other aquatic life and to prevent offensive odors. Low dissolved oxygen concentrations are generally due to excessive organic solids discharged as a result of inadequately treated waste (having high BOD); excessive algal growths may cause vastly fluctuating dissolved oxygen levels, and other factors such as temperature and water movement have an impact on dissolved oxygen levels.

Interstate Waters - Under the Federal Water Pollution Control Act, interstate waters are defined as:

1. rivers, lakes, and other waters which flow across or form part of State or international boundaries;
2. waters of the Great Lakes;

3. coastal waters - whose scope has been defined to include ocean waters seaward to the territorial limits and waters along the coastline (including inland streams) that are influenced by the rise and fall of the tide.

pH - The index of hydrogen ion activity, used as an indication of acidity or alkalinity in waters. The pH of most waters ranges from 6.5 to 8.5, and most uses of water, such as aquatic life propagation, prosper at these levels. In most cases, a pH outside this range is due to discharge of industrial wastes or decaying organic vegetation.

Pollution - The addition of sewage, industrial wastes or other harmful or objectionable material to water at a concentration or in sufficient quantity to result in measurable degradation of water quality.

Primary and Secondary Contact Recreation - Also called whole-body contact recreation. Primary contact recreation includes uses of water such as swimming, water skiing and skin diving. Secondary contact recreation includes such recreational uses as boating and fishing.

Primary Treatment - May be defined as that process capable of removing a high percentage of floating and settleable solids. This is the first major treatment in a sewage treatment works and generally removes from 30 to 65 percent of the suspended solids and 30 to 40 percent of the 5-day biochemical oxygen demand.

Secondary Treatment - May be defined as that process or group of processes capable of removing virtually all floating and settleable solids, generally from 85 to 95 percent of the 5-day biochemical oxygen demand, and a similar level of removal of suspended solids in untreated waste. The equivalent treatment may generally be defined as that process or group of processes achieving maximum practicable removal of solids, oils, grease, acids, alkalis, toxic materials, bacteria, taste and odor causing materials, color and any other objectionable constituents contained in untreated waste to produce an effluent equivalent to that obtained from secondary treatment facilities in current use for any specific category of industrial waste.

Sewage - (1) The water supply of a community after it has been used and discharged into a sewer, (2) wastewater from the sanitary conveniences of dwelling, business buildings, factories and other institutions.

Sewage, Combined - A sewage containing both sanitary sewage and surface or storm water with or without industrial wastes.

Sewer, Combined - A sewer which carries both sanitary sewage and storm drainage. Where combined sewers are used, the capacity is usually exceeded at times of heavy rainfall and the sewers overflow, discharging combined sewage directly into streams without treatment of any kind.


Warm-and-Cold-Water-Fish - Warm-water fish include black bass, sunfish, catfish, gar and others; cold-water fish include salmon and trout, whitefish, Miller's thumb and blackfish. The temperature factor determining distribution is set by adaptation of the eggs to warm or cold water.

Temperature - A measure of the heat content of water. While stream temperature is affected naturally, man significantly affects it through the construction and operation of dams and the discharge of cooling waters from industrial processes, particularly power generation.

Toxic Materials - Materials which are harmful to human, plant, animal, and aquatic life. These may include hundreds of compounds present in various waters such as industrial waste discharges or run-off from where pesticides have been applied.


Solids, Settleable - Suspended solids which will subside in quiescent water, sewage or other liquid in a reasonable period.

Solids, Suspended - Solids that either float on the surface of, or are in suspension in, water sewage or other liquids and which are largely removable by laboratory filtering.



Water Quality Standards Summary

Stream Index



INDEX OF STREAMS IN VIRGINIA

<u>Stream</u>	<u>Page</u>	<u>Stream</u>	<u>Page</u>
* Aarons River	56	Broad Bay	125
T Appomattax River	105	Broad Run	117
T Aquia Creek	142	Brown Run	74
* Ararat River	129	Browns Mill Creek	114
T* Atlantic Ocean	124	Brumley Creek	37
T* Back Bay	133	Brush Creek	47
* Back Creek	142	Buffalo Creek	106
Bannister River	56	Buffalo River	113
Barbaurs Creek	117	Bull Run	143
T Barrett Point	99	Bullpasture River	115
Battery Creek	114	Burks Fork	48
Bear Creek	38	Cabin Creek	47
* Beaver Creek	38	Cahoon Pond	99
Beaverdam Creek	39	Calfpasture River	115
Benges Branch	30	* Cane Creek	56
Bens Branch	30	Caney Creek	23
* Big Bluewing Creek	56	Carters Run	87
Big Cedar Creek	31	* Cascade Creek	57
Big Laurel Creek	39	* Cedar Creek	78
Big Laurel Run	77	Cedar Run	143
Big Mary's Creek	117	Cherry Creek	59
Big Moccassin Creek	37	Cherrystone Creek	56
Big Otto Creek	59	Chestnut Creek	49
Big Reed Island Creek	48	T Chickahominy River	105
Big Run	74	Chisel Run	99
Big Sandy	23	T Chopawamsic Creek	142
Big Stone Gap	30	Clayton Mill Creek	116
Big Stony Creek	78	Clear Fork Creek	45
Big Tumbling Creek	37	* Clinch River	30
Big Wilson Creek	47	Coal Creek	49
Black Run	76	Coleman Mill Pond	56
* Blackwater Creek	30	Coles Run	75
T* Blackwater River	67	Comers Creek	39
Blue Springs Run	116	Conway River	86
* Bluestone River	46	Corder Branch	30
Boozy Creek	37	Cornelius Creek	116
Bottom Creek	61	Couches Creek	68
Brokenback Run	86	County Line Creek	56
Brandon Creek	56	Courthouse Creeks	107
Brandy Branch	105	Cove Creek	30
Brentley Stream	59	Cowpasture River	115
Brattons Run	117	Coy Creek	57
Briery Branch	76	* Crab Run	117

<u>Stream</u>	<u>Page</u>	<u>Stream</u>	<u>Page</u>
Craig Creek	117	Francis Mill Creek	48
Cressy Creek	39	Fridleys Branch	116
Cripple Creek	48	Fryingpan Creek	23
* Crooked Creek	47	Fultz Run	75
Crutchfield Branch	56	Gardner Spring	76
Crystal Lake	125	Garth River	87
Cub Run	74	Georges Creek	56
* Dan River	56	German River	77
Davis Run	117	Glade Creek	47
Deep Creek	107	Goat Creek	57
Deep Hollow Run	78	Gooney Run	74
Deep Run	87	Goose Creek	143
Devils Ditch	86	Graham Creek	114
Diaseund Creek	105	Greasy Creek	48
Dickey Creek	39	Great Creek	68
Difficult Run	143	Great Neck Creek	125
Dismal Creek	45	Green Cove Creek	39
Dismal Swamp	133	Green Creek	60
Dockery Creek	56	Guys Run	117
Dodd Creek	49	Hanzlins Swamp Branch	67
Dry Creek	30	Happy Creek	75
Dry Fork	23	Hardy Creek	30
Dry River	76	Harris Branch	48
Dry Run	48	Harris Creek	48
+ Dunlap Creek	115	Hatcher Run	67
Eagle Bottom Creek	50	Hawksbill Creek	74
East Branch Naked Creek	74	* Hawtree Creek	56
East Fork Clear Fork Creek ..	45	Hays Creek	117
East Fork Crooked Creek	47	* Helton Creek	47
East Fork Little Seed		Hogan Branch	49
Island Creek	49	Hogcamp Branch	87
East Day Branch	115	Hogue Creek	144
East Hawis Creek	75	* Holston River	37
Eastern Branch Elizabeth		Hookers Creek	57
River	99	Horsepen Run	87
Eastern Branch Lynnhaven		T Hoskins Creek	86
River	125	Hot Run	144
T Elizabeth River	99	Howells Creek	49
* Elk Creek	47	Hughes River	86
Enchanted Creek	113	Hungry Mother Creek	38
Fall Creek	59	Hunting Creek	114
Falling Creek	59	Hunting Run	87
Falling River	59	Huntingcamp Creek	45
Fifteen Mile Creek	38	Hurricane Creek	39
Flat Rock Creek	68	* Hyco River	56
Fox Creek	47	Hypes Creek	116

<u>Stream</u>	<u>Page</u>
* Indian Creek	30
* Intercoastal Waterway	133
Irish Creek	113
Ivy Branch	106
Ivy Creek	58
Jackson River	115
Jacob Fork.....	
T James River	23
Jennings Creek	115
Jeremiah's Run	74
Jerkentight	116
Jerrys Run	115
John Keer Reservoir	59
Johns Creek	115
Johns Run	75
* Johnson Creek	107
Jones Creek	48
Kennedy Run	75
Killinger Creek	48
Kimberling Creek	45
Knob Fork Creek	47
* Knox Creek	23
Lake Bradford	125
Lake Burnt Mill	99
* Lake Drummong	133
Lake Gaston	56
Lake Jackson	143
Lake Jordan	67
Lake Joyce	125
Lake Kilby	99
Lake Meade	99
Lake Prince	99
Laurel Creek	37
* Laurel Fork	46
Laurel Run	77
Lovills Creek	129
Lazaretto Creek	67
* Levisa Fork	23
Lick Branch	117
Lick Creek	37
Lickinghole Creek	105
Linkhorn Bay	125
Little Back Creek	116
Little Calfpasture River	117
Little Cedar Creek	31

<u>Stream</u>	<u>Page</u>
Little Creek	30
* Little Dan River	56
Little Fisher River	129
Little Hawskill Creek	74
Little Mill Creek	116
Little Neck Creek	125
Little Passage Creek	77
Little Reed Island Creek ...	49
* Little River	48
T Little Salem Creek	93
Little Stony Creek	30
Little Tumbling Creek	37
Little Walker Creek	45
London Bridge Creek	23
Long Branch Creek	23
Long Creek	125
Long Run	77
* Lovills Creek	129
Lynnhaven Bay	125
T Lynnhaven River	125
Madison Creek	117
Maggodee Creek	60
Main Fork Helton Creek	47
Maple Swamp Branch	58
Mares Run	116
T Marlboro Point	142
* Martin Creek	30
Massaponax Creek	87
* Matrimony Creek	56
T Mattaponi River	93
Motts Run	87
Maury River	115
Mayberry Creek	58
* Mayo Creek	56
Meadow Creek	48
Mechum River	107
* Meherrin River	67
Middle Creek	116
Middle Fork Holston River ..	38
Middle Fox Creek	47
Middle River	75
Mill Branch	118
* Mill Creek	46
Mills Creek	75
Mira Fork Creek	48

<u>Stream</u>	<u>Page</u>	<u>Stream</u>	<u>Page</u>
Modest Creek	67	Peters Mill Run	77
Monacacy River	143	Phelps Creek	59
Moores Creek	118	Pigg River	60
Moormans River	107	Piney River	87
Mountain Run	77	Pitt Spring	74
Muddy Creek	76	Pitt Spring Run	74
Muddy Run	116	Pocosin Creek	86
T Nansemond River	99	Poorhouse Creek	58
* New River	45	Potomac Creek	142
Ni River	93	T Potomac River	142
Nicely Branch	37	* Potts Creek	115
Nicks Creek	38	Pound River	23
No Business Creek	45	Pounding Mill Creek	115
North Creek	116	Powell Creek	107
North Fork Buffalo River	113	Poverty Creek	47
North Fork Catoctin Creek	143	* Powell River	30
North Fork Clinch River	30	* Pumpkin Creek	57
North Fork Holston River	37	Queen Creek	93
North Fork Moormans River	107	Rainey Gut	125
North Fork Pound River	23	Ramsey's Draft	116
North Fork Powell River	30	Rapidan River	86
North Fork River	144	T Rappahannock River	86
North Fork Roanoke	61	Rawley Springs	76
North Fork Shenandoah	74	Reed Creek	48
North Fork South Mayo	56	Rivanna River	107
North Fork Stony Creek	46	* Roanoke River	59
North Fork Thornton River	87	Roaring Fork Creek	37
North Fork Tye River	113	Roaring Run	118
North River	75	Robinson River	86
* North Landing River	133	Rock Castle Creek	58
* North Mayo River	54	Rockfish Creek	107
Northeast Creek	93	Rockfish River	106
T* Nottoway River	67	Rocky Row Run	114
Occoquan Creek	143	Rocky Run	76
Old Town Creek	106	Rose River	87
* Opequon Creek	144	Round Meadow Creek	58
Pads Creek	116	Rowland Creek	39
Pagan River	99	Runnet Bag Creek	58
T Pamunkey River	93	Rush River	87
Pass Run	75	* Russell Fork	23
Passage Creek	77	Rutledge Creek	113
Paul's Creek	129	Salem Creek	93
Peach Bottom Creek	47	Shenandoah River	74
Peak Creek	49	Shingle Creek	99
Pedlar River	112	Shoemaker River	77
* Peters Creek	57	Silver Lake	76

<u>Stream</u>	<u>Page</u>	<u>Stream</u>	<u>Page</u>
Simpson Creek	115	Swift Creek	105
Sinking Creek	37	Swift Run	106
Skidmore Fork	76	Sycoline Creek	143
Slate Creek	23	Thaila Creek	125
Slate Lick Run	77	Thornton River	87
Slate River	108	T Thorofare Creek	93
* Smith Creek	56	Timbertree Branch	37
Smith Mountain Lake	56	Tinker Creek	60
T Smith Point	142	Tom's Creek	47
* Smith River	56	Totier Creek	107
South Anna River	93	Tract Fork	47
* South Branch Potomac River ...	144	Tuckahoe Creek	106
South Fork Catoctin Creek	143	* Tug Fork	23
South Fork Holston River	39	Tuggle Creek	59
South Fork Moormans River	106	Tuscarora Creek	143
South Fork Powell River	30	Tye River	113
South Fork Roanoke River	61	T Upper Machodoc Creek	142
South Fork Rivanna River	107	Valley Creek	39
South Fork Rockfish River	107	Walker Creek	45
South Fork Shenandoah	74	Walters Mill Pond	93
* South Holston Lake	37	Watkins Branch	23
* South Mayo River	59	West Fork Little River	48
South River	75	West Fork Peak Creek	47
Southern Branch Elizabeth		Western Branch Elizabeth	
River	99	River	99
Spring Creek	38	Western Branch Lynnhaven	
Spur Branch	45	River	125
St. Marys River	116	White Oak Canyon Run	87
Stacy Branch	23	White Oak Run	87
Staley Creek	38	White Rock Creek	48
Staton Creek	113	Whitetap Creek	39
Staunton River	86	Wilderness Creek	45
Steel Creek	38	Wilderness Run	87
* Stewarts Creek	129	Willis River	107
Stock Creek	31	Wilson Creek	116
Stony Creek	31	Wilson Run	86
Straight Branch	39	* Winns Creek	56
* Straight Fork	30	Wolf Creek	38
Straight Gap	30	Wolfpit Run	56
Strait Creek	144	T Wolfsnare Creek	125
Stumpy Lake	133	Yadkin River	129
Sugarland Run	143	T York River	93

* Significant Interstate Streams
T Tidal or streams influenced
(wholly or in part) by tide.

U.S. EPA Headquarters Library
Mail code 3404T
1200 Pennsylvania Avenue NW
Washington, DC 20460
202-566-0556